




Department of consumer and corporate affairs / Ministère de la consommation et des corporations

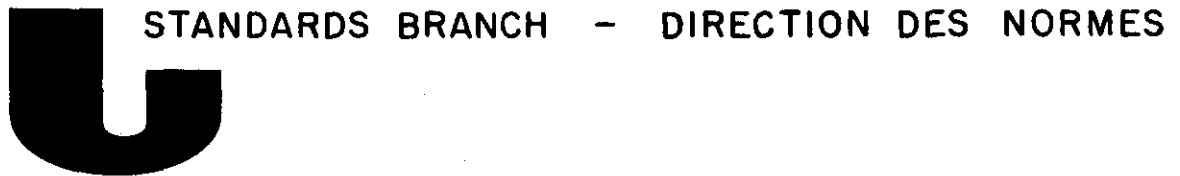

NOTICE OF APPROVAL

T-75-1

OTTAWA December 11, 1972.

FERRANTI-PACKARD TYPE "DCBW" CURRENT TRANSFORMERS

This Notice constitutes a supplement to T-75 which remains in effect.

It covers an additional variation of the subject transformers in the 400-5 ampere rating.

The new variation has a 2" diameter window opening rather than 1 9/16", and the accuracy rating is 0.3 BO.1, BO.2, BO.5; 0.6 BO.9, Bl.0, with the nameplate marked 0.3 BO.1, BO.2, BO.5.

This Notice also covers a correction to the accuracy rating as given in T-75 for the 800-5 ampere rating. The correct rating is: 0.3 BO.1, BO.2, BO.5; 0.6 BO.9, Bl.0, Bl.8.

It is further noted that some transformers of this type may be found using the term BO.3 in the accuracy rating. These may be accepted as approved although this is not recognized as a standard burden.

Transformers of this type are made in the U.S.A.

Approval granted to:

Ferranti-Packard Ltd.,
St. Catharines, Ont.

(for) *J. S. T. Swanson*
J.S.T. Swanson, P. Eng.,
Chief, Standards Laboratory,
Standards Branch.

W. J. S. Fraser
W.J.S. Fraser,
Chief, Electricity and Gas Div.
Standards Branch.

Ref: GL-1145-57/F2-983

FERRANTI-PACKARD TYPE "DCBW" CURRENT TRANSFORMERS

