

Easergy P3M30 and P3M32

Motor protection relay

User Manual

P3M/en M/H006

12/2021



Table of Contents

1 About this manual.....	12
1.1 Purpose.....	12
1.2 Related documents.....	12
1.3 Abbreviations and terms.....	13
2 Product introduction.....	19
2.1 Warranty.....	19
2.2 Product overview.....	19
2.3 Product selection guide.....	20
2.4 Access to device configuration.....	29
2.4.1 User accounts.....	29
2.4.2 Logging on via the front panel.....	29
2.4.3 HTTP and FTP logon details.....	30
2.4.4 Password management.....	30
2.4.5 Password restoring.....	31
2.5 Front panel.....	31
2.5.1 Push-buttons.....	32
2.5.2 LED indicators.....	33
2.5.3 Configuring the LED names via Easergy Pro.....	34
2.5.4 Controlling the alarm screen.....	34
2.5.5 Accessing operating levels.....	34
2.5.6 Adjusting the LCD contrast.....	35
2.5.7 Testing the LEDs and LCD screen.....	35
2.5.8 Controlling an object with selective control.....	35
2.5.9 Controlling an object with direct control.....	35
2.5.10 Menus.....	36
2.5.10.1 Moving in the menus	38
2.5.10.2 Local panel messages.....	38
2.6 Easergy Pro setting and configuration tool.....	39
2.7 Low-power instrument transformers.....	39
3 Mechanical structure.....	41
3.1 Modularity.....	41
3.2 Slot info and order code.....	43
4 Measurement functions.....	44
4.1 Primary, secondary and per unit scaling.....	51
4.1.1 Frequency adaptation mode.....	57
4.1.2 Current scaling.....	58
4.1.3 Voltage scaling for analog module E, F.....	60
4.2 Measurements for protection functions.....	63
4.3 Measurements for arc flash detection function.....	64
4.4 RMS values.....	65
4.5 Harmonics and total harmonic distortion (THD).....	65

4.6 Demand values.....	66
4.7 Minimum and maximum values.....	68
4.8 Maximum values of the last 31 days and 12 months.....	69
4.9 Memory management of measurements.....	71
4.10 Power and current direction.....	73
4.11 Symmetrical components.....	74
5 Control functions.....	76
5.1 Digital outputs.....	76
5.2 Digital inputs.....	80
5.3 Virtual inputs and outputs.....	86
5.4 Matrix.....	92
5.4.1 Output matrix.....	92
5.4.2 Blocking matrix.....	93
5.4.3 LED matrix.....	94
5.4.4 Object block matrix.....	97
5.5 Releasing latches.....	97
5.5.1 Releasing latches using Easergy Pro.....	97
5.5.2 Releasing latches using buttons and local panel display.....	98
5.5.3 Releasing latches using F1 or F2 buttons.....	98
5.6 Controllable objects.....	99
5.6.1 Object control with digital inputs.....	100
5.6.2 Local or remote selection.....	101
5.6.3 Object control with I and O buttons.....	101
5.6.4 Object control with F1 and F2.....	102
5.7 Logic functions.....	103
5.8 Local panel.....	111
5.8.1 Mimic view.....	111
5.8.2 Local panel configuration.....	114
6 Protection functions.....	120
6.1 Current transformer requirements for overcurrent elements.....	120
6.1.1 CT requirements when settings are unknown.....	121
6.1.2 Principle for calculating the saturation current in class P.....	121
6.1.3 Examples of calculating the saturation current in class P.....	121
6.1.4 Principle for calculating the saturation current in class PX.....	122
6.1.5 Examples of calculating the saturation current in class PX.....	123
6.2 Current transformer requirements for generator and motor differential protection.....	123
6.3 Maximum number of protection stages in one application.....	124
6.4 General features of protection stages.....	124
6.5 Dependent operate time.....	131
6.5.1 Standard dependent delays using IEC, IEEE, IEEE2 and RI curves..	134
6.5.2 Free parameterization using IEC, IEEE and IEEE2 curves.....	155
6.5.3 Programmable dependent time curves.....	156
6.6 Synchrocheck (ANSI 25).....	158
6.7 Undervoltage (ANSI 27).....	163
6.8 Directional power (ANSI 32)	166

6.9 Phase undercurrent (ANSI 37).....	167
6.10 Negative sequence overcurrent (ANSI 46)	168
6.11 Incorrect phase sequence (ANSI 47)	170
6.12 Negative sequence overvoltage protection (ANSI 47).....	171
6.13 Motor start-up supervision (ANSI 48)	172
6.14 Thermal overload (ANSI 49 RMS).....	177
6.15 Breaker failure (ANSI 50BF).....	181
6.16 Breaker failure 1 and 2 (ANSI 50BF).....	183
6.17 Switch-on-to-fault (ANSI 50HS)	189
6.18 Phase overcurrent (ANSI 50/51).....	191
6.19 Earth fault overcurrent (ANSI 50N/51N)	195
6.19.1 Earth fault faulty phase detection algorithm.....	198
6.20 Capacitor bank unbalance (ANSI 51C)	200
6.20.1 Taking unbalance protection into use.....	203
6.21 Locked rotor (ANSI 51LR).....	207
6.22 Overvoltage (ANSI 59).....	210
6.23 Neutral voltage displacement (ANSI 59N).....	214
6.24 Restricted high-impedance earth fault (ANSI 64REF, 64BEF).....	217
6.25 Motor restart inhibition (ANSI 66)	218
6.26 Directional phase overcurrent (ANSI 67)	220
6.27 Directional earth fault overcurrent (ANSI 67N).....	225
6.27.1 Earth fault faulty phase detection algorithm.....	231
6.28 Magnetizing inrush detection (ANSI 68F2).....	232
6.29 Fifth harmonic detection (ANSI 68H5).....	234
6.30 Overfrequency and underfrequency (ANSI 81)	235
6.31 Rate of change of frequency (ANSI 81R).....	237
6.32 Lockout (ANSI 86).....	241
6.33 Differential overcurrent protection (ANSI 87M)	243
6.34 Arc flash detection (AFD).....	250
6.34.1 Arc flash detection, general principle.....	250
6.34.2 Arc flash detection menus.....	250
6.34.3 Configuration example of arc flash detection.....	255
6.34.4 Arc flash detection characteristics.....	258
6.35 Programmable stages (ANSI 99).....	260
7 Supporting functions.....	263
7.1 Event log.....	263
7.2 Disturbance recording.....	265
7.2.1 Configuring the disturbance recorder.....	270
7.3 Cold load start and magnetizing inrush.....	271
7.4 System clock and synchronization.....	272
7.5 Voltage sags and swells.....	279
7.6 Voltage interruptions.....	282
7.7 Current transformer supervision (ANSI 60).....	284
7.8 Voltage transformer supervision (ANSI 60FL).....	286
7.9 Circuit breaker wear.....	288
7.10 Circuit breaker condition monitoring.....	294

7.11 Energy pulse outputs.....	297
7.12 Running hour counter.....	300
7.13 Timers.....	301
7.14 Combined overcurrent status.....	303
7.15 Trip circuit supervision (ANSI 74)	308
7.15.1 Trip circuit supervision with one digital input.....	308
7.15.2 Trip circuit supervision with two digital inputs.....	314
8 Communication and protocols.....	318
8.1 Cybersecurity.....	318
8.2 Communication ports.....	318
8.2.1 Ethernet port.....	322
8.2.2 Disabling the Ethernet communication.....	323
8.3 Storm protection.....	326
8.4 Parallel Redundancy Protocol.....	326
8.5 Communication protocols.....	327
8.5.1 Modbus RTU and Modbus TCP.....	327
8.5.2 Profibus DP.....	328
8.5.3 SPA-bus.....	328
8.5.4 IEC 60870-5-103 (IEC-103).....	329
8.5.5 DNP 3.0.....	330
8.5.6 IEC 60870-5-101 (IEC-101).....	330
8.5.7 IEC 61850.....	330
8.5.8 Ethernet/IP.....	331
8.5.9 HTTP server – Webset.....	331
8.6 IP filter.....	332
8.6.1 Configuring the IP filter.....	332
8.6.2 Unexpected packets.....	334
8.6.3 Alarms.....	335
9 Applications and configuration examples.....	336
9.1 Industrial motor protection.....	337
9.2 Rotor earth fault protection (ANSI 64R).....	337
9.3 Arc flash detection.....	338
9.4 Using CSH120 and CSH200 with I ₀₂ 0.2 A / 1 A core balance CT input.....	341
9.5 Using CSH120 and CSH200 with I ₀₂ CSH (2 / 20 A) core balance CT input.....	343
10 Installation.....	345
10.1 Checking the consignment.....	345
10.2 Product identification.....	345
10.3 Storage.....	346
10.4 Mounting.....	347
10.5 Connections.....	351
10.5.1 Supply voltage cards.....	352
10.5.2 Analog measurement cards.....	354
10.5.2.1 Analog measurement cards E , N, 1 and 5 (slot 8).....	354

10.5.2.2	Analog measurement cards F, O, 2 and 6 (slot 8)	356
10.5.2.3	Analog measurement cards T and 1 (slot 4)	359
10.5.3	I/O cards	360
10.5.3.1	I/O card "B = 3BIO+2Arc"	360
10.5.3.2	I/O card "C = F2BIO+1Arc"	362
10.5.3.3	I/O card "D = 2IGBT"	363
10.5.3.4	I/O option card "D=4Arc"	364
10.5.3.5	I/O card "G = 6DI+4DO"	364
10.5.3.6	I/O card "H = 6DI + 4DO (NC)"	366
10.5.3.7	I/O card "I = 10DI"	368
10.5.4	Arc flash sensor	369
10.5.4.1	Mounting the sensors to the switchgear	370
10.5.4.2	Connecting the sensors to the device	372
10.5.5	Communication cards	373
10.5.5.1	COM 1 port	379
10.5.5.2	COM 3 – COM 4 ports	379
10.5.6	Local port	384
10.5.7	Connection data	385
10.5.8	External option modules	395
10.5.8.1	VSE-001 fiber-optic interface module	395
10.5.8.2	VSE-002 RS-485 interface module	396
10.5.8.3	VPA-3CG Profibus interface module	397
10.5.8.4	VIO 12A RTD and analog input / output modules	398
10.5.9	Block diagrams	398
10.5.10	Connection examples	402
10.5.11	Low-power instrument transformers	406
10.5.11.1	Low-power instrument transformer measurement card M and P (slot 8)	407
10.5.12	Voltage adapter	408
10.5.12.1	Mounting the voltage adapter	411
10.5.12.2	RJ45 terminal locking	413
10.5.12.3	Voltage adapter parameters	414
10.6	Arc flash detection system setup and testing	415
10.6.1	Setting up the arc flash system	415
10.6.2	Commissioning and testing	416
10.6.2.1	Checking zones	417
10.6.2.2	Disconnecting trip circuits	417
10.6.2.3	Sensor testing	418
10.6.2.3.1	Testing the sensors	419
10.6.2.3.2	Testing the sensor supervision	419
10.6.2.3.3	Testing the binary I/O connectivity	420
10.6.3	Test report	420
10.6.3.1	Filling in the test report	420
10.6.3.2	Test report example	421
10.6.4	Troubleshooting	422
10.7	Low-power instrument transformer testing	422
10.7.1	Testing tools and equipment	423

10.7.2 Testing the low-power current transformer measurements.....	423
10.7.3 Testing the low-power voltage transformer measurements.....	424
10.8 Voltage measurement modes.....	424
10.8.1 Multiple channel voltage measurement – conventional VT.....	426
10.8.2 Multiple channel voltage measurement – LPVT.....	435
10.9 CSH120 and CSH200 Core balance CTs.....	437
11 Test and environmental conditions.....	441
11.1 Disturbance tests.....	441
11.2 Electrical safety tests.....	442
11.3 Mechanical tests.....	443
11.4 Environmental tests.....	443
11.5 Environmental conditions.....	444
11.6 Casing.....	445
12 Maintenance.....	446
12.1 Preventive maintenance.....	446
12.2 Periodic testing.....	447
12.3 Hardware cleaning.....	447
12.4 System status messages.....	447
12.5 Spare parts.....	447
12.6 Self-supervision.....	447
12.6.1 Diagnostics.....	450
12.7 Arc flash detection system maintenance.....	452
12.7.1 Visual inspection.....	453
12.7.2 Hardware cleaning.....	453
12.7.3 Sensor condition and positioning check.....	453
13 Order codes and accessories.....	455
13.1 Order codes.....	455
13.2 Accessories.....	457
14 Firmware revision.....	460

Legal information

The Schneider Electric brand and any registered trademarks of Schneider Electric Industries SAS referred to in this guide are the sole property of Schneider Electric SA and its subsidiaries. They may not be used for any purpose without the owner's permission, given in writing. This guide and its content are protected, within the meaning of the French intellectual property code (Code de la propriété intellectuelle français, referred to hereafter as "the Code"), under the laws of copyright covering texts, drawings and models, as well as by trademark law. You agree not to reproduce, other than for your own personal, noncommercial use as defined in the Code, all or part of this guide on any medium whatsoever without Schneider Electric's permission, given in writing. You also agree not to establish any hypertext links to this guide or its content. Schneider Electric does not grant any right or license for the personal and noncommercial use of the guide or its content, except for a non-exclusive license to consult it on an "as is" basis, at your own risk. All other rights are reserved.

Electrical equipment should be installed, operated, serviced and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

As standards, specifications and designs change from time to time, please ask for confirmation of the information given in this publication.

Safety information

Important information

Read these instructions carefully and look at the equipment to become familiar with the device before trying to install, operate, service or maintain it.

The following special messages may appear throughout this publication or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.



The addition of either symbol to a “Danger” or “Warning” safety label indicates that an electrical hazard exists which will result in personal injury if the instructions are not followed.

⚠ DANGER
DANGER indicates a hazardous situation which, if not avoided, will result in death or serious injury.

⚠ WARNING
WARNING indicates a hazardous situation which, if not avoided, could result in death or serious injury.

⚠ CAUTION
CAUTION indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.

NOTICE
NOTICE is used to address practices not related to physical injury.

Please note

Electrical equipment must only be installed, operated, serviced, and maintained by qualified personnel. A qualified person is one who has skills and knowledge related to the construction, installation, and operation of electrical equipment and has received safety training to recognize and avoid the hazards involved.

No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

Protective grounding

The user is responsible for compliance with all the existing international and national electrical codes concerning protective grounding of any device.

EU directive and UKCA regulations compliance



EU directive compliance

EMC compliance

2014/30/EU

Compliance with the European Commission's EMC Directive. Product Specific Standard was used to establish conformity:

- EN 60255-26 2013

Product safety

2014/35/EU

Compliance with the European Commission's Low Voltage Directive. Product Specific Safety Standard was used to establish conformity:

- EN 60255-27 2014

RoHS directive

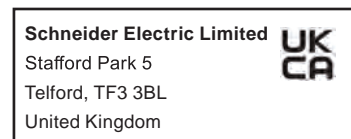
2011/65/EU (inclusive of Directive (EU) 2015/863) Compliance

Compliance with the European Commission's on the restriction of the use of certain hazardous substances in electrical and electronic equipment

- EN IEC 63000:2018 / IEC 63000:2016



UKCA regulations compliance



EMC compliance

SI 2016 No. 1091

The Electromagnetic Compatibility Regulations:

- BS EN 60255-26 2013

Product safety

SI 2016 No. 1101

The Electrical Equipment (Safety) Regulations:

- BS EN 60255-27 2014

RoHS regulation

SI 2012 No. 3032

The Restriction of the Use of Certain Hazardous Substances in Electrical and Electronic Equipment Regulations

- BS EN IEC 63000:2018

1 About this manual

1.1 Purpose

This document contains instructions on the installation, commissioning and operation of Easergy P3M30 and P3M32.

This document is intended for persons who are experts on electrical power engineering, and it covers the relay models as described by the order code.

Related topics

[13.1 Order codes](#)

1.2 Related documents

Table 1 - Related documents

Document	Identification ¹⁾
P3 Advanced Quick Start	P3x3x/EN QS/xxxx
Easergy Pro Setting and Configuration Tool User Manual	P3eSetup/EN M/xxxx
RTD and mA Output/Input Modules User Manual	P3VIO12A/EN M/A001
Profibus Interface Module User Manual	P3VPA3CG/EN M/A001
IEC 61850 configuration instructions	P3APS17001EN
Rapid Spanning Tree Protocol (RSTP)	P3APS17002EN
EtherNet/IP configuration instructions	P3APS17003EN
Parallel Redundancy Protocol for Easergy P3 relays with dual-port 100 Mbps Ethernet interface	P3APS17004EN
Communication parameter protocol mappings	P3TDS17005EN
Easergy P3 protection functions' parameters and recorded values	P3TDS17006EN
IEC103 Interoperability List	P3TDS17009EN
DNP 3.0 Device Profile Document	P3TDS17010EN
P3 Advanced Series facia label instruction	P3TDS17012EN

Document	Identification ¹⁾
Principles of numerical protection techniques	P3INS17019EN
Restricted earth fault protection using an I0 input of an Easergy P3 relay	P3APS17016EN

¹⁾ xxxx = revision number

1.3 Abbreviations and terms

Table 2 - Abbreviations and terms used in this manual

AFD	Arc flash detection
ANSI	American National Standards Institute A standardization organization
bps	Bits per second
CB	Circuit breaker
CBFP	Circuit breaker failure protection
CLPU	Cold load pickup
CM	Common mode
Controlling output	Heavy duty output rated for the circuit breaker controlling
CPU	Central processing unit
$\cos\phi$	Active power divided by apparent power = P/S (See power factor PF.) Negative sign indicates reverse power.
CT	Current transformer
CT primary	CT_{PRI} . Nominal primary value of the IL (star side) current transformer
CT' primary	CT'_{PRI} . Nominal primary value of the I'L (low-voltage) current transformer
CT secondary	CT_{SEC} . Nominal secondary value of the IL (high-voltage) current transformer
CT' secondary	CT'_{SEC} . Nominal secondary value of the I'L (low-voltage) current transformer
Dead band	See hysteresis.

DI	Digital input
Digital output	Relay's output contact
DM	Differential mode
DMS	Distribution management system
DO	Digital output
Document file	Stores information about the relay settings, events and fault logs
DSR	Data set ready An RS232 signal. Input in front panel port of Easergy P3 devices to disable rear panel local port.
DST	Daylight saving time Adjusting the official local time forward by one hour for summer time.
DT	Definite time
DTR	Data terminal ready An RS232 signal. Output and always true (+8 Vdc) in front panel port of Easergy P3 relays.
Easergy P3 Standard	P3U10, P3U20 and P3U30 relays
Easergy P3 Advanced	P3F30, P3L30, P3M30/32, P3G30/32 and P3T32 relays
eSetup Easergy Pro	Setting and configuration tool for Easergy P3 protection relays, later called Easergy Pro
ETAR T>	This measurement indicates the time to allow a restart coming from the T> stage (49F, 49M, 49G, 49T)
Eth packets per second limit	Use this to set the maximum transmitted packet limit in each second by the Easergy P3 device. The recommended setting is 75.
Event	A single occurrence in a power system process. In the HMI, event is abbreviated as "E" followed by an identification number. For example, E15 refers to Event 15.
F2BIO	2 x optical BIO interfaces, fibre

fy	Frequency on the other side of the breaker. This measurement is available when the voltage scaling mode has synchrocheck configured.
GOOSE	Generic object-oriented substation event A specific definition of a type of generic substation event, for peer-peer communication.
Hysteresis	I.e. dead band Used to avoid oscillation when comparing two nearby values.
IDMT	Inverse definite minimum time
I_{MODE}	Nominal current of the selected mode In feeder mode, $I_{MODE} = V_{T_{PRIMARY}}$. In motor mode, $I_{MODE} = I_{MOT}$.
I_{MOT}	Nominal current of the protected motor
I_N	Nominal current Rating of CT primary or secondary
I_{SET}	Start setting value $I > (50/51)$
I_{0N}	Nominal current of I_0 input in general
IEC	International Electrotechnical Commission An international standardization organisation
IEC-101	Communication protocol defined in standard IEC 60870-5-101
IEC-103	Communication protocol defined in standard IEC 60870-5-103
IEEE	Institute of Electrical and Electronics Engineers
IRIG-B	Inter-Range Instrumentation Group time code B Standard for time transfer
IT	Instrument transformer (current or voltage transformer): electrical device used to isolate or transform voltage or current levels

LAN	Local area network Ethernet-based network for computers and devices
Latching	Digital outputs and indication LEDs can be latched, which means that they are not released when the control signal is releasing. Releasing of latched devices is done with a separate action.
LCD	Liquid crystal display
LED	Light-emitting diode
LPCT	Low-power current transformer
LPIT	Low-power instrument transformer (LPCT or LPVT)
LPVT	Low-power voltage transformer
NTP	Network Time Protocol for LAN and WWW
Operation delay	A setting in Easergy Pro that specifies the total operate time from the fault occurrence until the output contacts are operated. The delay contains: <ul style="list-style-type: none"> • start delay • user-configurable operation delay • output contact delay
OVF	Indication of the event overflow
P	Active power Unit = [W]
PF	Power factor The absolute value is equal to $\cos\varphi$, but the sign is 'IND' for inductive i.e. lagging current and 'CAP' for capacitive i.e. leading current.
PLC	Programmable logic controller
P_M	Nominal power of the prime mover (Used by reverse/under power protection.)
POC signals	Binary signals that are transferred in the communication channel of two P3L30 line differential relays in both directions. POC signals are used to transfer statuses of the DI, VI, VO and logic outputs.

pu PU	Per unit Depending of the context, the per unit refers to any nominal value. For example, for overcurrent setting $1 \text{ pu} = 1 \times I_{\text{MOT}}$.
P3M30	P3M30 motor protection relay
Q	Reactive power Unit = [var]
RELxxxx	Short order code
RH	Relative humidity
RMS	Root mean square
RS232 or RS485 (EIA-232 or EIA-485)	Standard defining the electrical characteristics of a serial communication interface
RTU	Remote terminal unit
S	Apparent power Unit = [VA]
SCADA	Supervisory control and data acquisition
SF	Alarm duty watchdog output is energized when the auxiliary power supply is on and the product status is operative. This output is referenced as "service status output" in the setting tool.
Signaling output	Alarm duty output rated, not suitable for direct circuit breaker controlling
SNTP	Simple Network Time Protocol for LAN and WWW
SOTF	Switch on to fault
Squelch limit	Noise filter used to force the measured low signal level to zero
SPST	Single pole single throw
SPDT	Single pole double throw
Storm protection limit	Use this setting to limit broadcast messages. For example, limit the storm to 3%, that is $0.03 \times 100 \text{ Mbps} = 30 \text{ kbps}$. This means that only 30 kb (typically 45 packets) of broadcast traffic per second is processed by the Easergy P3 device.

TCP keepalive interval	Interval between keepalive messages. Keepalive messages are used to keep the connection active and to response faster to a lost connection.
TCS	Trip circuit supervision
THD	Total harmonic distortion
U_{0SEC}	Voltage at input U_c at zero ohm ground fault. (Used in voltage measurement mode "2LL+ U_0 ")
U_A	Voltage input for U_{12} or U_{L1} depending on the voltage measurement mode
U_B	Voltage input for U_{23} or U_{L2} depending on the voltage measurement mode
U_C	Voltage input for U_{31} or U_0 depending on the voltage measurement mode
U_N	Nominal voltage Rating of VT primary or secondary
UMI	User-machine interface
USB	Universal serial bus
UTC	Coordinated Universal Time Used to be called GMT = Greenwich Mean Time
Webset	HTTP configuration interface
VI	Virtual input
VO	Virtual output
VT	Voltage transformer
VT_{PRI}	Nominal primary value of voltage transformer
VT_{SEC}	Nominal secondary value of voltage transformer

2 Product introduction

2.1 Warranty

This product has a standard warranty of 2 years.

Ask your local Schneider Electric representative about our optional 10-year warranty. Local conditions and availability apply.

2.2 Product overview

The relay has a modular design and it can be optimized to almost all types of motor applications in low and medium voltage distribution systems.

Main characteristic and options

- The relay has all the necessary motor and feeder protection for industrial power distribution networks.
- The relay has an optional interface for connecting four arc flash point sensors.
- The relay has optional arc flash communications and high speed outputs to allow for simple arc flash system configuration.
- Two alternative display options
 - 128 x 128 LCD matrix
 - 128 x 128 LCD matrix detachable
- Power quality measurements and disturbance recorder enable capture of transients
- Wide range of communication protocols, for example:
 - Modbus TCP/IP
 - Profibus
 - IEC61850

The following options depend on the order code:

- power supply options
- earth fault overcurrent input sensitivity
- number of digital inputs
- number of trip contacts
- integrated arc-options (point sensors)
- various possibilities with communication interfaces:
 - high-speed outputs
 - simple arc flash system communications (BIO)
 - fiber loop
- front panel protection of IP54

Protection functions

- Universal, adaptive protection functions for user-configurable applications like feeder, motor and voltage protection from basic non-directional to directional overcurrent protection, thermal overload, and auto-recloser
- Universal, adaptive protection functions for user-configurable applications like feeder, motor and voltage protection from basic non-directional to directional overcurrent protection and thermal overload
- Neutral voltage displacement, overvoltage and frequency protection including synchrocheck for two breakers
- Single-line diagram, measurements and alarms in the user-machine interface (UMI)
- User-configurable interlocking for primary object control
- Optional arc flash detection utilizing point sensors and a fiber loop that can provide system wide arc flash detection.

Virtual injection

- Current and voltage injection by manipulating the database of the product by setting tool disturbance recorder file playback through the product's database

Robust hardware

- User-selectable Ethernet, RS485 or RS232 -based communication interfaces
- Designed for demanding industrial conditions with conformal-coated printed circuit boards
- Standard USB connection (type B) for Easergy P3 setting software

Common technology for cost efficiency

- Powerful CPU supporting IEC 61850
- Thanks to four setting groups, adaptation to various protection schemes is convenient

User-machine interface (UMI)

- Clear LCD display for alarms and events
- Single-line diagram mimic with control, indication and live measurements
- Programmable function keys and LEDs
- Circuit breaker ON/OFF control
- Common firmware platform with other Easergy P3 range protection relays

2.3 Product selection guide

The selection guide provides information on the Easergy P3 platform to aid in the relay selection. It suggests Easergy P3 types suitable for your protection requirements, based on your application characteristics. The most typical applications are presented along with the associated Easergy P3 type.

Table 3 - Applications

		Easergy P3 Standard			Easergy P3 Advanced	
Voltage		–	–	P3U30 with directional o/c with voltage protection	–	–
Feeder		P3U10	P3U20		P3F30 w. directional P3L30 w. line diff. & distance	–
Transformer					–	P3T32 with differential
Motor					P3M30	P3M32 with differential
Generator					P3G30	P3G32 with differential
Measuring inputs	Phase current			1/5A CT (x3)		1/5A CT (x3) or LPCT (x3)
	Residual current	1/5A CT or 0.2/1A CT or CSH			5/1A+1/0.2A or or 5/1A + CSH	5/1A+1/0.2A + 5/1A+1/0.2A CT
	Voltage	VT (x1)	VT (x4) or LPVT (x4)	VT (x4) or LPVT (x4) ²⁾	VT (x4)	
Arc flash sensor input		–			0 to 4 point sensor	0 to 4 point sensor
Digital I/O	Input	2	8/10	14/16	6 to 36	6 to 16
	Output	5 + SF	5/8 + SF	11/8 + SF	10 to 21 + SF	10 to 13 + SF
Analog I/O	Input	–	0 or 4 ³⁾		0 or 4 ³⁾	
	Output	–	0 or 4 ³⁾		0 or 4 ³⁾	
Temperature sensor input		–	0 or 8 or 12 ³⁾		0 or 8 or 12 ³⁾	
Front port		USB			USB	





	Easergy P3 Standard	Easergy P3 Advanced
Nominal power supply	24 V dc or 24...48 V dc or 48...230 V ac/dc ⁴⁾	24...48 V dc or 110...240 V ac/dc
Ambient temperature, in service	-40...60°C (-40...140°F)	-40...60°C (-40...140°F)

²⁾ LPCT/LPVT available for P3F30 and P3M30 only

³⁾ Using external RTD module

⁴⁾ Check the available power supply range from the device's serial number label.

Table 4 - Communication & others

		Easergy P3 Standard		Easergy P3 Advanced	
					
Communication					
Rear ports	RS-232	–	■	■	■
	IRIG/B		■	■	■
	RS-485	–	■	Using external I/O module	Using external I/O module
	Ethernet	–	■	■	■
Protocols	IEC 61850 Ed1 & Ed2	–	■	■	■
	IEC 60870-5-101	–	■	■	■
	IEC 60870-5-103	–	■	■	■
	DNP3 Over Ethernet	–	■	■	■
	Modbus serial	–	■	■	■
	Modbus TCP/IP	–	■	■	■
	Ethernet/IP	–	■	■	■
	Profibus DP	–	■	■	■
	SPAbus	–	■	■	■
Redundancy protocols	RSTP	–	■	■	■
	PRP	–	■	■	■
Others					
Control		1 object Mimic	8 objects Mimic	8 objects Mimic	
Logic	Matrix		■	■	
	Logic equations		■	■	
Cyber security			Password	Password	

	Easergy P3 Standard	Easergy P3 Advanced
Withdrawability (Pluggable connector)	■	–
Remote UMI	–	■

NOTE: The numbers in the following tables represent the amount of stages available for each Easergy P3 type.

Table 5 - Protection functions for P3U

Protection functions	ANSI code	Feeder P3U10/20	Feeder P3U30	Motor P3U10/20	Motor P3U30
Fault locator	21FL	–	1	–	1
Synchronization check ⁵⁾	25	–	2	–	2
Undervoltage	27	–	3	–	3
Directional power	32	–	2	–	2
Phase undercurrent	37	1	1	1	1
Temperature monitoring ⁶⁾	38/49T	12	12	12	12
Negative sequence overcurrent (motor, generator)	46	–	–	2	2
Cur. unbalance, broken conductor	46BC	1	1	–	–
Incorrect phase sequence	47	–	–	1	1
Negative sequence overvoltage protection	47	–	3	–	3
Motor start-up supervision / Locked rotor	48/51LR	–	–	1	1
Thermal overload	49	1	1	1	1
Phase overcurrent	50/51	3	3	3	3
Earth fault overcurrent	50N/51N	5	5	5	5
Breaker failure	50BF	1	1	1	1
SOTF	50HS	1	1	1	1
Capacitor bank unbalance ⁷⁾	51C	2	2	2	2
Voltage-dependent overcurrent	51V	–	1	–	1
Overvoltage	59	–	3	–	3
Capacitor overvoltage	59C	1	1	–	–
Neutral voltage displacement	59N	3	3	3	3

Protection functions	ANSI code	Feeder P3U10/20	Feeder P3U30	Motor P3U10/20	Motor P3U30
CT supervision	60	1	1	1	1
VT supervision	60FL	–	1	–	1
Restricted earth fault with external connection (high impedance)	64REF 64BEF	1	1	1	1
Frequent start inhibition	66	–	–	1	1
Directional phase overcurrent	67	–	4	–	4
Directional earth fault o/c	67N	3	3	3	3
Transient intermittent	67NI	1	1	–	–
Magnetizing inrush detection	68F2	1	1	1	1
Fifth harmonic detection	68H5	1	1	1	1
Auto-Recloser	79	5	5	–	–
Over or under frequency	81	–	2/2	–	2/2
Rate of change of frequency	81R	–	1	–	1
Under frequency	81U	–	2	–	2
Lockout	86	1	1	1	1
Programmable stages	99	8	8	8	8
Cold load pickup (CLPU)	–	1	1	1	1
Programmable curves	–	3	3	3	3
Setting groups ⁸⁾	–	4	4	4	4

⁵⁾ The availability depends on the selected voltage measurement mode (in the **Scaling** setting view in Easergy Pro)

⁶⁾ Using external RTD module

⁷⁾ Capacitor bank unbalance protection is connected to the earth fault overcurrent input and shares two stages with the earth fault overcurrent protection.

⁸⁾ Not all protection functions have 4 setting groups. See details in the manual.

Table 6 - Protection functions for Px3x

Protection functions	ANSI code	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Distance	21	–	1	–	–	–	–	–
Under-impedance	21G	–	–	–	–	2	2	–
Fault locator	21FL	1	1	–	–	–	–	–
Overfluxing	24	–	–	–	–	1	1	1
Synchronization check ⁹⁾	25	2	2	2	2	2	2	2

Protection functions	ANSI code	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Undervoltage	27	3	3	3	3	3	3	3
Positive sequence under-voltage	27P	–	–	–	–	2	2	–
Directional power	32	2	2	2	2	2	2	–
Phase undercurrent	37	–	–	1	1	–	–	–
Temperature monitoring ¹⁰⁾	38/49T	12	12	12	12	12	12	12
Loss of field	40	–	–	–	–	1	1	–
Under-reactance	21/40	–	–	–	–	2	2	–
Negative sequence overcurrent (motor, generator)	46	–	–	2	2	2	2	2
Cur. unbalance, broken conductor	46BC	1	1	–	–	–	–	–
Incorrect phase sequence	47	–	–	1	1	–	–	–
Negative sequence overvoltage protection	47	3	3	3	3	3	3	3
Excessive start time, locked rotor	48/51LR	–	–	1	1	–	–	–
Thermal overload	49	1	1	1	1	1	1	1
Phase overcurrent	50/51	3	3	3	3	3	3	3
Earth fault overcurrent	50N/51N	5	5	5	5	5	5	5
Breaker failure	50BF	1	1	1	1	1	1	1
SOTF	50HS	1	1	1	1	1	1	1
Capacitor bank unbalance ¹¹⁾	51C	2	2	2	2	2	2	2
Voltage-dependent overcurrent	51V	1	1	–	–	1	1	–
Overvoltage	59	3	3	3	3	3	3	3
Capacitor overvoltage	59C	1	1	–	–	–	–	–
Neutral voltage displacement	59N	2	2	2	2	2	2	2
CT supervision	60	1	1	1	1	1	2	2
VT supervision	60FL	1	1	1	1	1	1	1
Restricted earth fault with external connection (high impedance)	64REF 64BEF	1	1	1	1	1	1	1

Protection functions	ANSI code	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Restricted earth fault (low impedance)	64REF	–	–	–	–	–	1	1
Stator earth fault	64S	–	–	–	–	1	1	–
Frequent start inhibition	66	–	–	1	1	–	–	–
Directional phase overcurrent	67	4	4	4	4	4	4	4
Directional earth fault o/c	67N	3	3	3	3	3	3	3
Transient intermittent	67NI	1	1	–	–	–	–	–
Magnetizing inrush detection	68F2	1	1	1	1	1	1	1
Fifth harmonic detection	68H5	1	1	1	1	1	1	1
Pole slip	78PS	–	–	–	–	1	1	–
Auto-Recloser	79	5	5	–	–	–	–	–
Over or under frequency	81	2/2	2/2	2/2	2/2	2/2	2/2	2/2
Rate of change of frequency	81R	1	1	1	1	1	1	1
Under frequency	81U	2	2	2	2	2	2	2
Lockout	86	1	1	1	1	1	1	1
Line differential	87L	–	2	–	–	–	–	–
Machine differential	87M	–	–	–	2	–	2	–
Transformer differential	87T	–	–	–	–	–	–	2
Programmable stages	99	8	8	8	8	8	8	8
Arc flash detection (AFD)	–	8	8	8	8	8	8	8
Cold load pickup (CLPU)	–	1	1	1	1	1	1	1
Programmable curves	–	3	3	3	3	3	3	3
Setting groups ¹²⁾	–	4	4	4	4	4	4	4

⁹⁾ The availability depends on the selected voltage measurement mode (in the **Scaling** setting view in Easergy Pro)

¹⁰⁾ Using external RTD module

¹¹⁾ Capacitor bank unbalance protection is connected to the earth fault overcurrent input and shares two stages with the earth fault overcurrent protection.

¹²⁾ Not all protection functions have 4 setting groups. See details in the manual.

Table 7 - Control functions

Control functions	P3U10/ 20	P3U30	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Switchgear control and monitoring	1/2	4	6	6	6	6	6	6	6
Switchgear monitoring only	–	–	2	2	2	2	2	2	2
Programmable switchgear interlocking	■	■	■	■	■	■	■	■	■
Local control on single-line diagram	■	■	■	■	■	■	■	■	■
Local control with O/I keys	■	■	■	■	■	■	■	■	■
Local/remote function	■	■	■	■	■	■	■	■	■
Function keys	2	2	2	2	2	2	2	2	2
Custom logic (logic equations)	■	■	■	■	■	■	■	■	■
Control with Smart App	■	■	■	■	■	■	■	■	■

Table 8 - Measurements

Measurement	P3U10/ 20	P3U30	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
RMS current values	■	■	■	■	■	■ ¹³⁾	■	■ ¹³⁾	■ ¹³⁾
RMS voltage values	■	■	■	■	■	■	■	■	■
RMS active, reactive and apparent power	–	■	■	■	■	■	■	■	■
Frequency	■	■	■	■	■	■	■	■	■
Fundamental frequency current values	■	■	■	■	■	■ ¹³⁾	■	■ ¹³⁾	■ ¹³⁾
Fundamental frequency voltage values	–	■	■	■	■	■	■	■	■
Fundamental frequency active, reactive and apparent power values	–	■	■	■	■	■	■	■	■
Power factor	–	■	■	■	■	■	■	■	■
Energy values active and reactive	–	■	■	■	■	■	■	■	■
Energy transmitted with pulse outputs	–	■	■	■	■	■	■	■	■
Demand values: phase currents	■	■	■	■	■	■	■	■	■

Measurement	P3U10/ 20	P3U30	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Demand values: active, reactive, apparent power and power factor	–	■	■	■	■	■	■	■	■
Min and max demand values: phase currents	■	■	■	■	■	■	■	■	■
Min and max demand values: RMS phase currents	■	■	■	■	■	■	■	■	■
Min and max demand values: active, reactive, apparent power and power factor	–	■	■	■	■	■	■	■	■
Maximum demand values over the last 31 days and 12 months: active, reactive, apparent power	–	■	■	■	■	■	■	■	■
Minimum demand values over the last 31 days and 12 months: active, reactive power	–	■	■	■	■	■	■	■	■
Max and min values: currents	■	■	■	■	■	■	■	■	■
Max and min values: voltages	–	■	■	■	■	■	■	■	■
Max and min values: frequency	■	■	■	■	■	■	■	■	■
Max and min values: active, reactive, apparent power and power factor	–	■	■	■	■	■	■	■	■
Harmonic values of phase current and THD	■	■	■	■	■	■ ¹³⁾	■	■ ¹³⁾	■ ¹³⁾
Harmonic values of voltage and THD	–	■	■	■	■	■	■	■	■
Voltage sags and swells	–	■	■	■	■	■	■	■	■

¹³⁾ Function available on both sets of CT inputs

Table 9 - Logs and records

Logs and Records	P3U10/ 20	P3U30	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Sequence of event record	■	■	■	■	■	■	■	■	■
Disturbance record	■	■	■	■	■	■	■	■	■
Tripping context record	■	■	■	■	■	■	■	■	■

Table 10 - Monitoring functions

Monitoring functions	P3U10/ 20	P3U30	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Trip circuit supervision (ANSI 74)	1	1	1	1	1	1	1	1	1
Circuit breaker monitoring	1	1	1	1	1	1	1	1	1
Relay monitoring	■	■	■	■	■	■	■	■	■

2.4 Access to device configuration

You can access the device configuration via:

- the Easergy Pro setting tool
- the device's front panel

NOTE: There is a timeout mechanism for Telnet/Serial/Http connections. When logging on via the front panel or web HMI, you are automatically logged out after 15 minutes inactivity.

2.4.1 User accounts

By default, the Easergy P3 device has five user accounts.

Table 11 - User accounts


User account	User name	Default password	Use
User	user	0	Used for reading parameter values, measurements, and events, for example
Operator	operator	1	Used for controlling objects and for changing the protection stages' settings, for example
Configurator	conf	2	Needed during the device commissioning. For example, the scaling of the voltage and current transformers can be set only with this user account. Also used for logging on to the HTTP and FTP server.

2.4.2 Logging on via the front panel



NOTE: To log on via the front panel, you need a password that consists of letters, digits, or other characters in the scope of ASCII 0x21~0x7E.

1. Press  and  on the front panel. The **Enter password** view opens.

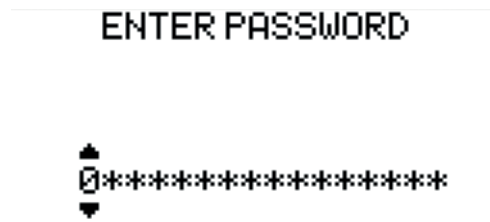Figure 1 - Enter password view




2. Enter the password for the desired access level.

Select a digit value using , and if the password is longer than one digit, move to the next digit position using .

NOTE: There are 16 digit positions in the **Enter password** view. Enter the password starting from the first digit position.

For example, if the password is 2, you can enter 2***, **2*, ***2, or 0002 to log on.

3. Press  to confirm the password.

Related topics

[2.4.4 Password management](#)

2.4.3 HTTP and FTP logon details

You can log on to the HTTP server and FTP using these user names and passwords.

Table 12 - HTTP and FTP logon details

Protocol	User name	Password
HTTP	conf	2
FTP	conf	2

2.4.4 Password management

NOTICE
<p>CYBERSECURITY HAZARD</p> <p>To improve cybersecurity:</p> <ul style="list-style-type: none"> • Change all passwords from their default values when taking the protection device into use. • Change all passwords regularly. • Ensure a minimum level of password complexity according to common password guidelines. <p>Failure to follow these instructions can increase the risk of unauthorized access.</p>

You can change the password for the operator or configurator user accounts in the **General > Device info** setting view in Easergy Pro.

The password can contain letters, digits or other characters in the scope of ASCII 0x21~0x7E. However, the new password cannot be any of the default passwords (digits 0–4 or 9999).

Follow these guidelines to improve the password complexity and thus device security:

- Use a password of minimum 8 characters.
- Use alphabetic (uppercase and lowercase) and numeric characters in addition to symbols.
- Avoid character repetition, number or letter sequences and keyboard patterns.
- Do not use any personal information, such as birthday, name, etc.
- Do not use the same password for different user accounts.
- Do not reuse old passwords.

Also, all users must be aware of the best practices concerning passwords including:

- not sharing personal passwords
- not displaying passwords during password entry
- not transmitting passwords in email or by other means
- not saving the passwords on PCs or other devices
- no written passwords on any supports
- regularly reminding users about the best practices concerning passwords

Related topics

[2.4.2 Logging on via the front panel](#)


2.4.5 Password restoring

If you have lost or forgotten all passwords, contact Schneider Electric to restore the default passwords.

2.5 Front panel

Easergy P3M30 and P3M32 has a 128 x 128 LCD matrix display.



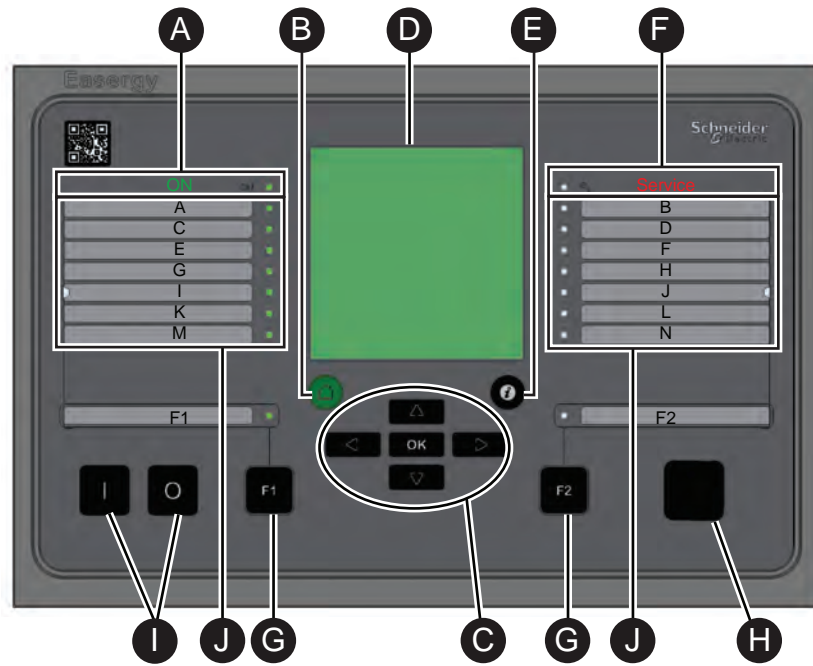

Figure 2 - Easergy P3M30 and P3M32 front panel



- A. Power LED
- B. CANCEL push-button
- C. Navigation push-buttons
- D. LCD
- E. INFO push-button
- F. Service LED
- G. Function push-buttons and LEDs showing their status
- H. Local port
- I. Object control buttons
- J. User-configurable LEDs

2.5.1 Push-buttons

Symbol	Function
	HOME/CANCEL push-button for returning to the previous menu. To return to the first menu item in the main menu, press the button for at least 3 seconds.
	INFO push-button for viewing additional information, for entering the password view and for adjusting the LCD contrast.
	Programmable function push-button. ¹⁴⁾
	Programmable function push-button. ¹⁴⁾
	ENTER push-button for activating or confirming a function.
	UP navigation push-button for moving up in the menu or increasing a numerical value.
	DOWN navigation push-button for moving down in the menu or decreasing a numerical value.

Symbol	Function
	LEFT navigation push-button for moving backwards in a parallel menu or selecting a digit in a numerical value.
	RIGHT navigation push-button for moving forwards in a parallel menu or selecting a digit in a numerical value.
	Circuit breaker ON push-button
	Circuit breaker OFF push-button

¹⁴⁾ The default names of the function buttons are Function button 1 and 2. You can change the names of the buttons in the **Control > Names for function buttons** setting view.

2.5.2 LED indicators

The relay has 18 LEDs on the front panel:

- two LEDs for function buttons (F1 and F2)
- two LEDs represent the unit's general status (power and service)
- 14 user-configurable LEDs (A-N)

When the relay is powered, the power LED is green. During normal use, the service LED is not active, it activates only when an error occurs or the relay is not operating correctly. Should this happen, contact your local representative for further guidance. The service LED and watchdog contact are assigned to work together. Hardwire the status output into the substation's automation system for alarm purposes.

The user-configurable LEDs may be red or green. You can configure them via Easergy Pro.

To customize the LED texts on the front panel for the user-configurable LEDs, the text may be created using a template and then printed. The printed text may be placed in the pockets beside the LEDs.

You can also customize the LED texts that are shown on the screen for active LEDs via Easergy Pro.

Table 13 - LED indicators and their information


LED indicator	LED color	Meaning	Measure / Remarks
Power LED lit	Green	The auxiliary power has been switched on	Normal operation state
Service LED lit	Red	Internal fault. Operates in parallel with the self-supervision output	The relay attempts to reboot. If the service LED remains lit, call for maintenance.

LED indicator	LED color	Meaning	Measure / Remarks
A–H LED lit	Green or red	Application-related status indicators.	Configurable in the Matrix setting view
F1 or F2 LED lit	Green	Corresponding function key pressed / activated	Depending on the function programmed to F1 / F2

2.5.3 Configuring the LED names via Easergy Pro

1. Go to **General > LED names**.
2. To change a LED name, click the LED **Description** text and type a new name. To save the new name, press **Enter**.

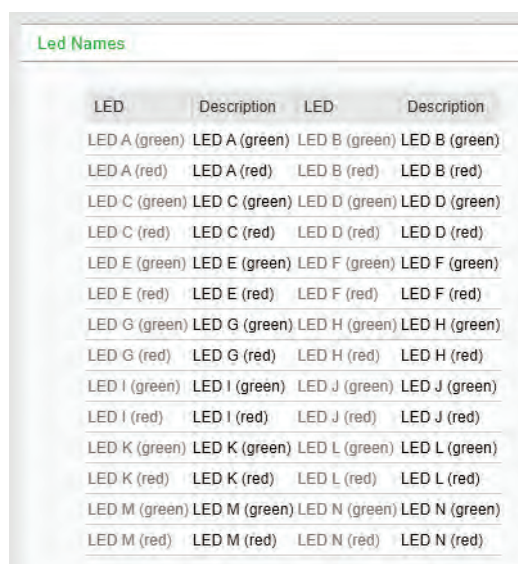Figure 3 - LED NAMES menu in Easergy Pro for LED configuration



2.5.4 Controlling the alarm screen

You can enable or disable the alarm screen either via the relay's local display or using Easergy Pro:





- On the local display, go to **Events > Alarms**.
- In Easergy Pro, go to **General > Local panel conf**.

2.5.5 Accessing operating levels

1. On the front panel, press **ⓘ** and **OK**.
2. Enter the password, and press **OK**.

2.5.6 Adjusting the LCD contrast

Prerequisite: You have entered the correct password.

1. Press , and adjust the contrast.
 - To increase the contrast, press .
 - To decrease the contrast, press .
2. To return to the main menu, press .

NOTE: By nature, the LCD display changes its contrast depending on the ambient temperature. The display may become dark or unreadable at low temperatures. However, this condition does not affect the proper operation of the protection or other functions.

2.5.7 Testing the LEDs and LCD screen

You can start the test sequence in any main menu window.

To start the LED and LCD test:







1. Press .
2. Press .

The relay tests the LCD screen and the functionality of all LEDs.

2.5.8 Controlling an object with selective control

Prerequisite: You have logged in with the correct password and enabled selective control in the **Objects** setting view.



When selective control is enabled, the control operation needs confirmation (select before operate).

- Press  to close an object.
 - Press  again to confirm.
 - Press  to cancel.
- Press  to open an object.
 - Press  again to confirm.
 - Press  to cancel.

2.5.9 Controlling an object with direct control

Prerequisite: You have logged in with the correct password and enabled direct control in the **Objects** setting view.

When direct control is enabled, the control operation is done without confirmation.

- Press  to close an object.
- Press  to open an object.

2.5.10 Menus

This section gives an overview of the menus that you can access via the device's front panel.

The main menu

Press the right arrow to access more measurements in the main menu.


Table 14 - Main menu

Menu name	Description
Active LEDs	User-configurable texts for active LEDs
Measurements	User-configurable measurements
Single line	Single line or Single line mimic, measurements and control view. This is a default start view. To return to this view from any location, press the HOME/ CANCEL button for at least 3 seconds.
Info	Information about the relay: relay's name, order code, date, time and firmware version
P	Power: power factor and frequency values calculated by the relay. Press the right arrow to view more measurements.
E	Energy: the amount of energy that has passed through the protected line, calculated by the relay from the currents and voltages. Press the right arrow to view more energy measurements.
I	Current: phase currents and demand values of phase currents. Press the right arrow to view more current measurements.
U	Line-to-line voltages. Press the right arrow to view other voltage measurements.
Dema	Minimum and maximum phase current and power demand values
Umax	Minimum and maximum values of voltage and frequency
I _{max}	Minimum and maximum current values
P _{max}	Minimum and maximum power values

Menu name	Description
Month	Monthly maximum current and power values
FL	Short-circuit locator applied to incomer or feeder
Evt	Event log: event codes and time stamps
DR	Disturbance recorder configuration settings
Runh	Running hour counter
TIMR	Timers: programmable timers that you can use to preset functions
DI	Digital input statuses and settings
DO	Digital output statuses and settings
Arc	Arc flash detection settings
Prot	Protection: settings and statuses for various protection functions
I>, I>>, etc.	Protection stage settings and statuses. The availability of the menus are depends on the activated protection stages.
AR	Auto-reclosure settings, statuses and registers
OBJ	Objects: settings related to object status data and object control (open/closed)
Lgic	Logic events and counters
CONF	General device setup: CT and VT scalings, frequency adaptation, units, device info, date, time, clock, etc.
Bus	Communication port settings
Slot	Slot info: card ID (CID) that is the name of the card used by the relay firmware
Diag	Diagnosis: various diagnostic information

2.5.10.1 Moving in the menus

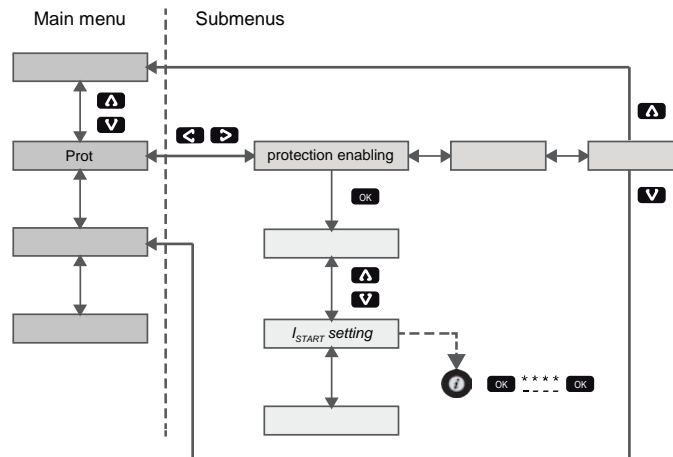Figure 4 - Moving in menus using the front panel



- To move in the main menu, press ▲ or ▼.
- To move in the submenus, press > or <.
- While in the submenu, press ▲ or ▼ to jump to the root.
- To enter a submenu, press OK and use ▼ or ▲ for moving down or up in the menu.
- To edit a parameter value, press F and OK.
- Enter the password, and press OK.
- To go back to the previous menu, press 🏠.
- To go back to the first menu item in the main menu, press 🏠 for at least three seconds.


NOTE: To enter the parameter edit mode, enter the password. When the value is in edit mode, its background is dark.

2.5.10.2 Local panel messages

Table 15 - Local panel messages

Value is not editable:	The value can not be edited or password is not given
Control disabled:	Object control disabled due to wrong operating level
Change causes autoboot:	Notification that if the parameter is changed the relay boots itself

2.6 Easergy Pro setting and configuration tool

⚡ ⚠ DANGER	
	<p>HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH</p> <p>Only qualified personnel should operate this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.</p> <p>Failure to follow this instruction will result in death or serious injury.</p>

Easergy Pro is a software tool for configuring Easergy P3 relays. It has a graphical interface where the relay settings and parameters are grouped under seven tabs:

- General
- Measurements
- Inputs/outputs
- Protection
- Matrix
- Logs
- Communication

The contents of the tabs depend on the relay type and the selected application mode.

Easergy Pro stores the relay configuration in a setting file. The configuration of one physical relay is saved in one setting file. The configurations can be printed out and saved for later use.

For more information, see the Easergy Pro user manual.

NOTE: Download the latest version of the software from se.com/ww/en/product-range-download/64884-easergy-p3-protection-relays.

NOTICE
<p>HAZARD OF EQUIPMENT DAMAGE</p> <p>After writing new settings or configurations to a device, perform a test to verify that the relay operates correctly with the new settings.</p> <p>Failure to follow these instructions can result in unwanted shutdown of the electrical installation.</p>

2.7 Low-power instrument transformers

Protection devices need current and voltage data from the equipment to be protected. For technical, economic and safety reasons, this data cannot be obtained directly from the equipment's medium-voltage (MV) power supply. For this purpose, low-power instrument transformers (LPITs) can be used. LPITs:

- reduce the size of value to be measured
- provide galvanic separation
- supply the power needed to process the data or even for the protection device to work

There are two types of LPITs:

- low-power current transformers (LPCTs) that are connected on the MV network primary circuit and supply a reduced current value to the secondary circuit, proportional to the network current on which they are installed.
- low-power voltage transformers (LPVTs) that are connected to the MV network primary and supply the secondary circuit with a reduced voltage value, proportional to the network voltage on which they are installed.

Using LPITs has many benefits compared to using traditional CTs or VTs:

- improved personal safety during testing and operation
- one LPCT replaces the dedicated measurement CTs and protection CTs
- the LPCT primary rating is no longer to be as close as possible to the nominal current
- time and money savings during project planning and execution
- reduced environmental impact because of reduced instrument transformer size

LPITs compliant with the standards IEC 60044 and IEC 61869 can be connected to the LPIT inputs of Easergy P3 devices.


3 Mechanical structure

3.1 Modularity

The relay has a modular structure. The relay is built from hardware modules that are installed into 10 different slots at the back of the relay. The location of the slots is shown in [Figure 5](#).

The type of the hardware modules is defined by the order code.

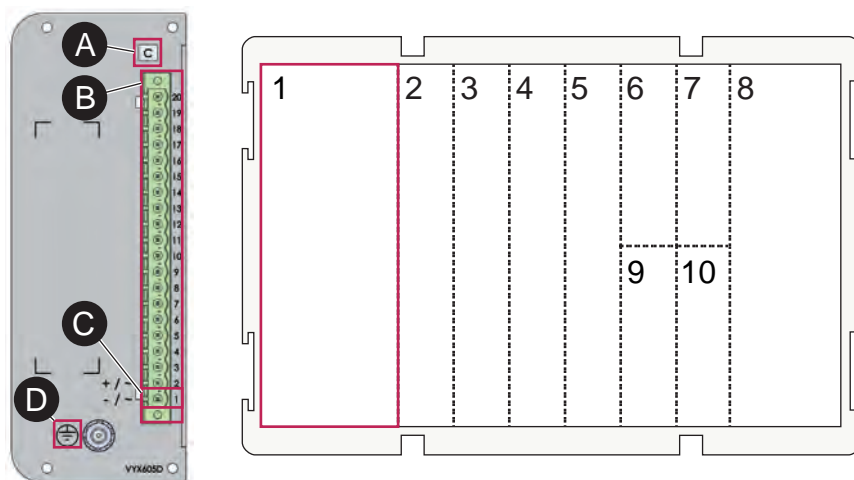Figure 5 - Slot numbering and card options in the Easergy P3M30 and P3M32 rear panel and an example of defining the pin address 1/C/1:1



A.	Card C	1	Supply voltage [V]
B.	Connector 2	2, 3	I/O card
C.	Pin 1	4, 5	I/O or analog measurement card
D.	Protective grounding	6, 9	Communication or I/O option card
		7, 8, 10	Analog measurement card (I, U)

For complete availability information on the different option cards, see [13.2 Accessories](#).

[10.5 Connections](#) contains detailed information on each card.

Example


Table 16 - Example of typical model P3M32-CGIII-DAENA-BB

SLOT	NAME	TYPE
	Application	M32 = Motor protection relay
1	Supply voltage	C = 110–240 V ac/dc (6 x DO: 1 change over signal duty and 5 tripping duty)
2	I/O card I	G = 6DI+4DO (6 x DI, 4 x DO)
3	I/O card II	I = 10DI (10 x DI)
4	I/O card III	I = 10DI (10 x DI)
5	I/O card IV	I = 10DI (10 x DI)
6	Option card I	D = 4Arc (4 x Arc sensor)
7	Future option	A = None
8	Analog measurement card (See application)	E = 3L(5A)+4U+2IO (5/1A +1/0.2A)
9	Communication interface I	N = 2 x RJ (Ethernet RJ 100Mbs, RSTP, PRP)
10	Future option	A = None
	Display type	B = 128x128 (128 x 128 LCD matrix)
	DI nominal voltage	B = 110 V dc/ac, with conformal coating
	Digital inputs	36 pcs
	Trip contacts	9 pcs
	Alarm contacts	1 pc
	Self-supervision contact	1 pc
	Phase currents (5A)	3 pcs
	Voltage channels	4 pcs
	(5/1A + 1/0.2A)	2 pcs
	Display	fixed in the relay

3.2 Slot info and order code

The relay's configuration can be checked via the front panel or Easergy Pro menu called **Slot** or **Slot info**. "Card ID" is the name of the card used by the relay firmware.

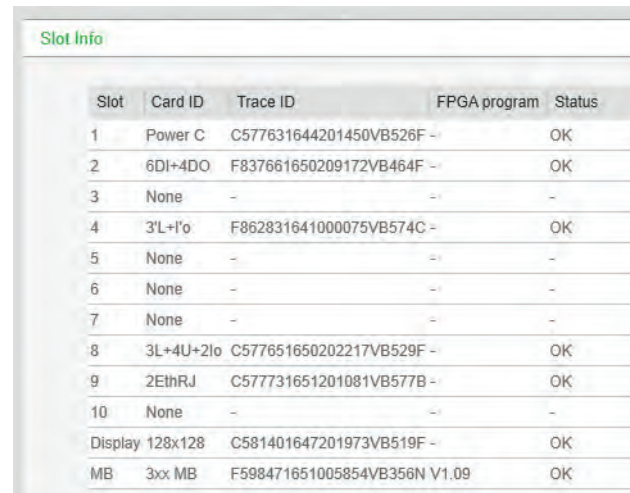Figure 6 - Hardware configuration example view from Easergy Pro configuration tool



Slot	Card ID	Trace ID	FPGA program	Status
1	Power C	C577631644201450VB526F	-	OK
2	6DI+4DO	F837661650209172VB464F	-	OK
3	None	-	-	-
4	3L+1o	F862831641000075VB574C	-	OK
5	None	-	-	-
6	None	-	-	-
7	None	-	-	-
8	3L+4U+2lo	C577651650202217VB529F	-	OK
9	2EthRJ	C577731651201081VB577B	-	OK
10	None	-	-	-
Display	128x128	C581401647201973VB519F	-	OK
MB	3xx MB	F598471651005854VB356N V1.09	-	OK

NOTE: See [13.1 Order codes](#) for the relay ordering options.

4 Measurement functions

Easergy P3 has various amounts of analog inputs depending on the model in use. [Table 17](#) introduces directly measured and calculated quantities for the power system monitoring. Also see [2.3 Product selection guide](#).

The current scaling impacts the following functions:

- Protection stages
- Measurements
- Disturbance recorder
- Fault location calculation

Table 17 - Measurement functions in Easergy P3 – conventional CT/VT

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
RMS phase current	■	■	■	$0.025-50 \times I_N$	$I \leq 1.5 \times I_N$: ± 0.5 % of value or ± 15 mA $I > 1.5 \times I_N$: ± 3 % of value
RMS earth fault overcurrent	■	■	■	$0.003-10 \times I_N$	$I \leq 1.5 \times I_N$: ± 0.3 % of value or ± 0.2 % of I_N $I > 1.5 \times I_N$: ± 3 % of value
RMS line-to-line voltage	—	■	■	$0.005-1.7 \times U_N$	± 0.5 % or ± 0.3 V
RMS phase-to-neutral voltage	—	■	■	$0.005-1.7 \times U_N$	± 0.5 % or ± 0.3 V
RMS active power (PF >0.5)	—	■	■	$\pm 0.1-1.5 \times P_N$	± 1 % for range $0.3-1.5 \times P_N$ ± 3 % for range $0.1-0.3 \times P_N$
RMS reactive power (PF >0.5)	—	■	■	$\pm 0.1-1.5 \times Q_N$	± 1 % for range $0.3-1.5 \times Q_N$ ± 3 % for range $0.1-0.3 \times Q_N$
RMS apparent power (PF >0.5)	—	■	■	$\pm 0.1-1.5 \times S_N$	± 1 % for range $0.3-1.5 \times S_N$ ± 3 % for range $0.1-0.3 \times S_N$
Frequency	■	■	■	16 Hz – 75 Hz	± 10 mHz

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
Fundamental frequency current values	■	■	■	$0.025-50 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$: $\pm 3\%$ of value
Fundamental frequency voltage values	—	■	■	$0.005-1.7 \times U_N$	$\pm 0.5\%$ or ± 0.3 V
Fundamental frequency active, reactive and apparent power values	—	■	■	$\pm 0.1-1.5 \times P_N$	$\pm 1\%$ for range $0.3-1.5 \times P_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N$
Fundamental frequency active power values	—	■	■	$\pm 0.1-1.5 \times Q_N$	$\pm 1\%$ for range $0.3-1.5 \times Q_N$ $\pm 3\%$ for range $0.1-0.3 \times Q_N$
Fundamental frequency reactive power values	—	■	■	$\pm 0.1-1.5 \times S_N$	$\pm 1\%$ for range $0.3-1.5 \times S_N$ $\pm 3\%$ for range $0.1-0.3 \times S_N$
Power factor	—	■	■	0.02–1	$\pm 2^\circ$ or ± 0.02 for PF > 0.5
Active energy	—	■	■		$\pm 1\%$ for range $0.3-1.5 \times EP_N$
Reactive energy	—	■	■		$\pm 1\%/1h$ for range $0.3-1.5 \times EQ_N$ $\pm 3\%/1h$ for range $0.1-0.3 \times EQ_N$
Energy transmitted with pulse outputs	—	■	■		$\pm 1\%/1h$ for range $0.3-1.5 \times EP_N$ $\pm 3\%/1h$ for range $0.1-0.3 \times EP_N$
Demand values: phase currents	■	■	■	$0.025-50 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$: $\pm 3\%$ of value

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
Active power demand	—	■	■	$\pm 0.1-1.5 \times P_N$	$\pm 1\%$ for range $0.3-1.5 \times P_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N$
Reactive power demand	—	■	■	$\pm 0.1-1.5 \times Q_N$	$\pm 1\%$ for range $0.3-1.5 \times Q_N$ $\pm 3\%$ for range $0.1-0.3 \times Q_N$
Apparent power demand	—	■	■	$\pm 0.1-1.5 \times S_N$	$\pm 1\%$ for range $0.3-1.5 \times S_N$ $\pm 3\%$ for range $0.1-0.3 \times S_N$
Power factor demand	—	■	■		$\pm 2^\circ$ or ± 0.02 for PF > 0.5
Min. and max. demand values: phase currents	■	■	■	$0.025-50 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$ $\pm 3\%$ of value
Min. and max. demand values: RMS phase currents	■	■	■	$0.025-50 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$ $\pm 3\%$ of value
Min. and max. demand values: active, reactive, apparent power and power factor	—	■	■		$\pm 1\%$ for range $0.3-1.5 \times P_N, Q_N, S_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N, Q_N, S_N$
Maximum demand values over the last 31 days and 12 months: active, reactive, apparent power	—	■	■		$\pm 1\%$ for range $0.3-1.5 \times P_N, Q_N, S_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N, Q_N, S_N$

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
Minimum demand values over the last 31 days and 12 months: active, reactive power	—	■	■		±1 % for range 0.3–1.5xP _N , Q _N , S _N ±3 % for range 0.1–0.3xP _N , Q _N , S _N
Max. and min. values: currents	■	■	■	0.025–50 x I _N	I ≤ 1.5 x I _N : ±0.5 % of value or ±15 mA I > 1.5 x I _N ±3 % of value
Max. and min. values: voltages	—	■	■	0.005–1.7 x U _N	±0.5 % or ±0.3 V
Max. and min. values: frequency	■	■	■	16 Hz-75 Hz	±10 mHz
Max. and min. values: active, reactive, apparent power and power factor	—	■	■	±0.1–1.5 x P _N , Q _N , S _N	±1 % for range 0.3–1.5xP _N , Q _N , S _N ±3 % for range 0.1–0.3xP _N , Q _N , S _N ±2° or ±0.02 for PF > 0.5
Harmonic values of phase current and THD	■	■	■	2nd–15th	
Harmonic values of voltage and THD	—	■	■	2nd–15th	
Voltage sags and swells	—	■	■	0.005–1.7 x U _N	±2° or ±0.02 for PF > 0.5

Table 18 - Measurement functions in Easergy P3 – LPIT

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
RMS phase current	■	■	■	$0.05-45 \times I_N$	$I \leq 1.5 \times I_N$: ± 0.5 % of value or ± 15 mA $I > 1.5 \times I_N$: ± 3 % of value
RMS earth fault overcurrent	■	■	■	$0.003-10 \times I_N$	$I \leq 1.5 \times I_N$: ± 0.3 % of value or ± 0.2 % of I_{ON} $I > 1.5 \times I_N$: ± 3 % of value
RMS phase-to-neutral voltage	—	■	■	$0.05-2.08 \times U_N$	± 0.5 % or ± 0.3 V
RMS active power (PF >0.5)	—	■	■	$0.005-1.7 \times P_N$	± 1 % for range $0.3-1.5 \times P_N$ ± 3 % for range $0.1-0.3 \times P_N$
RMS reactive power (PF >0.5)	—	■	■	$\pm 0.1-1.5 \times P_N$	± 1 % for range $0.3-1.5 \times Q_N$ ± 3 % for range $0.1-0.3 \times Q_N$
RMS apparent power (PF >0.5)	—	■	■	$\pm 0.1-1.5 \times Q_N$	± 1 % for range $0.3-1.5 \times S_N$ ± 3 % for range $0.1-0.3 \times S_N$
Frequency	■	■	■	45-65 Hz	± 10 mHz
Fundamental frequency current values	■	■	■	$0,05-45 \times I_N$	$I \leq 1.5 \times I_N$: ± 0.5 % of value or ± 15 mA $I > 1.5 \times I_N$: ± 3 % of value
Fundamental frequency voltage values	—	■	■	$0,05-2.08 \times U_N$	± 0.5 % or ± 0.3 V
Fundamental frequency active power values	—	■	■	$\pm 0.1-1.5 \times P_N$	± 1 % for range $0.3-1.5 \times P_N$ ± 3 % for range $0.1-0.3 \times P_N$

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
Fundamental frequency reactive power values	—	■	■	$\pm 0.1-1.5 \times Q_N$	$\pm 1\%$ for range $0.3-1.5 \times Q_N$ $\pm 3\%$ for range $0.1-0.3 \times Q_N$
Fundamental frequency apparent power values	—	■	■	$\pm 0.1-1.5 \times S_N$	$\pm 1\%$ for range $0.3-1.5 \times S_N$ $\pm 3\%$ for range $0.1-0.3 \times S_N$
Power factor	—	■	■	0.02–1	$\pm 2^\circ$ or ± 0.02 for PF > 0.5
Active energy	—	■	■		$\pm 1\%$ for range $0.3-1.5 \times EP_N$
Reactive energy	—	■	■		$\pm 1\%/1h$ for range $0.3-1.5 \times EQ_N$ $\pm 3\%/1h$ for range $0.1-0.3 \times EQ_N$
Energy transmitted with pulse outputs	—	■	■		$\pm 1\%/1h$ for range $0.3-1.5 \times EP_N$ $\pm 3\%/1h$ for range $0.1-0.3 \times EP_N$
Demand values: phase currents	■	■	■	$0,05-45 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$ $\pm 3\%$ of value
Active power demand	—	■	■	$\pm 0.1-1.5 \times P_N$	$\pm 1\%$ for range $0.3-1.5 \times P_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N$
Reactive power demand	—	■	■	$\pm 0.1-1.5 \times Q_N$	$\pm 1\%$ for range $0.3-1.5 \times Q_N$ $\pm 3\%$ for range $0.1-0.3 \times Q_N$
Apparent power demand	—	■	■	$\pm 0.1-1.5 \times S_N$	$\pm 1\%$ for range $0.3-1.5 \times S_N$ $\pm 3\%$ for range $0.1-0.3 \times S_N$
Power factor demand	—	■	■		$\pm 2^\circ$ or ± 0.02 for PF > 0.5

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
Min. and max. demand values: phase currents	■	■	■	$0.05-45 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$ $\pm 3\%$ of value
Min. and max. demand values: RMS phase currents	■	■	■	$0.05-45 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$ $\pm 3\%$ of value
Min. and max. demand values: active, reactive, apparent power and power factor	—	■	■		$\pm 1\%$ for range $0.3-1.5 \times P_N, Q_N, S_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N, Q_N, S_N$
Maximum demand values over the last 31 days and 12 months: active, reactive, apparent power	—	■	■		$\pm 1\%$ for range $0.3-1.5 \times P_N, Q_N, S_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N, Q_N, S_N$
Minimum demand values over the last 31 days and 12 months: active, reactive power	—	■	■		$\pm 1\%$ for range $0.3-1.5 \times P_N, Q_N, S_N$ $\pm 3\%$ for range $0.1-0.3 \times P_N, Q_N, S_N$
Max. and min. values: currents	■	■	■	$0.05-45 \times I_N$	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$ $\pm 3\%$ of value
Max. and min. values: voltages	—	■	■	$0,05-2.08 \times U_N$	$\pm 0.5\%$ or ± 0.3 V
Max. and min. values: frequency	■	■	■	45–65 Hz	± 10 mHz

Measurements Specification	P3U10/20	P3U30	P3x3x	Measurement range	Inaccuracy
Max. and min. values: active, reactive, apparent power and power factor	—	■	■	$\pm 0.1\text{--}1.5 \times P_N, Q_N, S_N$	$\pm 1\%$ for range $0.3\text{--}1.5 \times P_N, Q_N, S_N$ $\pm 3\%$ for range $0.1\text{--}0.3 \times P_N, Q_N, S_N$ $\pm 2^\circ$ or ± 0.02 for PF > 0.5
Harmonic values of phase current and THD	■	■	■	2nd–15th	
Harmonic values of voltage and THD	—	■	■	2nd–15th	
Voltage sags and swells	—	■	■	$0.05\text{--}2.08 \times U_N$	$\pm 2^\circ$ or ± 0.02 for PF > 0.5

NOTE: The measurement display's refresh rate is 0.2 s.

4.1 Primary, secondary and per unit scaling

Many measurement values are shown as primary values although the device is connected to secondary signals. Some measurement values are shown as relative values – per unit or percent. Almost all start setting values use relative scaling.

The scaling is done using the rated values of VTs and CTs or LPVTs and LPCTs depending on the selected model order option.

Scaling settings

The scaling settings define the characteristics of measurement transformers connected to the Easergy P3 protection device and determine the correct adaptation and performance of the metering and protection functions. They are accessed via:

- Easergy Pro or the web HMI in the **General > Scaling** view
- on local panel in the CT-VT view of the **General** menu

Table 19 - Phase current and earth fault overcurrent scaling parameters – conventional CT and VT

Parameter	Description
Motor nominal current	Nominal current of the motor
CT' primary	Primary current value of the CT at the I'L (low-voltage) side (only P3x32 devices). In Easergy Pro, this parameter is CT primary (2).
CT' secondary	Secondary current value of the CT at the I'L (low-voltage) side (only P3x32 devices). In Easergy Pro, this parameter is CT secondary (2).
Nominal input (IL side)	Rated value of the phase current input. The given thermal withstand, burden and impedance are based on this value. See Table 167 for details.
Nominal input (I'L side)	Rated value of the phase current input at I' side. The given thermal withstand, burden and impedance are based on this value (only P3x32 devices). See Table 167 for details.
CT primary	Primary current value of the IL (high-voltage) current transformer
CT secondary	Secondary current value of the IL (high-voltage) current transformer
I ₀₁ CT primary	Primary current value of the earth fault I ₀₁ overcurrent transformer
I ₀₁ CT secondary	Secondary current value of the earth fault I ₀₁ overcurrent transformer
Nominal I ₀₁ input	Selectable nominal input rating for the earth fault overcurrent input. Select either 5A or 1A depending on which I ₀ input is used. The given thermal withstand, burden and impedance are based on this value. See Table 167 for details.
I ₀₂ CT primary	Primary current value of the earth fault I ₀₂ overcurrent transformer
I ₀₂ CT secondary	Secondary current value of the I ₀₂ overcurrent transformer
Nominal I ₀₂ input	Selectable nominal input rating for the earth fault overcurrent input. Select either 1A or 0.2A depending on which I ₀ input is used. The given thermal withstand, burden and impedance are based on this value. See Table 167 for details.
I ₀₃ CT primary	Primary current value of the earth fault I ₀₃ overcurrent transformer
I ₀₃ CT secondary	Secondary current value of the earth fault I ₀₃ overcurrent transformer
VT primary	Primary voltage value of the voltage transformer

Parameter	Description
Nominal I_{03} input	Selectable nominal input rating for the earth fault overcurrent input. Select either 1A or 0.2A depending on which I_0 input is used. The given thermal withstand, burden and impedance are based on this value. See Table 167 for details.
VT secondary	Secondary voltage value of the voltage transformer
VT ₀ secondary	Secondary voltage value of the neutral voltage displacement voltage transformer
Voltage measurement mode	The device can be connected either to zero-sequence voltage, line-to-line voltage or line-to-neutral voltage. Set the voltage measurement mode according to the type of connection used.
Frequency adaptation mode	Parameter used to set the system frequency. There are three modes available: manual, auto and fixed. For more information, see 4.1.1 Frequency adaptation mode .
Adapted frequency	When the frequency adaption mode is set to manual, you can set the frequency in the Adapted frequency field, and it is not be updated even if the measured frequency is different.
Angle memory duration	Time setting for the directional overcurrent stage to keep the phase angle fixed if the system voltage collapses
I' 180 deg. angle turn	A setting to turn I' currents 180 degrees (only P3x32 devices)

Table 20 - Phase current and earth fault overcurrent scaling parameters – LPIT

Parameter	Description	Value
LPCT rated nominal current	All measurements are scaled by the LPCT rated nominal current and LPCT rated secondary voltage setting.	10 A – 1 kA
LPCT rated secondary voltage	All measurements are scaled by the LPCT rated nominal current and LPCT rated secondary voltage setting.	Fixed value
Protection nominal current	In feeder protection devices (P3U and P3F), the Protection nominal current setting value is used as a reference for all protection settings. NOTE: Measurement values are not scaled by the Protection nominal current setting value.	1–1600 A
Use current sensor corrections	If the 'Use current sensor corrections' checkbox is selected, the correction factor settings becomes visible for I_{L1} – I_{L3} . When the checkbox is not selected, the correction factors are not shown.	

Parameter	Description	Value
IL* magnitude correction factor	Factor to correct the current sensor amplitude. The value is found on the current sensor nameplate. If correction values are not used, the default value is applied.	0.900–1.100 Resolution 0.001 Default value 1.000
IL* phase correction offset	Factor to correct the current sensor phase offset. The value is found on the current sensor nameplate. If correction values are not used, the default value is applied.	+5.00° Resolution 0.01° Default value 0.00°
LPVT rated primary voltage	All measurements are scaled by the LPVT rated primary voltage and LPVT rated secondary voltage setting.	50–500 000 V
LPVT rated secondary voltage	All measurements are scaled by the LPVT rated primary voltage and LPVT rated secondary voltage setting.	Fixed value
Network voltage	All protection settings are associated to the network voltage setting. NOTE: Measurement values are not scaled by the Protection nominal current setting value.	50–500 000 V
Use voltage sensor corrections	If the 'Use voltage sensor corrections' checkbox is selected, the correction factor settings becomes visible for U1–U4. If the checkbox is not selected, the correction factors are not shown.	
Primary VT type		LPVT, VT + LPVT Default value LPVT
U* magnitude correction factor	Factor to correct the voltage sensor amplitude. The value is found on the voltage sensor nameplate. If correction values are not used, the default value is applied.	When LPVT selected: • 0.900–1.100 • Resolution 0.001 • Default value 1.000 When VT + LPVT selected: • 30.000–60.000 • Resolution 0.001
U* phase correction offset	Factor to correct the voltage sensor phase offset. The value is found on the voltage sensor nameplate. If correction values are not used, default value is applied	+5.00° Resolution 0.01° Default value 0.00°
I ₀₁ CT primary	Primary current value of the earth fault I ₀₁ overcurrent transformer	1–20000 A

Parameter	Description	Value
I_{01} CT secondary	Secondary current value of the earth fault I_{01} overcurrent transformer	0.1–10 A
Nominal I_{01} input	Selectable nominal input rating for the earth fault overcurrent input. Select either 5 A or 1 A depending on which I_0 input is used. The given thermal withstand, burden and impedance are based on this value. See Table 167 for details.	1.0 A / 5.0 A
I_{02} CT primary	Primary current value of the earth fault I_{02} overcurrent transformer	1–20000 A
I_{02} CT secondary	Secondary current value of the earth fault I_{02} overcurrent transformer	0.1–10 A
Nominal I_{02} input	Selectable nominal input rating for the earth fault overcurrent input. Select either 1 A or 0.2 A depending on which I_0 input is used. The given thermal withstand, burden and impedance are based on this value. See Table 167 for details.	0.2 A / 1.0 A
VT_0 secondary	Secondary voltage value of the neutral voltage displacement voltage transformer	25 000–240 0000 V
Voltage measurement mode	The device can be connected either to zero-sequence voltage or line-to-neutral voltage. Set the voltage measurement mode according to the type of connection used.	U_0 , 3LN, 3LN/LNy, 3LN + U_0 , LN+ U_0 /y/z
Frequency adaptation mode	Parameter used to set the system frequency. There are three modes available: manual, auto and fixed. For more information, see 4.1.1 Frequency adaptation mode .	
Adapted frequency	When the frequency adaption mode is set to manual, you can set the frequency in the Adapted frequency field, and it is not be updated even if the measured frequency is different.	45–65 Hz
Angle memory duration	Time setting for the directional overcurrent stage to keep the phase angle fixed if the system voltage collapses	0.20–3.20 s

Figure 7 - Scaling setting view in Easergy Pro – conventional CT/VT

Scaling

CT settings

CT primary	<input type="range" value="500"/>	500	A
CT secondary	<input type="range" value="5"/>	5	A
CT primary	<input type="range" value="500"/>	500	A
CT secondary	<input type="range" value="5"/>	5	A
Nominal input (I'L side)	<input type="text" value="5"/>	5	A
Io1 CT primary	<input type="range" value="50"/>	50	A
Io1 CT secondary	<input type="range" value="5.0"/>	5.0	A
Nominal Io1 input	<input type="text" value="5.0"/>	5.0	A
Io2 CT primary	<input type="range" value="50"/>	50	A
Io2 CT secondary	<input type="range" value="5.0"/>	5.0	A
Nominal Io2 input	<input type="text" value="1.0"/>	1.0	A
Io3 CT primary	<input type="range" value="50"/>	50	A
Io3 CT secondary	<input type="range" value="5.0"/>	5.0	A
Nominal Io3 input	<input type="text" value="5.0"/>	5.0	A

VT settings

VT primary	<input type="range" value="11000"/>	11000	V
VT secondary	<input type="range" value="100"/>	100	V
VTo secondary	<input type="range" value="100.000"/>	100.000	V

Voltage meas. mode	<input type="text" value="3LN+Uo"/>	
Frequency adaptation mode	<input type="text" value="Auto"/>	
Adapted frequency	<input type="range" value="50.0"/>	50.0 Hz
Angle memory duration	<input type="range" value="0.50"/>	0.50 s
I' 180 deg. angle turn	<input type="checkbox"/>	

Motor nominal current	<input type="range" value="400.0"/>	400.0	A
-----------------------	-------------------------------------	-------	---

56

P3M/en M/H006

Figure 8 - Scaling setting view – LPIT

Scaling

LPCT rated nominal current: 100 A

LPCT rated secondary voltage: 22.5 mV

Protection nominal current: 788 A

Use current sensor corrections:

LPVT rated primary voltage: 11000 V

LPVT rated secondary voltage: 3.25 V

Network voltage: 20000 V

Use voltage sensor corrections:

Io1 CT primary: 50 A

Io1 CT secondary: 5.0 A

Nominal Io1 input: 1.0 A

Io2 CT primary: 50 A

Io2 CT secondary: 5.0 A

Nominal Io2 input: A

VTo secondary: 100.000 V

Voltage meas. mode: Uo

Frequency adaptation mode: Auto

Adapted frequency: 50.0 Hz

Angle memory duration: 0.50 s

The scaling equations presented in [4.1.2 Current scaling](#) and [4.1.3 Voltage scaling for analog module E, F](#) are useful when doing secondary testing.

4.1.1 Frequency adaptation mode

You can set the system frequency in **General > Scaling** in Easergy Pro.

There are three frequency adaptation modes available:

- **Manual:** When the adaption mode is set to manual, you can set the frequency in the **Adapted frequency** field, and it will not be updated even if the measured frequency is different. However, the relay monitors the system

frequency internally and adapts to the new frequency even if the frequency has been set manually.

- **Auto:** The network frequency is automatically updated when the relay has measured the voltage for approximately 45 seconds. The **Adapted frequency** field is updated even if it has been set previously. The frequency is measured from the voltage signals.

Table 21 - Voltage signals

Voltage measurement mode	Voltage	Voltage channel
2LL+U ₀ , 2LL+U ₀ /LNy, 2LL+U ₀ /LLy	U ₁₂ , U ₂₃	U ₁ , U ₂
3LN, 3LN+U ₀ , 3LN/LNy, 3LN/LLy	U _{L1} , U _{L2}	U ₁ , U ₂
LN+U ₀ /y/z	U _{L1}	U ₁
LL+U ₀ /y/z	U ₁₂	U ₁₁

- **Fixed:** The frequency is not updated based on the measured voltage and only the set value is used. This mode is recommended to be used for the line-differential function.

4.1.2 Current scaling

NOTE: The rated value of the relay's current input, for example 5 A or 1 A, does not have any effect on the scaling equations, but it defines the measurement range and the maximum allowed continuous current. See [Table 167](#) for details.

Table 22 - Primary and secondary scaling – conventional CT

	Current (CT) Residual current calculated
secondary → primary	$I_{PRI} = I_{SEC} \cdot \frac{CT_{PRI}}{CT_{SEC}}$
primary → secondary	$I_{SEC} = I_{PRI} \cdot \frac{CT_{SEC}}{CT_{PRI}}$

For earth fault overcurrent to input I₀, use the corresponding CT_{PRI} and CT_{SEC} values. For earth fault stages using I_{0 Calc} signals, use the phase current CT values for CT_{PRI} and CT_{SEC}.

Examples

1. **Secondary to primary**

$$CT = 500 / 5$$

Current to the relay's input is 4 A.

$$\Rightarrow \text{Primary current is } I_{PRI} = 4 \times 500 / 5 = 400 \text{ A}$$

2. Primary to secondary

$$CT = 500 / 5$$

The relay displays $I_{PRI} = 400 \text{ A}$

$$\Rightarrow \text{Injected current is } I_{SEC} = 400 \times 5 / 500 = 4 \text{ A}$$

Per unit [pu] scaling

For phase currents excluding Arcl>stage:

$$1 \text{ pu} = 1 \times I_{MOT} = 100\%, \text{ where } I_{MOT} \text{ is the rated current of the motor.}$$

The rated current for high-voltage side (HV) and low-voltage side (LV) are calculated by the relay itself using [Equation 1](#).

Equation 1

$$I_{MOT} = \frac{S_{MOT}}{\sqrt{3} \cdot U_{MOT}}$$

I_{MOT} = The rated current 1 pu.

S_{MOT} = Rated apparent power of the protected object

U_{MOT} = Rated line-to-line voltage of the protected object

For earth fault overcurrents and Arcl> stage:

$$1 \text{ pu} = 1 \times CT_{SEC} \text{ for secondary side and } 1 \text{ pu} = 1 \times CT_{PRI} \text{ for primary side.}$$

	Phase current scaling excluding Arcl> stage	Earth fault overcurrent (3I ₀) scaling and phase current scaling for Arcl> stage
secondary → per unit	$I_{PU} = \frac{I_{SEC} \cdot CT_{PRI}}{CT_{SEC} \cdot I_{GN}}$	$I_{PU} = \frac{I_{SEC}}{CT_{SEC}}$
per unit → secondary	$I_{SEC} = I_{PU} \cdot CT_{SEC} \cdot \frac{I_{GN}}{CT_{PRI}}$	$I_{SEC} = I_{PU} \cdot CT_{SEC}$

Examples

1. Secondary to per unit for Arcl>

$$CT = 750 / 5$$

Current injected to the relay's inputs is 7 A.

$$\text{Per unit current is } I_{PU} = 7 / 5 = 1.4 \text{ pu} = 140\%$$

2. Secondary to per unit for phase currents excluding Arcl>

$$CT = 750/5$$

$$I_{MOT} = 525 \text{ A}$$

Current injected to the relay's inputs is 7 A.

$$\text{Per unit current is } I_{PU} = 7 \times 750 / (5 \times 525) = 2.00 \text{ pu} = 2.00 \times I_{MOT} = 200\%$$

3. Per unit to secondary for Arcl>

$$CT = 750 / 5$$

The relay setting is 2 pu = 200%.

$$\text{Secondary current is } I_{SEC} = 2 \times 5 = 10 \text{ A}$$

4. Per unit to secondary for phase currents excluding Arcl>

$$CT = 750 / 5$$

$$I_{MOT} = 525 \text{ A}$$

The relay setting is $2 \times I_{MOT} = 2 \text{ pu} = 200\%$.

$$\text{Secondary current is } I_{SEC} = 2 \times 5 \times 525 / 750 = 7 \text{ A}$$

5. Secondary to per unit for earth fault overcurrent

Input is I_{01} .

$$CT_0 = 50 / 1$$

Current injected to the relay's input is 30 mA.

$$\text{Per unit current is } I_{PU} = 0.03 / 1 = 0.03 \text{ pu} = 3\%$$

6. Secondary to per unit for earth fault overcurrent

Input is I_{01} .

$$CT_0 = 50 / 1$$

The relay setting is 0.03 pu = 3%.

$$\text{Secondary current is } I_{SEC} = 0.03 \times 1 = 30 \text{ mA}$$

7. Secondary to per unit for earth fault overcurrent

Input is $I_{0 \text{ Calc}}$.

$$CT = 750 / 5$$

Currents injected to the relay's I_{L1} input is 0.5 A.

$$I_{L2} = I_{L3} = 0.$$

$$\text{Per unit current is } I_{PU} = 0.5 / 5 = 0.1 \text{ pu} = 10\%$$

8. Secondary to per unit for earth fault overcurrent

Input is $I_{0 \text{ Calc}}$.

$$CT = 750 / 5$$

The relay setting is 0.1 pu = 10%.

$$\text{If } I_{L2} = I_{L3} = 0, \text{ then secondary current to } I_{L1} \text{ is } I_{SEC} = 0.1 \times 5 = 0.5 \text{ A}$$

4.1.3 Voltage scaling for analog module E, F

NOTE: Voltage transformer scaling is based on the line-to-line voltages in all voltage measurements modes.

Table 24 - Primary/secondary scaling of line-to-line voltages

	Line-to-line voltage measurement (LL) with VT	Line-to-neutral voltage measurement (LN) with VT
secondary → primary	$U_{PRI} = U_{SEC} \cdot \frac{VT_{PRI}}{VT_{SEC}}$	$U_{PRI} = \sqrt{3} \cdot U_{SEC} \cdot \frac{VT_{PRI}}{VT_{SEC}}$
primary → secondary	$U_{SEC} = U_{PRI} \cdot \frac{VT_{SEC}}{VT_{PRI}}$	$U_{SEC} = \frac{U_{PRI}}{\sqrt{3}} \cdot \frac{VT_{SEC}}{VT_{PRI}}$

Table 25 - Primary/secondary scaling of line-to-line voltages

	Line-to-line voltage measurement (LL) with VT	Line-to-neutral voltage measurement (LN) with VT	Line-to-neutral voltage measurement with LPVT
secondary → primary	$U_{PRI} = U_{SEC} \cdot \frac{VT_{PRI}}{VT_{SEC}}$	$U_{PRI} = \sqrt{3} \cdot U_{SEC} \cdot \frac{VT_{PRI}}{VT_{SEC}}$	
primary → secondary	$U_{SEC} = U_{PRI} \cdot \frac{VT_{SEC}}{VT_{PRI}}$	$U_{SEC} = \frac{U_{PRI}}{\sqrt{3}} \cdot \frac{VT_{SEC}}{VT_{PRI}}$	

Examples

1. Secondary to primary. Voltage measurement mode is "2LL+U₀"

$$VT = 12000/110$$

Voltage connected to the relay's input U_A or U_B is 100 V.

$$\Rightarrow \text{Primary voltage is } U_{PRI} = 100 \times 12000/110 = 10909 \text{ V.}$$

2. Secondary to primary. Voltage measurement mode is "3LN

$$VT = 12000/110$$

Three phase symmetric voltages connected to the relay's inputs U_A, U_B and U_C are 57.7 V.

$$\Rightarrow \text{Primary voltage is } U_{PRI} = \sqrt{3} \times 57.7 \times 12000/110 = 10902 \text{ V}$$

3. Primary to secondary. Voltage measurement mode is "2LL+U₀"

$$VT = 12000/110$$

The relay displays U_{PRI} = 10910 V.

$$\Rightarrow \text{Secondary voltage is } U_{SEC} = 10910 \times 110/12000 = 100 \text{ V}$$

4. Primary to secondary. Voltage measurement mode is "3LN

$$VT = 12000/110$$

The relay displays U₁₂ = U₂₃ = U₃₁ = 10910 V.

$$\Rightarrow \text{Symmetric secondary voltages at } U_A, U_B \text{ and } U_C \text{ are } U_{SEC} = 10910/\sqrt{3} \times 110/12000 = 57.7 \text{ V.}$$

Per unit [pu] scaling of line-to-line voltages

One per unit = 1 pu = 1 x U_N = 100%, where U_N = rated voltage of the VT.

	Line-to-line voltage scaling	
	Voltage measurement mode = "2LL+U ₀ ", "1LL+U ₀ /LLy", "2LL/LLy", "LL/LLy/LLz"	Voltage measurement mode = "3LN"
secondary → per unit	$U_{PU} = \frac{U_{SEC}}{VT_{SEC}} \cdot \frac{VT_{PRI}}{U_N}$	$U_{PU} = \sqrt{3} \cdot \frac{U_{SEC}}{VT_{SEC}} \cdot \frac{VT_{PRI}}{U_N}$
per unit → secondary	$U_{SEC} = U_{PU} \cdot VT_{SEC} \cdot \frac{U_N}{VT_{PRI}}$	$U_{SEC} = U_{PU} \cdot \frac{VT_{SEC}}{\sqrt{3}} \cdot \frac{U_N}{VT_{PRI}}$

Examples

1. Secondary to per unit. Voltage measurement mode is "2LL+U₀".

VT = 12000/110

Voltage connected to the relay's input U_A or U_B is 110 V.

=> Per unit voltage is U_{PU} = 110/110 = 1.00 pu = 1.00 x U_N = 100%

2. Secondary to per unit. Voltage measurement mode is "3LN".

VT = 12000/110

Three symmetric phase-to-neutral voltages connected to the relay's inputs U_A, U_B and U_C are 63.5 V

=> Per unit voltage is U_{PU} = √3 x 63.5/110 x 12000/11000 = 1.00 pu = 1.00 x U_N = 100%

3. Per unit to secondary. Voltage measurement mode is "2LL+U₀".

VT = 12000/110

The relay displays 1.00 pu = 100%.

=> Secondary voltage is U_{SEC} = 1.00 x 110 x 11000/12000 = 100.8 V

4. Per unit to secondary. Voltage measurement mode is "3LN".

VT = 12000/110

U_N = 11000 V

The relay displays 1.00 pu = 100%.

=> Three symmetric phase-to-neutral voltages connected to the relay's inputs U_A, U_B and U_C are U_{SEC} = 1.00 x 110/√3 x 11000/12000 = 58.2 V

Per unit [pu] scaling of neutral displacement voltage

	Neutral displacement voltage (U_0) scaling	
	Voltage measurement mode = "2LL+ U_0 ", "1LL+ U_0 /LLy"	Voltage measurement mode = "3LN"
secondary → per unit	$U_{PU} = \frac{U_{SEC}}{U_{0SEC}}$	$U_{PU} = \frac{1}{VT_{SEC}} \cdot \frac{ \bar{U}_a + \bar{U}_b + \bar{U}_c _{SEC}}{\sqrt{3}}$
per unit → secondary	$U_{SEC} = U_{PU} \cdot U_{0SEC}$	$ \bar{U}_a + \bar{U}_b + \bar{U}_c _{SEC} = \sqrt{3} \cdot U_{PU} \cdot VT_{SEC}$

Examples

1. Secondary to per unit. Voltage measurement mode is "2LL+ U_0 ".

$U_{0SEC} = 110$ V (This is a configuration value corresponding to U_0 at full earth fault.)

Voltage connected to the relay's input U_C is 22 V.

=> Per unit voltage is $U_{PU} = 22/110 = 0.20$ pu = 20%

2. Secondary to per unit. Voltage measurement mode is "3LN".

$VT = 12000/110$

Voltage connected to the relay's input U_A is 38.1 V, while $U_B = U_C = 0$.

=> Per unit voltage is $U_{PU} = (38.1+0+0)/(\sqrt{3} \times 110) = 0.20$ pu = 20%

3. Per unit to secondary. Voltage measurement mode is "2LL+ U_0 ".

$U_{0SEC} = 110$ V (This is a configuration value corresponding to U_0 at full earth fault.)

The relay displays $U_0 = 20\%$.

=> Secondary voltage at input U_C is $U_{SEC} = 0.20 \times 110 = 22$ V

4. Per unit to secondary. Voltage measurement mode is "3LN".

$VT = 12000/110$


The relay displays $U_0 = 20\%$.

=> If $U_B = U_C = 0$, then secondary voltages at U_A is $U_{SEC} = \sqrt{3} \times 0.2 \times 110 = 38.1$ V

4.2 Measurements for protection functions

The relay uses root mean square (RMS) measurement for the protection stages if not stated otherwise in the protection stage description.

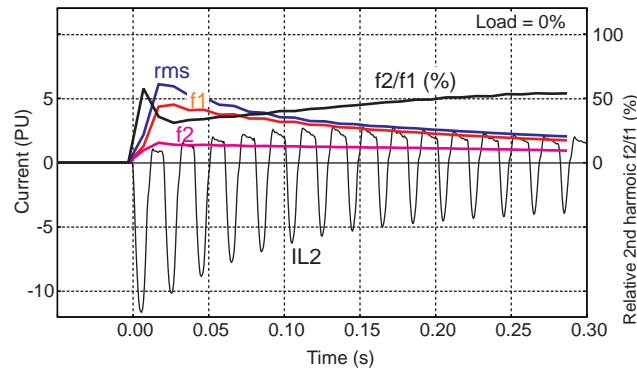Figure 9 - Example of various current values of a transformer inrush current



All the direct measurements are based on fundamental frequency values. The exceptions are frequency and instantaneous current for arc flash detection. Most protection functions are also based on the fundamental frequency values.

Figure 9 shows a current waveform and the corresponding fundamental frequency component f_1 , second harmonic f_2 , and RMS value in a special case where the current deviates significantly from a pure sine wave.


4.3 Measurements for arc flash detection function

The three-phase current measurement and ground fault current measurement for arc flash detection are done with electronics. The electronics compares the current levels to the start settings - THRESHOLDS - and gives a binary signals " $I>$ " or " $I_{01}>$ " to the arc flash detection function if limit is exceeded. All the frequency components of the currents are taken into account.

Signals " $I>$ " or " $I_{01}>$ " are connected to a FPGA chip which implements the arc flash detection function. The start settings are named " $I>$ int" and " $I_{01}>$ int" in the local LCD panel or Easergy Pro views, these settings are used to set the THRESHOLD levels for the electronics.

NOTE: The arc flash detection function is not yet available in LPIT models.

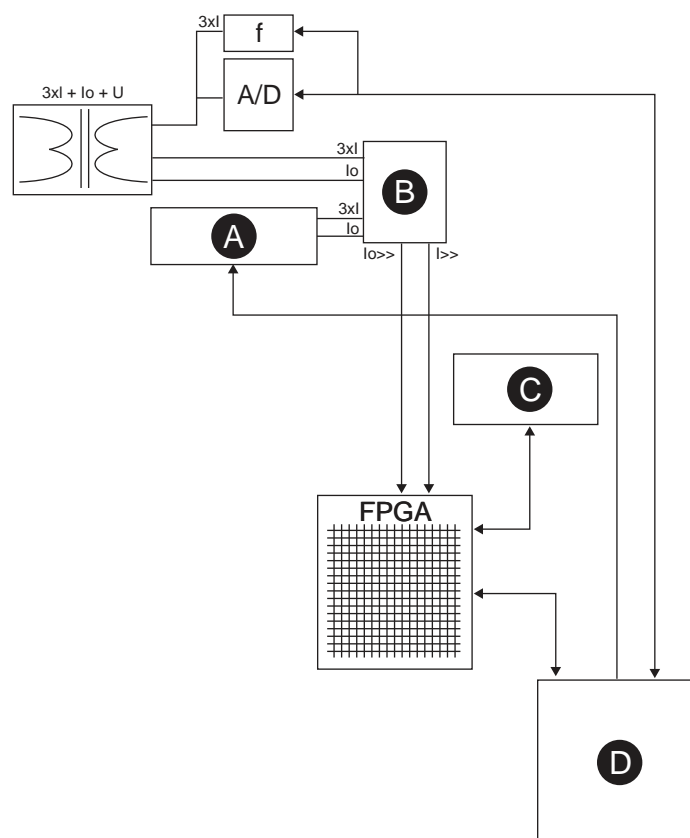Figure 10 - Measurement logic for the arc flash detection function



A. Threshold C. Conf. memory
 B. Comp. D. CPU

4.4 RMS values

RMS currents

The relay calculates the RMS value of each phase current. The minimum and maximum RMS values are recorded and stored (see [4.7 Minimum and maximum values](#)).

$$I_{RMS} = \sqrt{I_{f1}^2 + I_{f2}^2 + \dots + I_{f15}^2}$$

RMS voltages

The relay calculates the RMS value of each voltage input. The minimum and the maximum of RMS values are recorded and stored (see [4.7 Minimum and maximum values](#)).

$$U_{RMS} = \sqrt{U_{f1}^2 + U_{f2}^2 + \dots + U_{f15}^2}$$

4.5 Harmonics and total harmonic distortion (THD)

The relay calculates the the total harmonic distortions (THDs) as a percentage of the currents and voltages values measured at the fundamental frequency. The

relay calculates the harmonics from the 2nd to the 15th of phase currents and voltages. (The 17th harmonic component is also shown partly in the value of the 15th harmonic component. This is due to the nature of digital sampling.)

The harmonic distortion is calculated:

Equation 2

$$THD = \frac{\sqrt{\sum_{i=2}^{15} f_i^2}}{h_1}$$

f1 = Fundamental value

f₂₋₁₅ = Harmonics

Example

$$f_1 = 100 \text{ A}, \quad \left| f_3 = 10 \text{ A}, \quad \left| f_7 = 3 \text{ A}, \quad \left| f_{11} = 8 \text{ A} \right. \right. \right.$$

$$THD = \frac{\sqrt{10^2 + 3^2 + 8^2}}{100} = 13.2\%$$

For reference, the RMS value is:

$$RMS = \sqrt{100^2 + 10^2 + 3^2 + 8^2} = 100.9 \text{ A}$$

Another way to calculate the THD is to use the RMS value as reference instead of the fundamental frequency value. In the example above, the result would then be 13.0 %.

4.6 Demand values

The device calculates average i.e. demand values of phase currents I_{L1} , I_{L2} , I_{L3} and power values S, P and Q.

The demand time is configurable from 10 to 60 minutes with the parameter "Demand time".

Figure 11 - Demand values

Table 26 - Demand value parameters

Parameter	Value	Unit	Description	Set ¹⁵⁾
Time	10 – 30	min	Demand time (averaging time)	Set
Fundamental frequency values				
I_{L1da}		A	Demand of phase current I_{L1}	
I_{L2da}		A	Demand of phase current I_{L2}	
I_{L3da}		A	Demand of phase current I_{L3}	
Pda		kW	Demand of active power P	
$PFda$			Demand of power factor PF	
Qda		kvar	Demand of reactive power Q	
Sda		kVA	Demand of apparent power S	
RMS values				
$I_{L1RMSda}$		A	Demand of RMS phase current I_{L1}	
$I_{L2RMSda}$		A	Demand of RMS phase current I_{L2}	
$I_{L3RMSda}$		A	Demand of RMS phase current I_{L3}	
$Prmsda$		kW	Demand of RMS active power P	
$Qrmsda$		kvar	Demand of RMS reactive power Q	
$Srmsda$		kVA	Demand of RMS apparent power S	

¹⁵⁾ Set = An editable parameter (password needed)

4.7 Minimum and maximum values

Minimum and maximum values are registered with time stamps since the latest manual clearing or since the relay has been restarted. The available registered values are listed in [Table 27](#).

Figure 12 - Minimum and maximum values

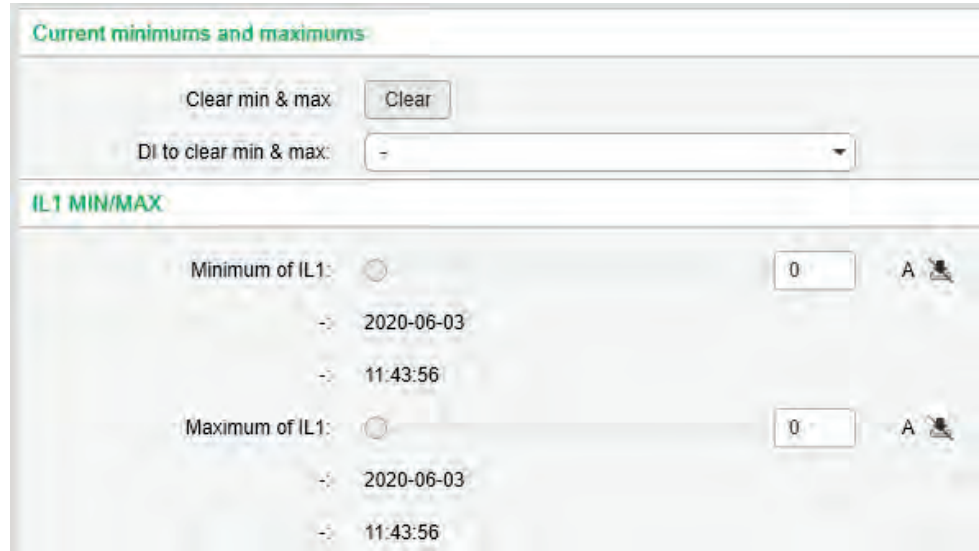


Table 27 - Minimum and maximum measurement values

Min & Max measurement	Description
I_{L1}, I_{L2}, I_{L3}	Phase current, fundamental frequency value
$I_{L1\text{ RMS}}, I_{L2\text{ RMS}}, I_{L3\text{ RMS}}$	Phase current, RMS value
I_{01}, I_{02}	Earth fault overcurrent, fundamental value
U_A, U_B, U_C, U_D	Voltages, fundamental frequency values
$U_{ARMS}, U_{BRMS}, U_{CRMS}, U_{DRMS}$	Line-to-neutral voltages, RMS value
f	Frequency
P, Q, S	Active, reactive, apparent power
P.F.	Power factor

The clearing parameter "ClrMax" is common for all these values.

Table 28 - Parameters

Parameter	Value	Description	Set ¹⁶⁾
ClrMax	-; Clear	Reset all minimum and maximum values	Set

¹⁶⁾ Set = An editable parameter (password needed).

4.8 Maximum values of the last 31 days and 12 months

The maximum and minimum values of the last 31 days and the last 12 months are stored in the relay's non-volatile memory. You can view them in the **Logs > Month max** setting view in Easergy Pro.

NOTE: The saving process starts every 30 minutes and it takes a while. If the relay's auxiliary supply power is switched off before all values have been saved, the old values remain for the unsaved ones.

Corresponding time stamps are stored for the last 31 days. The registered values are listed in [Table 29](#).

Figure 13 - Maximum and minimum values of the past 31 days

Month max

Timebase for maximums: ↻

Reset 31 days max

Reset month max

JANUARY	FEBRUARY	MARCH
APRIL	MAY	JUNE
JULY	AUGUST	SEPTEMBER
OCTOBER	NOVEMBER	DECEMBER

PAST 31 DAYS

Measurement	Date	Time of day
141248 A	2020-01-03	07:01:49
120640 A	2020-01-02	09:29:42
166720 A	2020-01-03	07:01:16
9.99 A	2020-01-03	06:24:50

Description	Measurement	Date	Time of day
Pmax	55795449 kW	2020-01-02	09:49:09
Pmin	-85357386 kW	2020-01-02	10:21:51
Qmax	27993 kvar	2020-01-02	09:49:10
Qmin	-127327 kvar	2020-01-02	10:21:53
Smax	85357386 kVA	2020-01-02	10:21:51

Figure 14 - Maximum and minimum values of the past 12 months

PAST 12 MONTHS										
Month	Year	IL1max	IL2max	IL3max	Iomax	Pmax	Pmin	Qmax	Qmin	Smax
JANUARY	2020	141248 A	120640 A	166720 A	9.99 A	55795449 kW	0 kW	27993 kvar	0 kvar	85357386 kVA
FEBRUARY	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
MARCH	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
APRIL	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
MAY	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
JUNE	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
JULY	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
AUGUST	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
SEPTEMBER	2019	0 A	0 A	0 A	0.00 A	0 kW	0 kW	0 kvar	0 kvar	0 kVA
OCTOBER	2019	112640 A	128000 A	64000 A	0.00 A	79660573 kW	0 kW	41982 kvar	0 kvar	184966573 kVA
NOVEMBER	2019	21376 A	21376 A	21376 A	266.00 A	0 kW	-9629 kW	0 kvar	0 kvar	9629 kVA
DECEMBER	2019	128000 A	128128 A	127360 A	0.00 A	289517076 kW	0 kW	105083805 kvar	0 kvar	301135414 kVA

Table 29 - Maximum registered values of the last 31 days and 12 months

12 months Measurement	Max	Min	Description	31 days	12 months
I_{L1}, I_{L2}, I_{L3}	X		Phase current (fundamental frequency value)		
I_{01}, I_{02}	X		Earth fault overcurrent		
S	X		Apparent power	X	X
P	X	X	Active power	X	X
Q	X	X	Reactive power	X	X

The timebase can be a value from one cycle to one minute. Also a demand value can be used as the timebase and its value can be set between 10 and 60 minutes. The demand value menu is located under the **Measurements** view.

Table 30 - Parameters of the day and month registers

Parameter	Value	Description	Set ¹⁷⁾
Timebase		Parameter to select the type of the registered values	Set
	20 ms	Collect min & max of one cycle values ¹⁸⁾	

Parameter	Value	Description	Set ¹⁷⁾
	200 ms	Collect min & max of 200 ms average values	
	1 s	Collect min & max of 1 s average values	
	1 min	Collect min & max of 1 minute average values	
	demand	Collect min & max of demand values (4.6 Demand values)	
ResetDays		Reset the 31 day registers	Set
ResetMon		Reset the 12 month registers	Set

¹⁷⁾ Set = An editable parameter (password needed)

¹⁸⁾ This is the fundamental frequency RMS value of one cycle updated every 20 ms.

4.9 Memory management of measurements

Table 31 - Memory management of measured and recorded values

Measurement	Online	Non-volatile ¹⁹⁾	Non-volatile ²⁰⁾
RMS phase current	x		
RMS earth fault overcurrent	x		
RMS line-to-line voltage	x		
RMS phase-to-neutral voltage	x		
RMS active power	x		
RMS reactive power	x		
RMS apparent power	x		
Frequency	x		
Fundamental frequency current values	x		
Fundamental frequency voltage values	x		
Fundamental frequency active, reactive and apparent power values	x		

Measurement	Online	Non-volatile¹⁹⁾	Non-volatile²⁰⁾
Fundamental frequency active power values	x		
Fundamental frequency reactive power values	x		
Power factor	x		
Active energy		x	
Reactive energy		x	
Energy transmitted with pulse outputs		x	
Demand values: phase currents		x	
Active power demand		x	
Reactive power demand		x	
Apparent power demand		x	
Power factor demand		x	
Min. and max. demand values: phase currents		x	
Min. and max. demand values: RMS phase currents		x	
Min. and max. demand values: active, reactive, apparent power and power factor		x	
Max. demand values over the last 31 days and 12 months: active, reactive, apparent power			x
Min. demand values over the last 31 days and 12 months: active, reactive power			x
Max. and min. values: currents			x
Max. and min. values: voltages			x
Max. and min. values: frequency			x
Max. and min. values: active, reactive, apparent power and power factor			x
Harmonic values of phase current and THD		x	
Harmonic values of voltage and THD		x	
Voltage sags and swells		x	

Measurement	Online	Non-volatile ¹⁹⁾	Non-volatile ²⁰⁾
Engine running counter		x	
Events		x	x
Disturbance record		x	x
Protection stage fault values and events		x	


¹⁹⁾ Capacitor-backed-up for 5-10 days

²⁰⁾ RAM

4.10 Power and current direction


Figure 15 shows the concept of three-phase current direction and sign of $\cos\phi$ and power factor PF (the absolute value is equal to $\cos\phi$, but the sign is 'IND' for inductive i.e. lagging current and 'CAP' for capacitive i.e. leading current). Figure 16 shows the same concepts on a PQ power plane.

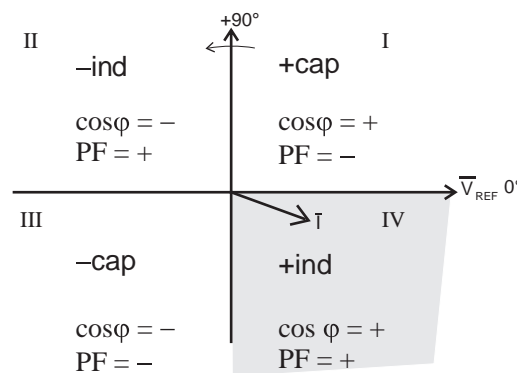Figure 15 - Quadrants of voltage/current phasor plane



I:	Forward capacitive power, current is leading
II:	Reverse inductive power, current is leading
III:	Reverse capacitive power, current is lagging
IV:	Forward inductive power, current is lagging

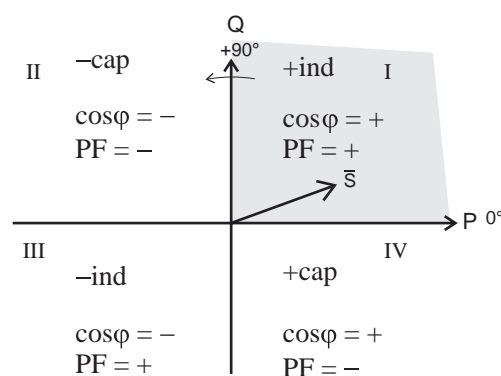Figure 16 - Quadrants of power plane



I:	Forward inductive power, current is lagging
II:	Reverse capacitive power, current is lagging
III:	Reverse inductive power, current is leading
IV:	Forward capacitive power, current is leading

Table 32 - Power quadrants

Power quadrant	Current related to voltage	Power direction	cosφ	Power factor PF
+ inductive	Lagging	Forward	+	+
+ capacitive	Leading	Forward	+	-
- inductive	Leading	Reverse	-	+
- capacitive	Lagging	Reverse	-	-

4.11 Symmetrical components

In a three-phase system, the voltage or current phasors may be divided into symmetrical components.

- Positive sequence 1
- Negative sequence 2
- Zero sequence 0

Symmetrical components are calculated according to the following equations:

$$\begin{bmatrix} \underline{S}_0 \\ \underline{S}_1 \\ \underline{S}_2 \end{bmatrix} = \frac{1}{3} \begin{bmatrix} 1 & 1 & 1 \\ 1 & \underline{a} & \underline{a}^2 \\ 1 & \underline{a}^2 & \underline{a} \end{bmatrix} \begin{bmatrix} \underline{S}_A \\ \underline{S}_B \\ \underline{S}_C \end{bmatrix}$$

\underline{S}_0 = zero sequence component

\underline{S}_1 = positive sequence component

\underline{S}_2 = negative sequence component

$$\underline{a} = 1 \angle 120^\circ = -\frac{1}{2} + j \frac{\sqrt{3}}{2}$$

, a phase rotating constant

\underline{S}_A = phasor of phase L1 (phase current or voltage)

\underline{S}_B = phasor of phase L2

\underline{S}_C = phasor of phase L3

Example: two phase injection with adjustable phase angle

$U_N = 100 \text{ V}$

Voltage measurement mode is "3LN".

Injection:

$$U_A = U_{L1} = 100/\sqrt{3} \text{ V } \angle 0^\circ = 57.7 \text{ V } \angle 0^\circ$$

$$U_B = U_{L2} = 100/\sqrt{3} \text{ V } \angle -120^\circ = 57.7 \text{ V } \angle -120^\circ$$

$$U_C = U_{L3} = 0 \text{ V}$$

$$\begin{aligned} \begin{bmatrix} \underline{U}_0 \\ \underline{U}_1 \\ \underline{U}_2 \end{bmatrix} &= \frac{1}{3} \begin{bmatrix} 1 & 1 & 1 \\ 1 & \underline{a} & \underline{a}^2 \\ 1 & \underline{a}^2 & \underline{a} \end{bmatrix} \begin{bmatrix} \frac{100}{\sqrt{3}} \angle 0^\circ \\ \frac{100}{\sqrt{3}} \angle -120^\circ \\ 0 \end{bmatrix} = \frac{1}{3\sqrt{3}} \begin{bmatrix} 100\angle 0^\circ + 100\angle -120^\circ \\ 100\angle 0^\circ + 100\angle 0^\circ \\ 100\angle 0^\circ + 100\angle +120^\circ \end{bmatrix} \\ &= \frac{1}{3\sqrt{3}} \begin{bmatrix} 100\angle -60^\circ \\ 200\angle 0^\circ \\ 100\angle 60^\circ \end{bmatrix} = \begin{bmatrix} 19.2\angle -60^\circ \\ 38.5\angle 0^\circ \\ 19.2\angle +60^\circ \end{bmatrix} \end{aligned}$$

$$U_0 = 19.2 \%$$


$$U_1 = 38.5 \%$$

$$U_2 = 19.2 \%$$

$$U_2/U_1 = 50 \%$$

Figure 17 shows a graphical solution. The input values have been scaled with $\sqrt{3}/100$ to make the calculation easier.

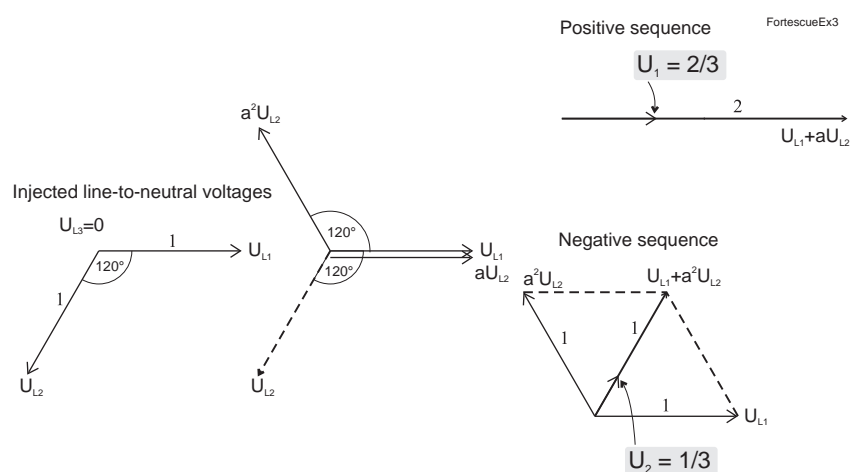Figure 17 - Example of symmetrical component calculation using line-to-neutral voltages.



Unscaling the geometric results gives

$$U_1 = 100/\sqrt{3} \times 2/3 = 38.5 \%$$

$$U_2 = 100/\sqrt{3} \times 1/3 = 19.2 \%$$

$$U_2/U_1 = 1/3:2/3 = 50 \%$$

5 Control functions

5.1 Digital outputs

The digital outputs are also called controlling outputs, signaling outputs and self-supervision outputs. Trip contacts can be controlled by using the relay output matrix or logic functions. Also forced control is possible. To use forced control, you must enable it in the **Device/Test > Relays** setting view.

Any internal signal can be connected to the digital outputs in the **Matrix > Arc matrix - output** setting views.

The **Output matrix** and **Relays** setting views represent the state (de-energized / energized) of the digital output's coil. For example, a bright green vertical line in the **Output matrix** and a logical "1" in the **Relays** view represent the energized state of the coil. The same principle applies for both NO and NC type digital outputs. The actual position (open / closed) of the digital outputs' contacts in coil's de-energized and energized state depends on the type (NO / NC) of the digital outputs. De-energized state of the coil corresponds to the normal state of the contacts. A digital output can be configured as latched or non-latched. [5.5 Releasing latches](#) describes releasing latches procedure.

The difference between trip contacts and signal contacts is the DC breaking capacity. The contacts are **single pole single throw (SPST)** normal open (NO) type, except signal relay A1 which has a changeover contact **single pole double throw (SPDT)**.

In addition to this, the relay has so called heavy duty outputs available in the power supply modules C and D. For more details, see [Table 167](#).

Programming matrix

1. Connected (single bullet)
2. Connected and latched (single bullet rounded with another circle)
3. Not connected (line crossing is empty)

Trip contacts can be connected to protection stages or other similar purpose in the **Output matrix** setting view.

Figure 18 - Output matrix view


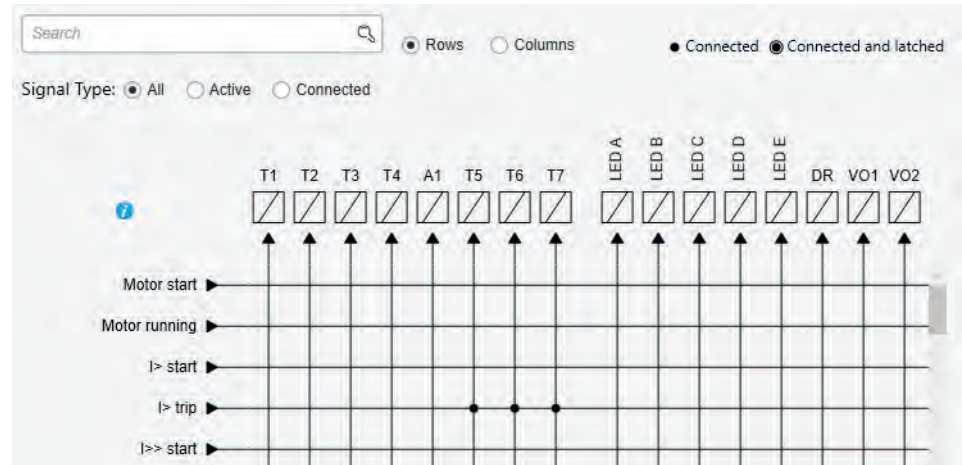


Figure 19 - Trip contacts assigned directly to outputs of logical operators

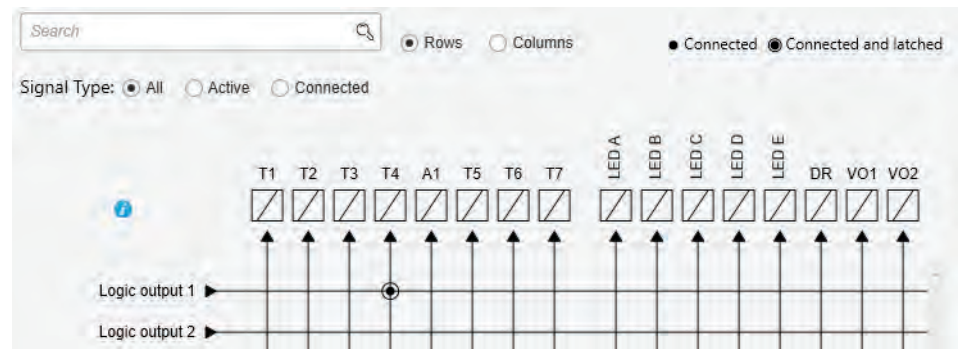

NOTE: Logic outputs are assigned automatically in the output matrix as well when logic is built.

Trip contact status can be viewed and forced to operate in the **Relays** setting view. Logical "0" means that the output is not energized and logical "1" states that the output is set active.

Figure 20 - **Relays** view

The screenshot shows a configuration window titled "Relays". It contains the following elements:

- Trip relay 1: 0
- Trip relay 2: 0
- Trip relay 3: 0
- Trip relay 4: 0
- Trip relay 5: 0
- Trip relay 6: 0
- Trip relay 7: 0
- Signal relay 1: 0
- Service status output: 0
- Force flag:

Enable NO / NC outputs in the **Polarity** setting view for the signals shown.

Figure 21 - **Polarity** view

The screenshot shows a configuration window titled "POLARITY". It contains the following elements:


- Trip relay 1: NO
- Trip relay 9: NO
- Trip relay 10: NO
- Trip relay 11: NO
- Trip relay 12: NO
- Signal relay 1: NO

Default numbering of DI / DO

Every option card and slot has default numbering. Below is an example of model P3x30 CGGII-AAEAA-BA showing the default numbering of digital outputs.

You can see the default digital output numbering and change the numbering of the following option cards in the **Inputs/Outputs > Relay config** setting view: slot 2, 3, 4, 5: G, I.

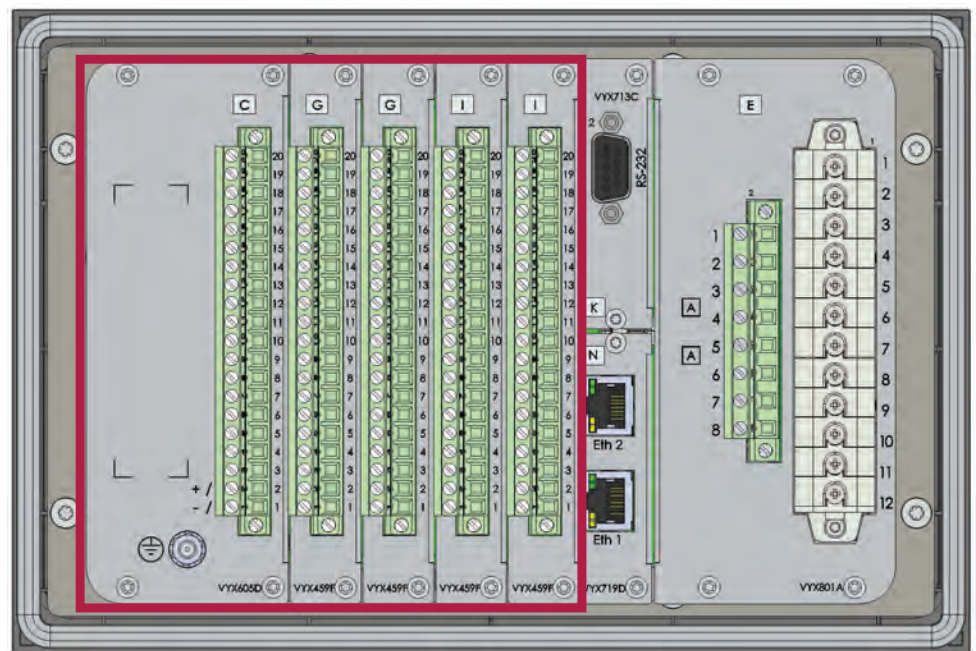Figure 22 - Default numbering of digital outputs for model P3x30-CGGII-AAEAA-BA



C: T1, T9–12, A1, SF I: –
 G: T13-16 I: –
 G: T17-20

Power supply card outputs are not visible in the **Relay config** setting view.

Figure 23 - **Relay config** setting view

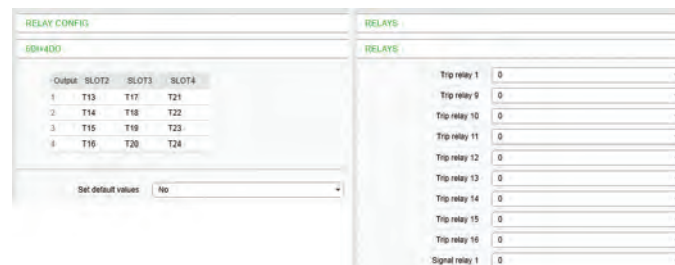


Table 33 - Parameters of digital outputs

Parameter	Value	Unit	Description	Note
T1 – Tx the available parameter list depends on the number and type of the I/O cards.	0 1		Status of trip controlling output	F ²¹⁾
A1	0 1		Status of alarm signalling output	F

Parameter	Value	Unit	Description	Note
SF	0 1		Status of the SF relay In Easergy Pro, it is called "Service status output"	F
Force	On Off		Force flag for digital output forcing for test purposes	Set ²²⁾
Names for output relays (editable with Easergy Pro only)				
Description	String of max. 32 characters		Names for DO on Easergy Pro screens. Default is "Trip relay n", n=1 – x or "Signal relay n", n=1	Set

²¹⁾ F = Editable when force flag is on

²²⁾ Set = An editable parameter (password needed).

5.2 Digital inputs

Digital inputs are available for control purposes. The number of available inputs depends on the number and type of option cards.


The polarity normal open (NO) / normal closed (NC) and a delay can be configured according to the application by using the front panel or Easergy Pro.

Digital inputs can be used in many operations. The status of the input can be checked in the **Output matrix** and **Digital inputs** setting views. The digital inputs make it possible to change group, block/enable/disable functions, to program logics, indicate object status, etc.

The digital inputs require an external control voltage (ac or dc). The digital inputs are activated after the activation voltage is exceeded. Deactivation follows when the voltage drops below threshold limit. The activation voltage level of digital inputs can be selected in the order code when such option cards are equipped.


Digital inputs can be connected, latched or unlatched to trip contacts or other similar purpose in **Output matrix** setting view.

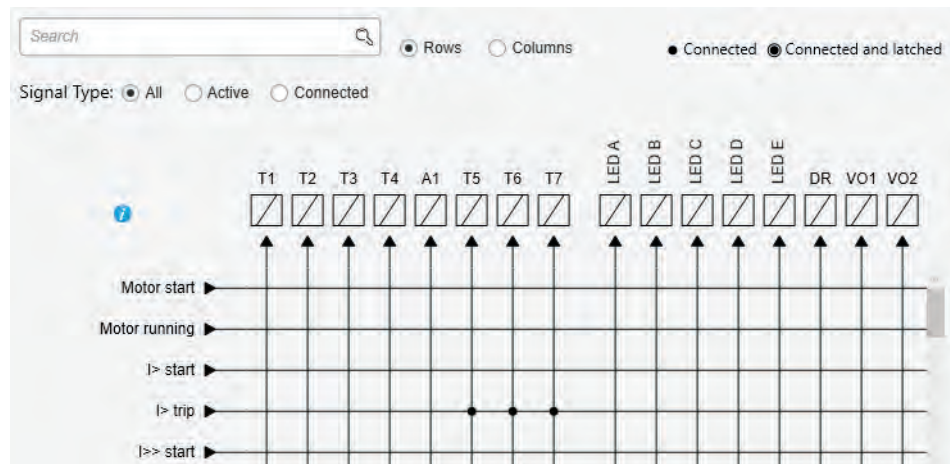Figure 24 - Output matrix view



Digital inputs can be assigned, latched or unlatched directly to inputs/outputs of logical operators.

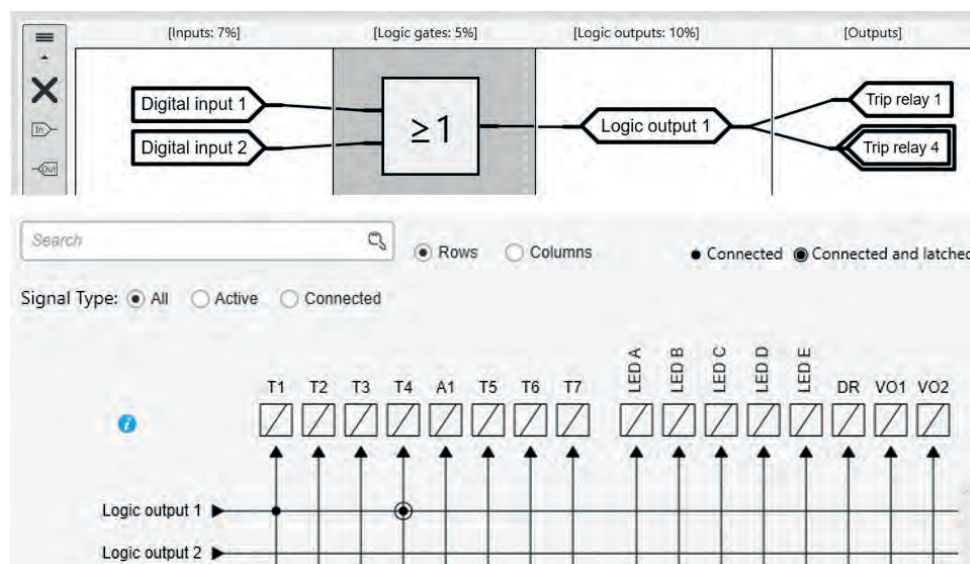Figure 25 - Digital inputs assigned to outputs of logical operators



Digital inputs can be viewed, named and changed between NO/NC in the **Digital inputs** and **Names for digital inputs** setting views.

Figure 26 - Names for digital inputs view


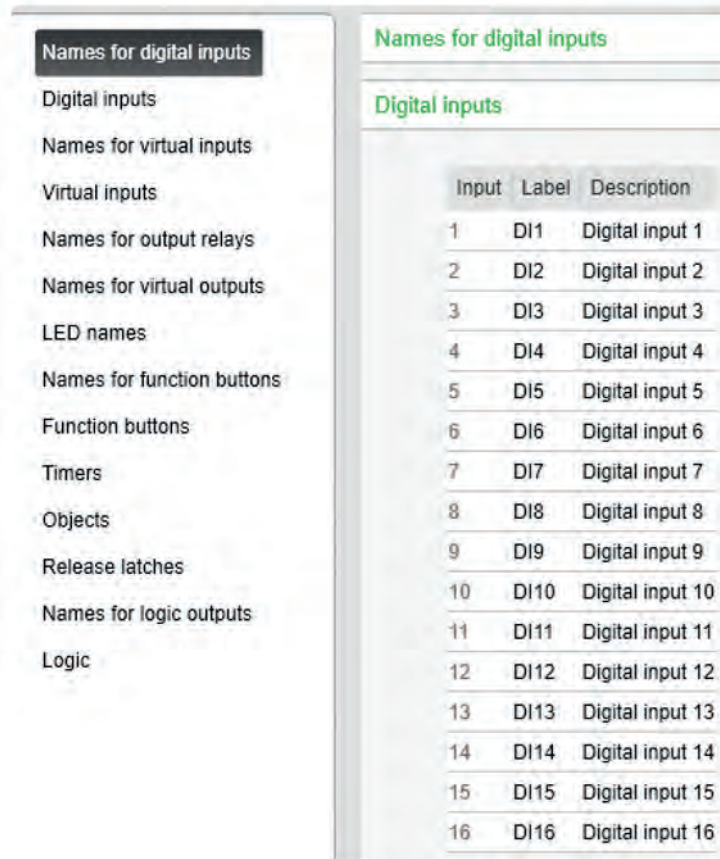


Figure 27 - Digital inputs view

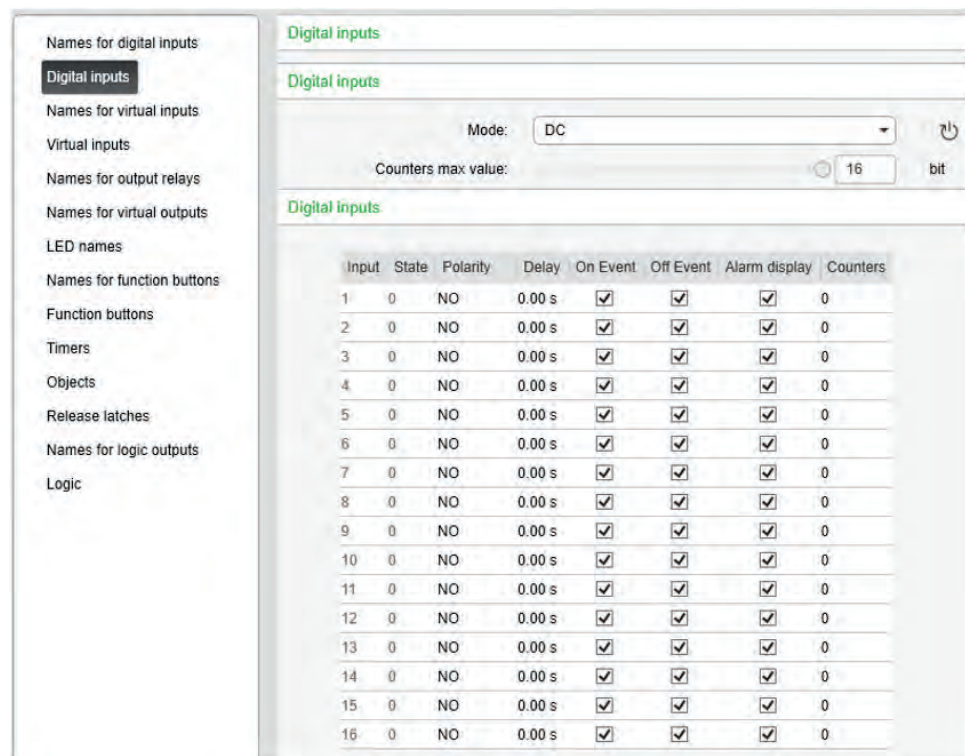

If inputs are energized by using ac voltage, “mode” has to be selected as ac.

All essential information on digital inputs can be found in the same location in the **Digital inputs** setting view. DI on/off events and alarm display (pop-up) can be enabled and disabled in **Digital inputs** setting view. Individual operation counters are located in the same view as well.

Label and description texts can be edited with Easergy Pro according to the demand. Labels are the short parameter names used on the local panel and descriptions are the longer names used by Easergy Pro.

The digital input activation thresholds are hardware-selectable.

Digital input delay determines the activation and de-activation delay for the input. *Figure 28* shows how the digital input behaves when the delay is set to 1 second.

Figure 28 - Digital input's behavior when delay is set to 1 second

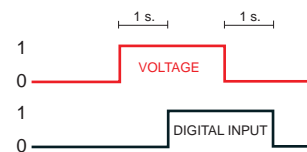


Table 34 - Parameters of digital inputs

Parameter	Value	Unit	Description	Note
Mode	dc, ac		Used voltage of digital inputs	Set ²³⁾
Input	D11 – D1x		Number of digital input. The available parameter list depends on the number and type of the I/O cards.	
Slot	2 – 6		Card slot number where option card is installed.	
State	0, 1		Status of digital input 1 – digital input x.	
Polarity	NO NC		For normal open contacts (NO). Active edge is 0 > 1 For normal closed contacts (NC) Active edge is 1 > 0	Set

Parameter	Value	Unit	Description	Note
Delay	0.00 – 60.00	s	Definite delay for both on and off transitions	Set
On event	On		Active edge event enabled	Set
	Off		Active edge event disabled	
Off event	On		Inactive edge event enabled	Set
	Off		Inactive edge event disabled	
Alarm display	no		No pop-up display	Set
	yes		Alarm pop-up display is activated at active DI edge	
Counters	0 – 65535		Cumulative active edge counter	(Set)
NAMES for DIGITAL INPUTS (editable with Easergy Pro only)				
Label	String of max. 10 characters		Short name for DIs on the local display Default is "DI1 – DIx". x is the maximum number of the digital input.	Set
Description	String of max. 32 characters		Long name for DIs. Default is "Digital input 1 – Digital input x". x is the maximum number of the digital input.	Set


²³⁾ Set = An editable parameter (password needed).

Every option card and slot has default numbering. After making any changes to the numbering, read the settings from the relay after the relay has rebooted.

Below is an example of model P3x30-CGGII-AAEAA-BAAAA showing default numbering of DI.

You can see the default digital input numbering and change the numbering of the following option cards in the **Inputs/Outputs > Digital inputs** setting view: slot 2, 3, 4, 5: G, I, I.

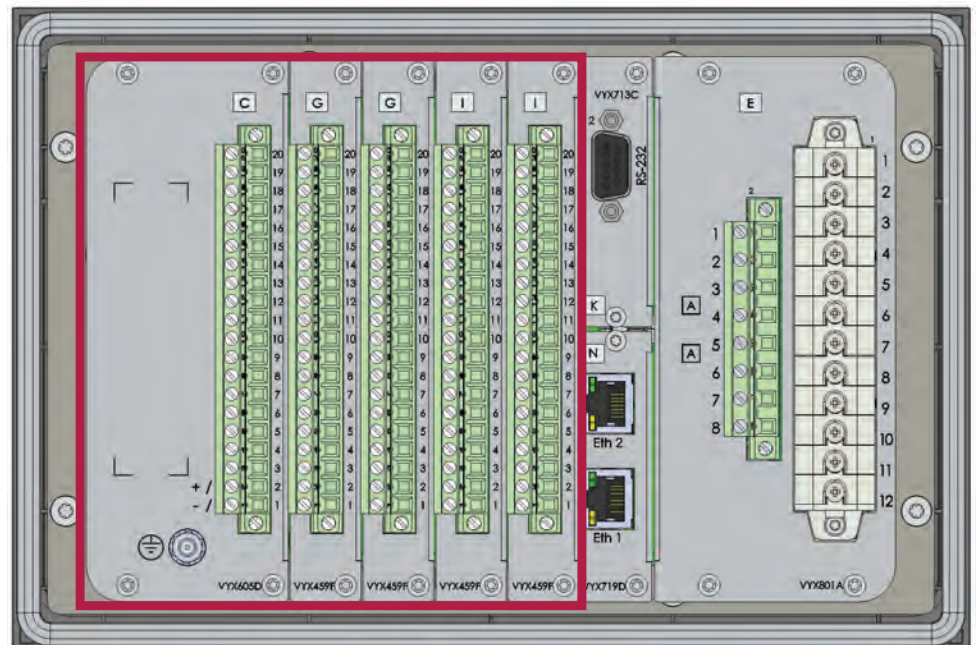Figure 29 - Default numbering of digital inputs for model P3x30-CGGII-AAEAA-BA



C: -


G: DI1–6

G: DI7–12

I: DI13–22

I: DI23–32

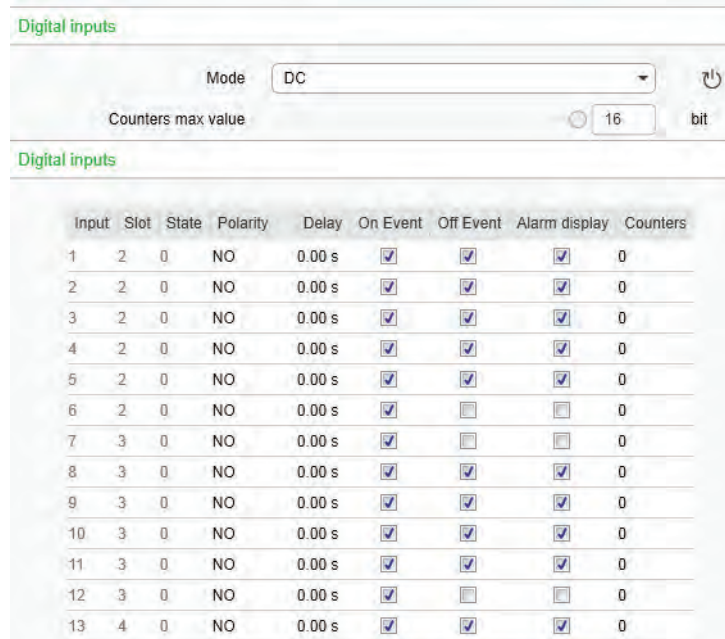Figure 30 - Digital inputs setting view



5.3 Virtual inputs and outputs

There are virtual inputs and virtual outputs that can in many places be used like their hardware equivalents except that they are located in the memory of the relay. The virtual inputs act like normal digital inputs. The status of the virtual input can be changed via the local display, communication bus and Easergy Pro. For example setting groups can be changed using virtual inputs.

Virtual inputs can be used in many operations. The status of the input can be checked in the **Matrix > Output matrix** and **Control > Virtual inputs** setting views. The status is also visible on local mimic display, if so selected. Virtual inputs can be selected to be operated with the function buttons F1 and F2, the local mimic or simply by using the virtual input menu. Virtual inputs have similar functions as digital inputs: they enable changing groups, block/enable/disable functions, to program logics and other similar to digital inputs.


The activation and reset delay of the input is approximately 5 ms.

Table 35 - Virtual inputs and outputs

Number of inputs	20
Number of outputs	20
Activation time / Reset time	< 5 ms


Virtual inputs and outputs can be used for many purposes in the **Output matrix** setting view.

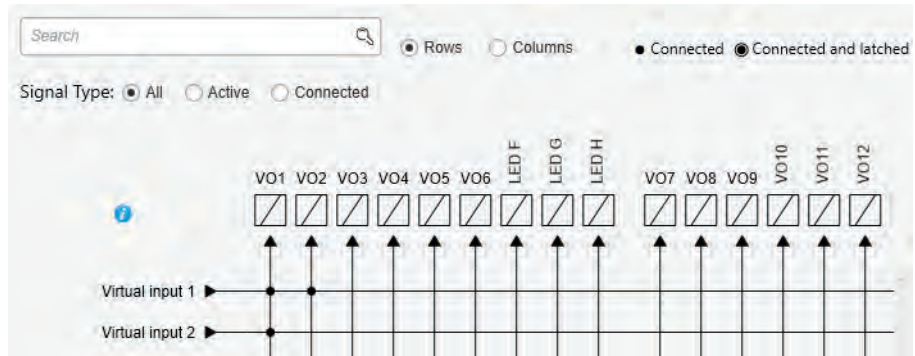Figure 31 - Virtual inputs and outputs in **Output matrix** view



Virtual inputs and outputs can be assigned, latched or unlatched, directly to inputs/outputs of logical operators.

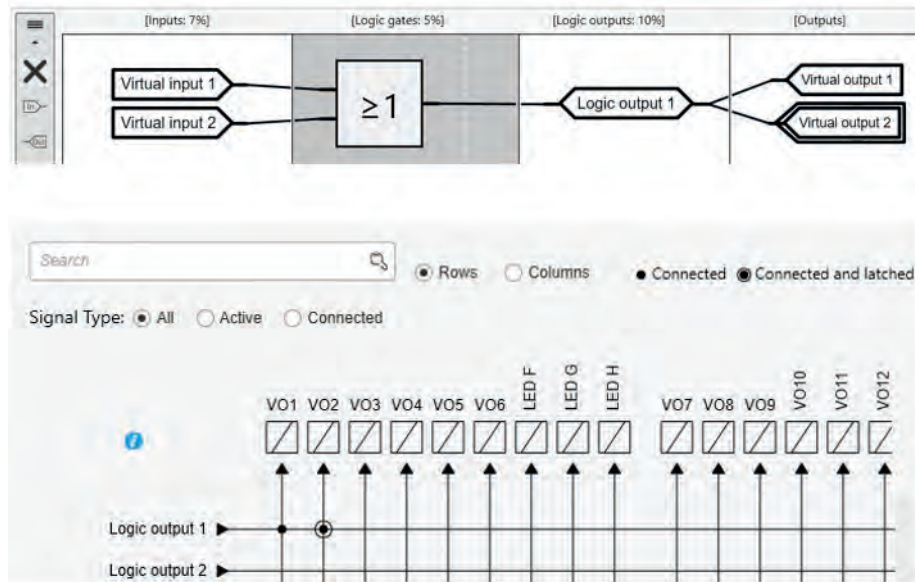Figure 32 - Virtual inputs and outputs assigned to outputs of logical operators



Virtual inputs

The virtual inputs can be viewed, named and controlled in the **Control > Virtual inputs** setting view.

Figure 33 - Virtual inputs view

Virtual inputs

Virtual input 1:	0
Virtual input 2:	0
Virtual input 3:	0
Virtual input 4:	0
Virtual input 5:	0
Virtual input 6:	0
Virtual input 7:	0
Virtual input 8:	0
Virtual input 9:	0
Virtual input 10:	0
Virtual input 11:	0
Virtual input 12:	0
Virtual input 13:	0
Virtual input 14:	0
Virtual input 15:	0
Virtual input 16:	0
Virtual input 17:	0
Virtual input 18:	0
Virtual input 19:	0
Virtual input 20:	0
Event enabling:	<input checked="" type="checkbox"/>
Check L/R selection:	<input type="checkbox"/>

Figure 34 - Names for virtual inputs view

Names for virtual inputs		
Virtual inputs		
Input	Label	Description
1	VI1	Virtual input 1
2	VI2	Virtual input 2
3	VI3	Virtual input 3
4	VI4	Virtual input 4
5	VI5	Virtual input 5
6	VI6	Virtual input 6
7	VI7	Virtual input 7
8	VI8	Virtual input 8
9	VI9	Virtual input 9
10	VI10	Virtual input 10
11	VI11	Virtual input 11
12	VI12	Virtual input 12
13	VI13	Virtual input 13
14	VI14	Virtual input 14
15	VI15	Virtual input 15
16	VI16	Virtual input 16
17	VI17	Virtual input 17
18	VI18	Virtual input 18
19	VI19	Virtual input 19
20	VI20	Virtual input 20

Table 36 - Parameters of virtual inputs


Parameter	Value	Unit	Description	Set ²⁴⁾
VI1-VI20	0 1		Status of virtual input	
Events	On Off		Event enabling	Set
Names for virtual inputs (editable with Easergy Pro only)				
Label	String of max. 10 characters		Short name for VIs on the local display Default is "VI n", n = 1–20	Set
Description	String of max. 32 characters		Long name for VIs. Default is "Virtual input n", n = 1–20	Set

²⁴⁾ Set = An editable parameter (password needed).

Virtual outputs

In Easergy Pro, the **Virtual outputs** setting view is located under **Control**.

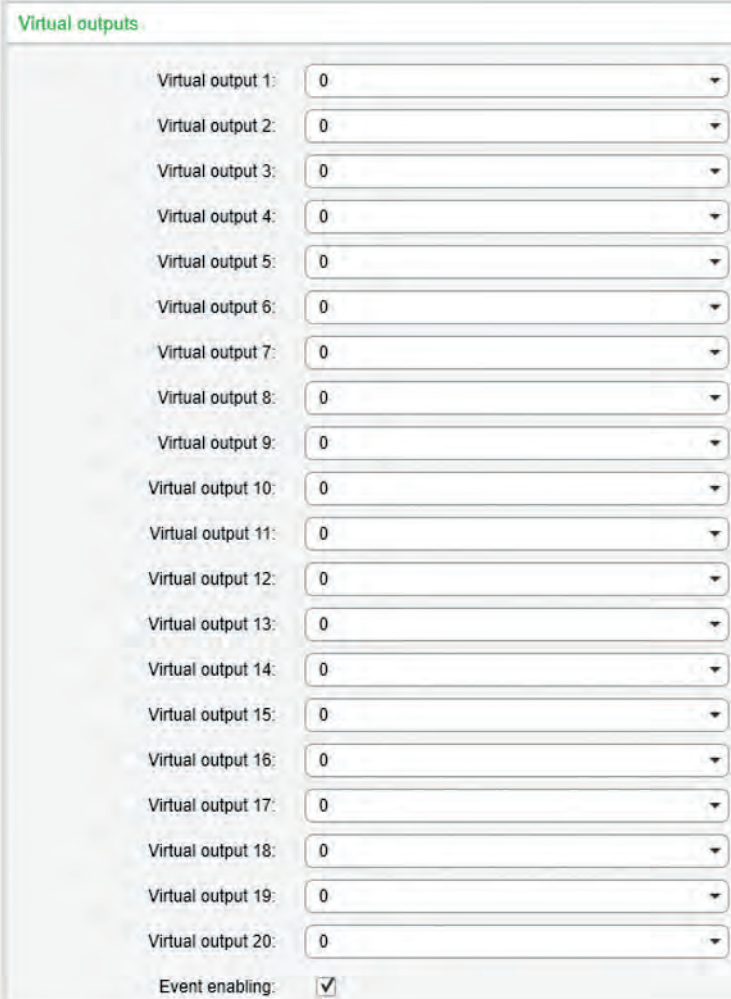Figure 35 - **Virtual outputs** view



Virtual output	Value
Virtual output 1:	0
Virtual output 2:	0
Virtual output 3:	0
Virtual output 4:	0
Virtual output 5:	0
Virtual output 6:	0
Virtual output 7:	0
Virtual output 8:	0
Virtual output 9:	0
Virtual output 10:	0
Virtual output 11:	0
Virtual output 12:	0
Virtual output 13:	0
Virtual output 14:	0
Virtual output 15:	0
Virtual output 16:	0
Virtual output 17:	0
Virtual output 18:	0
Virtual output 19:	0
Virtual output 20:	0
Event enabling:	<input checked="" type="checkbox"/>

Figure 36 - Names for virtual outputs view

Input	Label	Description
1	VO1	Virtual output 1
2	VO2	Virtual output 2
3	VO3	Virtual output 3
4	VO4	Virtual output 4
5	VO5	Virtual output 5
6	VO6	Virtual output 6
7	VO7	Virtual output 7
8	VO8	Virtual output 8
9	VO9	Virtual output 9
10	VO10	Virtual output 10
11	VO11	Virtual output 11
12	VO12	Virtual output 12
13	VO13	Virtual output 13
14	VO14	Virtual output 14
15	VO15	Virtual output 15
16	VO16	Virtual output 16
17	VO17	Virtual output 17
18	VO18	Virtual output 18
19	VO19	Virtual output 19
20	VO20	Virtual output 20

Table 37 - Parameters of virtual outputs

Parameter	Value	Unit	Description	Set ²⁵⁾
VO1-VO20	0 1		Status of virtual output	F
Events	On Off		Event enabling	Set
NAMES for VIRTUAL OUTPUTS (editable with Easergy Pro only)				
Label	String of max. 10 characters		Short name for VOs on the local display Default is "VOn", n=1-20	Set
Description	String of max. 32 characters		Long name for VOs. Default is "Virtual output n", n=1-20	Set


²⁵⁾ Set = An editable parameter (password needed). F = Editable when force flag is on.

5.4 Matrix

The relay has several matrices that are used for configuring the relay:

- **Output matrix** used to link protection stage signals, digital inputs, virtual inputs, function buttons, object control, logic output, relay's internal alarms, GOOSE signals and release latch signals to outputs, disturbance recorder trig input and virtual outputs
- **Block matrix** used to block protection stages
- **LED matrix** used to control LEDs on the front panel
- **Object block matrix** used to inhibit object control
- **Arc matrix** used to control current and light signals to arc stages and arc stages to the high-speed outputs

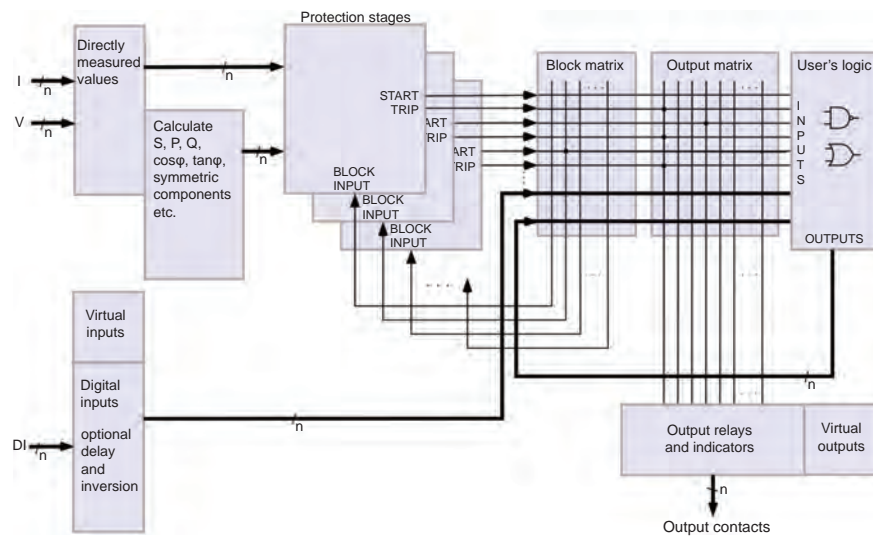Figure 37 - Blocking matrix and output matrix



NOTE: Blocking matrix can not be used to block the arc flash detection stages.

5.4.1 Output matrix

With the output matrix, the output signals of the various protection stages, digital inputs, logic outputs and other internal signals can be connected to the digital outputs, virtual outputs and so on.

NOTE: For configuring the high-speed operations of the arc flash detection, use the **Arc matrix – output** view. The configuration also becomes visible in the output matrix. The output matrix shows the status of the FPGA-driven outputs whereas the other electro-mechanical outputs can also be configured in the output matrix.

There are general-purpose LED indicators – "A", "B", "C" to "N" – available for customer-specific indications on the front panel. Their usage is define in a separate LED matrix.


There are two LED indicators specified for keys F1 and F2. The triggering of the disturbance recorder (DR) and virtual outputs are configurable in the output matrix.

A digital output or indicator LED can be configured as latched or non-latched. A non-latched relay follows the controlling signal. A latched relay remains activated although the controlling signal releases.

There is a common "release all latches" signal to release all the latched relays. This release signal resets all the latched digital outputs and indicators. The reset signal can be given via a digital input, via front panel or remotely through communication. For instructions on how to release latches, see [5.5 Releasing latches](#).

Trip and alarm relays together with virtual outputs can be assigned in the output matrix. Also automatic triggering of disturbance recorder is done in the output matrix.

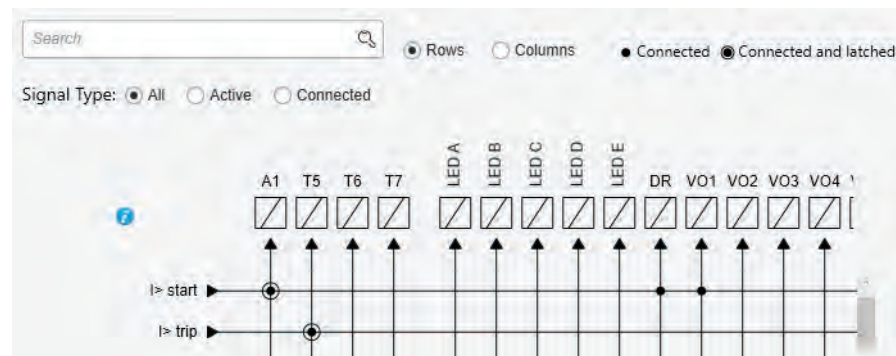Figure 38 - **Output matrix** example view




5.4.2 Blocking matrix

By means of a blocking matrix, the operation of any protection stage (except the arc flash detection stages) can be blocked. The blocking signal can originate from the digital inputs or it can be a start or trip signal from a protection stage or an output signal from the user's programmable logic. In [Figure 39](#), an active blocking is indicated with a black dot (●) in the crossing point of a blocking signal and the signal to be blocked.

All protection stages (except Arc stages) can be blocked in the block matrix

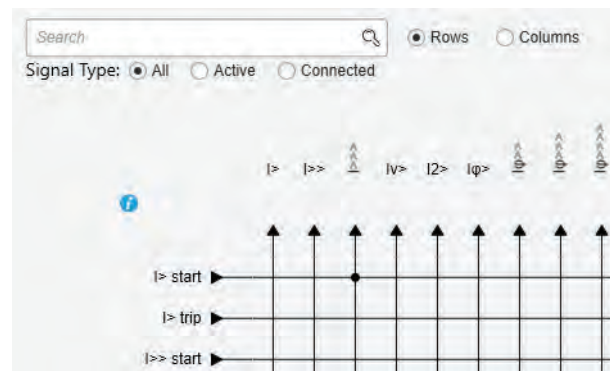Figure 39 - **Block matrix** view



The Blocked status becomes visible only when the stage is about to activate.

Figure 40 - DI input blocking connection

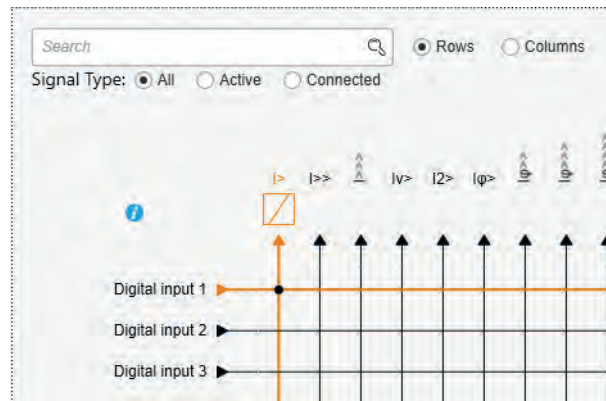


Figure 41 - Result for the I> stage when the DI is active and the stage exceeds its current start value



NOTICE
<p>RISK OF NUISANCE TRIPPING</p> <ul style="list-style-type: none"> The blocking matrix is dynamically controlled by selecting and deselecting protection stages. Activate the protection stages first, then store the settings in a relay. After that, refresh the blocking matrix before configuring it. <p>Failure to follow these instructions can result in unwanted shutdown of the electrical installation.</p>

5.4.3 LED matrix

The LED matrix is used to link digital inputs, virtual inputs, function buttons, protection stage outputs, object statuses, logic outputs, alarm signals and GOOSE signals to various LEDs located on the front panel.


In the **LED configuration** setting view, each LED has three checkboxes with which the behavior of the LED is configured.

Figure 42 - LED configuration

LED configuration				
LED	Description	Latch	Blink	Store
LED A (green)	LED A (green)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
LED A (red)	LED A (red)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
LED B (green)	LED B (green)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
LED B (red)	LED B (red)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED C (green)	LED C (green)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED C (red)	LED C (red)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED D (green)	LED D (green)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

LEDs are assigned to control signals in the **LED matrix** setting view. It is not possible to control LEDs directly with logics.

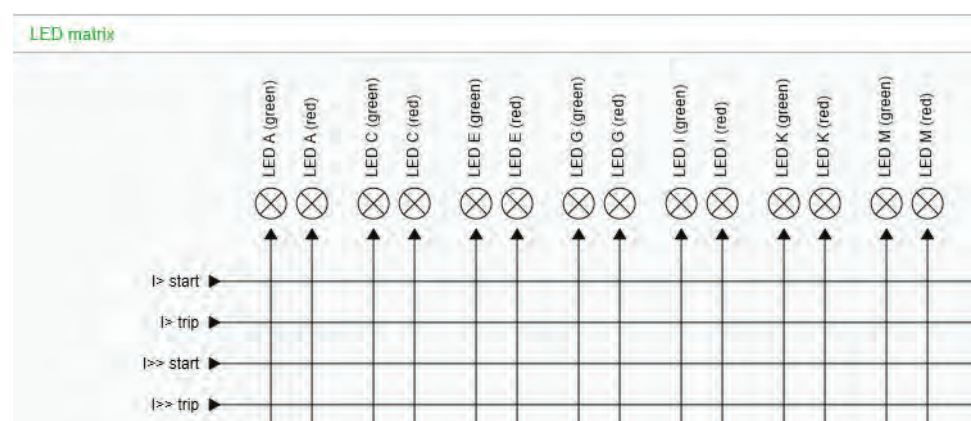Figure 43 - LED matrix



Normal setting

With no checkboxes selected, the assigned LED is active when the control signal is active. After deactivation, the LED turns off. LED activation and deactivation delay when controlled is approximately 10 ms.

Latch setting

A latched LED activates when the control signal activates but remains active when the control signal deactivates. Latched LEDs are released using the procedure described in [5.5 Releasing latches](#).

Blink setting

When the **Blink** setting is selected, the LED blinks when it is active.

Store setting

In the **LED configuration** setting view, you can configure the latched states of LEDs to be stored after a restart. In [Figure 42](#), storing has been configured for LED A (green).

NOTE: To use the **Store** setting, **Latch** must also be selected.

Inputs for LEDs

Inputs for LEDs can be assigned in the LED matrix. All 14 LEDs can be assigned as green or red. The connection can be normal, latched or blink-latched. In addition to protection stages, there are lots of functions that can be assigned to output LEDs. See [Table 38](#).

Table 38 - Inputs for LEDs A-N

Input	LED mapping	Latch	Description	Note
Protection, Arc and program-mable stages	LED A–N green or red	Normal/ Latched/ BlinkLatch	Different type of protection stages can be assigned to LEDs	Set
Digital/Virtual inputs and function buttons	LED A–N green or red	Normal/ Latched/ BlinkLatch	All different type of inputs can be assigned to LEDs	Set
Object open/close, object final trip and object failure information	LED A–N green or red	Normal/ Latched/ BlinkLatch	Information related to objects and object control	Set
Local control enabled	LED A–N green or red	Normal/ Latched/ BlinkLatch	While remote/local state is selected as local the “local control enabled” is active	Set
Logic output 1–20	LED A–N green or red	Normal/ Latched/ BlinkLatch	All logic outputs can be assigned to LEDs at the LED matrix	Set
Manual control indication	LED A–N green or red	Normal/ Latched/ BlinkLatch	When the user has controlled the objectives	Set
COM 1–5 comm.	LED A–N green or red	Normal/ Latched/ BlinkLatch	When the communication port 1 - 5 is active	Set
Setting error, seldiag alarm, pwd open and setting change	LED A–N green or red	Normal/ Latched/ BlinkLatch	Self diagnostic signal	Set
GOOSE NI1–64	LED A–N green or red	Normal/ Latched/ BlinkLatch	IEC 61850 goose communication signal	Set
GOOSEERR1–16	LED A–N green or red	Normal/ Latched/ BlinkLatch	IEC 61850 goose communication signal	Set

5.4.4 Object block matrix

The object block matrix is used to link digital inputs, virtual inputs, function buttons, protection stage outputs, logic outputs, alarm signals and GOOSE signals to inhibit the control of objects, that is, circuit breakers, isolators and earthing switches.

Typical signals to inhibit controlling of the objects like circuit breaker are:

- protection stage activation
- statuses of other objects
- interlocking made with logic
- GOOSE signals

These and other signals are linked to objects in the object block matrix.

There are also event-type signals that do not block objects as they are on only for a short time, for example "Object1" open and "Object1 close" signals.

5.5 Releasing latches

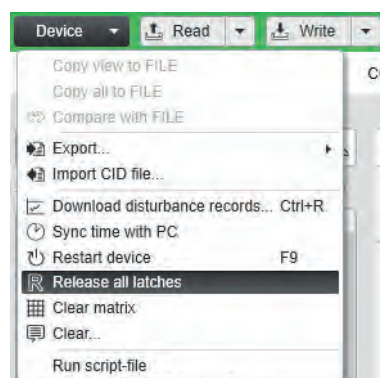
You can release latches using:

- Easergy Pro
- buttons and local panel display
- F1 or F2 buttons

5.5.1 Releasing latches using Easergy Pro

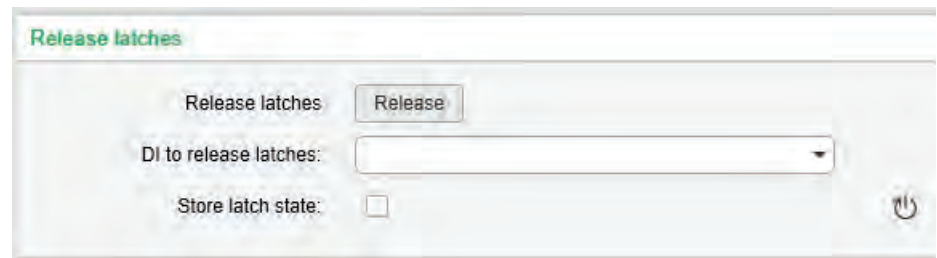
1. Connect Easergy Pro to the device.
2. From the Easergy Pro toolbar, select **Device > Release all latches**.

Figure 44 - Releasing all latches






Alternatively, go to **Control > Release latches**, and click the **Release** button.

Figure 45 - Release latches



5.5.2 Releasing latches using buttons and local panel display

Prerequisite: You have entered the correct password

1. Press .
 2. Press .
 3. Select **Release**, and press .
- All latches are released.

5.5.3 Releasing latches using F1 or F2 buttons

You can use the function buttons F1 or F2 to release all latches after configuring this function in Easergy Pro. You can make the configuration either under **Control > Release Latches** or under **Control > Function buttons**.

- To configure F1 to release latches under **Control > Release latches**:
 - a. In Easergy Pro, go to **Control > Release latches**.
 - b. Under **Release latches**, select F1 from the **DI to release latches** drop-down menu.
 - c. Set 1 s delay for **Latch release signal pulse**.

Figure 46 - **Release latches** view

After this, pressing the F1 button on the relay's front panel releases all latches.

- To configure F1 to release latches under **Control >Function buttons**:

- Under **Function buttons**, for F1, select PrgFncls from the **Selected control** drop down menu.
- Set 1 s delay for **F1 pulse length**.
- Under **Programmable functions for F1**, select "On" from the **Release all latches** drop-down menu.

Figure 47 - **Function buttons** view

Button	State	Selected control	Selected Object
F1	0	PrgFncls	-
F2	0	F2	-

F1 pulse length (0=infinite) s

F2 pulse length (0=infinite) s

Programmable functions for F1

Release all latches:

Clear I/O units' registers:

Install arc sensors & I/O units:

After this, pressing the F1 button on the relay's front panel releases all latches.

NOTE: The latch release signal can be activated only if the latched output is active.

5.6 Controllable objects

The relay allows controlling eight objects, that is, circuit breakers, disconnectors and earthing switches by the "select before operate" or "direct control" principle.

Controlling is possible in the following ways:

- through the object control buttons
- through front panel and display using single-line diagram
- through the function keys
- through digital input
- through remote communication
- through Easergy Pro setting tool
- through Web server
- through Smart APP

The connection of an object to specific controlling outputs is done via an output matrix (object 1–8 open output, object 1–8 close output). There is also an output signal "Object failed" that is activated if the control of an object is not completed.

Object states

Each object has the following states:

Setting	Value	Description
Object state	Undefined (00)	Actual state of the object
	Open	
	Close	
	Undefined (11)	

Basic settings for objects

Each object has the following settings:

Setting	Value	Description
DI for 'obj open'	None, any digital input, virtual input or virtual output	Open information
DI for 'obj close'		Close information
DI for 'obj ready'		Ready information
Max ctrl pulse length	0.02–600 s	Pulse length for open and close commands. Control pulse stops once object changes its state
Completion timeout	0.02–600 s	Timeout of ready indication
Object control	Open/Close	Direct object control

If changing the states takes longer than the time defined by the “Max ctrl pulse length” setting, the object is inoperative and the “Object failure” matrix signal is set. Also, an undefined event is generated. “Completion timeout” is only used for the ready indication. If “DI for 'obj ready'” is not set, the completion timeout has no meaning.

Output signals of objects

Each object has two control signals in matrix:

Output signal	Description
Object x Open	Open control signal for the object
Object x Close	Close control signal for the object

These signals send control pulse when an object is controlled by digital input, remote bus, auto-reclose etc.

5.6.1 Object control with digital inputs

Objects can be controlled with digital inputs, virtual inputs or virtual outputs. There are four settings for each object:

Setting	Active
DI for remote open / close control	In remote state
DI for local open / close control	In local state

If the relay is in local control state, the remote control inputs are ignored and vice versa. An object is controlled when a rising edge is detected from the selected input. The length of digital input pulse should be at least 60 ms.

5.6.2 Local or remote selection

In local mode, digital outputs can be controlled via the front panel but they cannot be controlled via a remote serial communication interface.

In remote mode, digital outputs cannot be controlled via a front panel but they can be controlled via a remote serial communication interface.

The local or remote mode can be selected by using the front panel or via one selectable digital input. The digital input is normally used to change a whole station to local or remote mode. You can select the L/R digital input in the **Control > Objects** setting view in Easergy Pro.

Table 39 - Local or remote selection



Action	Control through Easergy Pro or SmartApp		Control through communication protocol	
	Local	Remote	Local	Remote
Local/Remote switch status	Local	Remote	Local	Remote
CB control	Yes	No	No	Yes
Setting or configuration changes	Yes	Yes	Yes	Yes
Communication configuration	Yes	Yes	Yes	Yes
Virtual inputs ²⁶⁾	Yes	No	No	Yes

²⁶⁾ Virtual inputs have a general parameter "Check L/R selection" for disabling the L/R check.

5.6.3 Object control with I and O buttons

The relay also has dedicated control buttons for objects. (I) stands for object closing and (O) controls object open command internally. Control buttons are configured in the **Control > Objects** setting view.

Table 40 - Parameters of function keys



Parameter	Value	Unit	Description	Set
Object for control buttons	Obj1–Obj8		Button  closes selected object if password is enabled Button  opens selected object if password is enabled	Set
Mode for control buttons	Selective Direct		Control operation needs confirmation (select-execute) Control operation is done without confirmation	

5.6.4 Object control with F1 and F2

Objects can be controlled with the function buttons F1 and F2.

By default, the F1 and F2 buttons are configured to control F1 and F2 variables that can further be assigned to control objects.

Table 41 - Parameters of F1 and F2

Parameter	Value	State	Pulse length ²⁷⁾	Description
F1	F1, V ₁ -V ₂₀ , ObjCtrl	0.1	0600 s	 controls F1, V ₁ -V ₂₀ or ObjCtrl parameters.
F2	F2, V ₁ -V ₂₀ , ObjCtrl	0.1	0-600 s	 controls F2, V ₁ -V ₂₀ and ObjCtrl parameters.

²⁷⁾ Pulse length applies to values F1 and F2 only

You can configure the button functions in the **Control > Function buttons** setting view in Easergy Pro.

Figure 48 - **Function buttons** view

Button	State	Selected control	Selected Object
F1	0	ObjCtrl	-
F2	0	F2	-

If **ObjCtrl** has been selected under **Selected control**, the selected object is shown under **Selected object**. Otherwise, this column is empty.

When selecting **ObjCtrl**, link the function button to the appropriate object in the **Control > Objects** setting view.

Figure 49 - **Ctrl object 2** view

Demand values

Demand time: min

Clear min & max:

DI to clear min & max:

IL1 DEMAND

demand: A

Maximum of IL1: A
2020-06-03 11:43

Minimum of IL1: A
2020-06-03 11:43

5.7 Logic functions

The relay supports customer-defined programmable logic for boolean signals. User-configurable logic can be used to create something that is not provided by the relay as a default. You can see and modify the logic in the **Control > Logic** setting view in the Easergy Pro setting tool.

Table 42 - Available logic functions and their memory use


Logic functions	No. of gates reserved	Max. no. of input gates	Max. no. of logic outputs
AND	1	32 (An input gate can include any number of inputs.)	20
OR	1		
XOR	1		
AND+OR	2		

Logic functions	No. of gates reserved	Max. no. of input gates	Max. no. of logic outputs
CT (Count+Reset)	2		
INVAND	2		
INVOR	2		
OR+AND	2		
RS (Reset+Set)	2		
RS_D (Set D+Load +Reset)	4		

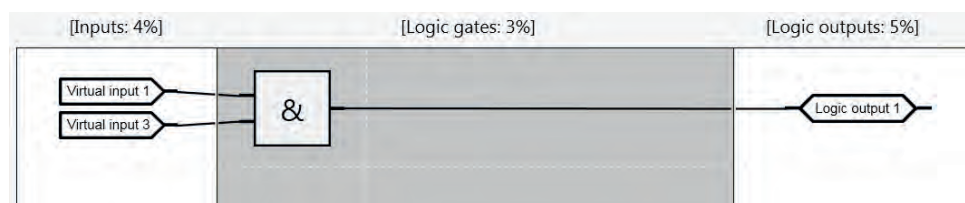The consumed memory is dynamically shown on the configuration view in percentage. The first value indicates the memory consumption of inputs, the second value the memory consumption of gates and the third value the memory consumption of outputs.






The logic is operational as long the memory consumption of the inputs, gates or outputs remains individually below or equal to 100%.




Figure 50 - Logic and memory consumption









Truth tables



Table 43 - Truth table

Gate	Symbol	Truth table																		
AND		<table border="1"> <thead> <tr> <th>In</th> <th>Out</th> </tr> </thead> <tbody> <tr> <td>A</td> <td>Y</td> </tr> <tr> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> </tr> </tbody> </table>	In	Out	A	Y	0	0	1	1										
	In	Out																		
	A	Y																		
	0	0																		
1	1																			
	<table border="1"> <thead> <tr> <th>In</th> <th>Out</th> </tr> </thead> <tbody> <tr> <td>A</td> <td>Y</td> </tr> <tr> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> </tr> </tbody> </table>	In	Out	A	Y	0	1	1	0											
In	Out																			
A	Y																			
0	1																			
1	0																			
	<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>1</td> <td>0</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> </tr> <tr> <td>0</td> <td>0</td> <td>0</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	1	0	1	0	0	1	1	1	0	0	0	
In		Out																		
A	B	Y																		
0	1	0																		
1	0	0																		
1	1	1																		
0	0	0																		
	<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>1</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>1</td> <td>0</td> </tr> <tr> <td>0</td> <td>0</td> <td>1</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	1	1	1	0	1	1	1	0	0	0	1	
In		Out																		
A	B	Y																		
0	1	1																		
1	0	1																		
1	1	0																		
0	0	1																		
AND+OR		<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>0</td> <td>1</td> <td>1</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	0	0	1	1	1	1	0	1	0	1	1
In		Out																		
A	B	Y																		
0	0	0																		
1	1	1																		
1	0	1																		
0	1	1																		

Gate	Symbol	Truth table																												
CT (Count+Reset)		<table border="1"> <thead> <tr> <th colspan="2">In</th> <th colspan="2">Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>Count</td> <td>Reset</td> <td>Setting</td> <td>New</td> </tr> <tr> <td>1</td> <td></td> <td>3</td> <td>0</td> </tr> <tr> <td>1</td> <td></td> <td>3</td> <td>0</td> </tr> <tr> <td>1</td> <td></td> <td>3</td> <td>1</td> </tr> <tr> <td></td> <td>1</td> <td>3</td> <td>0</td> </tr> </tbody> </table>	In		Out		A	B	Y	Y	Count	Reset	Setting	New	1		3	0	1		3	0	1		3	1		1	3	0
In		Out																												
A	B	Y	Y																											
Count	Reset	Setting	New																											
1		3	0																											
1		3	0																											
1		3	1																											
	1	3	0																											
INVAND		<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>1</td> <td>0</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	0	0	1	0	1	1	1	0	0	1	0										
In		Out																												
A	B	Y																												
0	0	0																												
1	0	1																												
1	1	0																												
0	1	0																												
INVOR		<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	0	1	1	1	1	1	0	1	0	1	0										
In		Out																												
A	B	Y																												
0	0	1																												
1	1	1																												
1	0	1																												
0	1	0																												

Gate	Symbol	Truth table																											
OR		<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>0</td> <td>1</td> <td>1</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	0	0	1	1	1	1	0	1	0	1	1									
	In		Out																										
	A	B	Y																										
	0	0	0																										
1	1	1																											
1	0	1																											
0	1	1																											
	<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>1</td> <td>0</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	0	1	1	1	0	1	0	0	0	1	0										
In		Out																											
A	B	Y																											
0	0	1																											
1	1	0																											
1	0	0																											
0	1	0																											
	<table border="1"> <thead> <tr> <th colspan="3">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>C</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> <td>1</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> <td>1</td> </tr> </tbody> </table>	In			Out	A	B	C	Y	0	0	0	1	1	1	0	1	1	0	0	1	0	1	0	1	1	1	1	1
In			Out																										
A	B	C	Y																										
0	0	0	1																										
1	1	0	1																										
1	0	0	1																										
0	1	0	1																										
1	1	1	1																										
	<table border="1"> <thead> <tr> <th colspan="3">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>C</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>0</td> <td>0</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> <td>0</td> </tr> </tbody> </table>	In			Out	A	B	C	Y	0	0	0	1	1	0	0	0	1	1	0	0	0	1	0	0	1	1	1	0
In			Out																										
A	B	C	Y																										
0	0	0	1																										
1	0	0	0																										
1	1	0	0																										
0	1	0	0																										
1	1	1	0																										

Gate	Symbol	Truth table																					
OR+AND		<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> </tr> </tbody> </table>	In		Out	A	B	Y	0	0	0	1	1	1	1	0	0	0	1	0			
In		Out																					
A	B	Y																					
0	0	0																					
1	1	1																					
1	0	0																					
0	1	0																					
RS (Reset+Set)		<table border="1"> <thead> <tr> <th colspan="2">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>Y</th> </tr> <tr> <th>Set</th> <th>Reset</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>0</td> <td>0</td> <td>1²⁸⁾</td> </tr> <tr> <td>0</td> <td>0</td> <td>0²⁹⁾</td> </tr> <tr> <td>X</td> <td>1</td> <td>0³⁰⁾</td> </tr> </tbody> </table> <p>²⁸⁾ Output = 1 (latched), if previous state was 1, 0, 1. ²⁹⁾ Output = 0, if previous state was X, 1, 0. ³⁰⁾ Output = 0, if RESET = 1 regardless of state of SET.</p>	In		Out	A	B	Y	Set	Reset	Y	1	0	1	0	0	1 ²⁸⁾	0	0	0 ²⁹⁾	X	1	0 ³⁰⁾
In		Out																					
A	B	Y																					
Set	Reset	Y																					
1	0	1																					
0	0	1 ²⁸⁾																					
0	0	0 ²⁹⁾																					
X	1	0 ³⁰⁾																					

Gate	Symbol	Truth table																																								
RS_D (Set+D+Load+Reset)		<table border="1"> <thead> <tr> <th>A</th> <th>B</th> <th>C</th> <th>D</th> <th>Y</th> </tr> <tr> <th>Set</th> <th>D</th> <th>Load</th> <th>Reset</th> <th>State</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0³¹⁾</td> </tr> <tr> <td>1</td> <td>X</td> <td>X</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>X</td> <td>X</td> <td>1</td> <td>0</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>0</td> <td>1</td> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>0</td> <td>1</td> <td>1</td> <td>1</td> <td>0³²⁾</td> </tr> </tbody> </table> <p>³¹⁾ Initial state ³²⁾ The state remains 1 until Reset is set active</p> <p>X = Any state</p> <p>If Set or D + Load are high, the state returns to high if Reset returns to low.</p>	A	B	C	D	Y	Set	D	Load	Reset	State	0	0	0	0	0 ³¹⁾	1	X	X	0	1	1	X	X	1	0	0	1	0	0	0	0	1	1	0	1	0	1	1	1	0 ³²⁾
A	B	C	D	Y																																						
Set	D	Load	Reset	State																																						
0	0	0	0	0 ³¹⁾																																						
1	X	X	0	1																																						
1	X	X	1	0																																						
0	1	0	0	0																																						
0	1	1	0	1																																						
0	1	1	1	0 ³²⁾																																						
XOR		<table border="1"> <thead> <tr> <th colspan="3">In</th> <th>Out</th> </tr> <tr> <th>A</th> <th>B</th> <th>C</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>0</td> <td>0</td> <td>1</td> <td>1</td> </tr> <tr> <td>0</td> <td>1</td> <td>0</td> <td>1</td> </tr> <tr> <td>0</td> <td>1</td> <td>1</td> <td>0</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> <td>1</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> <td>1</td> <td>1</td> </tr> </tbody> </table>	In			Out	A	B	C	Y	0	0	0	0	0	0	1	1	0	1	0	1	0	1	1	0	1	0	0	1	1	0	1	0	1	1	0	0	1	1	1	1
In			Out																																							
A	B	C	Y																																							
0	0	0	0																																							
0	0	1	1																																							
0	1	0	1																																							
0	1	1	0																																							
1	0	0	1																																							
1	0	1	0																																							
1	1	0	0																																							
1	1	1	1																																							

²⁸⁾ Output = 1 (latched), if previous state was 1, 0, 1.

²⁹⁾ Output = 0, if previous state was X, 1, 0.

³⁰⁾ Output = 0, if RESET = 1 regardless of state of SET.

³¹⁾ Initial state

³²⁾ The state remains 1 until Reset is set active

Logic element properties

After you have selected the required logic gate in Easergy Pro, you can change the function of the gate in the **Element properties** window by clicking the gate.

Figure 51 - Logic element properties

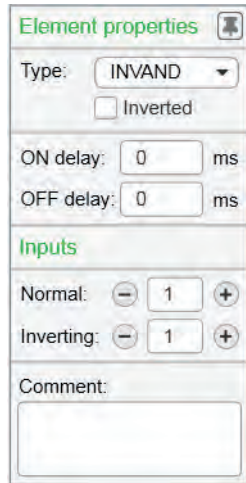


Table 44 - Settings available for the logical gates depending on the selected element

Property	Description
Element properties	
Type	Change the logical function of the gate
Inverted	Inverts the output state of the logical gate
ON delay	Time delay to activate the output after logical conditions are met
OFF delay	Time delay for how long the gate remain active even the logical condition is reset
Count	Setting for counter (CT gate only)
Reverse	Use to reverse AND and OR gates (AND +OR gate only)
Inputs	
Normal - / +	Use to increase or decrease number of inputs
Inverting - / +	Use to increase or decrease number of inverted inputs. This setting is visible for INVAND and INVOR gates only
Count	Use to increase or decrease number of count inputs (CT gate only)
Reset	Use to increase or decrease number of count inputs (CT gate only)
AND	Use to increase or decrease number of inputs for AND gates (AND+OR gate only)

Property	Description
OR	Use to increase or decrease number of inputs for OR gates (AND+OR gate only)
Set	Use to increase or decrease number of Set inputs (RS_D gate only)
D	Use to increase or decrease number of Data inputs (RS_D gate only)
Load	Use to increase or decrease number of Load inputs (RS_D gate only)
Reset	Use to increase or decrease number of Reset inputs (RS_D gate only)

5.8 Local panel

Easergy P3M30 and P3M32 have one LCD matrix display.

All the main menus are located on the left side of the display. To get to a submenu, move up and down the main menus.

Figure 52 - Local panel's main menu

```

I> STATUS          50/51 ▶
FL | Status         -
Evt| TripTime      0.0s
DR | SCntr         0
Run| TCntr         0
TIM| SetGrp        1
DI  | SGrp1DI      -
DO  | SGrp2DI      -
Arc | SGrp3DI      -
Prot| SGrp4DI      DI1
I> | Force         Off
I>>
I>>>
Io>
Io>>

```


5.8.1 Mimic view

The mimic view is set as the local panel's main view as default. You can modify the mimic according to the application or disable it, if it is not needed, via the Easergy Pro setting tool.

You can modify the mimic in the **General > Mimic** setting view in Easergy Pro and disable the mimic view in the **General > Local panel conf** setting view.

NOTE: The mimic itself or the local mimic settings cannot be modified via the local panel.

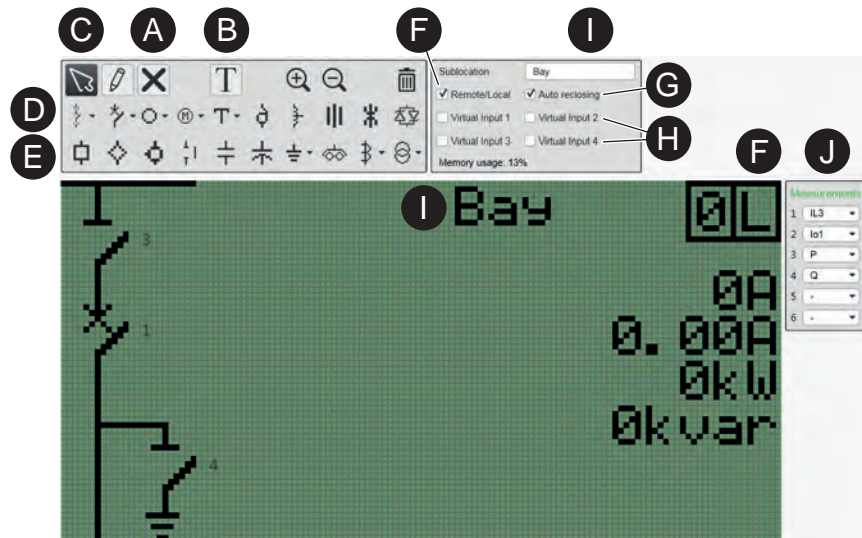Figure 53 - Mimic view



A. To clear an object or drawing, first point an empty square (A) with the mouse. Then point the object item with the mouse. The color of the object item turns red. To clear the whole mimic, click on the empty area.

B. Text tool

C. To move an existing drawing or object, point it with the mouse. The color turns green. Hold down the left mouse button and move the object.

D. Different type of configurable objects. The object's number corresponds to the number in **Control > Objects**.

E. Some predefined drawings.

F. The remote/local selection defines whether certain actions are granted or not. In remote state, it is not possible to locally enable or disable auto-reclosing or to control objects. The remote/local state can be changed in **Control > Objects**.

G. Creates auto-reclosing on/off selection to mimic.

H. Creates virtual input activation on the local mimic view.

I. Describes the relay's location. Text comes from the relay info menu.

J. Up to six configurable measurements.

Table 45 - Mimic functionality

Parameter	Value	Unit	Description	Set
Sublocation	Text field		Up to 9 characters. Fixed location.	Set
Object 1–8	1–8		Double-click on top of the object to change the control number between 1 and 8. Number 1 corresponds to object 1 in General > Objects .	Set

Parameter	Value	Unit	Description	Set
Remote/Local mode	L R		Local / Remote control. R stands for remote. Remote local state can be changed in General > Objects as well. Position can be changed.	Set
Auto reclosing	0 1		Possible to enable/disable auto-reclosure locally in local mode (L) or remotely in remote mode (R). Position can be changed.	Set

Parameter	Value	Unit	Description	Set
Measurement display 1–6	I_{L1} – I_{L3} I_0 U_{12} , U_{23} , U_{31} , U_{L1} , U_{L2} , U_{L3} , U_0 f , P , Q , S , P.F. CosPhi $E+$, $Eq+$, $E-$, $Eq-$ ARStart, ARFaill, ARShot1–5 IFLT Starts, Trips I_0 Calc I_{L1} – $I_{L3}da$, IL Pda , Qda , Sda T fSYNC, USYNC d_{IL1} – d_{IL3} dI_A – I_C VAI1–VAI5 ExtAI1–6 ³³⁾		Up to 6 freely selectable measurements.	Set
Virtual input 1–4	0 1		Change the status of virtual inputs while the password is enabled. Position can be changed.	Set

³³⁾ Requires serial communication interface and External IO protocol activated.

Set = Settable.

NOTE: The measurement view's data selection depends on the voltage measurement mode selected in the **General > Scaling** setting view.

5.8.2 Local panel configuration

You can modify the local panel configuration in the **General > Local panel conf** setting view in Easergy Pro.

Figure 54 - Local panel configuration view

Local panel conf

MEASUREMENT DISPLAYS

DISPLAY 1	DISPLAY 2	DISPLAY 3	DISPLAY 4	DISPLAY 5
IL1	U12	UL1	f	P.F.
IL2	U23	UL2	P	CosPhi
IL3	U31	UL3	Q	-
Io1	Uo	Uo	S	-

Display contrast: 110

Display backlight ctrl:

Backlight off timeout: 60.0 min

Panel reset timeout: 15.0 min

Default screen:

Enable alarm screen:

Display event time not in sync:

Auto LED release:

Auto LED release enable time: 1.5 s

Object for control buttons:

Mode for control buttons:

Fault value scaling:

Date style:

Local MIMIC:

Event buffer size: 200

Scroll order:

Clear Events

Table 46 - Local panel configuration parameters

Parameter	Value	Unit	Description	Set ³⁴⁾
Display 1–5	I_{L1-3} I_0 $U_{12}, U_{23}, U_{31},$ $U_{L1}, U_{L2}, U_{L3},$ U_0 $f, P, Q, S, P.F.$ CosPhi $E+, Eq+, E-, Eq-$ ARStart, ARFaill, ARShot1–5 IFLT Starts, Trips I_0 Calc IL IL1–3da IL1–3 max IL1–3 min IL1–3daMax Pda, Qda, Sda T fSYNC, USYNC VAI1–5 ExtAI1–6 ³⁵⁾ SetGrp		20 (5 x 4) freely configurable measurement values can be selected	Set ³⁶⁾
Display contrast	50–210		Contrast can be changed in the relay menu as well.	Set
Display backlight control	DI1–44, Arc1–3, ArcF, BI, VI1–4, LED1–14, VO1–6		Activates the backlight of the display.	Set ³⁶⁾

Parameter	Value	Unit	Description	Set ³⁴⁾
Panel reset timeout	Value range: 0.0–2000.0 Default value: 15.0	min	Configurable delay for the front panel to return to the default screen when the front panel is not used. When this value is zero (0.0), this timeout never occurs.	Set
Default screen	Value range: Mimic, Meas disp1, Meas disp2, Meas disp3, Meas disp4, Meas disp5 Default value: Mimic		Default screen for the front panel. If the selected screen would result in a blank screen, the title screen is used as the default screen.	Set
Backlight off timeout	0.0–2000.0	min	Configurable delay for backlight to turn off when the relay is not used. Default value is 60 minutes. When value is zero (0.0) backlight stays on all the time.	Set
Enable alarm screen	Selected Unselected		Pop-up text box for events. pop-up events can be checked individually by pressing enter, but holding the button for 2 seconds checks all the events at once.	Set

Parameter	Value	Unit	Description	Set ³⁴⁾
AR info for mimic display	Selected Unselected		Auto reclosure status visible on top of the local mimic view.	Set
Sync I info for mimic display	Selected Unselected		Synchro-check status visible on top of the local mimic view. Operates together with auto-reclosure.	Set
Auto LED release	Selected Unselected		Enables automatic LED release functionality.	Set
Auto LED release enable time	0.1–600	s	Default 1.5 s. When new LEDs are latched, the previous active latches are released automatically if the set time has passed.	Set
Fault value scaling	PU, Pri		Fault values per unit or primary scaled.	Set

Parameter	Value	Unit	Description	Set ³⁴⁾
Local MIMIC	Selected Unselected		Enable or disable the local mimic (enabled as default). When selected, the mimic is the local panel's default main view. When unselected, the measurement view is the default main view.	Set
Event buffer size	50–2000		Event buffer size. Default setting is 200 events.	Set ³⁷⁾

³⁴⁾ Set = Settable

³⁵⁾ Requires serial communication interface and External IO protocol activated.

³⁶⁾ Inputs vary according to the relay type.

³⁷⁾ The existing events are lost if the event buffer size is changed.

6 Protection functions

Each protection stage can independently be enabled or disabled according to the requirements of the intended application.

NOTE: When protection stages are enabled or disabled, the disturbance recordings are deleted from the relay's memory. Therefore, before activating or deactivating stages, store the recordings in your PC.

6.1 Current transformer requirements for overcurrent elements

The current transformer (CT) must be sized according to the rules described here for definite time (DT) or inverse definite minimum time (IDMT) to avoid saturation during steady-state short-circuit currents where accuracy is required.


The nominal CT primary and secondary must be selected according to the maximum short-circuit secondary current to meet the thermal withstand specified in [Table 167](#).

The condition to be fulfilled by the CT saturation current (I_{sat}) depends on the type of overcurrent protection operate time.

Table 47 - Condition to be fulfilled by CT saturation current

Time delay	Condition to be fulfilled
DT	$I_{sat} > 1.5 \times \text{set point } (I_s)$
IDMT	$I_{sat} > 1.5 \times \text{the curve value which is the smallest of these two values:}$ <ul style="list-style-type: none"> $I_{sc} \text{ max.}, \text{ maximum installation short-circuit current}$ $20 \times I_s \text{ (IDMT curve dynamic range)}$

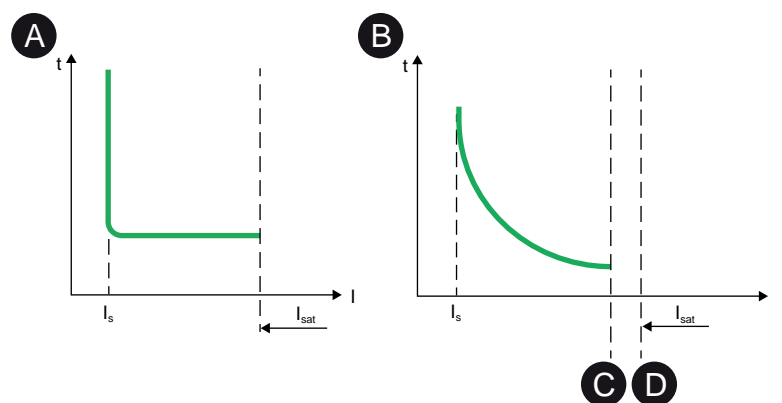Figure 55 - Overcurrent characteristics



- A. DT
- B. IDMT
- C. Minimum ($I_{sc} \text{ max.}, 20 I_s$)
- D. 1.5 minimum ($I_{sc} \text{ max.}, 20 I_s$)

The method for calculating the saturation current depends on the CT accuracy class.

6.1.1 CT requirements when settings are unknown

If no other information about the settings is available, these characteristics are suitable for most situations.

Class P accuracy class

Table 48 - CT requirements

Rated secondary current (I_{ns})	Rated burden (VA_{ct})	Accuracy class and accuracy limit factor	CT secondary resistance (R_{ct})	Wiring resistance (R_w)
1 A	2.5 VA	5P20	< 3 Ω	< 0.075 Ω
5 A	7.5 VA	5P20	< 0.2 Ω	< 0.075 Ω

Class PX accuracy class

$$Vk / (R_{ct} + R_w) > 30 \times I_{ns}$$

For 1 A: $Vk > 30 \times (R_{ct} + R_w)$; for example: $30 \times 3.9 = 117$ V

For 5 A: $Vk > 150 \times (R_{ct} + R_w)$; for example: $150 \times 0.53 = 79.5$ V

6.1.2 Principle for calculating the saturation current in class P

A class P CT is characterized by:

- I_{np} : rated primary current (in A)
- I_{ns} : rated secondary current (in A)
- accuracy class, expressed by a percentage, 5P or 10P, followed by the accuracy limit factor (ALF), whose usual values are 5, 10, 15, 20, 30
- VA_{ct} : rated burden, whose usual values are 2.5/5/7.5/10/15/30 VA
- R_{ct} : maximum resistance of the secondary winding (in Ω)

The installation is characterized by the load resistance R_w at the CT secondary (wiring + protection device). If the CT load complies with the rated burden, that is, $R_w \times I_{ns}^2 \leq VA_{ct}$, the saturation current is higher than $ALF \times I_{np}$.

If the resistance R_{ct} is known, it is possible to calculate the actual CT ALF which takes account of the actual CT load. The saturation current equals the actual ALF $\times I_{np}$.

Equation 3

$$Actual\ ALF = ALF \times \frac{R_{ct} \times I_{ns}^2 + VA_{ct}}{(R_{ct} + R_w) \times I_{ns}^2}$$

6.1.3 Examples of calculating the saturation current in class P

The saturation current for a CT is calculated with:

- transformation ratio: 100 A/5 A
- rated burden: 2.5 VA
- accuracy class and accuracy-limit factor: 5P20
- resistance of the secondary winding: 0.1 Ω

To have an ALF of at least 20, that is, a saturation current of $20 \times I_{np} = 2 \text{ kA}$, the load resistance R_w of the CT must be less than [Equation 4](#).

Equation 4

$$R_{w, \max} = \frac{V_{Act}}{I_{ns}^2} = \frac{2.5}{5^2} = 0.1 \Omega$$

This represents 12 m (39 ft) of wire with cross-section 2.5 mm² (AWG 14) for a resistance per unit length of approximately 8 Ω/km (2.4 mΩ/ft). For an installation with 50 m (164 ft) of wiring with section 2.5 mm² (AWG 14), $R_w = 0.4 \Omega$.

As a result, the actual ALF is as presented in [Equation 5](#).

Equation 5

$$Actual\ ALF = ALF \times \frac{R_{ct} \times I_{ns}^2 + V_{Act}}{(R_{ct} + R_w) \times I_{ns}^2} = 20 \times \frac{0.1 \times 25 + 2.5}{(0.1 + 0.4) \times 25} = 8$$

Therefore, the saturation current $I_{sat} = 8 \times I_{np} = 800 \text{ A}$.

NOTE: The impedance of an Easergy P3 protection device's current inputs (0.004 Ω) is often negligible compared to the wiring resistance.

6.1.4 Principle for calculating the saturation current in class PX

A class PX CT is characterized by:

- I_{np} : rated primary current (in A)
- I_{ns} : rated secondary current (in A)
- V_k : rated knee-point voltage (in V)
- R_{ct} : maximum resistance of the secondary winding (in Ω)

The saturation current is calculated by the load resistance R_w at the CT secondary (wiring + protection device) as shown in [Equation 6](#).

Equation 6

$$I_{sat} = \frac{V_k}{R_{ct} + R_w} \times \frac{I_{np}}{I_{ns}}$$

6.1.5 Examples of calculating the saturation current in class PX

Table 49 - Examples of calculating the saturation current in class PX

CT Transformati on ratio	V _k	R _{ct}	R _w	Saturation current
100 A/1 A	90 V	3.5 Ω	0.4 Ω	$I_{sat} = 90 / (3,5 + 0,4) / 1 \times I_{np} = 23,08 \times I_{np}$
100 A/5 A	60 V	0.13 Ω	0.4 Ω	$I_{sat} = 60 / (0,13 + 0,4) / 5 \times I_{np} = 22,6 \times I_{np}$

6.2 Current transformer requirements for generator and motor differential protection

NOTE: These current transformer (CT) requirements are applicable from firmware version FW30.204 onward.

Class 5P20 CTs are recommended.

The CT requirements are based on the following settings:

Table 50 - CT settings

Parameter	Value
dI> pickup (I _{bias} < 0.5 I _{gn})	20% of I _n
Slope1	50%
I _{bias} for start of slope 2	2 x I _n
Slope2	150%
dI> 2nd harmonics block limit	10%

CT requirements for Class 5P20 CTs

The rated burden shall be $SVA > R_{ba} \times I_{sr}^2$

R_{ba} = Actual burden = $2R_L + R_r$ (Ω)

R_L = Resistance of a single lead from protection device to current transformer (Ω)

R_r = Resistance of all protection devices sharing the current transformer (Ω)

I_{sr} = Secondary rated current (1A or 5A)

CT requirements for class PX and PY

$K = 20$

The minimum knee-point voltage is $V_k = K \times I_{sr} \times (R_{CT} + 2R_L + R_r)$.

V_k = Minimum current transformer knee-point voltage

I_{sr} = Secondary rated current (1A or 5A)

R_{CT} = Resistance of current transformer secondary winding (Ω)

R_L = Resistance of a single lead from relay to current transformer (Ω)

R_r = Resistance of all protective relays sharing the current transformer (Ω)

CT requirements for class P or PR CT (for example 5P10)

$K = 20$

The minimum rated burden is **SVA** > $((K / Kalf) \times (R_{CT} + R_{ba}) - R_{CT}) \times I_{sr}^2$

where $Kalf$ is the CT accuracy limit factor (20 for 5P20, 10 for 5P10)

R_{ba} = Actual burden = $2 R_L + R_r$ (Ω)

6.3 Maximum number of protection stages in one application

The relay limits the maximum number of enabled protection stages to about 30. The exact number depends on the central processing unit's load consumption and available memory as well as the type of the stages.

The individual protection stage and total load status can be found in the **Protection > Protection stage status** setting view in the Easergy Pro setting tool.

6.4 General features of protection stages

Setting groups

Setting groups are controlled by using digital inputs, function keys or virtual inputs, via the front panel or custom logic. When none of the assigned inputs are active, the setting group is defined by the parameter 'SetGrp no control state'. When controlled input activates, the corresponding setting group is activated as well. If the control signal of the setting group is lost, the setting "Keep last" forces the last active group into use. If multiple inputs are active at the same time, the active setting group is defined by 'SetGrp priority'. By using virtual I/O, the active setting group can be controlled using the local panel display, any communication protocol or the built-in programmable logic functions. All protection stages have four setting groups.

Figure 56 - **Setting groups** view

	Group 1	Group 2	Group 3	Group 4
Pick-up setting [A]	2000	1000	1200	2000
Pick-up setting [xIn]	2.00	1.00	1.20	2.00
Delay curve family	DT	IEC	IEC	DT
Delay type	DT	NI	NI	DT
Operation delay [s]	0.50			1.00
Inv. time coefficient k		1.000	1.000	
Inverse delay (20x) [s]	-	2.26	2.26	-
Inverse delay (4x) [s]	-	4.97	4.97	-
Inverse delay (1x) [s]	-	600.02	600.02	-

Example

Any digital input can be used to control setting groups but in this example, DI1, DI2, DI3 and DI4 are chosen to control setting groups 1 to 4. This setting is done with the parameter “Set group x DI control” where x refers to the desired setting group.

Figure 57 - DI1, DI2, DI3, DI4 configured to control Groups 1 to 4 respectively

	Group 1	Group 2	Group 3	Group 4
Pick-up setting [A]	50	500	120	120
Pick-up setting [xIn]	0.50	5.00	1.20	1.20
Delay curve family	DT	DT	IEC	IEC
Delay type	DT	DT	NI	NI
Operation delay [s]	300.00	0.30	0.30	0.30
Inv. time coefficient k	1.00	1.00	1.00	1.00

Use the 'SetGrp common change' parameter to force all protection stages to group 1, 2, 3 or 4. The control becomes active if there is no local control in the protection stage. You can activate this parameter using Easergy Pro.

“SetGrp priority” is used to give a condition to a situation where two or more digital inputs, controlling setting groups, are active at the same time. SetGrp priority could have values “1 to 4” or “4 to 1”.

Figure 58 - SetGrp priority setting in the **Valid Protection stages** view

The screenshot shows a configuration window titled "Valid protection stages". It contains four rows of settings, each with a label and a value field:

- Enabled stages: 1
- SetGrp common change: 1
- SetGrp no control state: 1
- SetGrp priority: 1 to 4

Assuming that DI2 and DI3 are active at the same time and SetGrp priority is set to “1 to 4”, setting group 2 becomes active. If SetGrp priority is reversed, that is, set to “4 to 1”, the setting group 3 becomes active.

Protection stage statuses

The status of a protection stage can be one of the followings:

- **Ok = ‘-‘**

The stage is idle and is measuring the analog quantity for the protection. No power system fault detected.

- **Blocked**

The stage is detecting a fault but blocked for some reason.

- **Start**

The stage is counting the operation delay.

- **Trip**

The stage has tripped and the fault is still on.

The blocking reason may be an active signal via the block matrix from other stages, the programmable logic or any digital input. Some stages also have built-in blocking logic. For example an under frequency stage is blocked if voltage is too low. For more details about the block matrix, see [5.4.2 Blocking matrix](#).

Protection stage counters

Each protection stage has start and trip counters that are incremented when the stage starts or trips. The start and trip counters are reset on relay reboot.

Forcing start or trip condition for testing purposes

There is a "Forcing flag" parameter which, when activated, allows forcing the status of any protection stage to be "start" or "trip" for half a second. By using this forcing feature, current or voltage injection is not necessary to check the output matrix configuration, to check the wiring from the digital outputs to the circuit breaker and also to check that communication protocols are correctly transferring event information to a SCADA system.

After testing, the forcing flag is automatically reset five minutes after the last local panel push button activity.

The force flag also enables forcing the digital outputs and the optional mA outputs.

The force flag can be found in the **Device/Test > Relays** setting view.

Figure 59 - Force flag

The screenshot shows the 'RELAYS' configuration page. It contains several dropdown menus for setting relays:

- Trip relay 1: 1
- Trip relay 2: 1
- Trip relay 3: 0
- Trip relay 4: 0
- Trip relay 5: 0
- Trip relay 6: 0
- Trip relay 7: 0
- Signal relay 1: 1
- Service status output: 0


At the bottom, the 'Force flag' is checked with a checkbox.

Start and trip signals

Every protection stage has two internal binary output signals: start and trip. The start signal is issued when a fault has been detected. The trip signal is issued after the configured operation delay unless the fault disappears before the end of the delay time.

The hysteresis, as indicated in the protection stage's characteristics data, means that the signal is regarded as a fault until the signal drops below the start setting determined by the hysteresis value.

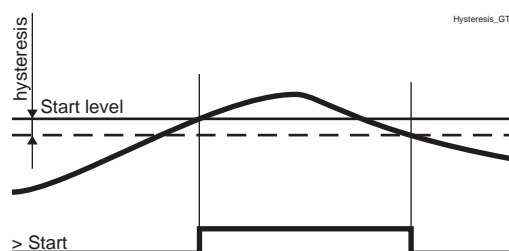Figure 60 - Behavior of a greater than comparator (for example, the hysteresis (dead band) in overvoltage stages)



Output matrix

Using the output matrix, you can connect the internal start and trip signals to the digital outputs and indicators. For more details, see [5.4.1 Output matrix](#).

Blocking

Any protection function, except for arc flash detection, can be blocked with internal and external signals using the block matrix ([5.4.2 Blocking matrix](#)).

Internal signals are for example logic outputs and start and trip signals from other stages and external signals are for example digital and virtual inputs.

Some protection stages have also built-in blocking functions. For example under-frequency protection has built-in under-voltage blocking to avoid tripping when the voltage is off.


When a protection stage is blocked, it does not start if a fault condition is detected. If blocking is activated during the operation delay, the delay counting is frozen until the blocking goes off or the start reason, that is the fault condition, disappears. If the stage is already tripping, the blocking has no effect.

Dependent time operation

The operate time in the dependent time mode is dependent on the magnitude of the injected signal. The bigger the signal, the faster the stage issues a trip signal and vice versa. The tripping time calculation resets if the injected quantity drops below the start level.

Definite time operation

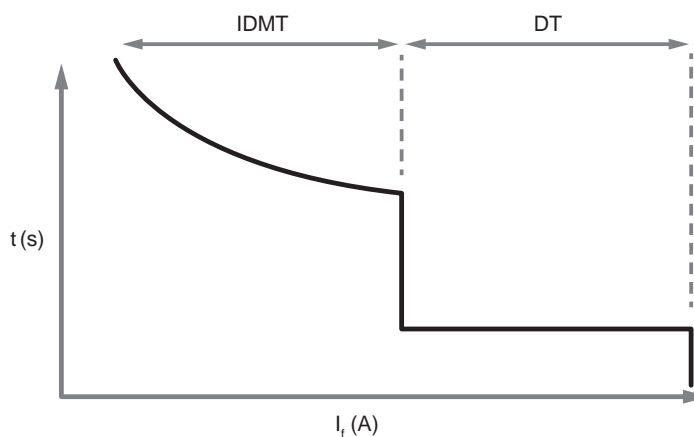Figure 61 - Dependent time and definite time operation curves




The operate time in the definite time mode is fixed by the **Operation delay** setting. The timer starts when the protection stage activates and counts until the set time has elapsed. After that, the stage issues a trip command. Should the protection stage reset before the definite time operation has elapsed, then the stage resets.

By default, the definite time delay cannot be set to zero because the value contains processing time of the function and operate time of the output contact. This means that the time indicated in the **Definite time** setting view is the actual operate time of the function. Use the **Accept zero delay** setting in the protection stage setting view to accept the zero setting for definite time function. In this case, the minimum operate time of the function must be tested separately.

Overshoot time

Overshoot time is the time the protection device needs to notice that a fault has been cleared during the operate time delay. This parameter is important when grading the operate time delay settings between devices.

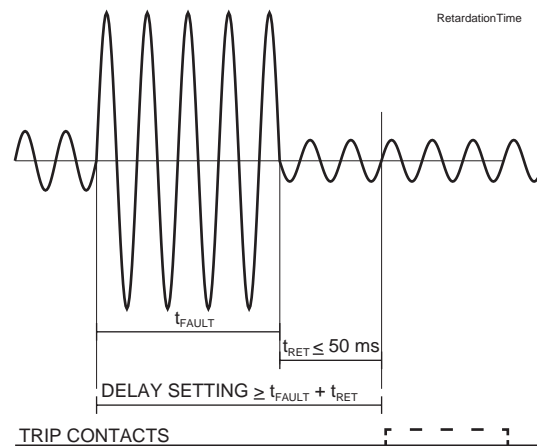Figure 62 - Overshoot time



If the delay setting would be slightly shorter, an unselective trip might occur (the dash line pulse).

For example, when there is a big fault in an outgoing feeder, it might start both the incoming and outgoing feeder relay. However, the fault must be cleared by the outgoing feeder relay and the incoming feeder relay must not trip. Although the operating delay setting of the incoming feeder is more than at the outgoing feeder, the incoming feeder might still trip if the operate time difference is not big enough. The difference must be more than the overshoot time of the incoming feeder relay plus the operate time of the outgoing feeder circuit breaker.


Figure 62 shows an overvoltage fault seen by the incoming feeder when the outgoing feeder clears the fault. If the operation delay setting would be slightly shorter or if the fault duration would be slightly longer than in the figure, an unselective trip might happen (the dashed 40 ms pulse in the figure). In Easergy P3 devices, the overshoot time is less than 50 ms.

Reset time

Figure 63 shows an example of reset time, that is, release delay when the relay is clearing an overcurrent fault. When the relay's trip contacts are closed, the circuit breaker (CB) starts to open. After the CB contacts are open, the fault current still flows through an arc between the opened contacts. The current is finally cut off when the arc extinguishes at the next zero crossing of the current. This is the start moment of the reset delay. After the reset delay the trip contacts and start contact are opened unless latching is configured. The precise reset time depends on the fault size; after a big fault, the reset time is longer. The reset time also depends on the specific protection stage.

The maximum reset time for each stage is specified under the characteristics of every protection function. For most stages, it is less than 95 ms.

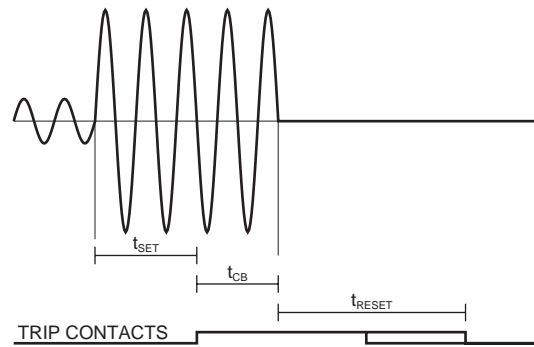Figure 63 - Reset time



Reset time is the time it takes the trip or start relay contacts to open after the fault has been cleared.

Hysteresis or dead band

When comparing a measured value against a start value, some amount of hysteresis is needed to avoid oscillation near equilibrium situation. With zero hysteresis, any noise in the measured signal or any noise in the measurement itself would cause unwanted oscillation between fault-on and fault-off situations.

Figure 64 - Example behavior of an over-protection with hysteresis


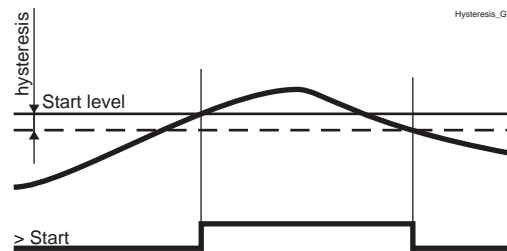


Figure 65 - Example behavior of an under-protection with hysteresis

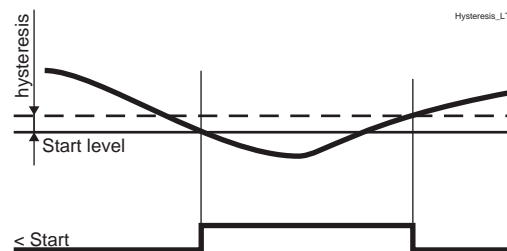


Time grading

When a fault occurs, the protection scheme only needs to trip circuit breakers whose operation is required to isolate the fault. This selective tripping is also called discrimination or protection coordination and is typically achieved by time grading. Protection systems in successive zones are arranged to operate in times that are graded through the sequence of equipment so that upon the occurrence of a fault, although a number of protections devices respond, only those relevant to the faulty zone complete the tripping function.

The recommended discrimination time between two Easergy P3 devices in an MV network is 170–200 ms. This is based on the following facts:

- T_c : circuit breaker operating time, 60 ms
- T_m : upstream protection overshoot time (retardation time), 50 ms
- δt : time delay tolerance, 25 ms
- m : safety margin, 10 ms
- Δt : discrimination time, 170–200 ms

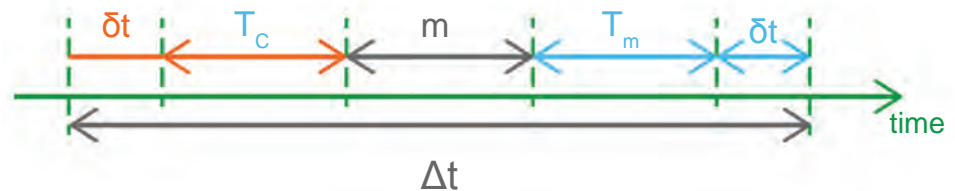Figure 66 - Time grading



Recorded values of the last eight faults

There is detailed information available on the last eight faults for each protection stage. The recorded values are specific for the protection stages and can contain information like time stamp, fault value, elapsed delay, fault current, fault voltage, phase angle and setting group.

NOTE: The recorded values are lost if the relay power is switched off.

Squelch limit

Current inputs have a squelch limit (noise filter) at $0.005 \times I_N$. When the measured signal goes below this threshold level, the signal is forced to zero.

NOTE: If I_{CALC} is used to measure the residual current, the squelch limit for the I_{CALC} signal is same as for the phase currents. The I_0 setting range begins at the level of phase currents' squelch limit. This can cause instability if the minimum setting is used with the I_0 CALC mode.

6.5 Dependent operate time

The dependent operate time – that is, the inverse definite minimum time (IDMT) type of operation – is available for several protection functions. The common principle, formula and graphic representations of the available dependent delay types are described in this chapter.

Dependent delay means that the operate time depends on the measured real time process values during a fault. For example, with an overcurrent stage using dependent delay, a bigger a fault current gives faster operation. The alternative to dependent delay is definite delay. With definite delay, a preset time is used and the operate time does not depend on the size of a fault.

Stage-specific dependent delay

Some protection functions have their own specific type of dependent delay. Details of these dedicated dependent delays are described with the appropriate protection function.

Operation modes

There are three operation modes to use the dependent time characteristics:

- Standard delays

Using standard delay characteristics by selecting a curve family (IEC, IEEE, IEEE2, RI) and a delay type (Normal inverse, Very inverse etc). See [6.5.1 Standard dependent delays using IEC, IEEE, IEEE2 and RI curves](#).
- Standard delay formulae with free parameters

selecting a curve family (IEC, IEEE, IEEE2) and defining one's own parameters for the selected delay formula. This mode is activated by setting delay type to 'Parameters', and then editing the delay function parameters A – E. See [6.5.2 Free parameterization using IEC, IEEE and IEEE2 curves](#).
- Fully programmable dependent delay characteristics

Building the characteristics by setting 16 [current, time] points. The relay interpolates the values between given points with second degree polynomials. This mode is activated by the setting curve family to 'PrgN'. There is a maximum of three different programmable curves available at the same time. Each programmed curve can be used by any number of protection stages. See [6.5.3 Programmable dependent time curves](#).

⚠ CAUTION

HAZARD OF NON-OPERATION

When changing the dependent time (inverse curves) operation mode settings manually through the device HMI, change both the Curve (Curve delay family) and Type (Delay type) setting.

Failure to follow these instructions can result in injury or equipment damage.

Dependent time limitation

The maximum dependent time is limited to 600 seconds.

Local panel graph

The relay shows a graph of the currently used dependent delay on the local panel display. The up and down keys can be used for zooming. Also the delays at $20 \times I_{SET}$, $4 \times I_{SET}$ and $2 \times I_{SET}$ are shown.

Dependent time setting error signal

If there are any errors in the dependent delay configuration, the appropriate protection stage uses the definite time delay.

There is a signal 'Setting Error' available in the output matrix that indicates different situations:

1. Settings are currently changed with Easergy Pro or local panel.
2. There is temporarily an illegal combination of curve points. For example, if previous setting was IEC/NI and then curve family is changed to IEEE, this causes a setting error because there is no NI type available for IEEE curves. After changing valid delay type for IEEE mode (for example MI), the 'Setting Error' signal releases.
3. There are errors in formula parameters A – E, and the relay is not able to build the delay curve.
4. There are errors in the programmable curve configuration, and the relay is not able to interpolate values between the given points.

Limitations

The maximum measured secondary phase current is $50 \times I_N$ and the maximum directly measured earth fault current is $10 \times I_{0N}$ for earth fault overcurrent input. The full scope of dependent delay curves goes up to 20 times the setting. At a high setting, the maximum measurement capability limits the scope of dependent curves according to [Table 51](#).

Table 51 - Maximum measured secondary currents and settings for phase and earth fault overcurrent inputs

Current input	Maximum measured secondary current	Maximum secondary scaled setting enabling dependent delay times up to full 20x setting
I_{L1}, I_{L2}, I_{L3} and I_0 Calc	250 A	12.5 A
$I_{01} = 5$ A	50 A	2.5 A
$I_{01} = 1$ A	10 A	0.5 A
$I_{01} = 0.2$ A	2 A	0.1 A

1. Example of limitation

$$CT = 750 / 5$$

$$CT_0 = 100 / 1 \text{ (cable CT is used for earth fault overcurrent)}$$

The CT_0 is connected to a 1 A terminals of input I_{01} .

For overcurrent stage $I>$, [Table 51](#) gives 12.5 A. Thus, the maximum setting for the $I>$ stage giving full dependent delay range is $12.5 \text{ A} / 5 \text{ A} = 2.5 \times I_N = 1875 \text{ A}_{\text{Primary}}$.

For earth fault stage $I_0>$, [Table 51](#) gives 0.5 A. Thus, the maximum setting for the $I_0>$ stage giving full dependent delay range is $0.5 \text{ A} / 1 \text{ A} = 0.5 \times I_{0N} = 50 \text{ A}_{\text{Primary}}$.

2. Example of limitation

$$CT = 750 / 5$$

Application mode is Motor

Rated current of the motor = 600 A

$I_{0Calc} = (I_{L1} + I_{L2} + I_{L3})$ is used for earth fault overcurrent.

At secondary level, the rated motor current is $600 / 750 \cdot 5 = 4 \text{ A}$

For overcurrent stage $I>$, [Table 51](#) gives 12.5 A. Thus, the maximum setting giving full dependent delay range is $12.5 \text{ A} / 4 \text{ A} = 3.13 \times I_{MOT} = 1875 \text{ A}_{Primary}$.

For earth fault stage $I_0>$, [Table 51](#) gives 12.5 A. Thus, the maximum setting for the $I_0>$ stage giving full dependent delay range is $12.5 \text{ A} / 5 \text{ A} = 2.5 \times I_{0N} = 1875 \text{ A}_{Primary}$.

6.5.1 Standard dependent delays using IEC, IEEE, IEEE2 and RI curves

The available standard dependent delays are divided in four categories called dependent curve families: IEC, IEEE, IEEE2 and RI. Each category contains a set of different delay types according to [Table 52](#).

Dependent time setting error signal

The dependent time setting error signal activates if the delay category is changed and the old delay type does not exist in the new category. See [6.5 Dependent operate time](#) for more details.

Limitations

The minimum definite time delay starts when the measured value is twenty times the setting, at the latest. However, there are limitations at high setting values due to the measurement range. See [6.5 Dependent operate time](#) for more details.

Table 52 - Available standard delay families and the available delay types within each family

Delay type		Curve family				
		DT	IEC	IEEE	IEEE2	RI
DT	Definite time	X				
NI	Normal inverse		X		X	
VI	Very inverse		X	X	X	
EI	Extremely inverse		X	X	X	
LTI	Long time inverse		X	X		
LTEI	Long time extremely inverse			X		

Delay type		Curve family				
		DT	IEC	IEEE	IEEE2	RI
LTVI	Long time very inverse			X		
MI	Moderately inverse			X	X	
STI	Short time inverse			X		
STEI	Short time extremely inverse			X		
RI	Old ASEA type					X
RXIDG	Old ASEA type					X

IEC dependent operate time

The operate time depends on the measured value and other parameters according to [Equation 7](#). Actually this equation can only be used to draw graphs or when the measured value I is constant during the fault. A modified version is implemented in the relay for real time usage.

Equation 7

$$t = \frac{k A}{\left(\frac{I}{I_{START}}\right)^B - 1}$$

t = Operation delay in seconds

k = User's multiplier Inv. time coefficient k

I = Measured value

I_{START} = Start setting

A, B = Constants parameters according to [Table 53](#).

There are three different dependent delay types according to IEC 60255-3, Normal inverse (NI), Extremely inverse (EI), Very inverse (VI) and a VI extension. In addition, there is a de facto standard Long time inverse (LTI).

Table 53 - Constants for IEC dependent delay equation

Delay type		Parameter	
		A	B
NI	Normal inverse	0.14	0.02
EI	Extremely inverse	80	2
VI	Very inverse	13.5	1
LTI	Long time inverse	120	1

Example of the delay type "Normal inverse (NI)":

$$k = 0.50$$

$$I = 4 \text{ pu (constant current)}$$

$$I_{\text{PICKUP}} = 2 \text{ pu}$$

$$A = 0.14$$


$$B = 0.02$$

Equation 8

$$t = \frac{0.50 \cdot 0.14}{\left(\frac{4}{2}\right)^{0.02} - 1} = 5.0$$


The operate time in this example is five seconds. The same result can be read from [Figure 67](#).

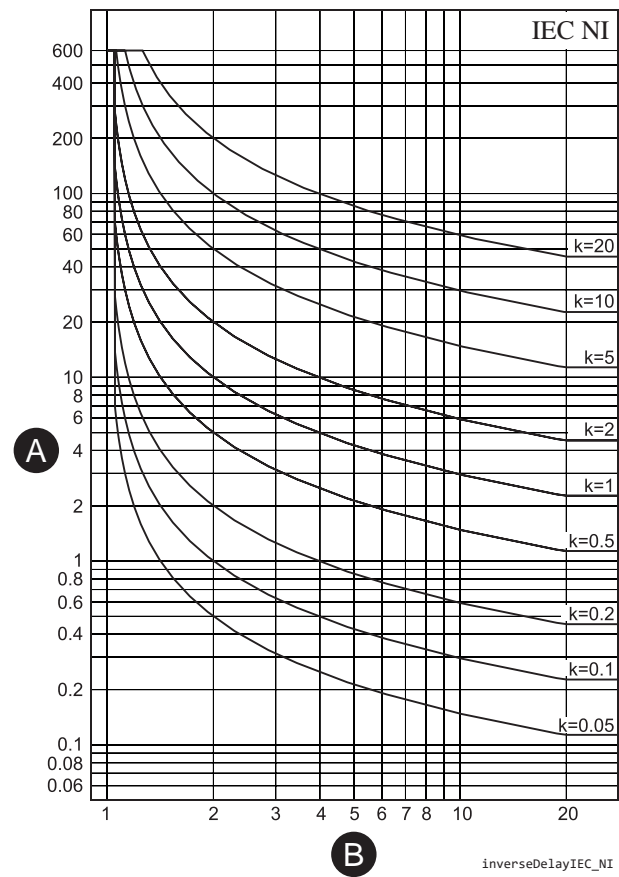Figure 67 - IEC normal inverse delay




A. Delay (s) B. I / I_{set}

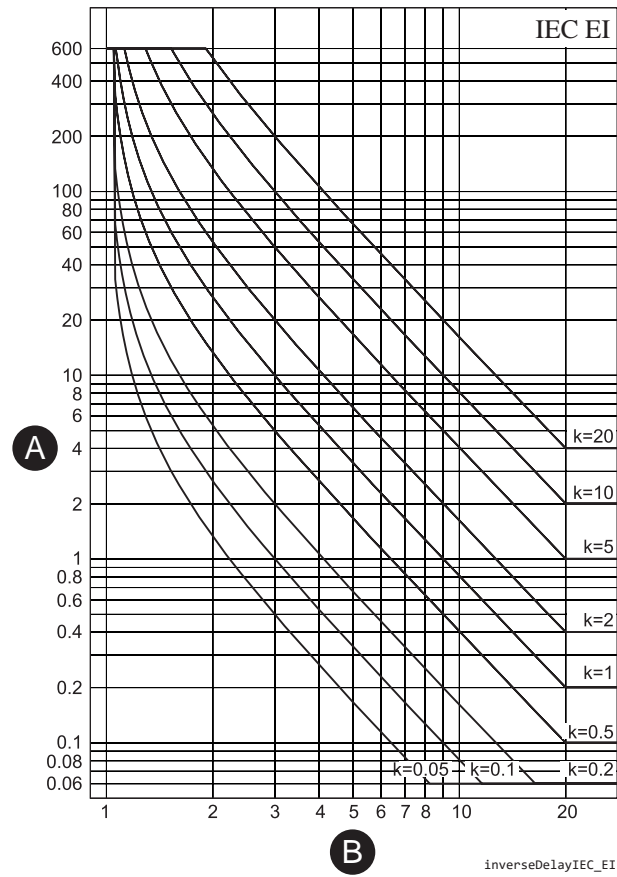Figure 68 - IEC extremely inverse delay




A. Delay (s) B. I / I_{set}

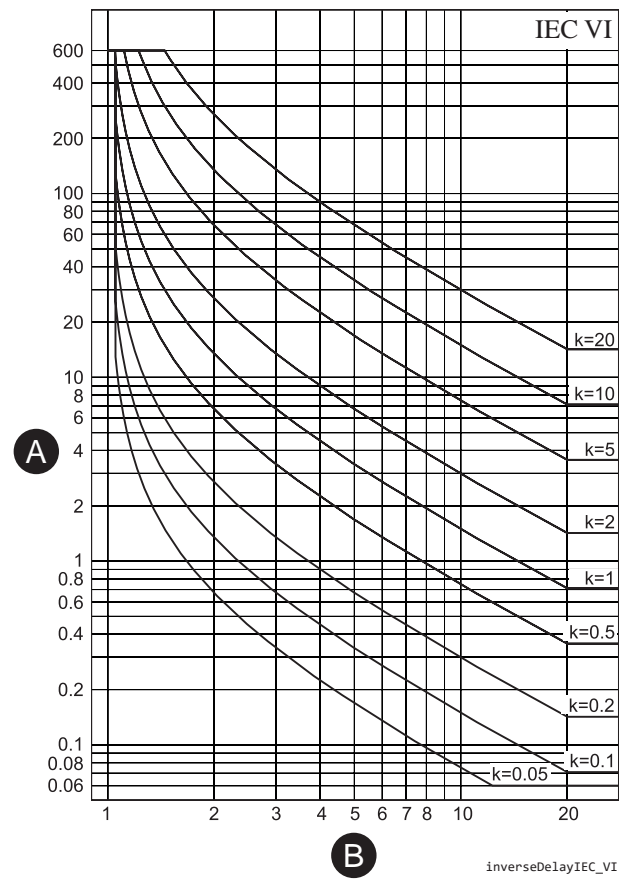Figure 69 - IEC very inverse delay



A. Delay (s) B. I / I_{set}

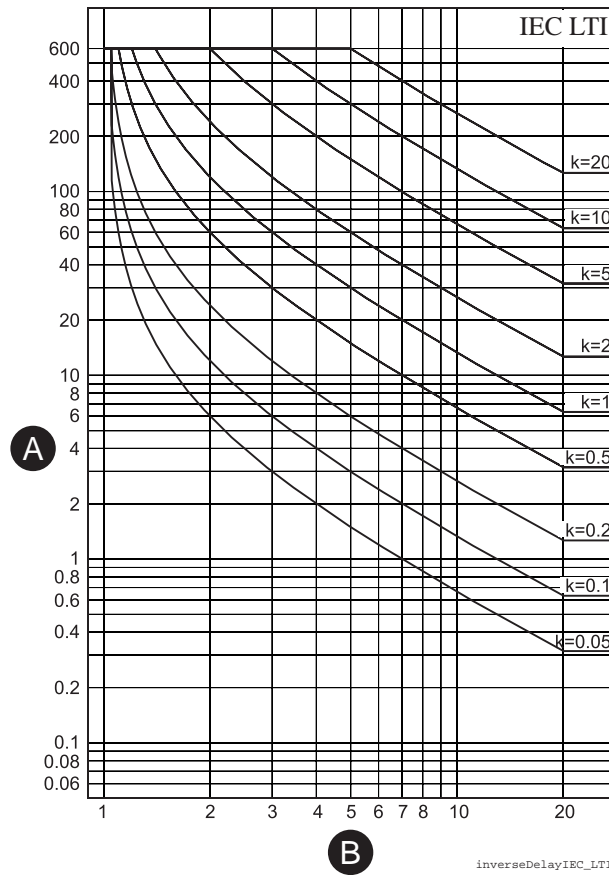Figure 70 - IEC long time inverse delay



A. Delay (s) B. I / I_{set}

IEEE/ANSI dependent operate time

There are three different delay types according to IEEE Std C37.112-1996 (MI, VI, EI) and many de facto versions according to [Table 54](#). The IEEE standard defines dependent delay for both trip and release operations. However, in the Easergy P3 relay only the trip time is dependent according to the standard but the reset time is constant.

The operate delay depends on the measured value and other parameters according to [Equation 9](#). Actually, this equation can only be used to draw graphs or when the measured value I is constant during the fault. A modified version is implemented in the relay for real-time usage.

Equation 9

$$t = k \left[\frac{A}{\left(\frac{I}{I_{START}} \right)^c - 1} + B \right]$$

t = Operation delay in seconds

k = User's multiplier

I = Measured value

I_{START} = Start setting

A,B,C = Constant parameter according to [Table 54](#)

Table 54 - Constants for IEEE/ANSI inverse delay equation

Delay type		Parameter		
		A	B	C
LTI	Long time inverse	0.086	0.185	0.02
LTVI	Long time very inverse	28.55	0.712	2
LTEI	Long time extremely inverse	64.07	0.250	2
MI	Moderately inverse	0.0515	0.1140	0.02
VI	Very inverse	19.61	0.491	2
EI	Extremely inverse	28.2	0.1217	2
STI	Short time inverse	0.16758	0.11858	0.02
STEI	Short time extremely inverse	1.281	0.005	2

Example of the delay type "Moderately inverse (MI)":

$k = 0.50$

$I = 4 \text{ pu}$

$I_{PICKUP} = 2 \text{ pu}$

$A = 0.0515$

$B = 0.114$

$C = 0.02$

Equation 10

$$t = 0.50 \cdot \left[\frac{0.0515}{\left(\frac{4}{2}\right)^{0.02} - 1} + 0.1140 \right] = 1.9$$

The operate time in this example is 1.9 seconds. The same result can be read from [Figure 74](#).

Figure 71 - ANSI/IEEE long time inverse delay



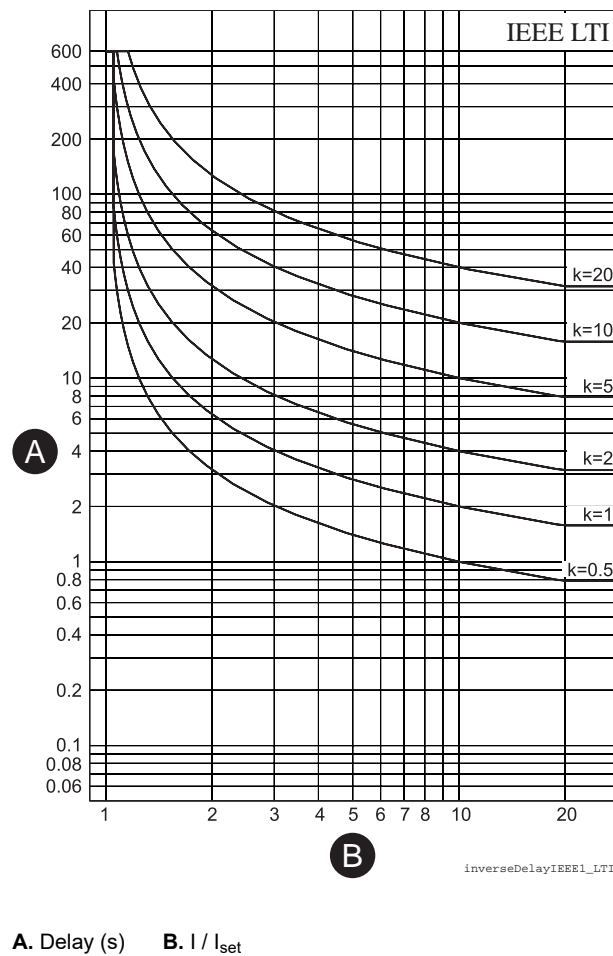


Figure 72 - ANSI/IEEE long time very inverse delay

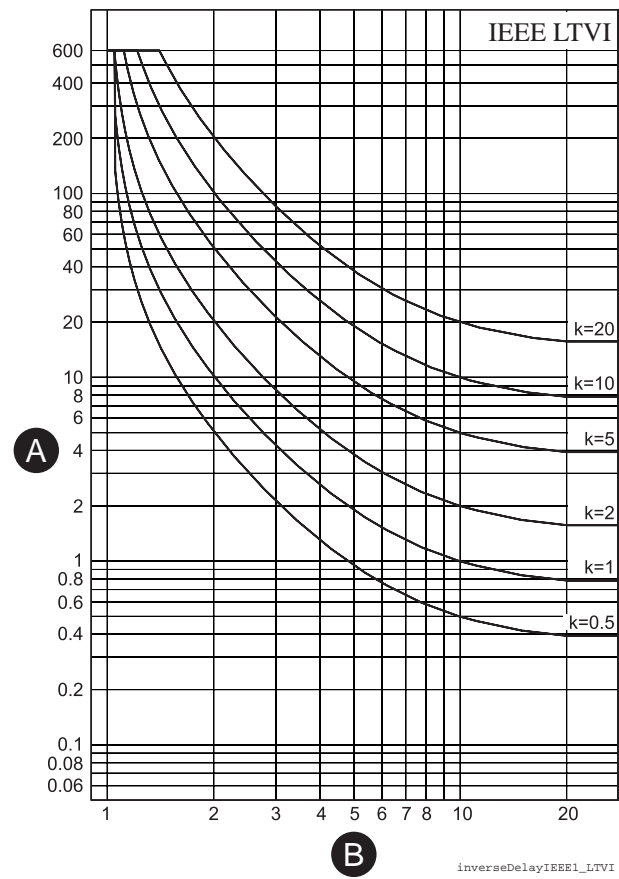


A. Delay (s) B. I / I_{set}

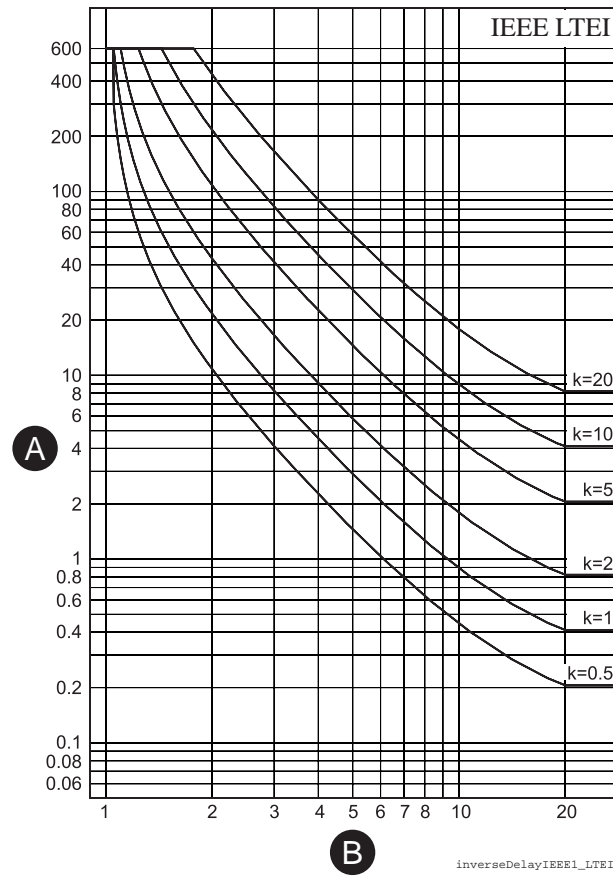Figure 73 - ANSI/IEEE long time extremely inverse delay




A. Delay (s) B. I / I_{set}

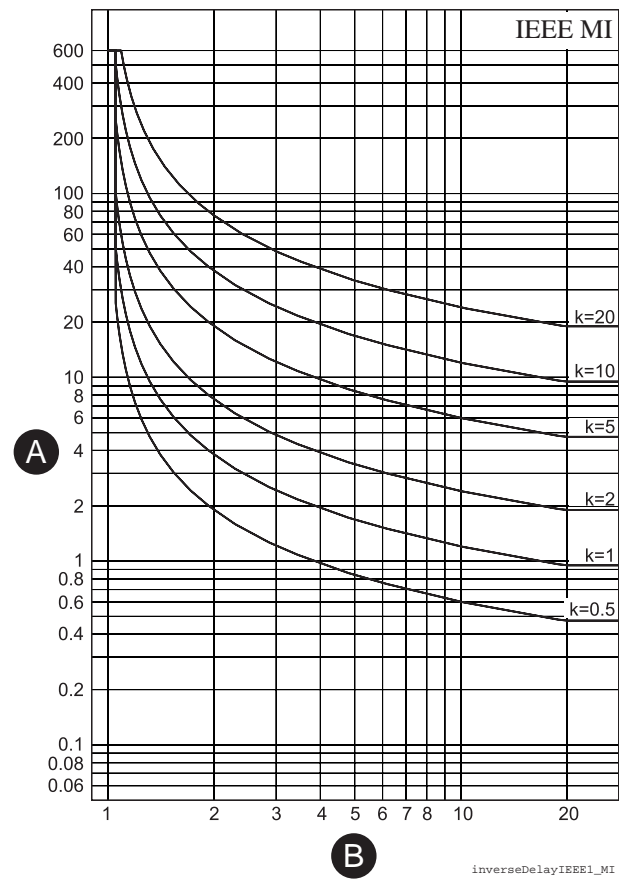Figure 74 - ANSI/IEEE moderately inverse delay




A. Delay (s) B. I / I_{set}

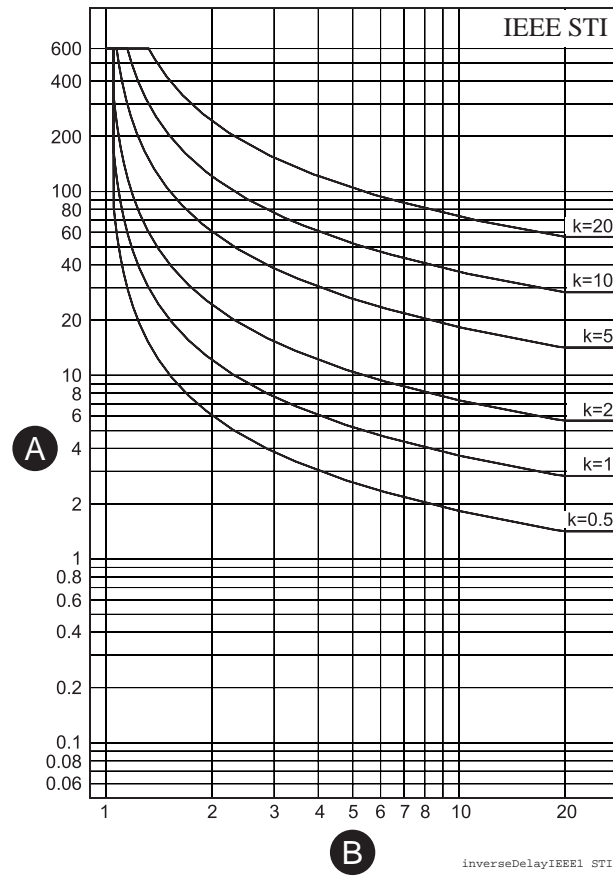Figure 75 - ANSI/IEEE short time inverse delay



A. Delay (s) B. I / I_{set}

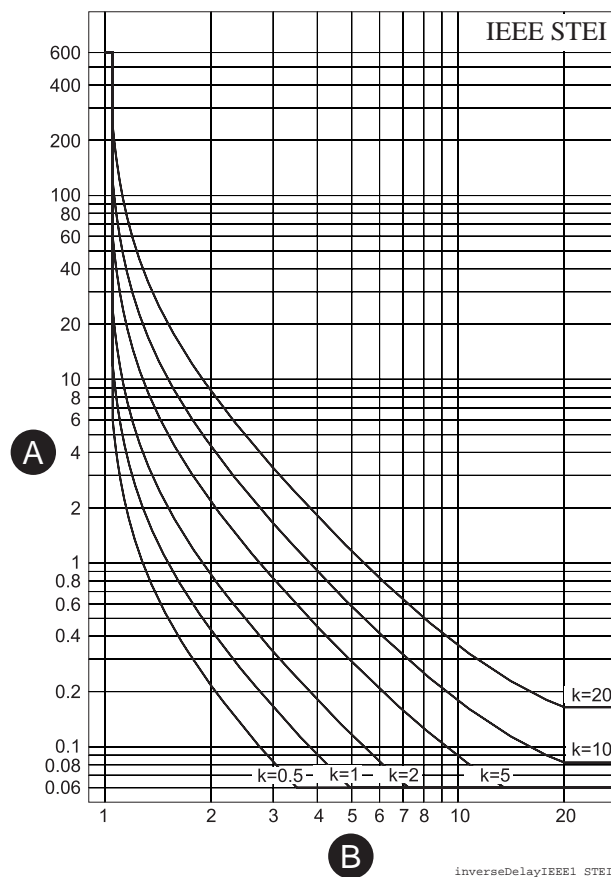Figure 76 - ANSI/IEEE short time extremely inverse delay



A. Delay (s) B. I / I_{set}

IEEE2 dependent operate time

Before the year 1996 and ANSI standard C37.112 microprocessor relays were using equations approximating the behavior of various induction disc type relays. A quite popular approximation is [Equation 11](#) which in Easergy P3 relays is called IEEE2. Another name could be IAC because the old General Electric IAC relays have been modeled using the same equation.

There are four different delay types according to [Table 55](#). The old electromechanical induction disc relays have dependent delay for both trip and release operations. However, in Easergy P3 relays, only the trip time is dependent and the reset time is constant.

The operate delay depends on the measured value and other parameters according to [Equation 11](#). Actually, this equation can only be used to draw graphs or when the measured value I is constant during the fault. A modified version is implemented in the relay for real-time usage.

Equation 11

$$t = k \left[A + \frac{B}{\left(\frac{I}{I_{START}} - C\right)} + \frac{D}{\left(\frac{I}{I_{START}} - C\right)^2} + \frac{E}{\left(\frac{I}{I_{START}} - C\right)^3} \right]$$

t = Operation delay in seconds

k = User's multiplier

I = Measured value

I_{START} = User's start setting

A, B, C, D = Constant parameter according to [Table 55](#).

Table 55 - Constants for IEEE2 inverse delay equation

Delay type		Parameter				
		A	B	C	D	E
MI	Moderately inverse	0.1735	0.6791	0.8	-0.08	0.1271
NI	Normally inverse	0.0274	2.2614	0.3	-4.1899	9.1272
VI	Very inverse	0.0615	0.7989	0.34	-0.284	4.0505
EI	Extremely inverse	0.0399	0.2294	0.5	3.0094	0.7222

Example of the delay type "Moderately inverse (MI)":

k = 0.50

I = 4 pu

I_{START} = 2 pu

A = 0.1735

B = 0.6791

C = 0.8

D = -0.08


E = 0.127

Equation 12

$$t = 0.5 \cdot \left[0.1735 + \frac{0.6791}{\left(\frac{4}{2} - 0.8\right)} + \frac{-0.08}{\left(\frac{4}{2} - 0.8\right)^2} + \frac{0.127}{\left(\frac{4}{2} - 0.8\right)^3} \right] = 0.38$$


The operate time in this example is 0.38 seconds. The same result can be read from [Figure 77](#).

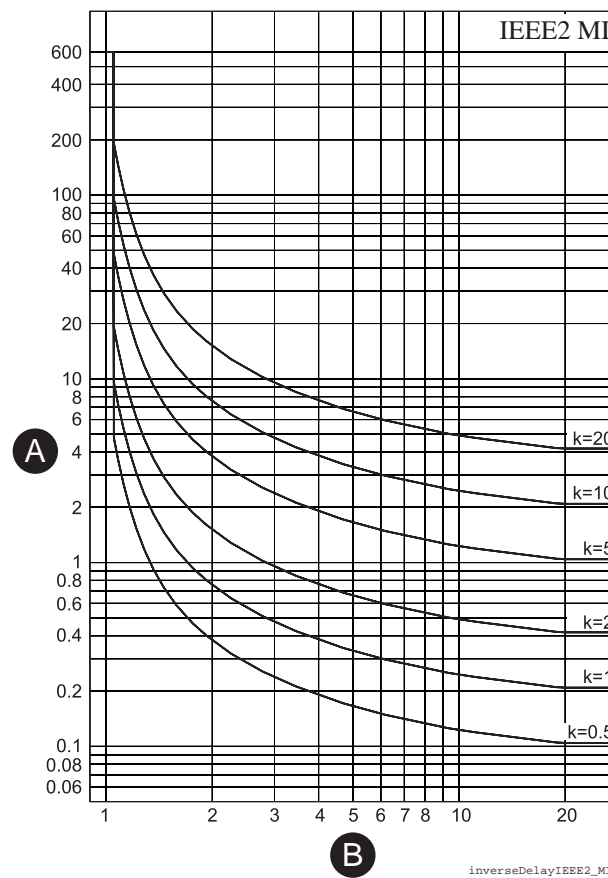Figure 77 - IEEE2 moderately inverse delay




A. Delay (s) B. I / I_{set}

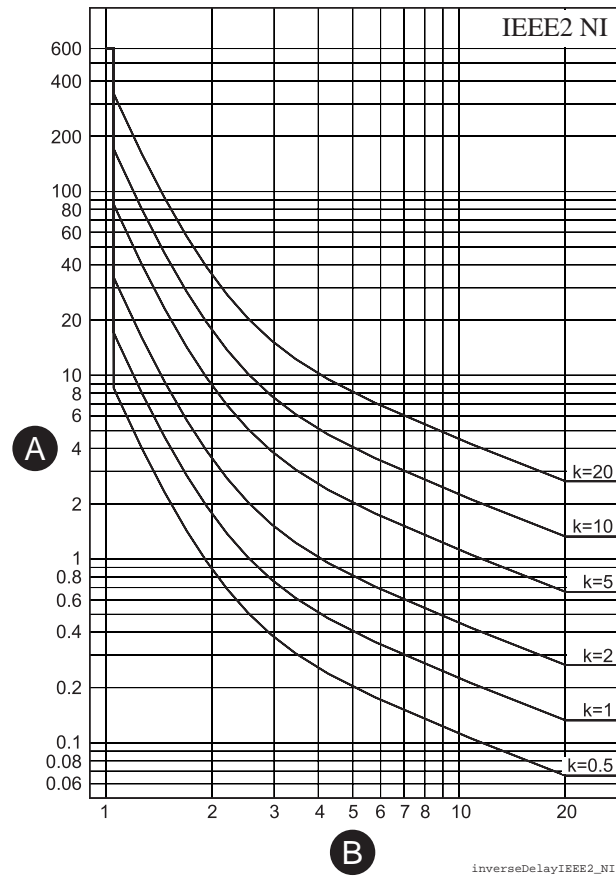Figure 78 - IEEE2 normal inverse delay




A. Delay (s) B. I / I_{set}

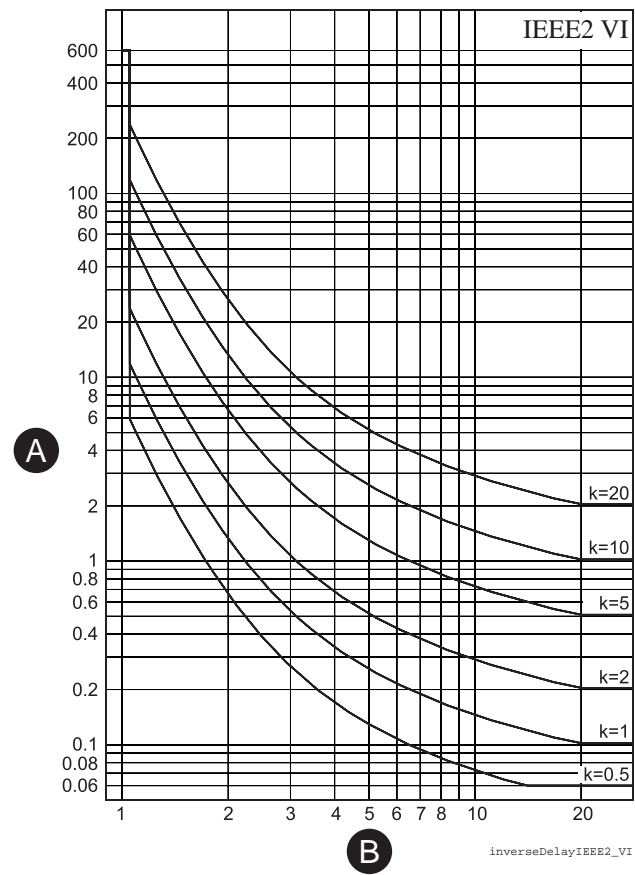Figure 79 - IEEE2 very inverse delay



A. Delay (s) B. I / I_{set}

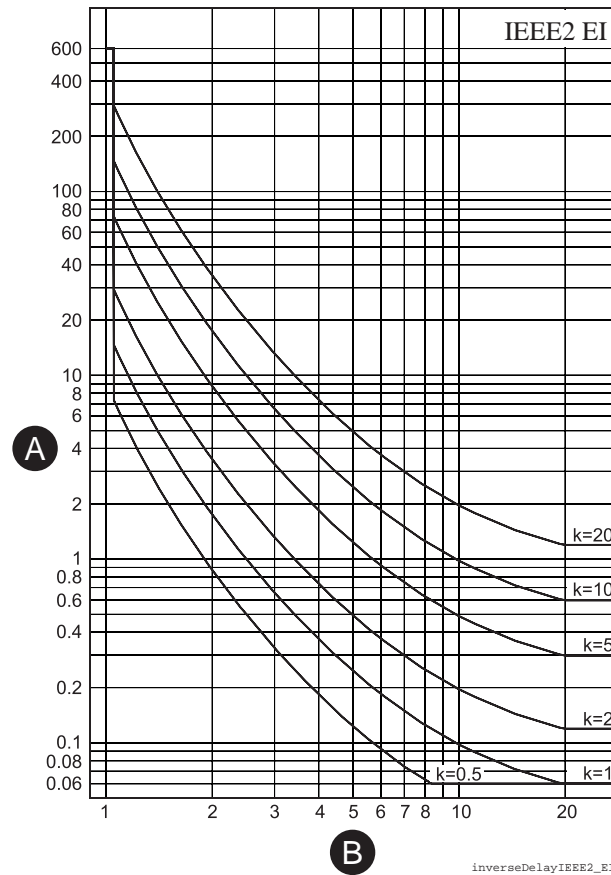Figure 80 - IEEE2 extremely inverse delay



A. Delay (s) B. I / I_{set}

RI and RXIDG type dependent operate time

These two dependent delay types have their origin in old ASEA (nowadays ABB) earth fault relays.

The operate delay of types RI and RXIDG depends on the measured value and other parameters according to Equation 13 and Equation 14. Actually, these equations can only be used to draw graphs or when the measured value I is constant during the fault. Modified versions are implemented in the relay for real-time usage.

Equation 13

$$t_{RI} = \frac{k}{0.339 - \frac{0.236}{\left(\frac{I}{I_{START}}\right)}}$$

Equation 14

$$t_{RXIDG} = 5.8 - 1.35 \ln \frac{I}{k I_{START}}$$

t = Operate delay in seconds

k = User's multiplier

I = Measured value

I_{START} = Start setting

Example of the delay type RI

$$k = 0.50$$

$$I = 4 \text{ pu}$$

$$I_{\text{START}} = 2 \text{ pu}$$

Equation 15

$$t_{RI} = \frac{0.5}{0.339 - \frac{0.236}{\left(\frac{4}{2}\right)}} = 2.3$$

The operate time in this example is 2.3 seconds. The same result can be read from [Figure 81](#).

Example of the delay type RXIDG

$$k = 0.50$$

$$I = 4 \text{ pu}$$


$$I_{\text{START}} = 2 \text{ pu}$$

Equation 16

$$t_{RXIDG} = 5.8 - 1.35 \ln \frac{4}{0.5 \cdot 2} = 3.9$$


The operate time in this example is 3.9 seconds. The same result can be read from [Figure 82](#).

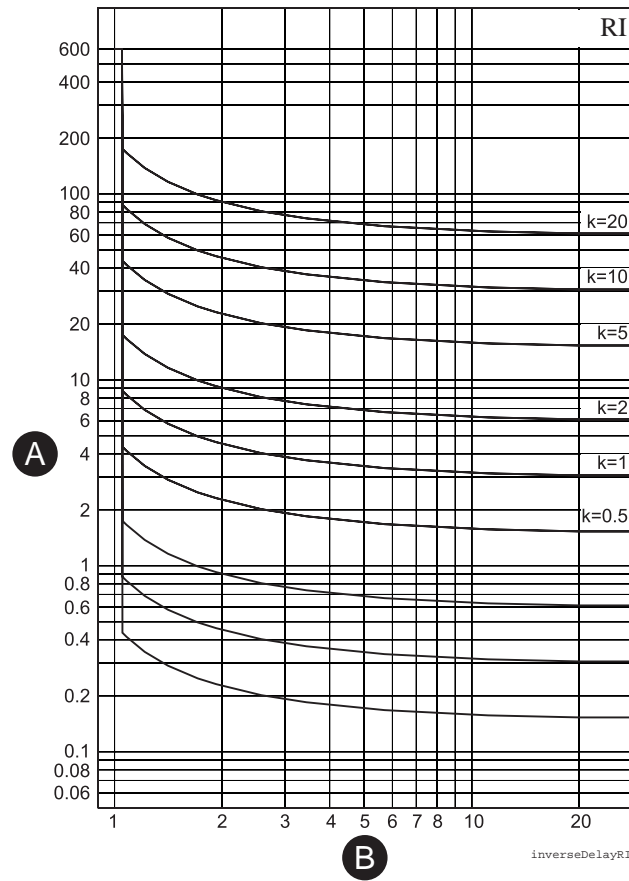Figure 81 - RI dependent delay



A. Delay (s) B. I / I_{set}

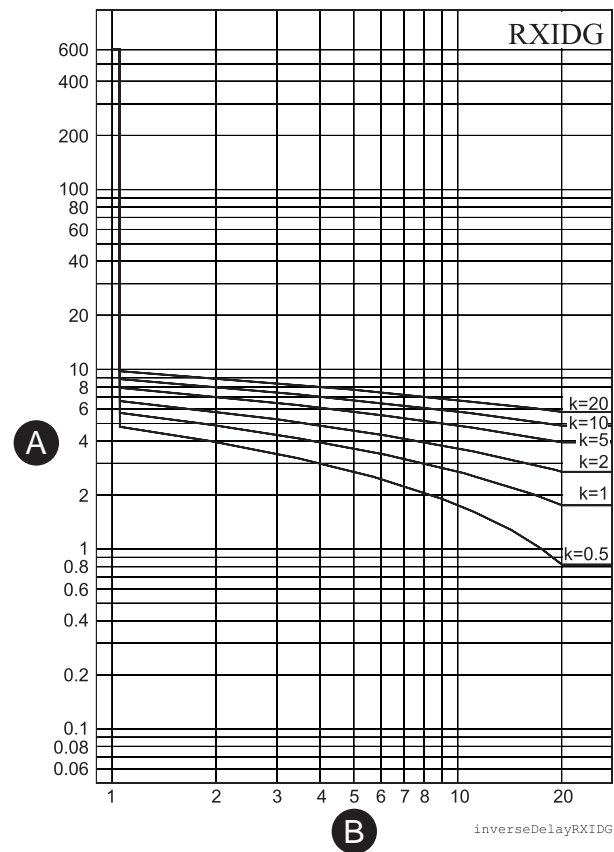Figure 82 - RXIDG dependent delay



A. Delay (s) B. I / I_{set}

6.5.2 Free parameterization using IEC, IEEE and IEEE2 curves

This mode is activated by the setting delay type to 'Parameters', and then editing the delay function constants, that is, the parameters A – E. The idea is to use the standard equations with one's own constants instead of the standardized constants as in the previous chapter.

Example of the GE-IAC51 delay type:

$$k = 0.50$$

$$I = 4 \text{ pu}$$

$$I_{START} = 2 \text{ pu}$$

$$A = 0.2078$$

$$B = 0.8630$$

$$C = 0.8000$$

$$D = -0.4180$$

$$E = 0.1947$$

Equation 17

$$t = 0.5 \cdot \left[0.2078 + \frac{0.8630}{\left(\frac{4}{2} - 0.8\right)} + \frac{-0.4180}{\left(\frac{4}{2} - 0.8\right)^2} + \frac{0.1947}{\left(\frac{4}{2} - 0.8\right)^3} \right] = 0.37$$

The operate time in this example is 0.37 seconds.

The resulting time/current characteristic of this example matches quite well the characteristic of the old electromechanical IAC51 induction disc relay.

Dependent time setting error signal

The dependent time setting error signal activates if interpolation with the given parameters is not possible. See [6.5 Dependent operate time](#) for more details.

Limitations

The minimum definite time delay starts at the latest when the measured value is twenty times the setting. However, there are limitations at high setting values due to the measurement range. See [6.5 Dependent operate time](#) for more details.

6.5.3 Programmable dependent time curves

Programming dependent time curves requires Easergy Pro setting tool and rebooting the unit.

The [current, time] curve points are programmed using Easergy Pro PC program. There are some rules for defining the curve points:

- the configuration must begin from the topmost line
- the line order must be as follows: the smallest current (longest operate time) on the top and the largest current (shortest operate time) on the bottom
- all unused lines (on the bottom) should be filled with [1.00 0.00s]

Here is an example configuration of curve points:

Point	Current I/I _{START}	Operate delay
1	1.00	10.00 s
2	2.00	6.50 s
3	5.00	4.00 s
4	10.00	3.00 s
5	20.00	2.00 s
6	40.00	1.00 s
7	1.00	0.00 s
8	1.00	0.00 s

Point	Current I/I_{START}	Operate delay
9	1.00	0.00 s
10	1.00	0.00 s
11	1.00	0.00 s
12	1.00	0.00 s
13	1.00	0.00 s
14	1.00	0.00 s
15	1.00	0.00 s
16	1.00	0.00 s

Dependent time setting error signal

The dependent time setting error signal activates if interpolation with the given points fails. See [6.5 Dependent operate time](#) for more details.

Limitations


The minimum definite time delay starts at the latest when the measured value is twenty times the setting. However, there are limitations at high setting values due to the measurement range. See [6.5 Dependent operate time](#) for more details.

6.6 Synchrocheck (ANSI 25)

Description

The relay includes a function that checks the synchronism before giving or enabling the circuit breaker close command. The function monitors the voltage amplitude, frequency and phase angle difference between two voltages. Since there are two stages available, it is possible to monitor three voltages. The voltages can be busbar and line or busbar and busbar (bus coupler).

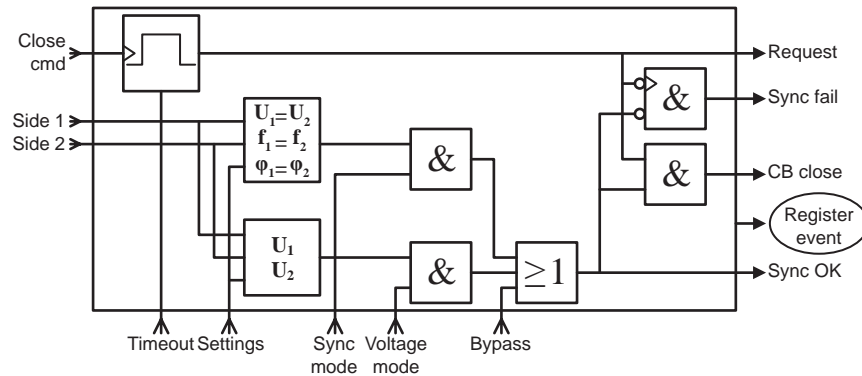Figure 83 - Synchrocheck function



The synchrocheck stage includes two separate synchronism criteria that can be used separately or combined:

- voltage only
- voltage, frequency, and phase

The voltage check simply compares voltage conditions of the supervised objects. The supervised object is considered dead (not energized) when the measured voltage is below the U_{dead} setting limit. Similarly, the supervised object is considered live (energized) when the measured voltage is above the U_{live} setting limit. Based on the measured voltage conditions and the selected voltage check criteria, synchronism is declared.

When the network sections to be connected are part of the same network, the frequency and phase are the same. Therefore, the voltage check criteria is safe to use without frequency and phase check.

The frequency and phase check compares the voltages, frequency and phase of the supervised objects. Synchronism is declared if the voltages are above the U_{live} limit and all three difference criteria are within the given limits. This synchronism check is dynamic by nature, and the object close command is given at a certain moment of time, depending on the selected mode of operation.

When two networks are running at slightly different frequencies, there is also a phase difference between these two networks. Because of the different frequency, the phase angle tends to rotate. The time for one cycle depends on the frequency difference. The stress for electrical components is lowest when two networks are connected at zero phase difference.

In the “Sync” mode, the circuit breaker closing is aimed at the moment of zero phase difference. Therefore, the close command is advanced by the time defined by the CB close time setting. In the “Async” mode, the circuit breaker closing is

aimed at the moment when the synchronism conditions are met, that is, when the phase difference is within the given phase difference limit.

When two network sections to be connected are from different sources or generators, the voltage criteria alone is not safe, so also frequency and phase check must be used.


When two networks with different frequencies are to be connected, the request timeout setting must be long enough to allow the synchronism criteria to be met. For example, if the frequency difference is 0.1 Hz, the synchronism criteria is met only once in ten seconds.

The synchrocheck stage starts from an object close command that generates a request to close the selected circuit breaker when the synchronism conditions are met. The synchrocheck stage provides a "request" signal that is active from the stage start until the synchronism conditions are met or the request timeout has elapsed. When the synchronism conditions are not met within the request timeout, a "fail" pulse is generated. The fail pulse has a fixed length of 200 ms. When the synchronism conditions are met in a timely manner, the object close command is initiated for the selected object. This signal is purely internal and not available outside the synchrocheck stage. When the synchronism conditions are met, the "OK" signal is always active. The activation of the bypass input bypasses the synchronism check and declares synchronism at all times.

The request, OK, and fail signals are available in the output matrix.

The synchronized circuit breaker close execution order is shown in [Figure 84](#).

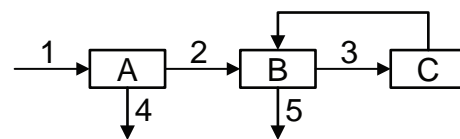
Figure 84 - Synchrocheck execution order



- A. Synchrocheck stage
- B. Object
- C. Circuit breaker (physical)

1. Object close command from mimic, digital inputs or communication protocol
2. Synchronism declared
3. Circuit breaker close command
4. Sync fail signal if request timeout elapsed before synchronism conditions met
5. Object fail signal if CB failed to operate

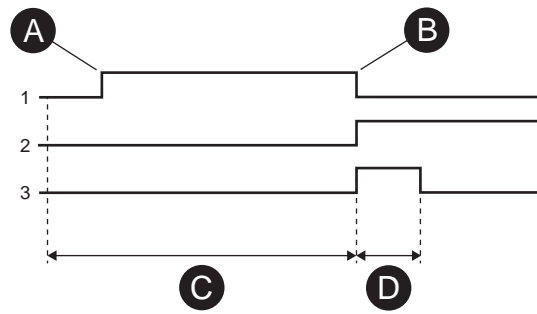Figure 85 - Synchrocheck function principle



1. Sync request
2. Sync OK
3. Object close command

- A. The object close command given (mimic or bus) actually only makes a sync request.
- B. The sync request ends when the synchronism conditions are met and CB command is given or if the request timeout elapsed.
- C. If the request timeout elapsed before synchronism conditions are met, sync fail pulse is generated.
- D. Normal object close operation

The synchrocheck function is available when one of the following analog measurement modules and a suitable measuring mode are in use:

Table 56 - Voltage measuring modes

Voltage measuring mode	Number of synchrocheck stages
3LN+LLy	1
3LN+LNy	1
2LL+U ₀ +LLy	1
2LL+U ₀ +LNy	1
LL+U ₀ +LLy+LLz	2
LN+U ₀ +LNy+LNz	2

Table 57 - Voltage measuring modes with LPVT

Voltage measuring mode	Number of synchrocheck stages
3LN+LLy	1
3LN+LNy	1
LL+U ₀ +LLy+LLz	2
LN+U ₀ +LNy+LNz	2

Connections for synchrocheck

The voltage used for synchrochecking is always line-to-line voltage U_{12} even when U_{L1} is measured. The synchrocheck stage 1 always compares U_{12} with U_{12y} .

The compared voltages for the stage 2 can be selected (U_{12}/U_{12y} , U_{12}/U_{12z} , U_{12y}/U_{12z}). See [10.8 Voltage measurement modes](#).

NOTE: To perform its operation, the synchrocheck stage 2 converts the voltages LN_y and LN_z to line-to-line voltage U_{12} . As such, the measured voltage for LN_y and LN_z must be U_{1-N} .

NOTE: The wiring of the secondary circuits of voltage transformers to the relay terminal depends on the selected voltage measuring mode.

See the synchrocheck stage's connection diagrams in [10.8 Voltage measurement modes](#).

Characteristics

Table 58 - Synchrocheck function Δf , ΔU , $\Delta \varphi$ (25)

Input signal	$U_A - U_N$
Synchrocheck mode (S_{MODE})	Off; Async; Sync ^{38) 39) 40)}
Voltage check mode (U_{MODE})	DD; DL; LD; DD/DL; DD/LD; DL/LD; DD/DL/LD ^{41) 42) 43) 44)}
CB closing time	0.04–0.6 s
U_{DEAD} limit setting	10–120% U_N
U_{LIVE} limit setting	10–120% U_N
Frequency difference	0.01–1.00 Hz
Voltage difference	1–60% U_N
Phase angle difference	2°–90°
Request timeout	0.1–600.0 s
Stage operation range	46.0–64.0 Hz

Reset ratio (U)	0.97
Inaccuracy:	
- voltage	$\pm 3\% U_N$
- frequency	± 20 mHz
- phase angle	$\pm 2^\circ$ (when $\Delta f < 0.2$ Hz, else $\pm 5^\circ$)
- operate time	$\pm 1\%$ or ± 30 ms

³⁸⁾ Off – Frequency and phase criteria not in use

³⁹⁾ Async – d_F , d_U and d angle criteria are used. Circuit breaker close is aimed at the moment when the phase angle is within phase angle difference limit. Slip frequency d_F determines how much the close command needs to be advanced to make the actual connection at the moment when the phase angle is within the phase angle limit

⁴⁰⁾ Sync mode – d_F , d_U and d angle criteria are used. Circuit breaker close is aimed at the moment when the phase angle becomes zero. Slip frequency d_F determines how much the close command needs to be advanced to make the actual connection at zero phase angle.

⁴¹⁾ The first letter refers to the reference voltage and the second letter to the comparison voltage.

⁴²⁾ D means that the side must be “dead” when closing (dead = The voltage is below the dead voltage limit setting).

⁴³⁾ L means that the side must be “live” when closing (live = The voltage is higher than the live voltage limit setting).

⁴⁴⁾ Example: DL mode for stage 1: The U12 side must be “dead” and the U12y side must be “live”.

6.7 Undervoltage (ANSI 27)

Description

Undervoltage protection is used to detect voltage dips or sense abnormally low voltages to trip or trigger load shedding or load transfer. The function measures the three line-to-line voltages, and whenever the smallest of them drops below the start setting of a particular stage, this stage starts and a start signal is issued. If the fault situation remains on longer than the operate time delay setting, a trip signal is issued.


Blocking during voltage transformer fuse failure

As all the protection stages, the undervoltage function can be blocked with any internal or external signal using the block matrix. For example if the secondary voltage of one of the measuring transformers disappears because of a fuse failure (See the voltage transformer supervision function in [7.8 Voltage transformer supervision \(ANSI 60FL\)](#)). The blocking signal can also be a signal from the custom logic (see [5.7 Logic functions](#)).

Low-voltage self blocking

The stages can be blocked with a separate low-limit setting. With this setting, the particular stage is blocked when the biggest of the three line-to-line voltages drops below the given limit. The idea is to avoid unwanted tripping when the voltage is switched off. If the operate time is less than 0.08 s, the blocking level setting should not be less than 15% for the blocking action to be fast enough. The self blocking can be disabled by setting the low-voltage block limit equal to zero.

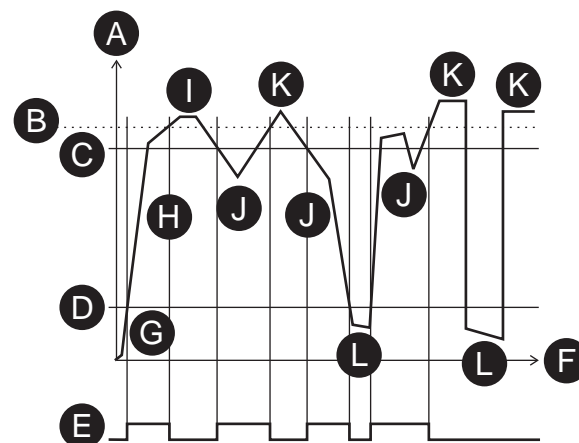Figure 86 - Example of low-voltage self blocking



A. $U_{LLmax} = \max (U_{12}, U_{23}, U_{31})$

B. Deadband

C. $U <$ setting

D. Block limit

E. $U <$ undervoltage state

F. Time

G. The maximum of the three line-to-line voltages U_{LLmax} is below the block limit. This is not regarded as an undervoltage situation.

H. The voltage U_{LLmax} is above the block limit but below the start level. This is an undervoltage situation.

I. The voltage is OK because it is above the start limit.

- J. This is an undervoltage situation.
- K. The voltage is OK.
- L. The voltage U_{LLmax} is under the block limit and this is not regarded as an undervoltage situation.

Three independent stages

There are three separately adjustable stages: $U<$, $U<<$ and $U<<<$. All these stages can be configured for the definite time (DT) operation characteristic.

Setting groups

There are four setting groups available for all stages.

Characteristics

Table 59 - Undervoltage $U<$ (27)

Input signal	$U_{L1} - U_{L3}$
Start value	20–120% U_N (step 1%)
Definite time characteristic: - Operate time	0.08 ⁴⁵⁾ – 300.00 s (step 0.02)
Hysteresis (reset ratio)	1.001–1.200 (0.1–20.0%, step 0.1%)
Self-blocking value of the undervoltage	0–80% U_N
Start time	Typically 60 ms
Release delay	0.06–300.00 s (step 0.02 s)
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio (Block limit)	0.5 V or 1.03 (3%)
Reset ratio	1.03 (depends on the hysteresis setting)
Inaccuracy: - Starting - Blocking - Operate time	$\pm 3\%$ of the set value $\pm 3\%$ of set value or ± 0.5 V $\pm 1\%$ or ± 30 ms

⁴⁵⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

Table 60 - Undervoltage $U<<$ (27)

Input signal	$U_{L1} - U_{L3}$
Start value	20–120% U_N (step 1%)

Definite time characteristic:	
- Operate time	0.06 ⁴⁶ – 300.00 s (step 0.02)
Hysteresis (reset ratio)	1.001–1.200 (0.1–20.0%, step 0.1%)
Self-blocking value of the undervoltage	0–80% U _N
Start time	Typically 60 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio (Block limit)	0.5 V or 1.03 (3%)
Reset ratio	1.03 (depends on the hysteresis setting)
Inaccuracy:	
- Starting	±3% of the set value
- Blocking	±3% of set value or ±0.5 V
- Operate time	±1% or ±30 ms

⁴⁶) This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

Table 61 - Undervoltage U<<< (27)

Input signal	U _{L1} – U _{L3}
Start value	20–120% U _N (step 1%)
Definite time characteristic:	
- Operate time	0.04 ⁴⁷ – 300.00 s (step 0.01)
Hysteresis (reset ratio)	1.001–1.200 (0.1–20.0%, step 0.1%)
Self-blocking value of the undervoltage	0–80% U _N
Start time	Typically 30 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio (Block limit)	0.5 V or 1.03 (3%)
Reset ratio	1.03 (depends on the hysteresis setting)
Inaccuracy:	
- Starting	±3% of the set value
- Blocking	±3% of set value or ±0.5 V
- Operate time	±1% or ±25 ms

⁴⁷) This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

6.8 Directional power (ANSI 32)

Description

The directional power function can be used, for example, to disconnect a motor if the supply voltage is lost and thus prevent power generation by the motor. It can also be used to detect loss of load of a motor.

The directional power function is sensitive to active power. For the directional power function, the start value is negative. For the underpower function, a positive start value is used. Whenever the active power goes under the start value, the stage starts and issues a start signal. If the fault situation stays on longer than the delay setting, a trip signal is issued.

The start setting range is from -200% to +200% of the nominal shaft power P_M . If the P_M value is not known, set it equal to the machine's nominal power. The directional power stages use this value as reference for 1.00 per unit.

There are two identical stages available with independent setting parameters.

Setting groups

There are four setting groups available for all stages.

Characteristics

Table 62 - Directional power stages P<, P<< (32)

Input signal	$I_{L1} - I_{L3}$ $U_{L1} - U_{L3}$
Start value	-200.0 to +200.0% P_M (step 0.5)
Definite time function: - Operate time	0.3–300.0 s (step 0.1)
Start time	Typically 200 ms
Reset time	< 500 ms
Reset ratio	1.05
Inaccuracy: - Starting - Operate time at definite time function	- ±3% of set value or ±0.5% of rated value ±1% or ±150 ms

NOTE: When the start setting is +1 to +200% , an internal block is activated if the maximum voltage of all phases drops below 5% of rated.

6.9 Phase undercurrent (ANSI 37)

Description

The phase undercurrent stage measures the fundamental component of the phase currents.

The stage I< can be configured for definite time characteristic.

The undercurrent stage protects rather the relay driven by the motor, for example a submersible pump, than the motor itself.

Setting groups

There are four setting groups available for each stage.

Characteristics

Table 63 - Phase undercurrent I< (37)

Input signal	$I_{L1} - I_{L3}$
Current setting range	20 – 70 % I_N or % I_{MOT} (step 1%)
Definite time characteristic:	-
- operate time	0.3 – 300.0 s (step 0.1)
Block limit	15 % (fixed)
Start time	Typically 200 ms
Reset time	< 450 ms
Reset ratio	>1.05
Accuracy:	-
- Starting	$\pm 2\%$ of set value or $\pm 0.5\%$ of the rated value
- Operate time	$\pm 1\%$ or ± 150 ms

NOTE: Stage Blocking is functional when all phase currents are below the block limit.

6.10 Negative sequence overcurrent (ANSI 46)

Description

Negative sequence overcurrent in a motor causes double frequency currents in the rotor. This warms up the surface of the rotor, and the available thermal capacity of the rotor is much less than the thermal capacity of the whole motor. Thus, RMS-current-based overload protection (see [6.14 Thermal overload \(ANSI 49 RMS\)](#)) is not capable of protecting a motor against negative sequence overcurrent.

The negative sequence overcurrent protection is based on the negative sequence of the base frequency phase currents. Both definite time and dependent time characteristics are available.

Dependent time delay

The dependent time delay is based on the following equation:

Equation 18

$$T = \frac{K_1}{\left(\frac{I_2}{I_{MOT}}\right)^2 - K_2^2}$$

T = Operate time

K₁ = Delay multiplier

I₂ = Measured and calculated negative sequence phase current of fundamental frequency

I_{MOT} = Nominal current of the motor

K₂ = Start setting I₂ > in pu. The maximum allowed degree of unbalance.

Example

K₁ = 15 s

I₂ = 22.9 % = 0.229 x I_{MOT}

K₂ = 5 % = 0.05 x I_{MOT}


$$t = \frac{15}{\left(\frac{0.229}{1}\right)^2 - 0.05^2} = 300.4$$

The operate time in this example is five minutes.

More stages (definite time delay only)

If more than one definite time delay stages are needed for negative sequence overcurrent protection, the freely programmable stages can be used ([6.35 Programmable stages \(ANSI 99\)](#)).

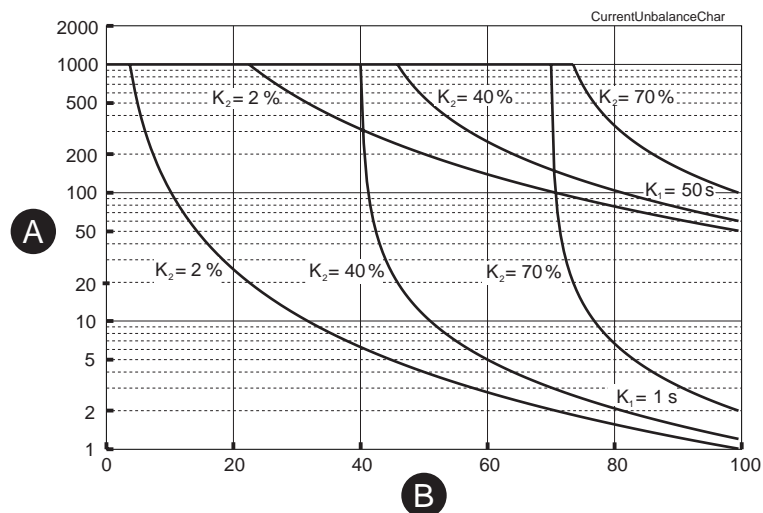Figure 87 - Dependent operation delay of negative sequence overcurrent $I_2 >$ (ANSI 46). The longest delay is limited to 1000 seconds (=16min 40s).



A. Operate time (s) B. Negative sequence current $I_2\%$

Setting groups

There are four setting groups available.

Characteristics

Table 64 - Negative sequence overcurrent $I_2 >$ (46) in motor mode (46)

Input signal	$I_{L1} - I_{L3}$
Start value	2–70% (step 1%)
Definite time characteristic: - Operate time	1.0–600.0 s (step 0.1 s)
Dependent time characteristic: - 1 characteristic curve - Time multiplier - Upper limit for dependent time	Inv 1–50 s (step 1) 1000 s
Start time	Typically 300 ms
Reset time	< 450 ms
Reset ratio	0.95
Inaccuracy: - Starting - Operate time	±1% - unit ±5% or ±200 ms

NOTE: The stage is operational when all secondary currents are above 250 mA.

6.11 Incorrect phase sequence (ANSI 47)

Description

The incorrect phase sequence detection prevents the motor from being started to wrong direction, thus protecting the load.

When the ratio between negative and positive sequence current exceeds 80% and the average of three phase currents exceeds $0.2 \times I_{MOT}$ in the start-up situation, the phase sequence stage starts and trips 100 ms after start-up.

Setting groups

This stage has one setting group.

Characteristics

Table 65 - Incorrect phase sequence $I_2 \gg$ (47)

Input signal	$I_{L1} - I_{L3}$
Setting:	80 % (fixed)
Operate time	<120 ms
Reset time	< 105 ms

NOTE: Stage is blocked when motor has been running for 2 seconds.

Stage is operational only when least one of the currents is above $0.2 \times I_{MOT}$

6.12 Negative sequence overvoltage protection (ANSI 47)

Description

This protection stage can be used to detect voltage unbalance and phase reversal situations. It calculates the fundamental frequency value of the negative sequence component U_2 based on the measured voltages (for calculation of U_2 , see [4.11 Symmetrical components](#)).

Whenever the negative sequence voltage U_2 raises above the user's start setting of a particular stage, this stage starts, and a start signal is issued. If the fault situation remains on longer than the user's operate time delay setting, a trip signal is issued.

Blocking during VT fuse failure

Like all the protection stages, the negative sequence overvoltage can be blocked with any internal or external signal using the block matrix, for example, if the secondary voltage of one of the measuring transformers disappears because of a fuse failure (See VT supervision function in [7.8 Voltage transformer supervision \(ANSI 60FL\)](#)).

The blocking signal can also be a signal from the user's logic (see [5.7 Logic functions](#)).

Three independent stages

There are three separately adjustable stages: $U_{2>}$, $U_{2>>}$, and $U_{2>>>}$. Both stages can be configured for the definite time (DT) operation characteristic.

Setting groups

There are four settings groups available for all stages. Switching between setting groups can be controlled by digital inputs, virtual inputs (mimic display, communication, logic) and manually.

Characteristics

Table 66 - Negative sequence overvoltage protection $U_{2>}$ (47)

Start value: $U_{2>}$, $U_{2>>}$, $U_{2>>>}$	2–120%
Operate time	0.08–300 s
Reset ratio	0.95
Inaccuracy:	
- Starting	±1% - unit
- Operate time	±5% or ±200 ms


6.13 Motor start-up supervision (ANSI 48)

Description

The motor start-up supervision $I_{ST}>$ protects the motor against prolonged direct-on-line (DOL) starts caused by, for example, a stalled rotor, too high inertia of the load or too low voltage. It measures the fundamental frequency component of the phase currents.

The $I_{ST}>$ stage can be configured for definite operate time or dependent operate time characteristic. For a weak voltage supply, the dependent characteristic is useful allowing more start time when a voltage drop decreases the start current and increases the start time. *Equation 19* defines the dependent operate time. *Figure 88* shows an example of the dependent characteristic.

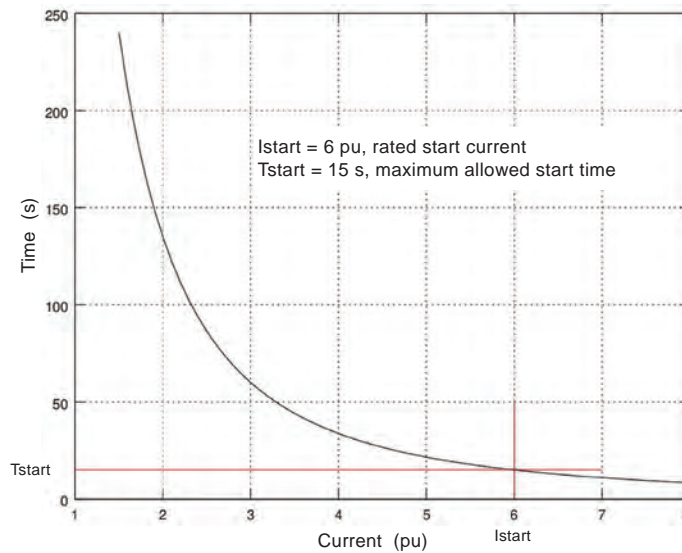Figure 88 - Example of a dependent operate time delay of the motor start-up supervision stage



If the measured current is less than the specified start current I_{START} , the operate time is longer than the specified start time T_{START} and vice versa.

Equation 19

$$T = \left(\frac{I_{START}}{I_{MEAS}} \right)^2 T_{START}$$

T = Dependent operate time

I_{START} = Rated start current of the motor “Nom motor start current I_{MOTST} . The default setting is $6.00 \times I_{MOT}$.”

I_{MEAS} = Measured current


T_{START} = Maximum allowed start time “Inv. time coefficient” $k >$ for the motor at rated voltage

The start setting “Motor start detection current” $I_{ST} >$ is the start detection level of the start current. When the current has been less than 10% of I_{MOT} and then

within 200 milliseconds exceeds the setting $I_{ST} >$, the motor start-up supervision stage starts to count the operate time T_{START} . When the current drops below $120\% \times I_{MOT}$, the motor start-up supervision stage releases. The motor start-up supervision is only active during the starting of the motor.

Block diagram

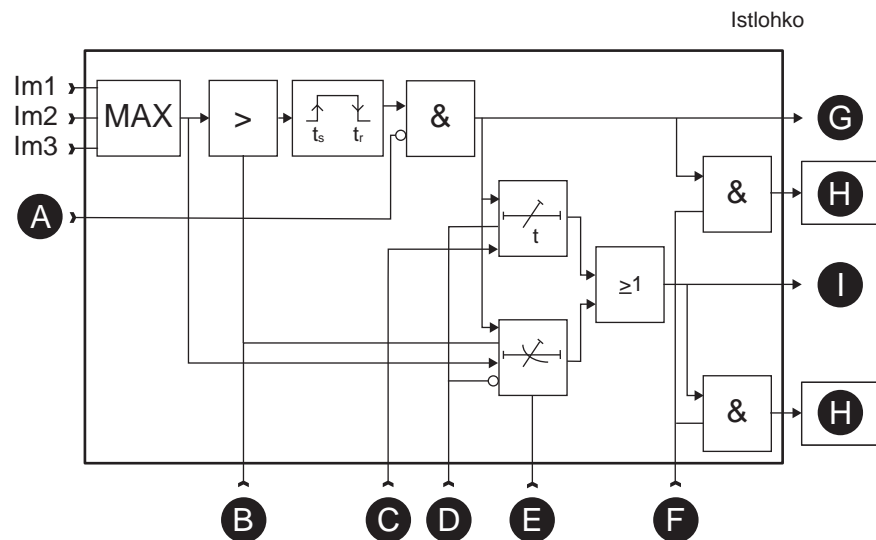Figure 89 - Block diagram of motor start-up supervision $I_{ST} >$



- | | |
|--------------------------------|-------------------|
| A. Block | F. Enable events |
| B. Motor nominal start current | G. Start |
| C. Delay | H. Register event |
| D. Definite / dependent time | I. Trip |
| E. Dependent delay | |

Motor status view

There are three possible statuses for a motor.

- Motor stopped: the motor average current is less than 10% of the motor nominal current (I_{MOT}).
- Motor starting: To reach the starting position, the motor has to be stopped for at least 500 ms before starting. The average motor current has to increase above the motor start detection current (setting value) within 200 ms. The motor remains starting as long as the terms for turning into running condition are not fulfilled.
- Motor running: The motor can change to the running position from both stopped and starting position. The low limit for motor running is 20% and the high limit 120% of I_{MOT} .

The motor status can be viewed via Easergy Pro software or via the device's front panel (Mstat). The starting and running statuses can be found on the output and block matrix. Therefore, it is possible to use these signals for tripping or indication and for blocking purposes.

Figure 90 - Motor status via Easergy Pro and local panel


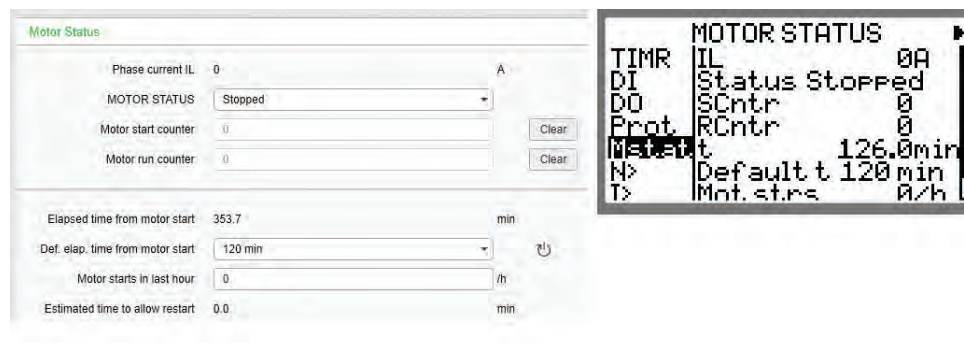


Figure 91 - Motor status in output and block matrix

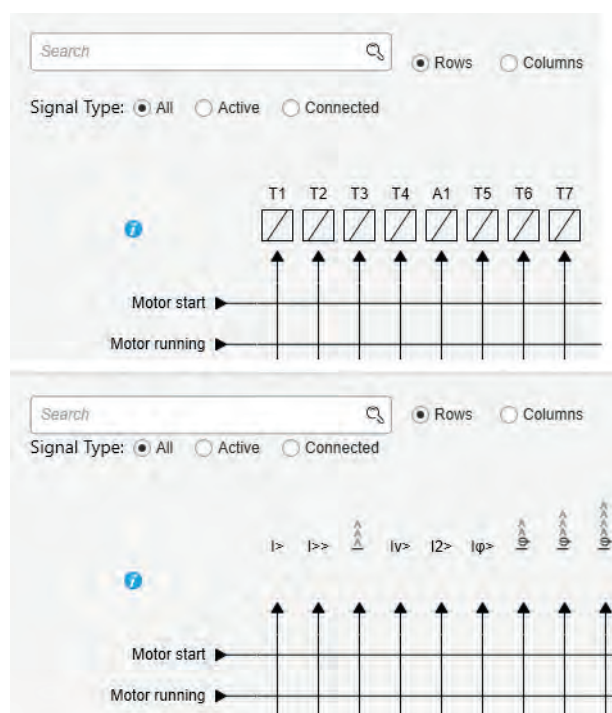


Normal starting sequence

The default value for the motor start detection is six times the motor nominal value. The motor current is

$$\frac{IL1+IL2+IL3}{3}$$

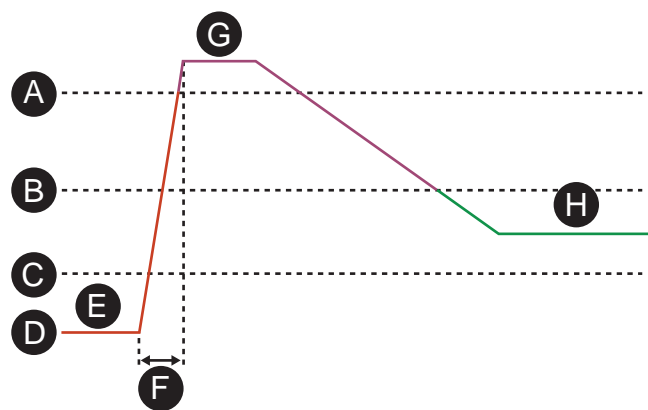Figure 92 - Normal starting sequence



- A. Motor start detection current
- B. Motor running high limit (120% of I_{MOT})
- C. Motor stopped limit (10% of I_{MOT})
- D. Motor current
- E. Stopped for 500 ms before starting
- F. Motor current exceeds the start detection current (200 ms)
- G. Starting
- H. Running


Soft start

Frequency converter drives and soft starter applications do not initiate the motor start signal because of the low current during motor start. The motor changes directly from stopped to running position when the current increases to a certain level.

The motor current is

$$\frac{IL1+IL2+IL3}{3}$$

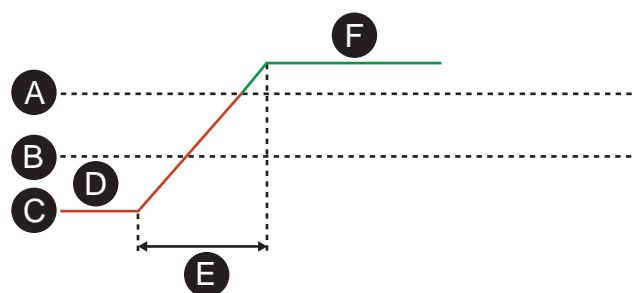Figure 93 - Soft starting sequence



- A. Motor running limit (20% of I_{MOT})
- B. Motor stopped limit (10% of I_{MOT})
- C. Motor current
- D. Stopped for 500 ms
- E. Motor current exceeds the motor running limit (200 ms)
- F. Running

Setting groups

This stage has one setting group.

Characteristics

Table 67 - Motor start-up supervision (48) in motor mode

Input signal	$I_{L1} - I_{L3}$
Setting range:	-
- Motor start detection current, I_{ST}	$1.30-10.00 \times I_{MOT}$ (step 0.01)
- Nominal motor start current, I_{MOTST}	$1.50-10.00 \times I_{MOT}$ (step 0.01)
Delay type	DT, INV
Definite time characteristic (DT):	-
- operate time	$1.0-300.0$ s (step 0.1) ⁴⁸⁾
Dependent time characteristic (INV):	-
- operate delay	$1.0-300.0$ s (step 0.1)
- dependent time coefficient, k	$1.0-200.0$ s (step 0.1)
Minimum motor stop time to activate motor start-up supervision	500 ms
Maximum current raise time from motor stop to start	200 ms
Motor stopped limit	$0.10 \times I_{MOT}$
Motor running lower limit	$0.20 \times I_{MOT}$
Motor running limit after starting	$1.20 \times I_{MOT}$
Start time	Typically 60 ms
Reset time	<95 ms
Reset ratio	<0.95
Inaccuracy:	-
- Starting	$\pm 3\%$ of the set value or 5 mA secondary
- Operate time at definite time function	$\pm 1\%$ or at ± 30 ms
- Operate time at IDMT function	$\pm 5\%$ or at least ± 30 ms

⁴⁸⁾ This is the instantaneous time i.e. the minimum total operational time including the fault detection time and operation time of the trip contacts.

NOTE: Motor stopped and running limits are based on the average of three phase currents.

6.14 Thermal overload (ANSI 49 RMS)

Description

The thermal overload function protects the motor against excessive heating.

Thermal model

The temperature is calculated using RMS values of phase currents and a thermal model according IEC60255-149. The RMS values are calculated using harmonic components up to the 15th.

Trip time:

$$t = \tau \cdot \ln \frac{I^2 - I_P^2}{I^2 - a^2}$$

Alarm (alarm 60% = 0.6):

$$a = k \cdot k_{\Theta} \cdot I_{MOT} \cdot \sqrt{alarm}$$

Trip:

$$a = k \cdot k_{\Theta} \cdot I_{MOT}$$

Reset time:

$$t = \tau \cdot C_r \cdot \ln \frac{I_P^2}{a^2 - I^2}$$

Trip release:

$$a = \sqrt{0.95} \times k \times I_{MOT}$$

Start release (alarm 60% = 0.6):

$$a = \sqrt{0.95} \times k \times I_{MOT} \times \sqrt{alarm}$$

T = Operate time

τ = Thermal time constant tau (setting value). Unit: minute

ln = Natural logarithm function

I = Measured RMS phase current (the max. value of three phase currents)

k = Overload factor (Maximum continuous current), i.e. service factor (setting value).

k_{Θ} = Ambient temperature factor (permitted current due to t_{amb}).

I_P = Preload current, $I_P = \sqrt{\theta} \times k \times I_{MOT}$ (If temperature rise is 120% $\rightarrow \theta = 1.2$). This parameter is the memory of the algorithm and corresponds to the actual temperature rise.

I_{MOT} = The rated current of the motor

C_r = Relay cooling time constant (setting value)

Time constant for cooling situation (ANSI 49M)

If the motor's fan is stopped, the cooling is slower than with an active fan. Therefore, there is a coefficient C_T for thermal constant available to be used as cooling time constant when the current is less than $0.3 \times I_{MOT}$.

Heat capacitance, service factor and ambient temperature

The trip level is determined by the maximum allowed continuous current I_{MAX} corresponding to the 100% temperature rise Θ_{TRIP} for example the heat capacitance of the motor. I_{MAX} depends on the given service factor k and ambient temperature Θ_{AMB} and settings I_{MAX40} and I_{MAX70} according to the following equation.


$$I_{MAX} = k \cdot k_{\Theta} \cdot I_{MOT}$$

The value of ambient temperature compensation factor k_{Θ} depends on the ambient temperature Θ_{AMB} and settings I_{MAX40} and I_{MAX70} . See [Figure 94](#).

Ambient temperature is not in use when $k_{\Theta} = 1$. This is true when

- I_{MAX40} is 1.0
- S_{amb} is "n/a" (no ambient temperature sensor)
- Θ_{AMB} is +40 °C.

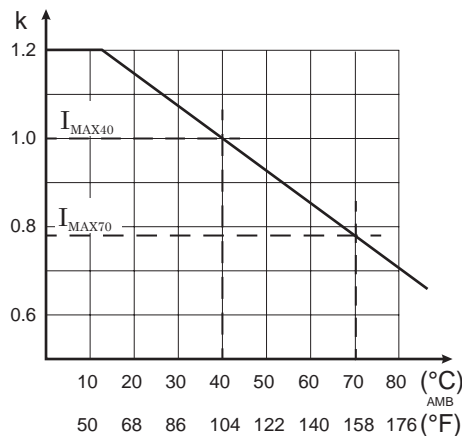Figure 94 - Ambient temperature correction of the overload stage T>



Example of the thermal model behavior

[Figure 94](#) shows an example of the thermal model behavior. In this example, $\tau = 30$ minutes, $k = 1.06$ and $k_{\Theta} = 1$ and the current has been zero for a long time and thus the initial temperature rise is 0%. At time = 50 minutes, the current changes to $0.85 \times I_{MOT}$ and the temperature rise starts to approach value $(0.85/1.06)^2 = 64\%$ according to the time constant. At time = 300 min, the temperature is nearly stable, and the current increases to 5% over the maximum defined by the rated current and the service factor k . The temperature rise starts to approach value 110%. At about 340 minutes, the temperature rise is 100% and a trip follows.


Initial temperature rise after restart

When the relay is switched on, an initial temperature rise of 70% is used. Depending on the actual current, the calculated temperature rise then starts to approach the final value.

Alarm function

The thermal overload stage is provided with a separately settable alarm function. When the alarm limit is reached, the stage activates its start signal.

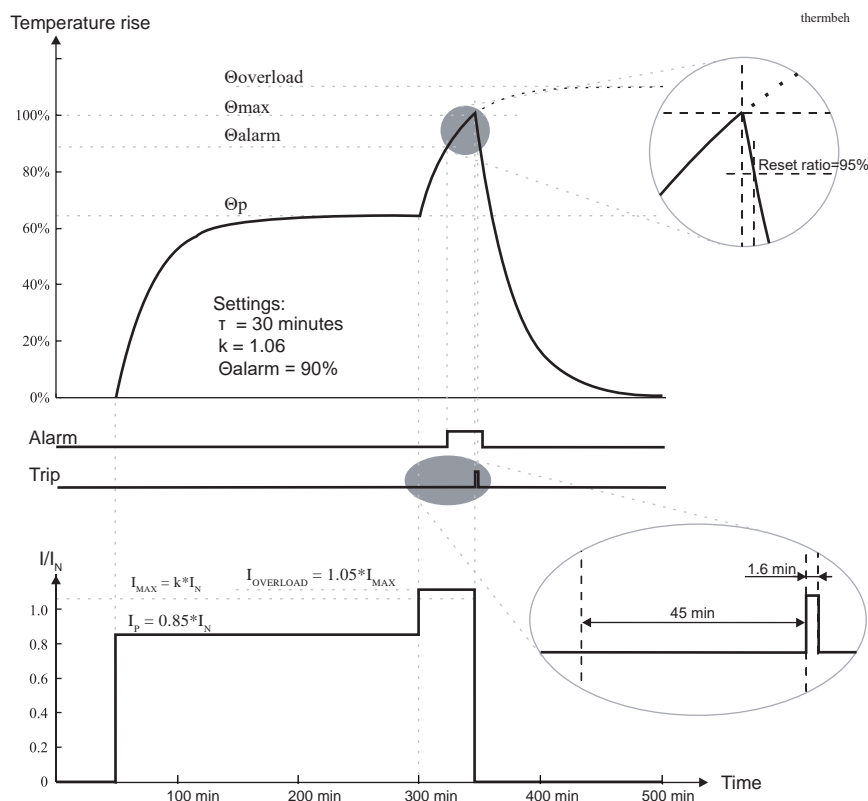Figure 95 - Example of the thermal model behavior



Setting groups

This stage has one setting group.

Characteristics

Table 68 - Thermal overload(49M)

Input signal	$I_{L1} - I_{L3}$
Maximum continuous current	$0.1-2.40 \times I_{MOT}$
Alarm setting range	60–99% (step 1%)
Time constant τ	2–180 min (step 1)
Cooling time coefficient	$1.0-10.0 \times \tau$ (step 0.1)
Max. overload at +40°C	$70-120 \% I_{MOT}$ (step 1)

Max. overload at +70°C	50–100 % I_{MOT} (step 1)
Ambient temperature	-55 – 125°C (step 1°)
Reset ratio (Start & trip)	0.95
Operate time inaccuracy	Relative inaccuracy $\pm 5\%$ or absolute inaccuracy 1 s of the theoretical value

6.15 Breaker failure (ANSI 50BF)

Description

The circuit breaker failure protection stage (CBFP) can be used to operate any upstream circuit breaker (CB) if the programmed output matrix signals, selected to control the main breaker, have not disappeared within a given time after the initial command. The supervised output contact is defined by the “Monitored Trip Relay” setting. An alternative output contact of the relay must be used for this backup control selected in the **Output matrix** setting view.


The CBFP operation is based on the supervision of the signal to the selected output contact and the time. The following output matrix signals, when programmed into use, start the CBFP function:

- protection functions
- control functions
- supporting functions
- GOOSE signals (through communication)

If the signal is longer than the CBFP stage’s operate time, the stage activates another output contact defined in the **Output matrix** setting view. The output contact remains activated until the signal resets. The CBFP stage supervises all the signals assigned to the same selected output contact.

In *Figure 96*, both the trip and CBFP start signals activate simultaneously (left picture). If $T >$ trip fails to control the CB through T1, the CBFP activates T3 after the breaker failure operate time.

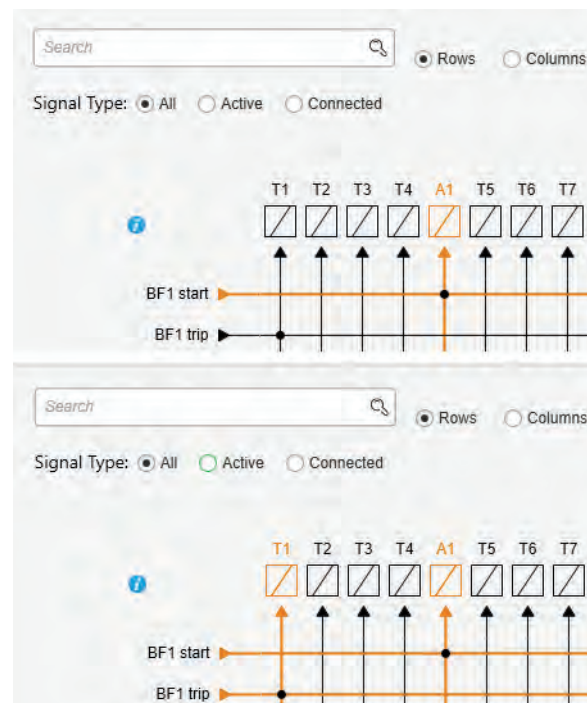Figure 96 - Trip and CBFP start signals in the **Output matrix** view



NOTE: For the CBFP, always select the “Connected” crossing symbol in the **Output matrix** setting view.

Characteristics

Table 69 - Breaker failure (50BF)

Relay to be supervised	T1–T4 (depending on the order code)
Definite time function: - Operate time	0.1–10.0 s (step 0.1 s)
Inaccuracy: - Operate time	±20 ms

6.16 Breaker failure 1 and 2 (ANSI 50BF)


Easergy P3 has two identical Breaker failure 1 (ANSI 50BF) and Breaker failure 2 (ANSI 50BF) stages.

Description

Power system protection should always have some sort of backup protection available. Backup protection is intended to operate when a power system fault is not cleared or an abnormal condition is not detected in the required time because of a failure or the inability of the primary protection to operate or failure of the appropriate circuit breakers to trip. Backup protection may be local or remote.

Circuit breaker failure protection (CBFP) is part of the local backup protection. CBFP provides a backup trip signal to an upstream circuit breaker (CB) when the CB nearest to fault fails to clear fault current. The CB may fail to operate for several reasons, for example burnt open coil or a flashover in the CB.

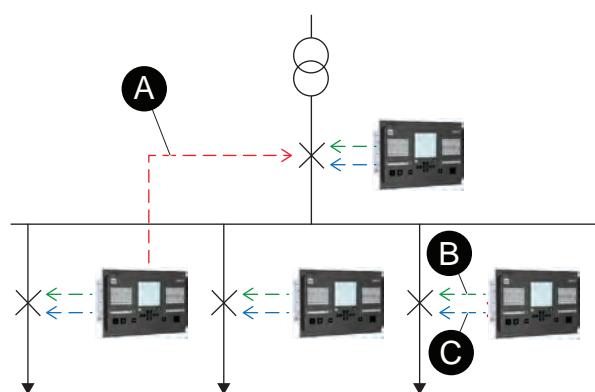Figure 97 - CBFP implementation




A. CBFP trip C. Re-trip
B. Normal trip

Two separate stages are provided to enable re-trip and CBFP trip commands. The first stage can be used to give re-trip command (for example to control second/backup open coil of the main CB) while the second stage can give dedicated CBFP trip command to an upstream circuit breaker. Select the required outputs for re-trip and CBFP trip through the output matrix.

Block diagram

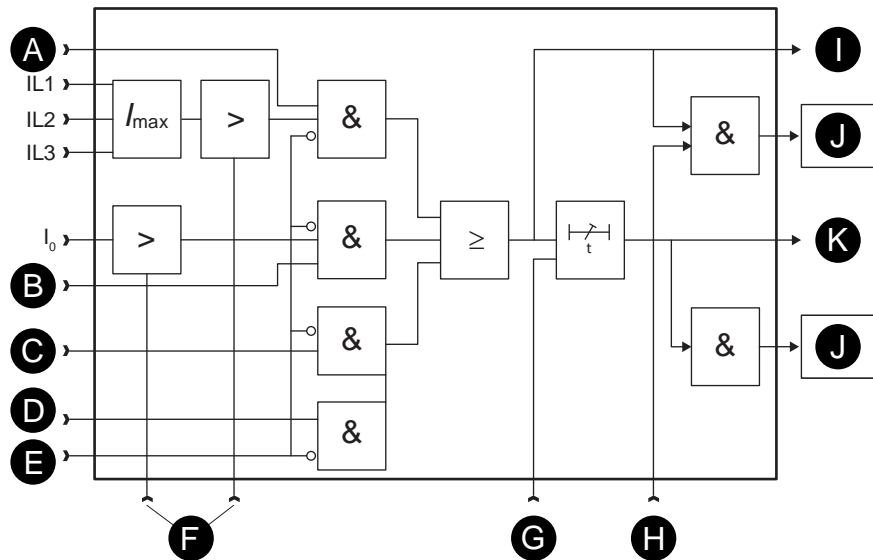Figure 98 - Breaker failure 2 operation



- | | |
|-------------------------|--------------------------|
| A. Condition 1 | G. Delay setting |
| B. Condition 2 | H. Enable events setting |
| C. Condition 3 | I. Start |
| D. Condition 4 | J. Event register |
| E. Block | K. Trip |
| F. Zero-current setting | |

CBFP operation

The CBFP function can be enabled and disabled with the **Enable for BF2** selection. The CBFP function activates when any of the selected start signals becomes and stays active.

The CBFP operation can be temporarily blocked by the stage block signal from the block matrix. When the stage is blocked by the block signal, the stage timer stops but it does not reset. The stage timer continues its operation when the block signal is disabled. When the block signal is active, the stage output signals are disabled.

The CBFP stage provides the following events:

- start on
- start off
- trip on
- trip off

Events can be activated via the **Enable events** setting view.


Condition selectors

The CBFP function has four condition selectors that can be used separately or all together to activate and reset the CBFP function.

The four condition selectors are almost identical. The only difference is that condition selectors 1 and 2 are for all protection functions that benefit from zero-current detection for resetting the CBFP as described in section *Zero-current detector*, and selectors 3 and 4 are for all the protection functions that do not benefit from zero-current detection for CBFP.

Condition selector 4 can be used to support selectors 1, 2 and 3. For example, if there are too many stages to be monitored in condition set 1, condition selector 4 can be used to monitor the output contacts. Monitoring digital inputs is also possible if the backup protection is based on external current relay, for example. The only CBFP reset criteria for condition set 4 are the monitored input and output signals.

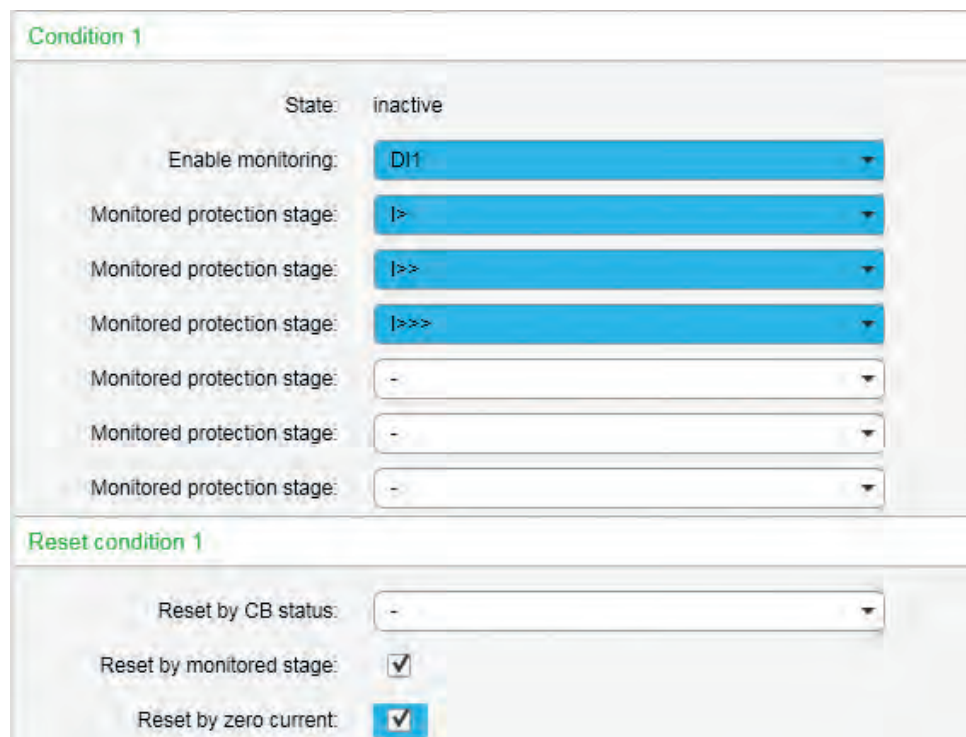Figure 99 - Start signal and reset condition setting view for Condition 1



Separate zero-current detection with dedicated start settings exists for phase overcurrent and earth fault overcurrent signals. Zero-current detection is independent of the protection stages.

The condition criteria, available signals and reset conditions are listed in [Table 70](#).

NOTE: The start signal can be selected for each condition in advance from the pull-down menu even if the concerned stage is not enabled. For the CBFP activation, the concerned stage must be enabled from the protection stage menu and the stage has to start to activate the CBFP start signal.

Table 70 - CBFP condition selectors

Criteria	Start signal	Reset condition
Condition 1	I>, I>>, I>>>, Iv>, I2>, dl>, dl>>, Iφ>, Iφ>>, Iφ>>>, Iφ>>>>, T>, If2>, X<, X<<, I'>, I'>>, If5, SOTF	Reset by CB status: DI1 – DIx (1, F1, F2, VI1-20, VO1–20, GOOSE_N11–64, POC1–16, Obj1-8Op
Condition 2	Io>, Io>>, Io>>>, Io>>>>, Io>>>>>, Ioφ>, Ioφ>>, Ioφ>>>, dIo>, dIo>>	Monitored stage: On/Off Zero-current detection: On/Off

Criteria	Start signal	Reset condition
Condition 3	Uof3<, U>, U>>, U>>>, U<, U<<, U<<<, U1<, U1<<, Uo>, Uo>>, P<, P<<, Q<, Z<, Z<<, Pgr1-8, f<, f<<, fx, fxx, df/dt, Uf>, Pslip	Reset by CB status: DI1 – DIx (1, F1, F2, VI1-20, VO1–20, GOOSE_NI1–64, POC1–16, Obj1-8Op Monitored stage: On/Off
Condition 4	Outputs: A1, T1-Tx (1) Inputs: DI1 – DIx (1, F1, F2, VI1-20, VO1 – 20, GOOSE_NI1 – 64, POC1 – 16 Arc sensor 3- 10, ArcStg1-8, I>int, Io>int	

In addition to the selection of the start signal, the CBFP reset condition needs to be selected.

If no reset conditions are selected, the stage uses **Reset by monitored stage** as the reset condition. This prevents a situation where the stage never releases.

The reset condition **Reset by CB status** is useful if the current is already zero when the CB is opened (for example unloaded CB).

When more than one selection criteria are selected, AND condition is used, for example “zero current detection” AND “object open”. See [Figure 98](#) for details.

Stage timer

The operate delay timer is started by a signal activated by the monitored stages (condition selectors). The operate time delay is a settable parameter. When the given time delay has elapsed, the stage provides a trip signal through the output matrix and the event codes.

The timer delay can be set between 40 and 200 ms.

Zero-current detector

The zero-current detector is an undercurrent condition to reset the CBFP function when all phase currents are below the start (pick-up) setting value. This separate undercurrent condition is needed to properly detect successful CB operation. For example, in a CB failure condition where one or more CB poles are partly conducting when the CB is open, the fault current can be small enough to reset the primary protection stage (for example overcurrent stage), in which case the CBFP does not operate. When a separate undercurrent limit is used, CBFP reset can be performed only when the fault current really is zero or near zero instead of relying on the protection stage reset.

Figure 100 - Zero-current detector setting view

Breaker failure 2 50BF

Enable for BF2:

Status: -

Start counter: 0 Clear

Trip counter: 0 Clear

Zero current detection

Max. of IL1 IL2 IL3: 0 A

Pick-up setting: 100 A

Pick-up setting:

0.10 xIn

Zero E-F current detection

Io1 residual current: 0.000 pu

Io input: Io1

Pick-up setting: 0.50 A

Pick-up setting:


0.050 pu

The setting range of the zero-current detector is always associated with the CT nominal value, even in case of motor and transformer protection. The setting range minimum depends on the relay accuracy. Instead of zero, a small minimum value can be accepted. See [Table 71](#).

CBFP coordination

The CBFP delay setting has to be coordinated according to the CB operation time and the reset time of protection stages monitored by the CBFP function as described in [Figure 101](#).

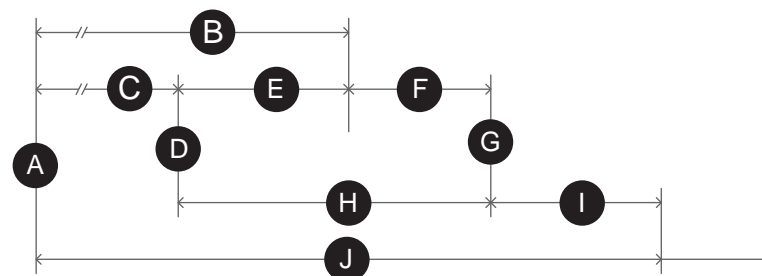Figure 101 - CBFP coordination



- | | |
|--|--|
| <p>A. Fault occurrence</p> <p>B. Normal fault clearing time</p> <p>C. Protection delay</p> <p>D. CBFP stage start</p> <p>E. CB operate time</p> | <p>F. Protection stage reset time + safety margin</p> <p>G. CBFP trip</p> <p>H. CBFP stage operate delay (CB operate time + protection stage reset time + safety margin)</p> <p>I. CB operate time</p> <p>J. Total fault clearing time in case of failed CB operation but successful CBFP operation</p> |
|--|--|

Characteristics

Table 71 - Breaker failure 2 (ANSI 50BF)


Zero-current detection: - Phase overcurrent - Earth fault overcurrent	$0.05-0.2 \times I_n$ 0.005–8.000 pu (when I_{01} or I_{02} measured with standard EF CT) (step 0.001) 0.050–8.000 pu (when I_{01} or I_{02} measured with CSH) (step 0.001) 0.005–20.000 pu (when $I_{0\text{ Calc}}$) (step 0.001)
Definite time function: - Operate time	0.04–0.2 s
Inaccuracy: - Operate time	± 20 ms

6.17 Switch-on-to-fault (ANSI 50HS)

Description

The switch-on-to-fault (SOTF) protection function offers fast protection when the circuit breaker (CB) is closed manually against a faulty line. Overcurrent-based protection does not clear the fault until the intended time delay has elapsed. SOTF gives a trip signal without additional time delay if the CB is closed and a fault is detected after closing the CB.

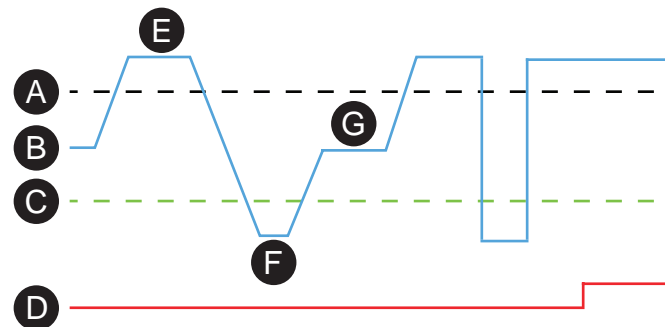Figure 102 - Switch-on-to-fault function operates when the CB has detected open and the fault current reaches start setting value



A. Start setting

B. Maximum of I_{L1} , I_{L2} , I_{L3}

C. Low limit $0.02 \times I_N$

D. SOTF trip

E. Switch-on-to-fault does not activate if the CB has not been in open position before the fault. Open CB detection is noticed from the highest phase current value which has to be under a fixed low-limit threshold ($0.02 \times I_N$). Opening of the CB can be detected also with digital inputs (Dead line detection input = DI1 – DIx, VI1 – VIx). The default detection input is based on the current threshold, so the dead line detection input parameter has value “-“.

F. Dead line detection delay defines how long the CB has to be open so that the SOTF function is active. If the set time delay is not fulfilled and the highest phase current value (maximum of I_{L1} , I_{L2} , I_{L3}) rises over the start setting, the SOTF does not operate.

G. If the highest phase current value of I_{L1} , I_{L2} , I_{L3} goes successfully under the low limit and rises to a value between the low limit and the start value, then if the highest phase current value rises over the start setting value before the set SOTF active after CB closure time delay has elapsed, the SOTF trips. If this time delay is exceeded, the SOTF does not trip even if the start setting value is exceeded.

Setting groups

This stage has one setting group.

Characteristics

Table 72 - Switch-on-to-fault SOTF (50HS)

Current input	IL or I'L
Start value	1.00–3.00 $\times I_N$ (step 0.01)
Dead line detection delay	0.00–60.00 s (step 0.01)
SOTF active after CB closure	0.10–60.00 s (step 0.01)

Operate time	< 30 ms (When I_M/I_{SET} ratio > 1.5)
Reset time	< 95 ms
Reset ratio	0.97
Inaccuracy	$\pm 3\%$ of the set value or 5 mA secondary

6.18 Phase overcurrent (ANSI 50/51)


Description

Phase overcurrent protection is used against short-circuit faults and heavy overloads.

The overcurrent function measures the fundamental frequency component of the phase currents. The protection is sensitive to the highest of the three phase currents. Whenever this value exceeds the user's start setting of a particular stage, this stage starts and a start signal is issued. If the fault situation remains on longer than the operation delay setting, a trip signal is issued.


Block diagram

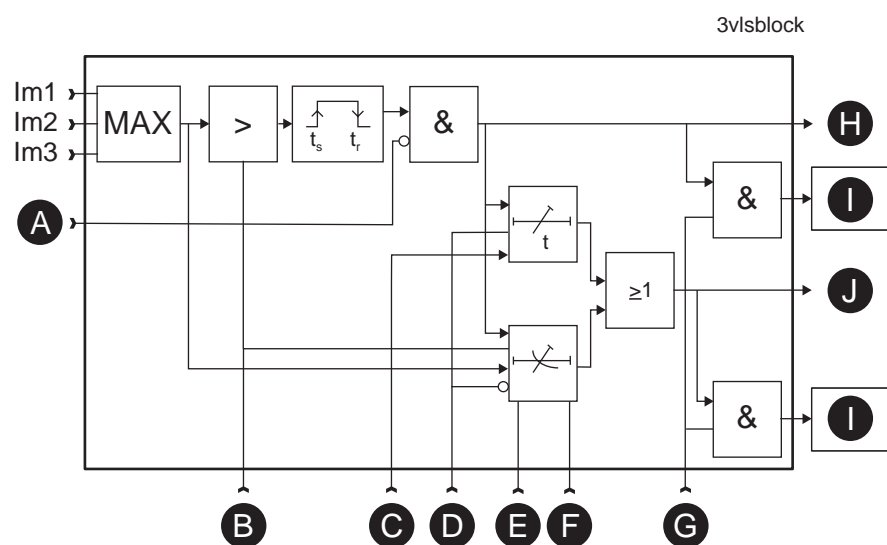Figure 103 - Block diagram of the three-phase overcurrent stage I>



- | | |
|-----------------------------------|-------------------|
| A. Block | F. Multiplier |
| B. Setting I>s | G. Enable events |
| C. Delay | H. Start |
| D. Definite / dependent time | I. Register event |
| E. Dependent time characteristics | J. Trip |

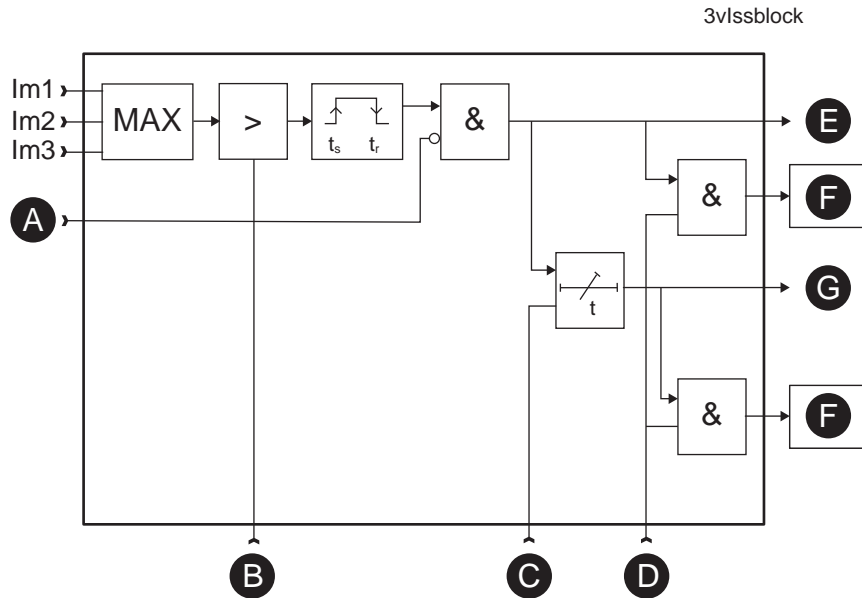Figure 104 - Block diagram of the three-phase overcurrent stage I>> and I>>>



- A. Block
- B. Setting I>>s
- C. Delay
- D. Enable events
- E. Start
- F. Register event
- G. Trip

Three independent stages

There are three separately adjustable overcurrent stages: I>, I>> and I>>>. The first stage I> can be configured for definite time (DT) or dependent operate time (IDMT) characteristic. The stages I>> and I>>> have definite time operation characteristic. By using the definite delay type and setting the delay to its minimum, an instantaneous (ANSI 50) operation is obtained.

Figure 103 shows a functional block diagram of the I> overcurrent stage with definite time and dependent time operate time. Figure 104 shows a functional block diagram of the I>> and I>>> overcurrent stages with definite time operation delay.

Dependent operate time

Dependent operate time means that the operate time depends on the amount the measured current exceeds the start setting. The bigger the fault current is, the faster is the operation. The dependent time delay types are described in 6.5 *Dependent operate time*. The relay shows the currently used dependent operate time curve graph on the local panel display.

Dependent time limitation

The maximum measured secondary current is $50 \times I_N$. This limits the scope of *dependent curves* with high start settings. See 6.5 *Dependent operate time* for more information.

Include harmonics setting

The I> and I>> (50/51) overcurrent protection stages have a setting parameter to include harmonics. When this setting is activated, the overcurrent stage

calculates the sum of the base frequency and all measured harmonics. This feature is used to determine the signal's true root mean square value to detect the signal's real heating factor. The operate time is 5 ms more when harmonics are included in the measurement. Activate the "Include harmonics" setting if the overcurrent protection is used for thermal protection and the content of the harmonics is known to exist in the power system.

Cold load and inrush current handling

See [7.3 Cold load start and magnetizing inrush](#).

Setting groups

There are four setting groups available for each stage.

Characteristics

Table 73 - Phase overcurrent stage I> (50/51)

Input signal	$I_{L1} - I_{L3}$
Start value	0.05–5.00 x I_{MOT} (step 0.01)
Definite time function: - Operate time	DT ⁴⁹⁾ 0.04–300.00 s (step 0.01 s)
IDMT function: - Delay curve family - Curve type - Inv. time coefficient k - RI curve	(DT), IEC, IEEE, RI Prg EI, VI, NI, LTI, MI..., depends on the family ⁵⁰⁾ 0.025–20.0 0.025–20.0
Start time	Typically 35 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio	0.97
Transient overreach, any τ	< 10%
Inaccuracy: - Starting - Operate time at definite time function - Operate time at IDMT function	$\pm 3\%$ of the set value or 5 mA secondary $\pm 1\%$ or ± 25 ms $\pm 5\%$ or at least ± 25 ms**

⁴⁹⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

⁵⁰⁾ EI = Extremely Inverse, NI = Normal Inverse, VI = Very Inverse, LTI = Long Time Inverse, MI = Moderately Inverse

Table 74 - Phase overcurrent stage I>> (50/51)

Input signal	$I_{L1} - I_{L3}$
Start value	0.10 – 20.00 x I_{MOT} (step 0.01)
Definite time function: - Operate time	DT ⁵¹⁾ 0.04 – 1800.00 s (step 0.01 s)
Start time	Typically 35 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio	0.97
Transient overreach, any τ	< 10%
Inaccuracy: - Starting - operate time	$\pm 3\%$ of the set value or 5 mA secondary $\pm 1\%$ or ± 25 ms

⁵¹⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

Table 75 - Phase overcurrent stage I>>> (50/51)

Input signal	$I_{L1} - I_{L3}$
Start value	0.10–40.00 x I_{MOT} (step 0.01)
Definite time function: - Operate time	DT ⁵²⁾ 0.03–300.00 s (step 0.01 s)
Instant operate time: I_M / I_{SET} ratio > 1.5 I_M / I_{SET} ratio 1.03 – 1.5	<30 ms < 50 ms
Start time	Typically 20 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio	0.97
Inaccuracy: - Starting - Operate time DT (I_M/I_{SET} ratio > 1.5) - Operate time DT (I_M/I_{SET} ratio 1.03 – 1.5)	$\pm 3\%$ of the set value or 5 mA secondary $\pm 1\%$ or ± 15 ms $\pm 1\%$ or ± 25 ms

⁵²⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

6.19 Earth fault overcurrent (ANSI 50N/51N)


Description

The purpose of the nondirectional earth fault overcurrent protection is to detect earth faults in low-impedance earthed networks. In high-impedance earthed networks, compensated networks and isolated networks, nondirectional earth fault overcurrent can be used as backup protection.

The nondirectional earth fault overcurrent function is sensitive to the fundamental frequency component of the earth fault overcurrent $3I_0$. The attenuation of the third harmonic is more than 60 dB. Whenever this fundamental value exceeds the start setting of a particular stage, this stage starts and a start signal is issued. If the fault situation remains on longer than the operate time delay setting, a trip signal is issued.


Block diagram

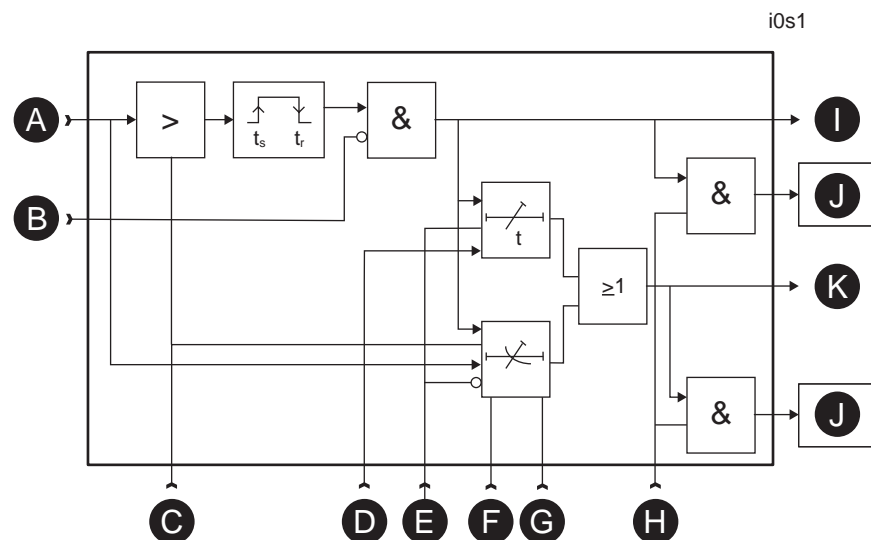Figure 105 - Block diagram of the earth fault stage overcurrent $I_0 >$



- | | |
|---------------------------------|-------------------|
| A. I_0 | G. Multiplier |
| B. Block | H. Enable events |
| C. Setting $I_0 > s$ | I. Start |
| D. Delay | J. Register event |
| E. Definite / inverse time | K. Trip |
| F. Inverse time characteristics | |

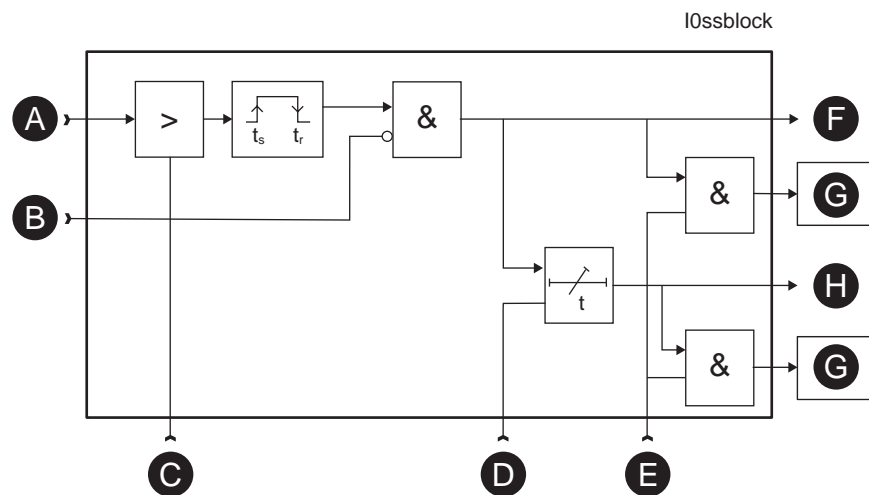Figure 106 - Block diagram of the earth fault stages overcurrent $I_0>>$, $I_0>>>$, $I_0>>>>$



- A. I_0
- B. Block
- C. Setting $I_0>>s$
- D. Delay
- E. Enable events
- F. Start
- G. Register event
- H. Trip

Input signal selection

Each stage can be connected to supervise any of the following inputs and signals:

- Input I_{01} for all networks other than solidly earthed.
- Input I_{02} for all networks other than solidly earthed.
- Calculated signal $I_{0\text{ Calc}}$ for solidly and low-impedance earthed networks.. I_0

$$\text{Calc} = I_{L1} + I_{L2} + I_{L3}$$

Four or six independent nondirectional earth fault overcurrent stages

There are four separately adjustable earth fault overcurrent stages: $I_0>$, $I_0>>$, $I_0>>>$, and $I_0>>>>$. The first stage $I_0>$ can be configured for definite time (DT) or dependent time operation characteristic (IDMT). The other stages have definite time operation characteristic. By using the definite delay type and setting the delay to its minimum, an instantaneous (ANSI 50N) operation is obtained.

Using the directional earth fault overcurrent stages ([6.27 Directional earth fault overcurrent \(ANSI 67N\)](#)) in nondirectional mode, three more stages with dependent operate time delay are available for nondirectional earth fault overcurrent protection.

Dependent time limitation

The maximum measured secondary earth fault overcurrent is $10 \times I_{0N}$ and the maximum measured phase current is $50 \times I_N$. This limits the scope of dependent curves with high start settings.

Setting groups

There are four setting groups available for each stage.

Characteristics

Table 76 - Earth fault overcurrent $I_0 >$ (50N/51N)

Input signal	I_{01}, I_{02} $I_{0 \text{ Calc}} = (I_{L1} + I_{L2} + I_{L3})$
Start value	0.005–8.000 pu (when I_{01} or I_{02} measured with standard EF CT) (step 0.001) 0.050–8.000 pu (when I_{01} or I_{02} measured with CSH) (step 0.001) 0.005–20.000 pu (when $I_{0 \text{ Calc}}$) (step 0.001)
Definite time function: - Operate time	DT ⁵³⁾ 0.04 ⁵³⁾ –300.00 s (step 0.01 s)
IDMT function: - Delay curve family - Curve type - Inv. time coefficient k	(DT), IEC, IEEE, RI Prg EI, VI, NI, LTI, MI..., depends on the family ⁵⁴⁾ 0.025–20.0, except 0.50–20.0 for RXIDG, IEEE and IEEE2
Start time	Typically 45 ms
Reset time	< 95 ms
Reset ratio	0.95
Inaccuracy: - Starting - Starting (Peak mode) - Operate time at definite time function - Operate time at IDMT function	$\pm 2\%$ of the set value or $\pm 0.3\%$ of the rated value $\pm 5\%$ of the set value or $\pm 2\%$ of the rated value (Sine wave <65 Hz) $\pm 1\%$ or ± 25 ms $\pm 5\%$ or at least ± 25 ms ⁵³⁾

⁵³⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

⁵⁴⁾ EI = Extremely Inverse, NI = Normal Inverse, VI = Very Inverse, LTI = Long Time Inverse, MI= Moderately Inverse

Table 77 - Earth fault overcurrent $I_{0>>}$, $I_{0>>>}$, $I_{0>>>>}$, $I_{0>>>>>}$ (50N/51N)

Input signal	I_{01} , I_{02} $I_{0\text{ Calc}} = (I_{L1} + I_{L2} + I_{L3})$
Start value	0.01-8.00 pu (when I_{01} or I_{02} measured with standard EF CT) (step 0.01) 0.05-8.00 pu (when I_{01} or I_{02} measured with CSH) (step 0.01) 0.01-20.00 pu (when $I_{0\text{ Calc}}$) (step 0.01)
Definite time function: - Operate time	0.04 ⁵⁵⁾ – 300.00 s (step 0.01 s)
Start time	Typically 45 ms ($I_{0>>}$, $I_{0>>>}$, $I_{0>>>>}$) and 30 ms ($I_{0>>>>>}$)
Reset time	<95 ms
Reset ratio	0.95
Inaccuracy: - Starting - Starting (Peak mode) - Operate time	$\pm 2\%$ of the set value or $\pm 0.3\%$ of the rated value $\pm 5\%$ of the set value or $\pm 2\%$ of the rated value (Sine wave <65 Hz) $\pm 1\%$ or ± 25 ms

⁵⁵⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

6.19.1 Earth fault faulty phase detection algorithm

The earth fault overcurrent stage (ANSI 50N/51N) and directional earth fault overcurrent stage (ANSI 67N) have an inbuilt detection algorithm to detect a faulty phase. This algorithm is meant to be used in radial-operated distribution networks. The faulty phase detection can be used in solidly-earthed, impedance-earthed or resonant-earthed networks.

Operation

The faulty phase detection starts from the earth fault stage trip. At the moment of stage start, the phase currents measured prior to start are registered and stored as prior-to-fault currents. At the moment of trip, phase currents are registered again. Finally, faulty phase detection algorithm is performed by comparing prior-to-fault currents to fault currents. The algorithm also uses positive sequence current and negative sequence current to detect faulty phase.

The detection algorithm can be enabled and disabled by selecting or unselecting a checkbox in the protection stage settings. Correct network earthing configuration must be selected in the stage settings, too. In the earth fault overcurrent stage settings, you can select between RES and CAP network

earthing configuration. This selection has no effect on the protection itself, only on the faulty phase detection. In the directional earth fault overcurrent stage settings, the detection algorithm uses the same network earthing type as selected for protection. RES is used for solidly-earthed, impedance-earthed and resonant-earthed networks. CAP is only used for isolated networks.

The detected faulty phase is registered in the protection stage fault log (and also in the event list and alarm screen). Faulty phase is also indicated by a line alarm and line fault signals in the output matrix.

Possible detections of faulty phases are L1-N, L2-N, L3-N, L1-L2-N, L1-L3-N, L2-L3-N, L1-L2-L3-N, and REV. If the relay protection coordination is incorrect, REV indication is given in case of a relay sympathetic trip to a reverse fault.

6.20 Capacitor bank unbalance (ANSI 51C)

NOTE: Configure the capacitor bank unbalance protection through the earth fault overcurrent stages $I_0>>>$ and $I_0>>>>$.

Description

The relay enables capacitor, filter and reactor bank protection with its five current measurement inputs. The fifth input is typically useful for unbalance current measurement of a double-wye connected unearthed bank.


The relay enables capacitor, filter and reactor bank protection with its five current measurement inputs. The fifth input is typically useful for unbalance current measurement of a double-wye connected ungrounded bank.

The unbalance protection is highly sensitive to internal faults of a bank because of the sophisticated natural unbalance compensation. The location method enables easy maintenance monitoring for a bank.

This protection scheme is specially used in double-wye-connected capacitor banks. The unbalance current is measured with a dedicated current transformer (like 5A/5A) between two starpoints of the bank.

As the capacitor elements are not identical and have acceptable tolerances, there is a natural unbalance current between the starpoints of the capacitor banks. This natural unbalance current can be compensated to tune the protection sensitive against real faults inside the capacitor banks.

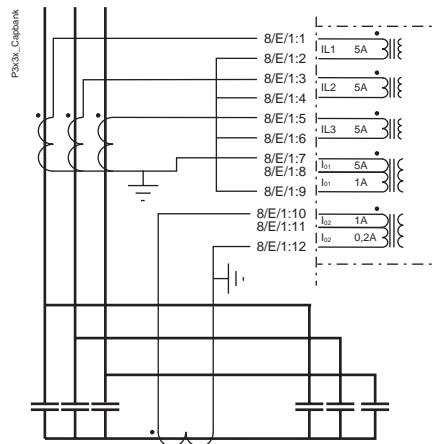Figure 107 - Typical capacitor bank protection application with Easergy P3 relays



Compensation method

The method of unbalance protection is to compensate for the natural unbalance current. The compensation is triggered manually when commissioning. The phasors of the unbalance current and one phase current are then recorded. This is because one polarizing measurement is needed. When the phasor of the unbalance current is always related to I_{L1} , the frequency changes or deviations have no effect on the protection. After the recording, the measured unbalance current corresponds to the zero-level and therefore, the setting of the stage can be very sensitive.

Compensation and location

The most sophisticated method is to use the compensation method described above with an add-on feature that locates the branch of each faulty element (the broken fuse).

This feature is implemented to the stage $I_{0>>>>}$, while the other stage $I_{0>>>}$ can still function as normal unbalance protection stage with the compensation method. Normally, the $I_{0>>>>}$ could be set as an alarming stage while stage $I_{0>>>}$ trips the circuit breaker.

The stage $I_{0>>>>}$ should be set based on the calculated unbalance current change of one faulty element. You can calculate this using the following formula:

Equation 20


$$3I_0 = \frac{\frac{U_{L-N}}{(2 \cdot \pi \cdot f \cdot C_1)^{-1}} - \frac{U_{L-N}}{(2 \cdot \pi \cdot f \cdot C_2)^{-1}}}{3}$$

C_1 = Capacitor unit capacitance (μF)

C_2 = Capacitor unit capacitance, after one element fails (μF)

However, the setting must be 10% smaller than the calculated value, since there are some tolerances in the primary equipment as well as in the relay measurement circuit. Then, the time setting of $I_{0>>>>}$ is not used for tripping purposes. The time setting specifies, how long the relay must wait until it is certain that there is a faulty element in the bank. After this time has elapsed, the stage $I_{0>>>>}$ makes a new compensation automatically, and the measured unbalance current for this stage is now zero. Note, the automatic compensation does not affect the measured unbalance current of stage $I_{0>>>}$.

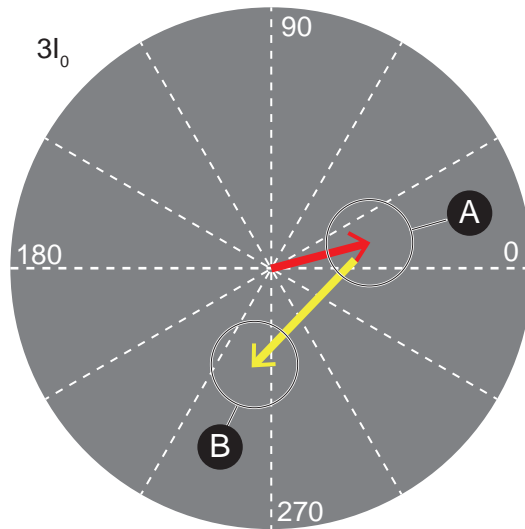
Figure 108 - Natural unbalance compensation and a single capacitor fault



- A. The natural unbalance is compensated for.
- B. When the I_0 current increases above the set start value (normally 90% of a single capacitor unit) according to the angle ratio between I_0 and I_{L1} , it is decided in which branch and phase the fault occurred. The fault is memorised and compensation is completed automatically. After the set amount of faults, the stage trips.

If there is an element failure in the bank, the algorithm checks the phase angle of the unbalance current related to the phase angle of the phase current I_{L1} . Based on this angle, the algorithm can increase the corresponding faulty elements counter (there are six counters).

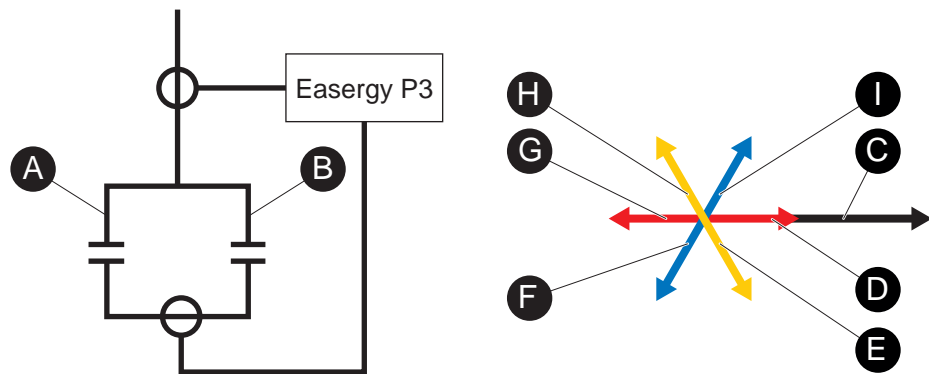Figure 109 - How a failure in different branches of the bank affects the I_0 measurement



- A. Branch 1
- B. Branch 2
- C. I_{L1} as reference
- D. Phase 1 fault in branch 1
- E. Phase 3 fault in branch 2
- F. Phase 2 fault in branch 1
- G. Phase 1 fault in branch 2
- H. Phase 3 fault in branch 1
- I. Phase 2 fault in branch 2


You can set for the stage $I_0 >>>>$ the allowed number of faulty elements. For example, if set to three elements, the fourth fault element will issue the trip signal.

The fault location is used with internal fused capacitor and filter banks. There is no need to use it with fuseless or external fused capacitor and filter banks, nor with the reactor banks.

Application example

An application example is presented below. Each capacitor unit has 12 elements in parallel and four elements in series.

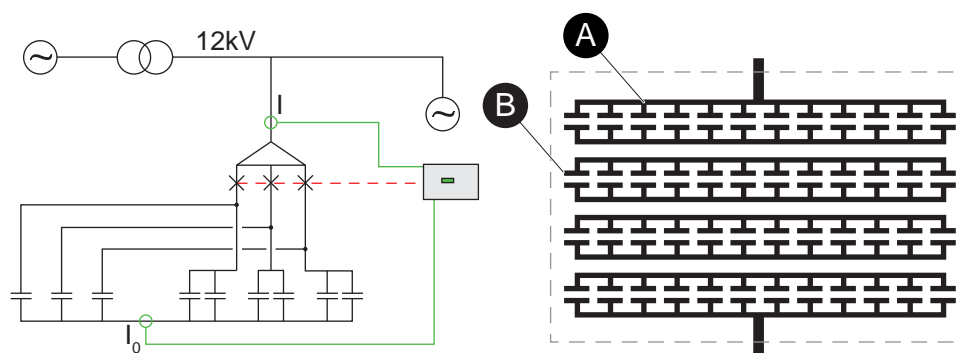Figure 110 - 131.43 μF Y-Y connected capacitor bank with internal fuses



A. 12 in parallel B. Four in series

Characteristics


Table 78 - Capacitor bank unbalance $I_0 \gg \gg$ and $I_0 \gg \gg \gg$ (51C)

Start value	0.01-8.00 pu (when I_{01} or I_{02} measured with standard EF CT) (step 0.01) 0.05-8.00 pu (when I_{01} or I_{02} measured with CSH) (step 0.01) 0.01-20.00 pu (when $I_0 \text{ Calc}$) (step 0.01)
Operate time	0.04-300 s (step 0.01)
Start time	Typically 30 ms
Reset time	<95 ms
Reset ratio	0.95
Inaccuracy: - Starting - Operate time	$\pm 2\%$ of the set value or $\pm 0.3\%$ of the rated value $\pm 1\%$ or ± 25 ms

6.20.1 Taking unbalance protection into use


- To enable the capacitor bank protection:
 - in Easergy Pro, in the **Protection > $I_0 \gg \gg \gg$ Unbalance** setting view, select **Location** for **Compensation mode**.

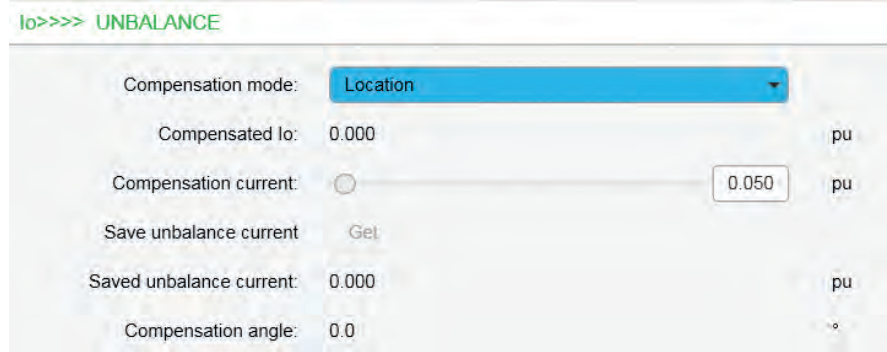Figure 111 - Enabling unbalance protection



- via the Easergy P3 device's front panel: go to the **I₀>>>>** menu, scroll right to **1 SET 50N/51N**, and select **Location** for **CMode**.
2. To save the natural unbalance:
- in Easergy Pro, in the **Protection > I₀>>>> Unbalance** setting view, select **Get** for **Save unbalance current**.

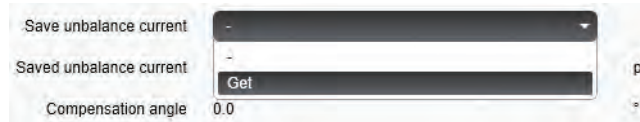Figure 112 - Saving the unbalance current



- via the device's front panel: go to the **I₀>>>>** menu, scroll right to **SET2 50N/51N**, and select **Get** for **SaveBal**.

NOTE: CMode has to be selected as **Location** before proceeding to this step.

3. Set the start value for both branches.
- Total capacitance of the bank is 131.43 µF. In each phase, there are three capacitor units (1+2), so the capacitance of one unit is 43.81 µF. Failure of one element inside the capacitor unit makes the total capacitance decrease to 41.92 µF (Ohm's law). This value is important when calculating the start value.

Equation 21

$$3I_0 = \frac{U_{L-N}}{(2 \cdot \pi \cdot f \cdot C_1)^{-1}} - \frac{U_{L-N}}{(2 \cdot \pi \cdot f \cdot C_2)^{-1}}$$

$$3I_0 = \frac{6928}{(2 \cdot \pi \cdot 50 \cdot 43.81 \cdot 10^{-6})^{-1}} - \frac{6928}{(2 \cdot \pi \cdot 50 \cdot 43.81 \cdot 10^{-6})^{-1}}$$


$$3I_0 = 1.37A$$

Failure of one element inside the bank on the left branch causes approximately 1.37 ampere unbalance current at the star point. On the right branch, there are two capacitor units in parallel, and therefore, a failure of one

element causes only 0.69 ampere unbalance. A different start value for each branch is necessary. Set the start value to 80% of the calculated value.

4. Test the operation of the unbalance protection.

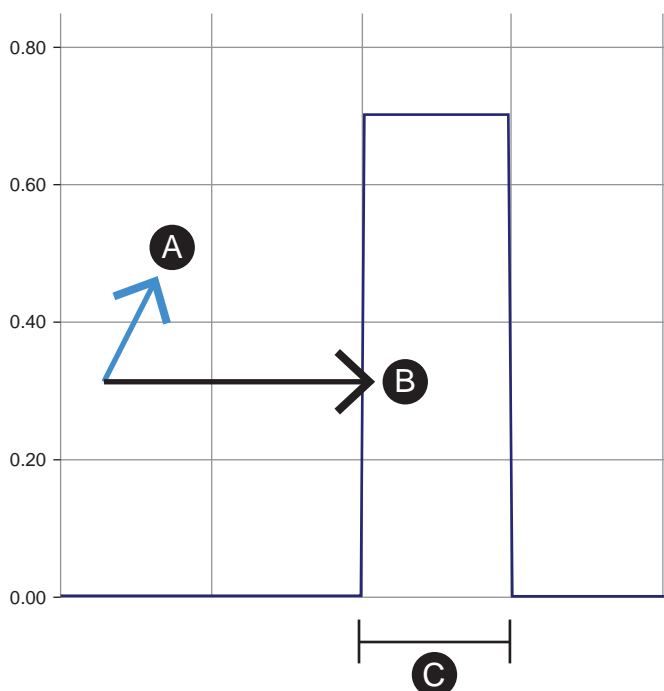Figure 113 - Testing the operation of the unbalance protection




- A. Phase 2 fault in branch 2 C. Set operation delay
 B. I_{L1} as reference

Conduct testing by injecting current to channels I_{L1} and I_{01} of the device. In the example above, 0.69 A primary current is injected to the I_{01} channel. I_{01} is leading the phase current I_{L1} by 60 degrees. This means the fault has to be on the right branch and in phase 2. Compensation happens automatically after the set operate time until the allowed total amount of failed units is exceeded (Max. allowed faults). In this application, the fourth failed element would cause the stage to trip.

NOTE: If branch 1 faults occur in branch 2, change the polarity of the I_0 input. Clear the location counters when the commissioning of the relay has been completed.

5. Clear the location counters by clicking the **Clear** button.

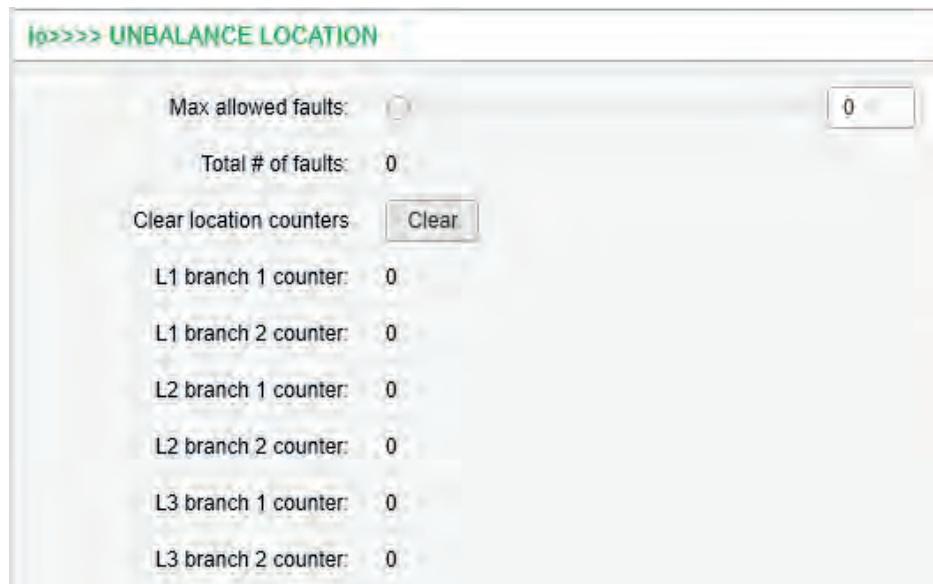Figure 114 - Clearing location counters



The screenshot displays a configuration window titled "UNBALANCE LOCATION". At the top, there is a green header with the text "ip>>> UNBALANCE LOCATION". Below the header, the following settings are visible:

- Max allowed faults: 0 (indicated by a slider and a text box containing "0")
- Total # of faults: 0
- Clear location counters: A button labeled "Clear"
- L1 branch 1 counter: 0
- L1 branch 2 counter: 0
- L2 branch 1 counter: 0
- L2 branch 2 counter: 0
- L3 branch 1 counter: 0
- L3 branch 2 counter: 0

6.21 Locked rotor (ANSI 51LR)

Description

The locked rotor protection stage I_{lr} measures the fundamental frequency component of the phase currents and calculates the average of the measured three phase currents (= phase current I_L).

The locked rotor stage protects the motor when too heavy load or a mechanical failure of the motor causes rotor jam during the motor running condition.

The stage's start setting is relative to the motor's nominal starting current. The nominal starting current can be configured in the Motor start-up supervision stage (ANSI 48).

The locked rotor stage can be configured for definite time or dependent time operation characteristic. [Equation 22](#) defines the dependent operate time.

Equation 22

$$T = \left(\frac{I_{START}}{I_{MEAS}} \right)^2 k$$

T = Dependent operate time

I_{START} = Nominal motor starting current


I_{MEAS} = Average of measured phase currents during fault

k = Dependent time coefficient

When the calculated average phase current I_L exceeds the defined start setting, the locked rotor protection stage starts operation delay calculation. The stage releases when the average phase current I_L drops below the start setting. The stage operation is automatically blocked when the motor status is "starting". For details of the criteria for motor status, see [Motor status view](#).

Block diagram

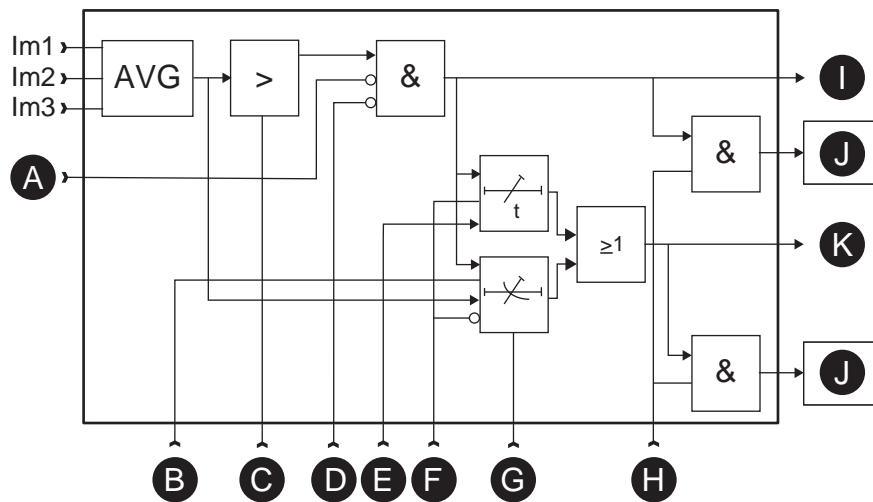Figure 115 - Block diagram of the locked rotor protection stage $I_{lr}>$



- A. Block
- B. Motor nominal start current
- C. Start setting $I_{lr}>$
- D. Motor starting
- E. Delay
- F. Definite / inverse time
- G. Inverse delay
- H. Enable events
- I. Start
- J. Register event
- K. Trip

Setting groups

This stage has one setting group.

Characteristics

Table 79 - Locked rotor (51LR) in motor mode

Start value	10 – 100 % I_{MOTSt} (step 0.1%)
Delay type	DT, INV
Definite time characteristic (DT): - Operate time	- 1.0 – 300.0 s (step 0.1) ⁵⁶⁾
Dependent time characteristic (INV): - Dependent time coefficient, k	- 1.0 – 200.0 s (step 0.1)
Start time	Typically 60 ms
Reset time	<95 ms

Reset ratio	<0.95
Inaccuracy:	-
- Starting	±3% of the set value or 5 mA secondary
- Operate time at definite time function	±1% or at ±30 ms
- Operate time at IDMT function	±5% or at least ±30 ms

⁵⁶⁾ This is the instantaneous time i.e. the minimum total operational time including the fault detection time and operation time of the trip contacts.

6.22 Overvoltage (ANSI 59)

Description

Overvoltage protection is used to detect too high system voltages or to check that there is sufficient voltage to authorize a source transfer.

The overvoltage function measures the fundamental frequency component of the line-to-line voltages regardless of the voltage measurement mode (see [10.8 Voltage measurement modes](#)). By using line-to-line voltages any line-to-neutral over-voltages during earth faults have no effect. (The earth fault protection functions take care of earth faults.) Whenever any of these three line-to-line voltages exceeds the start setting of a particular stage, this stage starts and a start signal is issued. If the fault situation remains on longer than the operate time delay setting, a trip signal is issued.

In solidly earthed, four-wire networks with loads between phase and neutral voltages, overvoltage protection may be needed for line-to-neutral voltages, too. In such applications, the programmable stages can be used. [6.35 Programmable stages \(ANSI 99\)](#).

Three independent stages

There are three separately adjustable stages: U>, U>> and U>>>. All the stages can be configured for the definite time (DT) operation characteristic.

Configurable release delay


The U> stage has a settable reset delay that enables detecting intermittent faults. This means that the time counter of the protection function does not reset immediately after the fault is cleared, but resets after the release delay has elapsed. If the fault appears again before the release delay time has elapsed, the delay counter continues from the previous value. This means that the function eventually trips if faults are occurring often enough.

Configurable hysteresis

The dead band is 3% by default. This means that an overvoltage fault is regarded as a fault until the voltage drops below 97% of the start setting. In a sensitive alarm application, a smaller hysteresis is needed. For example, if the start setting is about only 2% above the normal voltage level, the hysteresis must be less than 2%. Otherwise, the stage does not release after fault.

Block diagram

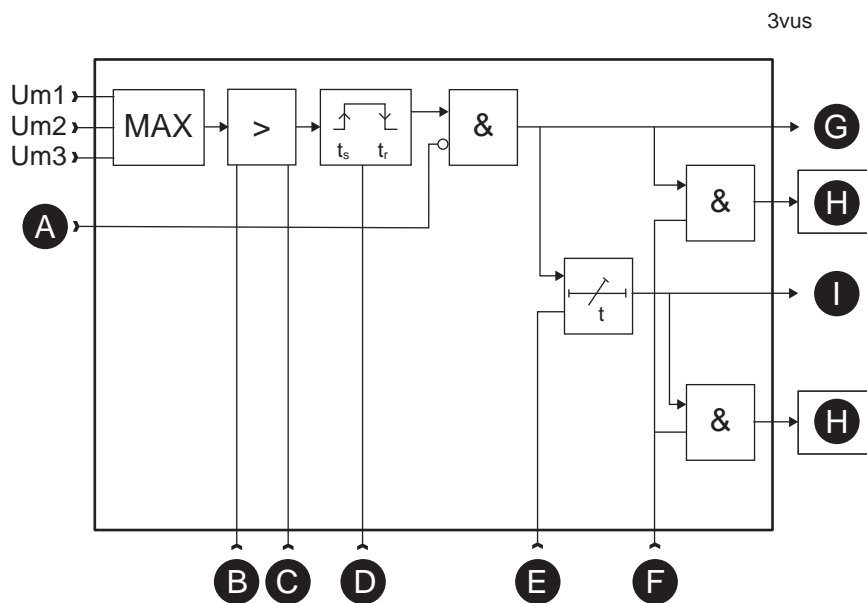Figure 116 - Block diagram of the three-phase overvoltage stages U>, U>> and U>>>



- A. Blocking
- B. Setting U>s
- C. Hysteresis
- D. Release delay
- E. Delay
- F. Enable events
- G. Start
- H. Event register
- I. Trip

Setting groups

There are four setting groups available for each stage.

Characteristics

Table 80 - Overvoltage stage U> (59)

Input signal	$U_{L1} - U_{L3}$
Start value	50–150% U_N (step 1%)
Definite time characteristic: - operate time	0.08 ⁵⁷ – 300.00 s (step 0.02)
Hysteresis	0.99–0.800 (0.1 – 20.0%, step 0.1%)
Start time	Typically 60 ms
Release delay	0.06–300.00 s (step 0.02)
Reset time	< 95 ms

Overshoot time	< 50 ms
Inaccuracy:	
- Starting	±3% of the set value
- operate time	±1% or ±30 ms

⁵⁷⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

Table 81 - Overvoltage stage U>> (59)

Input signal	$U_{L1} - U_{L3}$
Start value	50–150% U_N (step 1%) The measurement range is up to 160 V. This limit is the maximum usable setting when rated VT secondary is more than 100 V.
Definite time characteristic:	
- Operate time	0.06 ⁵⁸⁾ – 300.00 s (step 0.02)
Hysteresis	0.99–0.800 (0.1–20.0%, step 0.1%)
Start time	Typically 60 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Inaccuracy:	
- Starting	±3% of the set value
- Operate time	±1% or ±30 ms

⁵⁸⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

Table 82 - Overvoltage stage U>>> (59)

Input signal	$U_{L1} - U_{L3}$
Start value	50–160% U_N (step 1%) The measurement range is up to 160 V. This limit is the maximum usable setting when rated VT secondary is more than 100 V.
Definite time characteristic:	
- Operate time	0.04 ⁵⁹⁾ – 300.00 s (step 0.01)
Hysteresis	0.99–0.800 (0.1–20.0%, step 0.1%)
Start time	Typically 50 ms

Reset time	< 95 ms
Overshoot time	< 50 ms
Inaccuracy: - Starting - Operate time	$\pm 3\%$ of the set value $\pm 1\%$ or ± 25 ms

⁵⁹⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

6.23 Neutral voltage displacement (ANSI 59N)

Description

The neutral voltage displacement protection is used as unselective backup for earth faults and also for selective earth fault protections for motors having a unit transformer between the motor and the busbar.

This function is sensitive to the fundamental frequency component of the neutral voltage displacement voltage. The attenuation of the third harmonic is more than 60 dB. This is essential because third harmonics exist between the neutral point and earth also when there is no earth fault.

Whenever the measured value exceeds the start setting of a particular stage, this stage starts and a start signal is issued. If the fault situation remains on longer than the operate time delay setting, a trip signal is issued.

Measuring the neutral displacement voltage

The neutral displacement voltage is either measured with three voltage transformers (for example broken delta connection), one voltage transformer between the motor's neutral point and earth or calculated from the measured phase-to-neutral voltages according to the selected voltage measurement mode (see [10.8 Voltage measurement modes](#)):


- When the voltage measurement mode is 3LN: the neutral displacement voltage is calculated from the line-to-line voltages and therefore a separate neutral displacement voltage transformer is not needed. The setting values are relative to the configured voltage transformer (VT) voltage/ $\sqrt{3}$
- When the voltage measurement mode contains "+U₀": The neutral displacement voltage is measured with voltage transformer(s) for example using a broken delta connection. The setting values are relative to the VT₀ secondary voltage defined in configuration.
- Connect the U₀ signal according to the connection diagram to achieve correct polarization.

Two independent stages

There are two separately adjustable stages: U₀> and U₀>>. Both stages can be configured for the definite time (DT) operation characteristic.

Block diagram

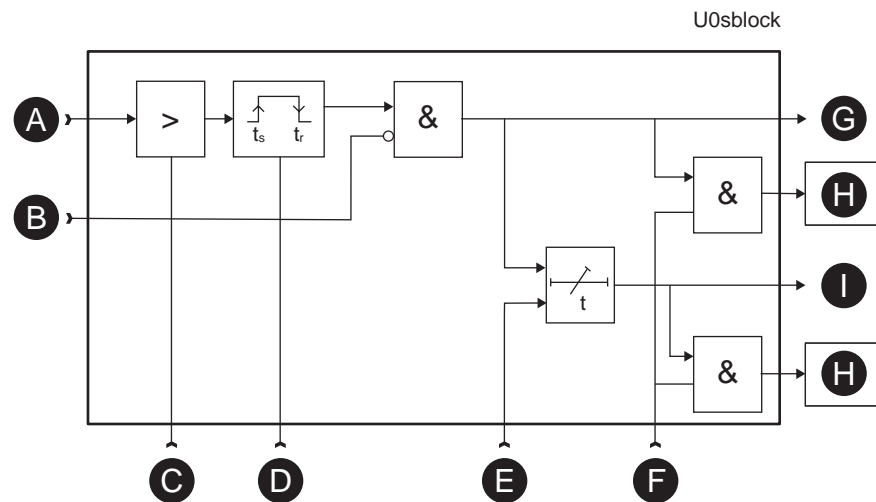Figure 117 - Block diagram of the neutral voltage displacement stages $U_0>$, $U_0>>$



- A. U_0
- B. Blocking
- C. Setting $U_0>s$
- D. Release delay
- E. Delay
- F. Enable events
- G. Start
- H. Register event
- I. Trip

Setting groups

There are four setting groups available for both stages.

Characteristics

Table 83 - Neutral voltage displacement stage $U_0>$ (59N)

Input signal	U_0 $U_{0\text{Calc}} = (U_{L1} + U_{L2} + U_{L3})$
Start value	1–60% U_{0N} (step 1%)
Definite time function: - Operate time	0.3–300.0 s (step 0.1 s)
Start time	Typically 200 ms
Reset time	< 450 ms
Reset ratio	0.97
Inaccuracy: - Starting - Starting $U_{0\text{Calc}}$ (3LN mode) - Operate time	$\pm 2\%$ of the set value or $\pm 0.3\%$ of the rated value ± 1 V $\pm 1\%$ or ± 150 ms

Table 84 - Neutral voltage displacement stage $U_0 \gg$ (59N)

Input signal	U_0 $U_{0\text{ Calc}} = (U_{L1} + U_{L2} + U_{L3})$
Start value	1–60% U_{0N} (step 1%)
Definite time function: - Operate time	0.08–300.0 s (step 0.02 s)
Start time	Typically 60 ms
Reset time	<95 ms
Reset ratio	0.97
Inaccuracy: - Starting - Starting $U_{0\text{ Calc}}$ (3LN mode) - Operate time	$\pm 2\%$ of the set value or $\pm 0.3\%$ of the rated value $\pm 1\text{ V}$ $\pm 1\%$ or $\pm 30\text{ ms}$

6.24 Restricted high-impedance earth fault (ANSI 64REF, 64BEF)

The high-impedance REF/BEF protection function is based on an external connection of a stabilizing resistor and a voltage limiting varistor connection to the I_0 input of Easergy P3 devices. The CT requirement, stabilizing resistor and voltage limiting varistor calculations are explained in a separate Application Note (P3APS17016EN).

6.25 Motor restart inhibition (ANSI 66)

Description

The simplest way to start an asynchronous motor is just to switch the stator windings to the supply voltages. However, every such start heats up the motor considerably because the initial currents are significantly above the rated current.

If the motor manufacturer has defined the maximum number of starts within an hour or the minimum time between two consecutive starts, this stage is easy to apply to prevent too frequent starts.

When the current has been less than 10 % of the motor nominal current and then exceeds the value Motor start detection current of $I_{ST>}$ (Motor start-up supervision stage, ANSI 48), the situation is recognized as a motor start. After the recognition of the motor start, if the current drops to less than 10 % of the motor nominal current, the stage considers the motor to be stopped.

The motor restart inhibition stage provides an N> alarm signal when the second last start has been done and remains active until the maximum amount of motor starts have been reached or one hour of time has passed.

The N> motor start inhibit signal activates after starting the motor and remains active a period of time that is defined for parameter Min time between motor starts. After the given time has passed, the inhibit signal returns to inactive state.


When the stage's start counter reaches the value defined for Max. motor starts/hour, the N> motor start inhibit signal activates and remains active until one hour has passed.

Set the parameter **Def. elap time from motor start** to 120 min if the ANSI 66 stage is required to give permission to start the motor immediately after the relay is powered. If this setting is 0 min, the motor is not started until the **Min time between motor starts** delay has elapsed.

The motor restart inhibition stage's correlation to the output contacts is defined in the output matrix menu. See [5.4.1 Output matrix](#).

[Figure 118](#) shows an application for preventing too frequent starting using the N> stage. Closed coil wire has been connected through the normal close (NC) contact of the signal relay A1, and A1 is controlled with the N> start inhibit signal. Whenever the N> motor start inhibit signal becomes active, it prevents circuit breaker closing.

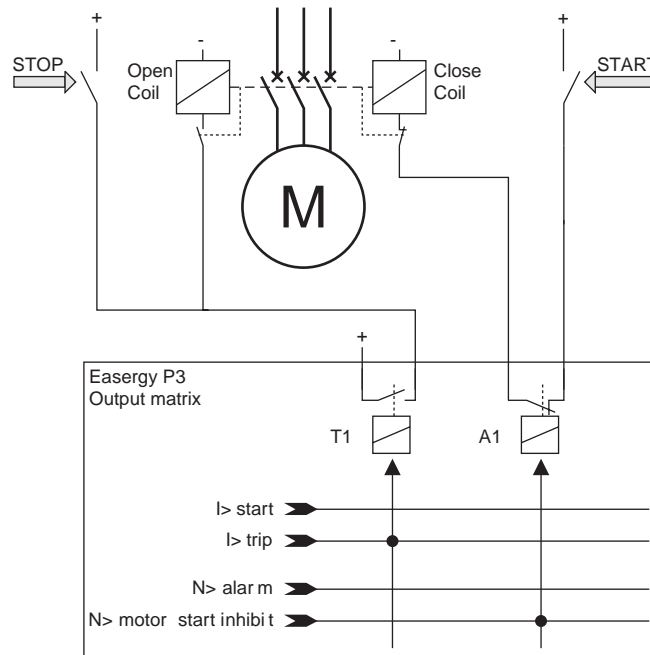Figure 118 - Application for preventing too frequent starting using the N> stage



Setting groups

This stage has one setting group.

Characteristics

Table 85 - Motor restart inhibition N> (66)

Input signal	$I_{L1} - I_{L3}$
Settings:	-
- Max. motor starts	1 – 20
- Min. time between motor starts ⁶⁰⁾	0.0–100 min. (step 0.1 min)
- Def. elap. (default elapsed) time from motor start	0 or 120 min

⁶⁰⁾ If *Min. time between motors starts* is set to zero, this function is disabled, that is, the minimum time between successive motor starts is not considered.

6.26 Directional phase overcurrent (ANSI 67)

Description

Directional overcurrent protection can be used for directional short circuit protection. Typical applications are:

- Short-circuit protection of two parallel cables or overhead lines in a radial network.
- Short-circuit protection of a looped network with single feeding point.
- Short-circuit protection of a two-way feeder, which usually supplies loads but is used in special cases as an incoming feeder.
- Directional overcurrent protection in low impedance earthed networks. In this case, the device has to be connected to line-to-neutral voltages instead of line-to-line voltages. In other words, the voltage measurement mode has to be "3LN" (See chapter [10.8 Voltage measurement modes](#)).

The stages are sensitive to the amplitude of the highest fundamental frequency current of the three measured phase currents.

In line-to-line and in three-phase faults, the fault angle is determined by using angles between positive sequence of currents and voltages. In line-to-neutral faults, the fault angle is determined by using fault-phase current and the healthy line to line voltage. For details of power direction, see [4.10 Power and current direction](#).


A typical characteristic is shown in [Figure 119](#). The base angle setting is -30° . The stage starts if the tip of the three phase current phasor gets into the grey area.

NOTE: If the maximum possible earth fault current is greater than the used most sensitive directional overcurrent setting, connect the relay to the line-to-neutral voltages instead of line-to-line voltages to get the right direction for earth faults, too. For networks having the maximum possible earth fault current less than the over current setting, use 67N, the directional earth fault stages.

Voltage memory

An adjustable 0.2–3.2 second cyclic buffer storing the phase-to-earth voltages is used as the voltage memory. The stored phase angle information is used as direction reference if all the line-to-line voltages drop below 1% during a fault. To adjust the voltage memory, set the **Angele memory duration** parameter in the **Scalings** setting view in Easergy Pro.

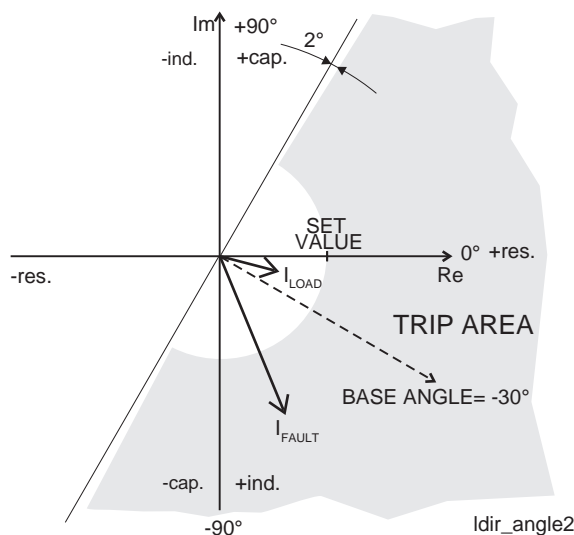
Figure 119 - Example of the directional overcurrent function's protection area



Three modes are available: dirctional, non-direct, and directional+back-up (Figure 120). In the non-directional mode, the stage is acting just like an ordinary overcurrent 50/51 stage.


Directional+back-up mode works the same way as the directional mode, but it has unidirectional backup protection in case a close-up fault forces all voltages to about zero. After the angle memory hold time, the direction would be lost. Basically the directional+backup mode is required when operate time is set longer than voltage memory setting and no other unidirectional back-up protection is in use.

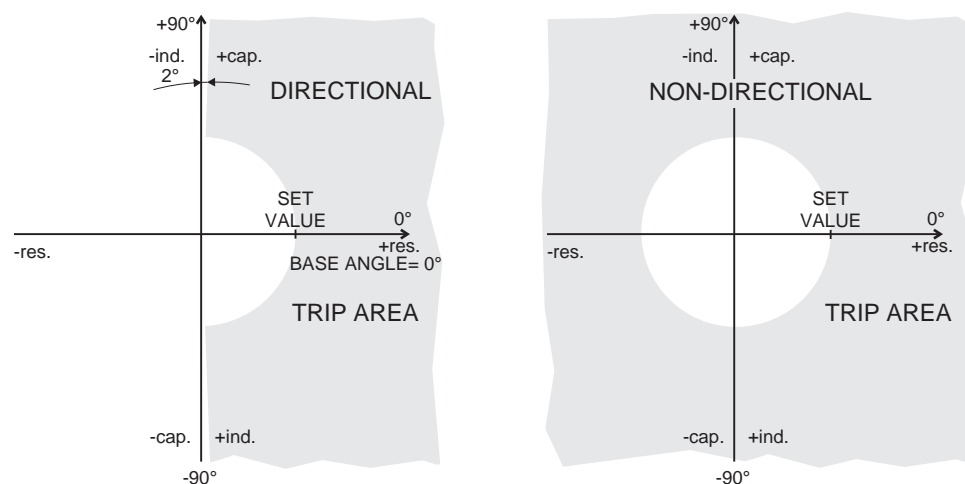Figure 120 - Difference between directional mode and non-directional mode. The grey area is the trip region.



An example of the bi-directional operation characteristic is shown in Figure 121. The right side stage in this example is the stage $I_{\varphi>}$ and the left side is $I_{\varphi>>}$. The base angle setting of the $I_{\varphi>}$ is 0° and the base angle of $I_{\varphi>>}$ is set to -180° .

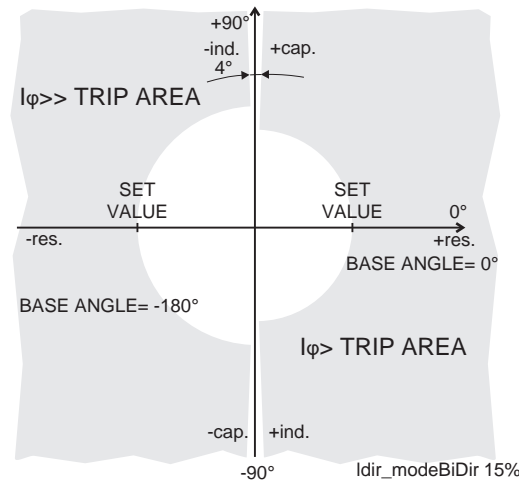Figure 121 - Bi-directional application with two stages $I_{\phi>}$ and $I_{\phi>>}$



When any of the three phase currents exceeds the setting value and, in directional mode, the phase angle including the base angle is within the active $\pm 88^\circ$ wide sector, the stage starts and issues a start signal. If this fault situation remains on longer than the delay setting, a trip signal is issued.

Four independent stages

There are four separately adjustable stages available: $I_{\phi>}$, $I_{\phi>>}$, $I_{\phi>>>}$ and $I_{\phi>>>>}$.

Dependent operate time

Stages $I_{\phi>}$ and $I_{\phi>>}$ can be configured for definite time or dependent time characteristic. See [6.5 Dependent operate time](#) for details of the available dependent delays.

Stages $I_{\phi>>>}$ and $I_{\phi>>>>}$ have definite time (DT) operation delay. The relay shows a scaleable graph of the configured delay on the local panel display.

Dependent time limitation

The maximum measured secondary current is $50 \times I_N$. This limits the scope of dependent curves with high start settings. See [6.5 Dependent operate time](#) for more information.

Setting groups

There are four setting groups available for each stage.

Characteristics

Table 86 - Directional phase overcurrent $I_{\phi>}$, $I_{\phi>>}$ (67)

Input signal	$I_{L1} - I_{L3}$ $U_{L1} - U_{L3}$
Start value	$0.10 - 4.00 \times I_N$ (step 0.01)

Mode	Directional/Directional+BackUp
Minimum voltage for the direction solving	$2 V_{\text{SECONDARY}}$
Base angle setting range	$-180^{\circ} - +179^{\circ}$
Operate angle	$\pm 88^{\circ}$
Definite time function: - Operate time	DT ⁶¹⁾ 0.04–300.00 s (step 0.01)
IDMT function: - Delay curve family - Curve type - Inv. time coefficient k	(DT), IEC, IEEE, RI Prg EI, VI, NI, LTI, MI...depends on the family ⁶²⁾ 0.025–20.0, except 0.50–20.0 for RXIDG, IEEE and IEEE2
Start time	Typically 30 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio	0.95
Reset ratio (angle)	2°
Transient overreach, any τ	< 10%
Angle memory duration	0.2–3.2 s
Inaccuracy: - Starting (rated value $I_N = 1-5A$) - Angle - Operate time at definite time function - Operate time at IDMT function	$\pm 3\%$ of the set value or $\pm 0.5\%$ of the rated value $\pm 2^{\circ}$ $U > 5 V$ $\pm 30^{\circ}$ $U = 0.1-5.0 V$ $\pm 1\%$ or ± 25 ms $\pm 5\%$ or at least ± 30 ms ⁶¹⁾

⁶¹⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

⁶²⁾ EI = Extremely Inverse, NI = Normal Inverse, VI = Very Inverse, LTI = Long Time Inverse, MI = Moderately Inverse

Table 87 - Directional phase overcurrent $I_{\phi} >>>$, $I_{\phi} >>>>$ (67)

Input signal	$I_{L1} - I_{L3}$ $U_{L1} - U_{L3}$
Start value	$0.10-20.00 \times I_N$ (step 0.01)

Mode	Directional/Directional+BackUp
Minimum voltage for the direction solving	$2 V_{\text{SECONDARY}}$
Base angle setting range	$-180^{\circ} - +179^{\circ}$
Operate angle	$\pm 88^{\circ}$
Definite time function: - Operate time	DT ⁶³⁾ 0.04–300.00 s (step 0.01)
Start time	Typically 30 ms
Reset time	< 95 ms
Overshoot time	< 50 ms
Reset ratio	0.95
Reset ratio (angle)	2°
Transient overreach, any τ	< 10%
Angle memory duration	0.2–3.2 s
Inaccuracy: - Starting (rated value $I_N = 1 - 5A$) - Angle - Operate time at definite time function	$\pm 3\%$ of the set value or $\pm 0.5\%$ of the rated value $\pm 2^{\circ}$ $U > 5 V$ $\pm 30^{\circ}$ $U = 0.1 - 5.0 V$ $\pm 1\%$ or ± 25 ms

⁶³⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

6.27 Directional earth fault overcurrent (ANSI 67N)

Description

The directional earth fault overcurrent is used in networks or motors where a selective and sensitive earth fault protection is needed and in applications with varying network structure and length.

The earth fault protection is adapted for various network earth systems.

The function is sensitive to the fundamental frequency component of the earth fault overcurrent and neutral voltage displacement voltage and the phase angle between them. The attenuation of the third harmonic is more than 60 dB.

Whenever the size of I_0 and U_0 and the phase angle between I_0 and U_0 fulfils the start criteria, the stage starts and a start signal is issued. If the fault situation remains on longer than the operate time delay setting, a trip signal is issued.

Polarization

The neutral displacement voltage, used for polarization, is measured by energizing input U_0 , that is, the angle reference for I_0 . Connect the U_0 signal according to the connection diagram. Alternatively, the U_0 can be calculated from the line-to-line voltages internally depending on the selected voltage measurement mode (see [10.8 Voltage measurement modes](#)):

- 3LN/LL $_{\gamma}$, 3LN/LN $_{\gamma}$ and 3LN/ U_0 : the zero sequence voltage is calculated from the line-to-line voltages and therefore any separate zero sequence voltage transformers are not needed. The setting values are relative to the configured voltage transformer (VT) voltage/ $\sqrt{3}$.
- 3LN+ U_0 , 2LL+ U_0 , 2LL+ U_0 +LL $_{\gamma}$, 2LL+ U_0 +LN $_{\gamma}$, LL+ U_0 +LL $_{\gamma}$ +LLz, and LN+ U_0 +LN $_{\gamma}$ +LNz: the neutral voltage displacement voltage is measured with voltage transformer(s) for example using a broken delta connection. The setting values are relative to the VT $_0$ secondary voltage defined in the configuration.

Modes for different network types

The available modes are:

- ResCap

This mode consists of two sub modes, Res and Cap. A digital signal can be used to dynamically switch between these two submodes. When the digital input is active (DI = 1), Cap mode is in use and when the digital input is inactive (DI = 0), Res mode is in use. This feature can be used with compensated networks when the Petersen coil is temporarily switched off.

- Res

The stage is sensitive to the resistive component of the selected I_0 signal. This mode is used with compensated **networks** (resonant earthing) and **networks earthed with a high resistance**. Compensation is usually done with a Petersen coil between the neutral point of the main transformer and earth. In this context, high resistance means that the fault current is limited to be less than the rated phase current. The trip area is a half plane as drawn in [Figure 123](#). The base angle is usually set to zero degrees.

- Cap

The stage is sensitive to the capacitive component of the selected I_0 signal. This mode is used with **unearthed networks**. The trip area is a half plane as drawn in *Figure 123*. The base angle is usually set to zero degrees.

- Sector

This mode is used with **networks earthed with a small resistance**. In this context, "small" means that a fault current may be more than the rated phase currents. The trip area has a shape of a sector as drawn in *Figure 124*. The base angle is usually set to zero degrees or slightly on the lagging inductive side (negative angle).

- Undir

This mode makes the stage equal to the unidirectional stage $I_{0>}$. The phase angle and U_0 amplitude setting are discarded. Only the amplitude of the selected I_0 input is supervised.

Input signal selection

Each stage can be connected to supervise any of the following inputs and signals:

- Input I_{01} for all networks other than solidly earthed.
- Input I_{02} for all networks other than solidly earthed.
- Calculated signal $I_{0\text{ Calc}}$ for solidly and low-impedance earthed networks. $I_{0\text{ Calc}} = I_{L1} + I_{L2} + I_{L3} = 3I_0$.

Intermittent earth fault detection

Short earth faults make the protection start but does not cause a trip. A short fault means one cycle or more. For shorter than 1 ms transient type of intermittent earth faults in compensated networks, there is a dedicated stage $I_{0\text{INT}} > 67N_I$. When starting happens often enough, such intermittent faults can be cleared using the intermittent time setting.

When a new start happens within the set intermittent time, the operation delay counter is not cleared between adjacent faults and finally the stage trips.

Two independent stages

There are two separately adjustable stages: $I_{0\phi >}$ and $I_{0\phi >>}$. Both stages can be configured for definite time delay (DT) or dependent time delay operate time.

Dependent operate time

Accomplished dependent delays are available for all stages $I_{N\phi >}$ and $I_{N\phi >>}$.


The relay shows a scalable graph of the configured delay on the local panel display.

Dependent time limitation

The maximum measured secondary earth fault overcurrent is $10 \times I_{0N}$ and the maximum measured phase current is $50 \times I_N$. This limits the scope of dependent curves with high start settings.


Block diagram

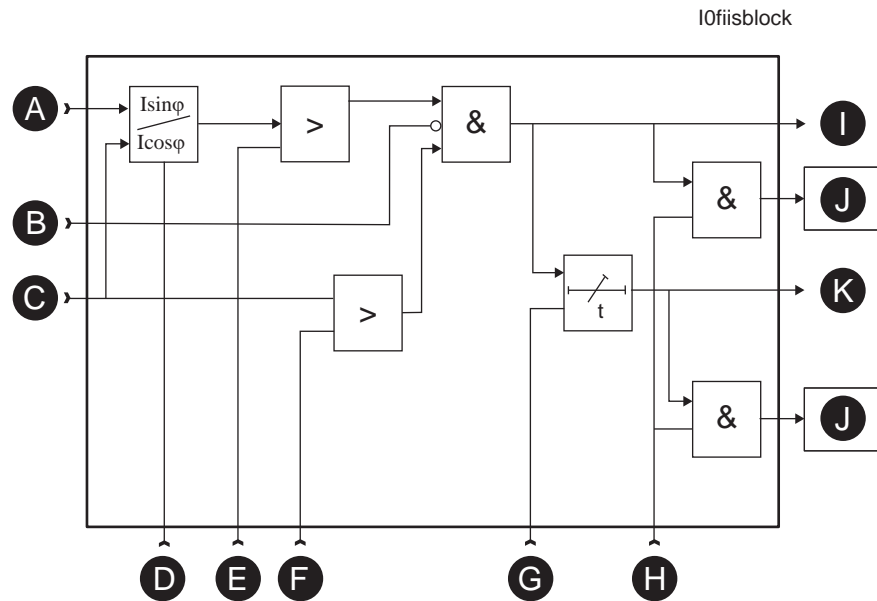Figure 122 - Block diagram of the directional earth fault overcurrent stages $I_{0\phi} >$, $I_{0\phi} >>$




- A. I_0
- B. Block
- C. U_0
- D. Choise $I_{cos\phi}$ (Res) / $I_{sin\phi}$ (Cap)
- E. Setting $I\phi > s$
- F. Setting $I_0 > s$
- G. Delay
- H. Enable events
- I. Start
- J. Register event
- K. Trip

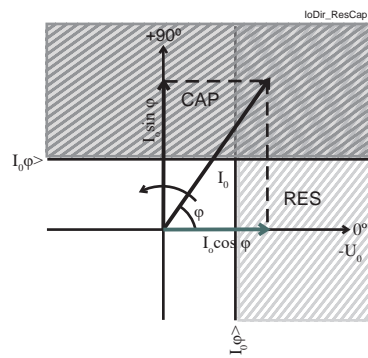Figure 123 - Operation characteristics of the directional earth fault protection in Res and Cap mode



Res mode can be used with compensated networks. Cap mode is used with unearthed networks.

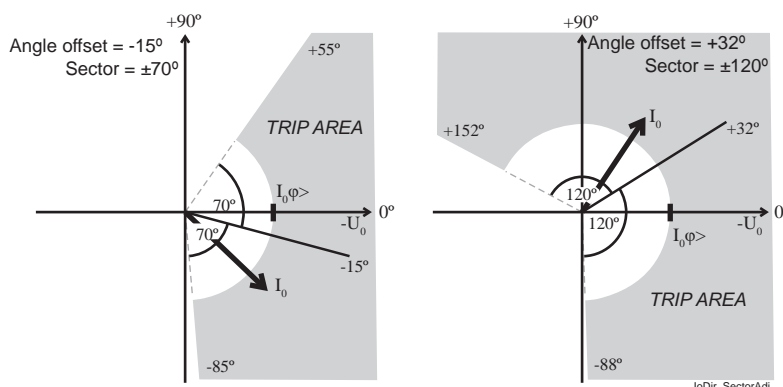Figure 124 - Operation characteristics examples of the directional earth fault stages in the sector mode



The drawn I_0 phasor is inside the trip area. The angle offset and half sector size are user's parameters.

Setting groups

There are four setting groups available for each stage.

Characteristics

Table 88 - Directional earth fault overcurrent $I_{0\phi>}$, $I_{0\phi>>}$ (67N)

Input signal	I_0, U_0 $I_{0\text{ Calc}} = (I_{L1} + I_{L2} + I_{L3})$
Start value $I_{0\phi>}$	0.005–8.000 pu (when I_{01} or I_{02} measured with standard EF CT) (step 0.001) 0.050–8.000 pu (when I_{01} or I_{02} measured with CSH) (step 0.001) 0.005–20.000 pu (when $I_{0\text{ Calc}}$) (step 0.001)
Start value $I_{0\phi>>}$	0.01-8.00 pu (when I_{01} or I_{02} measured with standard EF CT) (step 0.01) 0.05-8.00 pu (when I_{01} or I_{02} measured with CSH) (step 0.01) 0.01-20.00 pu (when $I_{0\text{ Calc}}$) (step 0.01)
Start voltage	1–100% U_{0N} (step 1%)
Mode	Non-directional/Sector/ResCap
Base angle setting range	-180°–179°
Operate angle	±88°
Definite time function: - Operate time	0.10^{64} – 300.00 s (step 0.02 s)

IDMT function: - Delay curve family - Curve type - Inv. time coefficient k	(DT), IEC, IEEE, RI Prg EI, VI, NI, LTI, MI..., depends on the family ⁶⁵⁾ 0.025–20.0, except 0.50–20.0 for RI, IEEE and IEEE2
Start time	Typically 60 ms
Reset time	< 95 ms
Reset ratio	0.95
Reset ratio (angle)	2°
Inaccuracy:	
- Starting U_0 & I_0 (rated value $I_n = 1-5A$)	$\pm 3\%$ of the set value or $\pm 0.3\%$ of the rated value
- Starting U_0 & I_0 (Peak Mode when, rated value $I_{0n} = 1-10A$)	$\pm 5\%$ of the set value or $\pm 2\%$ of the rated value (Sine wave <65 Hz)
- Starting U_0 & I_0 ($I_{0\text{ Calc}}$)	$\pm 3\%$ of the set value or $\pm 0.5\%$ of the rated value
- Angle	$\pm 2^\circ$ when $U > 1V$ and $I_0 > 5\%$ of I_{0N} or $> 50\text{ mA}$ else $\pm 20^\circ$
- Operate time at definite time function	$\pm 1\%$ or $\pm 30\text{ ms}$
- Operate time at IDMT function	$\pm 5\%$ or at least $\pm 30\text{ ms}$ ⁶⁴⁾

⁶⁴⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

⁶⁵⁾ EI = Extremely Inverse, NI = Normal Inverse, VI = Very Inverse, LTI = Long Time Inverse, MI = Moderately Inverse

Table 89 - Directional earth fault overcurrent $I_{0\phi} >>>$ (67N)

Input signal	I_0, U_0 $I_{0\text{ Calc}} = (I_{L1} + I_{L2} + I_{L3})$
Start value	0.01-8.00 pu (when I_{01} or I_{02} measured with standard EF CT) (step 0.01) 0.05-8.00 pu (when I_{01} or I_{02} measured with CSH) (step 0.01) 0.01-20.00 pu (when $I_{0\text{ Calc}}$) (step 0.01)
Start voltage	1–100% U_{0N} (step 1%)

Mode	Non-directional/Sector/ResCap
Base angle setting range	-180° – 179°
Operation angle	±88°
Definite time function: - Operate time	0.10 ⁶⁶ – 300.00 s (step 0.02 s)
IDMT function: - Delay curve family - Curve type - Inv. time coefficient k	(DT), IEC, IEEE, RI Prg EI, VI, NI, LTI, MI..., depends on the family ⁶⁷ 0.05–20.0, except 0.50–20.0 for RI, IEEE and IEEE2
Start time	Typically 60 ms
Reset time	< 95 ms
Reset ratio	0.95
Reset ratio (angle)	2°
Inaccuracy:	
- Starting U_0 & I_0 (rated value $I_n = 1 - 5A$)	±3% of the set value or ±0.3% of the rated value
- Starting U_0 & I_0 (Peak Mode when, rated value $I_{0n} = 1 - 10A$)	±5% of the set value or ±2% of the rated value (Sine wave <65 Hz)
- Starting U_0 & I_0 ($I_{0\text{ Calc}}$)	±3% of the set value or ±0.5% of the rated value
- Angle	±2° when $U > 1V$ and $I_0 > 5\%$ of I_{0N} or > 50 mA else ±20°
- Operate time at definite time function	±1% or ±30 ms
- Operate time at IDMT function	±5% or at least ±30 ms ⁶⁶)

⁶⁶) This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

⁶⁷) EI = Extremely Inverse, NI = Normal Inverse, VI = Very Inverse, LTI = Long Time Inverse, MI = Moderately Inverse

6.27.1 Earth fault faulty phase detection algorithm

The earth fault overcurrent stage (ANSI 50N/51N) and directional earth fault overcurrent stage (ANSI 67N) have an inbuilt detection algorithm to detect a faulty phase. This algorithm is meant to be used in radial-operated distribution networks. The faulty phase detection can be used in solidly-earthed, impedance-earthed or resonant-earthed networks.

Operation

The faulty phase detection starts from the earth fault stage trip. At the moment of stage start, the phase currents measured prior to start are registered and stored as prior-to-fault currents. At the moment of trip, phase currents are registered again. Finally, faulty phase detection algorithm is performed by comparing prior-to-fault currents to fault currents. The algorithm also uses positive sequence current and negative sequence current to detect faulty phase.

The detection algorithm can be enabled and disabled by selecting or unselecting a checkbox in the protection stage settings. Correct network earthing configuration must be selected in the stage settings, too. In the earth fault overcurrent stage settings, you can select between RES and CAP network earthing configuration. This selection has no effect on the protection itself, only on the faulty phase detection. In the directional earth fault overcurrent stage settings, the detection algorithm uses the same network earthing type as selected for protection. RES is used for solidly-earthed, impedance-earthed and resonant-earthed networks. CAP is only used for isolated networks.

The detected faulty phase is registered in the protection stage fault log (and also in the event list and alarm screen). Faulty phase is also indicated by a line alarm and line fault signals in the output matrix.

Possible detections of faulty phases are L1-N, L2-N, L3-N, L1-L2-N, L1-L3-N, L2-L3-N, L1-L2-L3-N, and REV. If the relay protection coordination is incorrect, REV indication is given in case of a relay sympathetic trip to a reverse fault.

6.28 Magnetizing inrush detection (ANSI 68F2)

Description

This stage can be used to block other stages and to indicate possible primary faults in the power distribution network. The ratio between the second harmonic component and the fundamental frequency component is measured on all the phase currents. When the ratio in any phase exceeds the setting value, the stage gives a start signal. After a settable delay, the stage gives a trip signal.


The start and trip signals can be used for blocking the other stages.

The trip delay is irrelevant if only the start signal is used for blocking.

The trip delay of the stages to be blocked must be more than 60 ms to ensure a proper blocking.

Block diagram

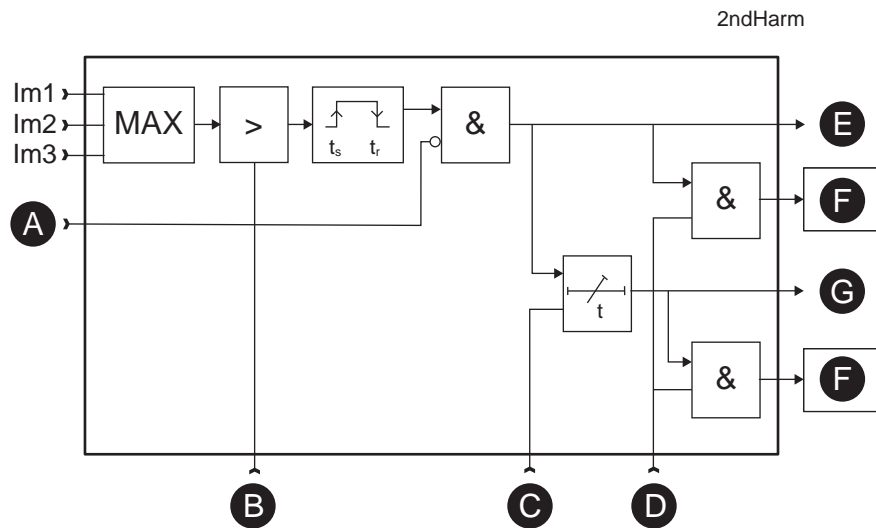Figure 125 - Block diagram of the magnetizing inrush detection stage



- A. Block
- B. Setting 2nd harmonics
- C. Delay
- D. Enable events
- E. Start
- F. Register event
- G. Trip

Characteristics

Table 90 - Magnetizing inrush detection (68F2)

Current input	IL or I'L
Input signal	$I_{L1} - I_{L3}$
Settings:	
- Start value	10–100 % (step 1%)
- Operate time	0.03–300.00 s (step 0.01 s)
Inaccuracy:	
- Starting	±1% - unit

NOTE: The amplitude of second harmonic content has to be at least 2% of the nominal of CT. If the nominal current is 5 A, the 100 Hz component needs to exceed 100 mA.

6.29 Fifth harmonic detection (ANSI 68H5)

Description

Overexcitation of a transformer creates odd harmonics. The fifth harmonic detection stage can be used detect overexcitation. This stage can also be used to block some other stages.

The ratio between the fifth harmonic component and the fundamental frequency component is measured on all the phase currents. When the ratio in any phase exceeds the setting value, the stage activates a start signal. After a settable delay, the stage operates and activates a trip signal.

The trip delay of the stages to be blocked must be more than 60 ms to ensure a proper blocking.

Characteristics

Table 91 - Fifth harmonic detection (68H5)

Current input	IL or I'L
Input signal	$I_{L1} - I_{L3}$
Settings: - Setting range over excitation - Operate time	10–100% (step 1%) 0.03–300.00 s (step 0.01 s)
Inaccuracy: - Starting	±2%- unit

6.30 Overfrequency and underfrequency (ANSI 81)

Description

Frequency protection is used for load sharing, loss of power system detection and as a backup protection for overspeeding.

The frequency function measures the frequency from the two first voltage inputs. At least one of these two inputs must have a voltage connected to be able to measure the frequency. Whenever the frequency crosses the start setting of a particular stage, this stage starts, and a start signal is issued. If the fault remains on longer than the operating delay setting, a trip signal is issued. For situations where no voltage is present, an adapted frequency is used.

Protection mode for $f >$ and $f >>$ stages

These two stages can be configured either for overfrequency or for underfrequency.

Undervoltage self-blocking of underfrequency stages

The underfrequency stages are blocked when the biggest of the three line-to-line voltages is below the low-voltage block limit setting. With this common setting, LVBlk, all stages in underfrequency mode are blocked when the voltage drops below the given limit. The idea is to avoid purposeless alarms when the voltage is off.

Initial self-blocking of underfrequency stages

When the biggest of the three line-to-line voltages has been below the block limit, the underfrequency stages are blocked until the start setting has been reached.

Four independent frequency stages

There are four separately adjustable frequency stages: $f >$, $f >>$, $f <$, $f <<$. The two first stages can be configured for either overfrequency or underfrequency usage. So totally four underfrequency stages can be in use simultaneously. Using the programmable stages even more can be implemented (chapter [6.35 Programmable stages \(ANSI 99\)](#)). All the stages have definite operate time delay (DT).

Setting groups

There are four setting groups available for each stage.

Characteristics

Table 92 - Overfrequency and underfrequency $f >$, $f >>$ (81H/81L)

Input signal	$U_{L1} - U_{L3}$
Frequency measuring area	16.0–75.0 Hz
Current and voltage meas. range	45.0–65.0 Hz
Frequency stage setting range	40.0–70.0 Hz (step 0.01)

Low-voltage blocking	10–100% U_N
Definite time function:	
- Operate time	0.10 ⁶⁸) – 300.0 s (step 0.02 s)
Start time	< 100 ms
Reset time	<120 ms
Reset ratio (LV block)	Instant (no hysteresis)
Inaccuracy:	
- Starting	±20 mHz
- Starting (LV block)	3% of the set value or ±0.5 V
- operate time	±1% or ±30 ms

⁶⁸⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

NOTE: If the relay restarts for some reason, there is no trip even if the frequency is below the set limit during the start-up (Start and trip is blocked). To cancel this block, frequency has to rise above the set limit.

Table 93 - Underfrequency $f<$, $f<<$ (81L)

Input signal	$U_{L1} - U_{L3}$
Frequency measuring area	16.0–75.0 Hz
Current and voltage meas. range	45.0–65.0 Hz
Frequency stage setting range	40.0–64.0 Hz
Low-voltage blocking	10–100% U_N
Definite time function:	
- operate time	0.10 ⁶⁹⁾) – 300.0 s (step 0.02 s)
Undervoltage blocking	2–100 %
Start time	< 100 ms
Reset time	< 120 ms
Reset ratio	1.002
Reset ratio (LV block)	Instant (no hysteresis)
Inaccuracy:	
- Starting	±20 mHz
- starting (LV block)	3% of the set value or ±0.5 V
- operate time	±1% or ±30 ms

⁶⁹⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

6.31 Rate of change of frequency (ANSI 81R)

Description


The rate of change of frequency (ROCOF or df/dt) function is used for fast load shedding, to speed up operate time in overfrequency and underfrequency situations and to detect loss of grid. For example, a centralized dedicated load shedding relay can be omitted and replaced with distributed load shedding, if all outgoing feeders are equipped with Easergy P3 relays.

A special application for ROCOF is to detect loss of grid (loss of mains, islanding). The more the remaining load differs from the load before the loss of grid, the better the ROCOF function detects the situation.

Frequency behavior during load switching

Load switching and fault situations may generate change in frequency. A load drop may increase the frequency and increasing load may decrease the frequency, at least for a while. The frequency may also oscillate after the initial change. After a while, the control system of any local generator may drive the frequency back to the original value. However, in case of a heavy short-circuit fault or if the new load exceeds the generating capacity, the average frequency keeps on decreasing.

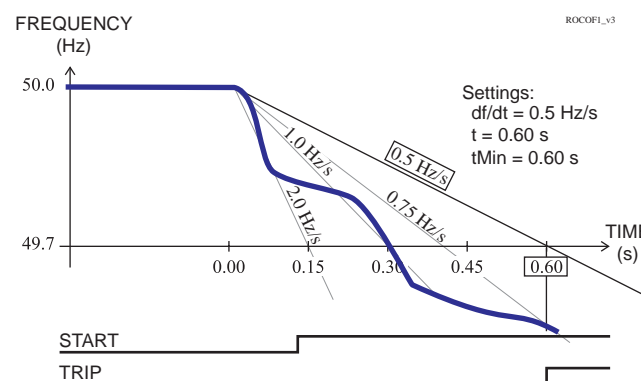Figure 126 - An example of definite time df/dt operate time. At 0.6 s, which is the delay setting, the average slope exceeds the setting 0.5 Hz/s and a trip signal is generated.



ROCOF implementation

The ROCOF function is sensitive to the absolute average value of the time derivate of the measured frequency $|df/dt|$. Whenever the measured frequency slope $|df/dt|$ exceeds the setting value for 80 ms time, the ROCOF stage starts and issues a start signal after an additional 60 ms delay. If the average $|df/dt|$, since the start moment, still exceeds the setting, when the operation delay has elapsed, a trip signal is issued. In this definite time mode the second delay parameter "minimum delay, t_{MIN} " must be equal to the operation delay parameter " t ".

If the frequency is stable for about 80 ms and the time t has already elapsed without a trip, the stage resets.

ROCOF and overfrequency and underfrequency stages


One difference between the overfrequency and underfrequency and the df/dt function is the speed. Often a df/dt function can predict an overfrequency or underfrequency situation and is thus faster than a simple overfrequency or underfrequency function. However, in most cases, standard overfrequency and underfrequency stages must be used together with ROCOF to ensure tripping also if the frequency drift is slower than the slope setting of ROCOF.

Definite operate time characteristics

Figure 126 shows an example where the df/dt start value is 0.5 Hz/s and the delay settings are $t = 0.60$ s and $t_{MIN} = 0.60$ s. Equal times $t = t_{MIN}$ gives a definite time delay characteristic. Although the frequency slope fluctuates, the stage does not release but continues to calculate the average slope since the initial start. At the defined operate time, $t = 0.6$ s, the average slope is 0.75 Hz/s. This exceeds the setting, and the stage trips.

At slope settings less than 0.7 Hz/s, the fastest possible operate time is limited according to the Figure 127.

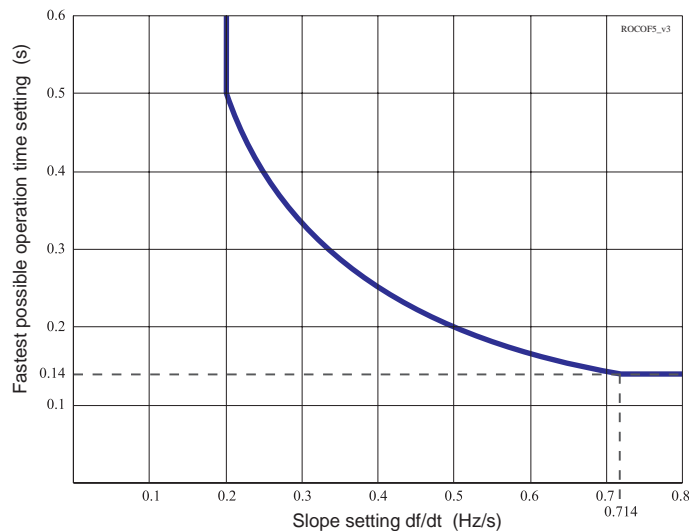Figure 127 - At very sensitive slope settings the fastest possible operate time is limited.



Dependent operate time characteristics

By setting the second delay parameter t_{MIN} smaller than the operate time delay t , a dependent type of operate time characteristic is achieved.

Figure 129 shows one example, where the frequency behavior is the same as in the first figure, but the t_{MIN} setting is 0.15 s instead of being equal to t . The operate time depends on the measured average slope according to the following equation:

Equation 23

$$t_{TRIP} = \frac{s_{SET} \cdot t_{SET}}{|s|}$$

t_{TRIP} = Resulting operate time (seconds).

s_{SET} = df/dt i.e. slope setting (hertz/seconds).

t_{SET} = Operate time setting t (seconds).

s = Measured average frequency slope (hertz/seconds).

The minimum operate time is always limited by the setting parameter t_{MIN} . In the example, the fastest operate time, 0.15 s, is achieved when the slope is 2 Hz/s or more. The leftmost curve in [Figure 128](#) shows the dependent characteristics with the same settings as in [Figure 129](#).

Figure 128 - Three examples of possible dependent df/dt operate time characteristics. The slope and operation delay settings define the knee points on the left. A common setting for t_{Min} has been used in these three examples. This minimum delay parameter defines the knee point positions on the right.


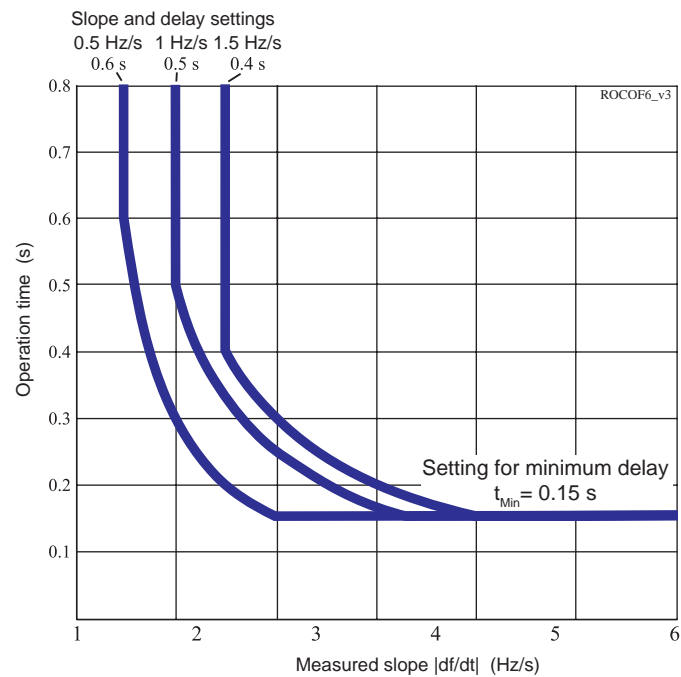


Figure 129 - An example of dependent df/dt operate time. The time to trip will be 0.3 s, although the setting is 0.6 s, because the average slope 1 Hz/s is steeper than the setting value 0.5 Hz/s.

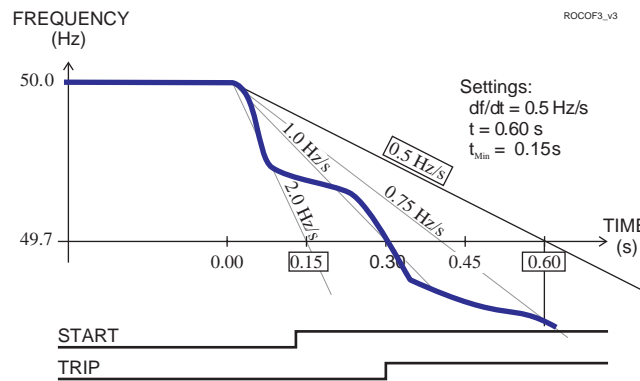

Settings groups

There are four setting groups available.

Characteristics

Table 94 - Rate of change of frequency df/dt > (81R)

Start setting df/dt	0.2–10.0 Hz/s (step 0.1 Hz/s)
Definite time delay (t> and t _{Min} > are equal): - Operate time t>	0.14 ⁷⁰ – 10.00 s (step 0.02 s)
Dependent time delay (t> is more than t _{Min} >): - Minimum operate time t _{Min} >	0.14 ⁷⁰ – 10.00 s (step 0.02 s)
Start time	Typically 140 ms
Reset time	150 ms
Overshoot time	< 90 ms
Reset ratio	1
Inaccuracy: - Starting - Operate time(overshoot ≥ 0.2 Hz/s)	10% of set value or ±0.1 Hz/s ±35 ms, when area is 0.2 – 1.0 Hz/s

⁷⁰) This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

NOTE: ROCOF stage is using the same low voltage blocking limit as the frequency stages.


6.32 Lockout (ANSI 86)

Description

The lockout feature, also called latching, can be programmed for outputs in the **Output matrix** setting view. Any protection stage start or trip, digital input, logic output, alarm and GOOSE signal connected to the following outputs can be latched when required:

- output contacts T1 – T7, A1
- LEDs on the front panel
- virtual outputs VO1- VO20

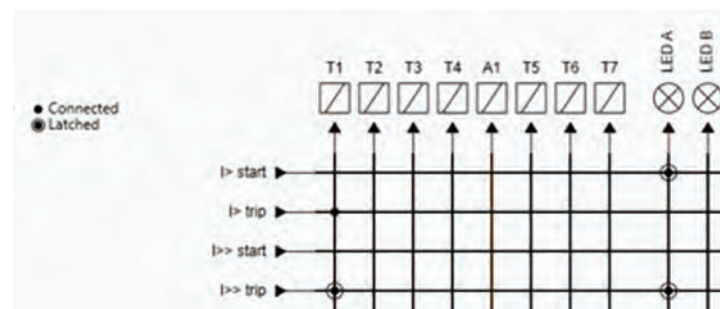Figure 130 - The lockout programmed for LED A and I>> trip signals



In [Figure 130](#), the latched signal is identified with a dot and circle in the matrix signal line crossing.

The lockout can be released through the display or via the Easergy Pro. See Chapter 4 Control functions.

Storing latch states

In the **General > Release latches** setting view, select the **Store latch state** setting to configure latched states of relay outputs, virtual outputs, binary outputs (BO) and high-speed outputs (HSO) to be stored. If some of these outputs are latched and in “on” state, and the device is restarted, their status is set back to “on” after restart.

Figure 131 - Store latch setting view



In the **LED configuration** setting view, you can configure the latched states of LEDs to be stored after a restart. In this example, storing has been configured for LED A (green).

Figure 132 - LED configuration example

LED configuration

LED	Description	Latch	Blink	Store
LED A (green)	LED A (green)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
LED A (red)	LED A (red)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED B (green)	LED B (green)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED B (red)	LED B (red)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED C (green)	LED C (green)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED C (red)	LED C (red)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED D (green)	LED D (green)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LED D (red)	LED D (red)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

NOTE: To use the **Store** setting, **Latch** must also be selected.


6.33 Differential overcurrent protection (ANSI 87M)

Description

The differential overcurrent protection comprises of two separately adjustable stages: stage $\Delta I >$ and stage $\Delta I >>$.

The differential protection is based on the winding currents' difference between IL and I'L side. In motor applications, the connection group is always Yy0 and measured currents are also winding currents.

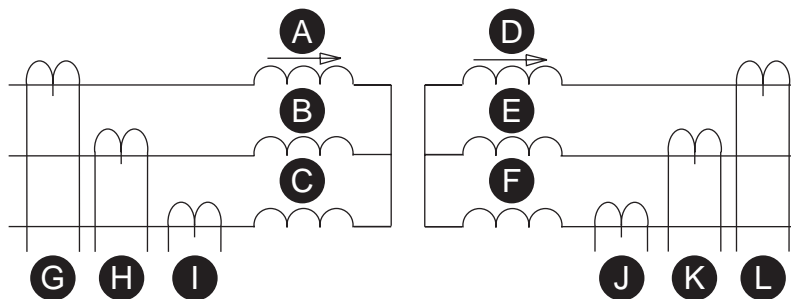
Figure 133 - Winding currents in connection group Yy0



- A. I_{L1} winding
- B. I_{L2} winding
- C. I_{L2} winding
- D. I'_{L1} winding
- E. I'_{L2} winding
- F. I'_{L3} winding
- G. I_{L1}
- H. I_{L2}
- I. I_{L3}
- J. I'_{L3}
- K. I'_{L2}
- L. I'_{L1}

Bias current calculation is only used in protection stage $\Delta I >$. Bias current describes the average current flow in the transformer. Bias and differential currents are calculated individually for each phase.

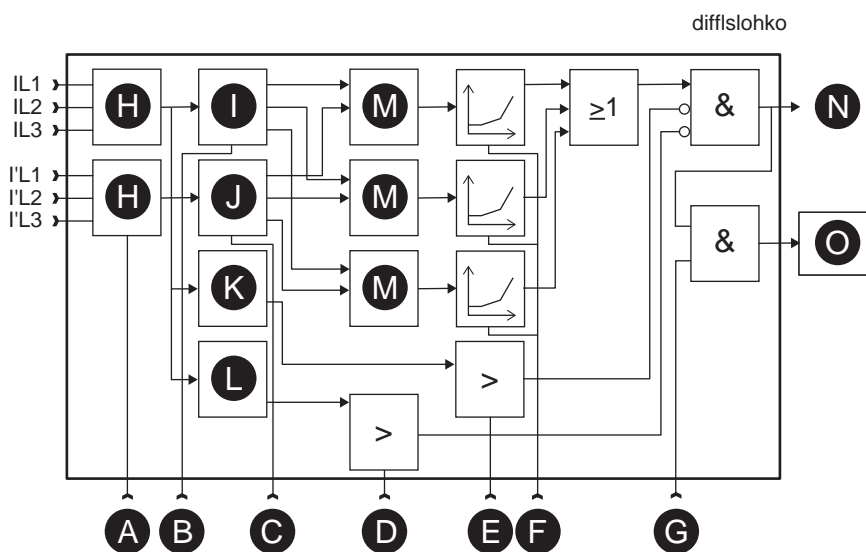Figure 134 - Block diagram of the differential overcurrent stage $\Delta I >$




- A. Conngrp setting
- B. I_0 cmprs
- C. I'_0 cmprs
- D. 5th harmonics setting
- E. 2nd harmonics setting
- I. I_0 compensation
- J. I'_0 compensation
- K. 2nd harmonics / Fund
- L. 5th harmonics / Fund
- M. Diff & bias calculation

- F. $\Delta I >$ setting
- G. Enable events
- H. Y/D
- N. Trip
- O. Register event

The stage $\Delta I >$ can be configured to operate as shown in *Figure 135*. This dual slope characteristic allows more differential current at higher currents before tripping.

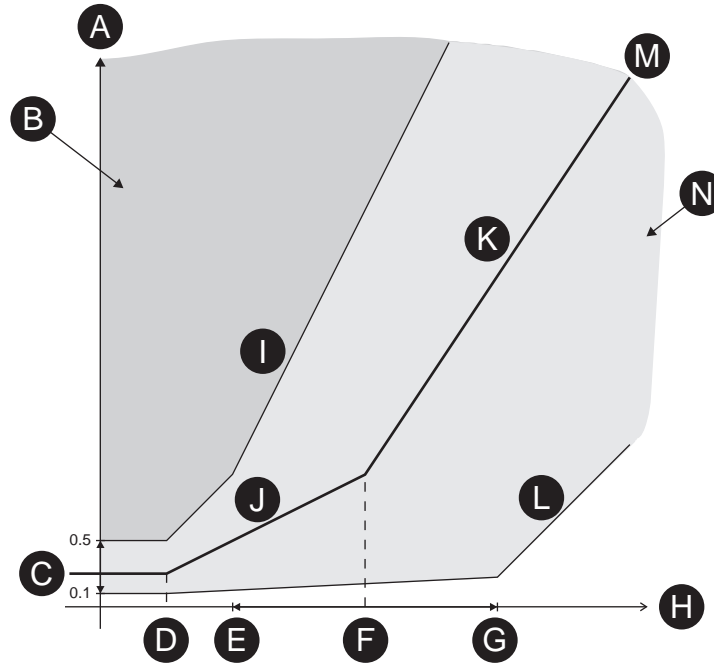Figure 135 - Example of differential overcurrent characteristics



- A. I_D/I_N
- B. Minimum trip area
- C. I_{START}
- D. $0.5 \times I_N / I_{BIAS1}$
- E. I_N
- F. I_{BIAS2}
- G. $3 \times I_N$
- H. I_{BIAS}
- I. Maximum setting
- J. Slope 1
- K. Slope 2
- L. Minimum setting
- M. Default setting
- N. Setting area

Table 95 - Settings

Parameter	Value	Default
I_{Start}	5...50% I_N	0.25
Slope 1	5...100%	50%
I_{BIAS2}	1.00...3.00 $\times I_N$	2.00
Slope 2	100...200%	150%


The stage also includes second harmonic blocking. The second harmonic is calculated from winding currents. Harmonic ratio is:

$$100 \times I_{f2_Winding} / I_{f1_Winding} [\%].$$

The fast differential overcurrent stage $\Delta I >>$ does not include slope characteristics or second harmonics blocking.

Differential protection using six CTs

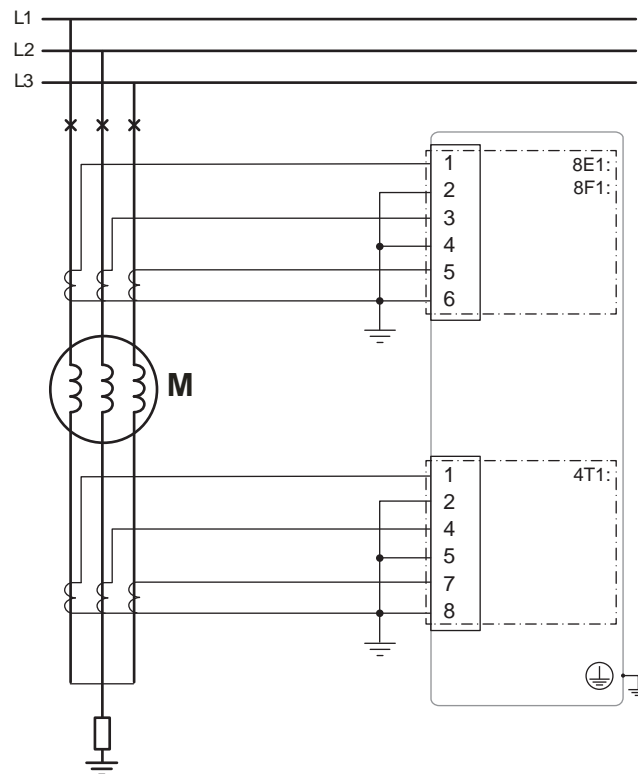Figure 136 - Easergy P3M30 and P3M32 connected as a motor differential protection device using six CTs



In this application mode, the settings in the device's **Scaling** menu should be set as described in the following sections.

CT settings

Here, the motor high and low side primary and secondary CT ratings are set according to the actual CT ratios.

Set motor nominal current.

Settings of the differential protection

$\Delta I > 87$ function shall be enabled for differential protection.

$\Delta I >$ pick-up setting range is user selectable from 5 % to 50 %.

Slope 1 can be set to 5 %.

I_{BIAS} for start of slope 2 can be set to $3 \times I_N$

Slope 2 can be set to 50 %.


If CTs are saturating at through faults, the Slope 2 settings must be changed accordingly.

$\Delta I >$ 2nd harmonic block enable can be set OFF (disabled).

$\Delta I >$ 2nd harmonic block limit can be disregarded and the factory default setting can be left intact.

Motor differential protection using flux balancing principle

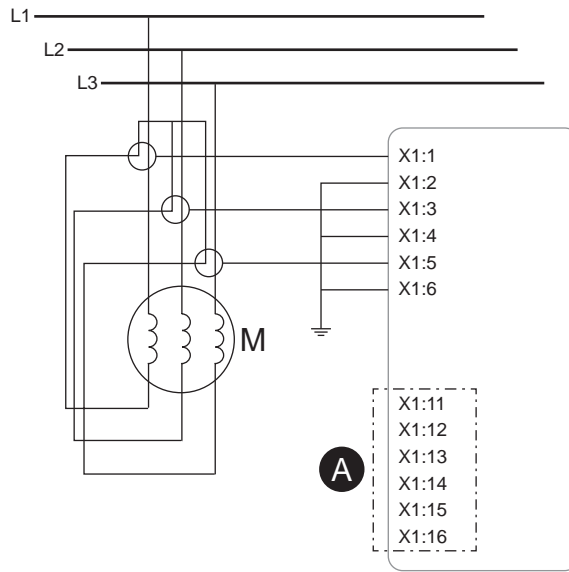Figure 137 - Easergy P3M30 and P3M32 connected as a motor differential protection using 3 core balance CT's connected using flux balancing principle.



A. Leave unconnected

In this application mode the settings in Easergy P3M30 and P3M32 relay's menu SCALING should be set as described in the following section.

NOTE: If motor protection functions are used, connect the differential connection to the LV side CT inputs (I'L1, I'L2, I'L3).

CT Settings

CT Primary and CT Secondary settings shall be set according to the actual core balance CT ratios.

CT' Primary and CT' Secondary settings can be disregarded and the factory default settings can be left intact.

Set motor nominal current.

Settings of the differential protection

$\Delta I > 87$ function shall be enabled for differential protection.

$\Delta I >$ pick-up setting range is user selectable from 5 % to 50 %.

Slope 1 can be set to 5 %.

I_{BIAS} for start of slope 2 can be set to $3 \times I_N$.

Slope 2 can be set to 50 %.


$\Delta I >$ 2nd harmonic block enable can be set OFF (disabled).

$\Delta I >$ 2nd harmonic block limit can be disregarded and the factory default setting can be left intact.

Current transformer supervision

The current transformer supervision (CTS) feature is used to detect a failure of one or more of the phase current inputs to the relay. Failure of a phase current transformer (CT) or an open circuit of the interconnecting wiring can result in incorrect operation of any current-operated element. Additionally, interruption in the current circuit generates dangerous CT secondary voltages.

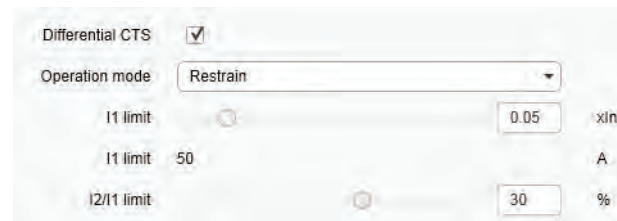Figure 138 - Current transformer supervision settings



The differential CTS method uses the ratio between positive and negative sequence currents at both sides of the protected motor to determine a CT failure. This algorithm is inbuilt in the dI> stage. When this ratio is small (zero), one of the following four conditions is present:

- The system is unloaded – both I2 and I1 are zero.
- The system is loaded but balanced – I2 is zero.
- The system has a three-phase fault – I2 is zero.
- There is a three-phase CT failure – unlikely to happen.

When the ratio is non-zero, one of the following two conditions is present:

- The system has an asymmetric fault – both I2 and I1 are non-zero.
- There is a 1 or 2 phase CT fault – both I2 and I1 are non-zero.

The I2 to I1 ratio is calculated at both sides of the protected motor. With this information, we can assume that:

- If the ratio is non-zero at both sides, there is a real fault in the network and the CTS should not operate.
- If the ratio is non-zero only at one side, there is a change of CT failure and the CTS should operate.

Another criterion for CTS is to check whether the differential system is loaded or not. For this purpose, the positive sequence current I1 is checked at both sides of the protected motor.

If load current is detected only at one side, it is assumed that there is an internal fault condition and CTS is prevented from operating, but if load current is detected at both line ends, CTS operation is permitted.

Another criterion for CTS is to check whether the differential system is loaded or not. For this purpose, the positive sequence current I1 is checked at both ends. If load current is detected only at one end, it is assumed that there is an internal fault condition and CTS is prevented from operating, but if load current is detected at both line ends, CTS operation is permitted.

There are three modes of operation:

- indication mode: CTS alarm is raised but there is no effect on tripping
- restrain mode: an alarm is raised and the differential current percentage setting value increased by 100 (for example 30 % + 100 % = 130 %). The new value is theoretically the maximum amount of differential current that a CT failure can produce in a normal full-load condition.
- block mode: an alarm is raised and differential protection is prevented from tripping

The differential CTS block mode is not recommended for two reasons:

- If there is a real fault during a CT failure, the differential protection would not protect the line at all.
- Blocking the protection could slow down the operate time of the differential protection because of transients in the beginning of the fault on the protected line.

Setting groups

This stage has one setting group.

Characteristics

Table 96 - Differential overcurrent stage $\Delta I >$ (87)

Start value	5–50 % I_N
Bias current for start of slope 1	0.50 x I_N
Slope 1	5–100 %
Bias current for start of slope 2	1.00–3.00 x I_N
Slope 2	100–200 %
Second harmonic blocking	5–30 %, or disable
Fifth harmonic blocking	20–50 %, or disable
Reset time	< 95 ms
Reset ratio	0.95
Inaccuracy:	
- Second harmonic blocking	±2% - unit
- Fifth harmonic blocking	±3% - unit
- Starting	±3% of set value or 0.02 x I_N when currents are < 200 mA
- Operate time ($I_D > 1.2 \times I_{SET}$)	< 60 ms
- Operate time ($I_D > 3.5 \times I_{SET}$)	< 50 ms

Table 97 - Differential overcurrent stage $\Delta I >>$ (87)

Start value	$5.0 - 40.0 \times I_N$
Reset time	< 95 ms
Reset ratio	0.95
Inaccuracy:	
- Starting	$\pm 3\%$ of set value or $\pm 0.5\%$ of rated value
- Operate time ($I_D > 3.5 \times I_{SET}$)	< 40 ms

6.34 Arc flash detection (AFD)

⚠ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Information on this product is offered as a tool for conducting arc flash hazard analysis. It is intended for use only by qualified persons who are knowledgeable about power system studies, power distribution equipment, and equipment installation practices. It is not intended as a substitute for the engineering judgement and adequate review necessary for such activities.

Failure to follow this instruction will result in death or serious injury.

6.34.1 Arc flash detection, general principle

The arc flash detection contains 8 arc stages that can be used to trip for example the circuit breakers. Arc stages are activated with overcurrent and light signals (or light signals alone). The allocation of different current and light signals to arc stages is defined in arc flash detection matrices: current, light and output matrix. The matrices are programmed via the arc flash detection menus. Available matrix signals depend on the order code (see [13.1 Order codes](#)).

The available signal inputs and outputs for arc flash detection depend on the relay's hardware configuration.

NOTE: The arc flash detection function is not yet available in LPIT models.

6.34.2 Arc flash detection menus

The arc flash detection menus are located in the main menu under ARC. The ARC menu can be viewed either on the front panel or by using Easergy Pro.

Arc protection

Table 98 - Arc protection parameter group

Item	Default	Range	Description
I>int. start setting	1.00 xIn	0.50–8.00 x In	Phase L1, L2, L3 overcurrent start level
Io>int. start setting	1.00 xIn	0.10–5.00 x In	Residual overcurrent start level
Install arc sensors	-	-, Install	Installs all connected sensors
Installation state	Ready	Installing, Ready	Installation state
Link Arc selfdiag to SF relay	On	On, Off	Links Arc protection selfsupervision signal to SF relay

Item	Default	Range	Description
Stage Enabled	On or Off	On, Off	Enables the arc protection stage
Trip delay [ms]	0	0–255	Trip delay for the arc protection stage
Min. hold time [10ms]	2	2–255	Minimum trip pulse length for the arc protection stage (Overshoot time <35ms)

⚠ WARNING

HAZARD OF DELAYED OPERATION

Do not use the arc stage delay for primary trip. This delay is intended, with the separate arc stage, for the circuit breaker failure scheme only

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Arc matrix – current

In the **Arc matrix – current** setting view, the available current signals (left column) are linked to the appropriate arc stages (1–8).

Figure 139 - Example view of **Arc matrix – current**

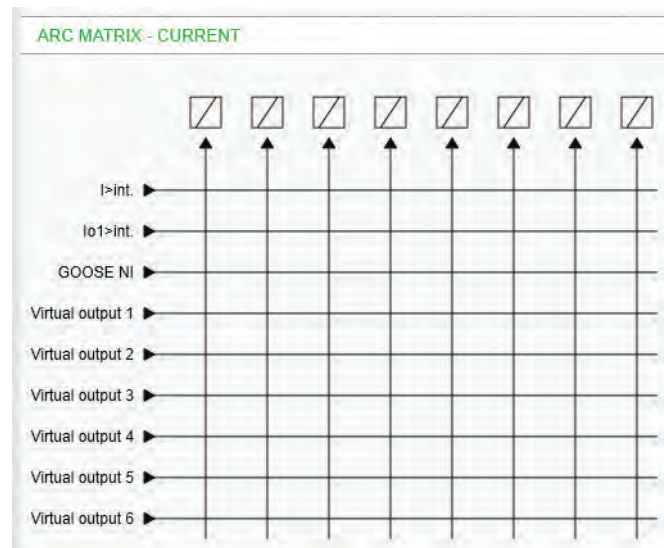


Table 99 - **Arc matrix – current** parameter group

Item	Default	Range	Description
I>int.	-	On, Off	Phase L1, L2, L3 internal overcurrent signal
Io>int.	-	On, Off	Residual overcurrent signal
GOOSE NI	-	On, Off	Goose network input
Virtual output 1 – 6	-	On, Off	Virtual output
Arc stage 1 – 8	-	On, Off	Arc protection stage 1–8

Arc matrix – light

In the **Arc matrix – light** setting view, the available arc light signals (left column) are linked to the appropriate arc stages (1–8).

Figure 140 - Example view of **Arc matrix – light**


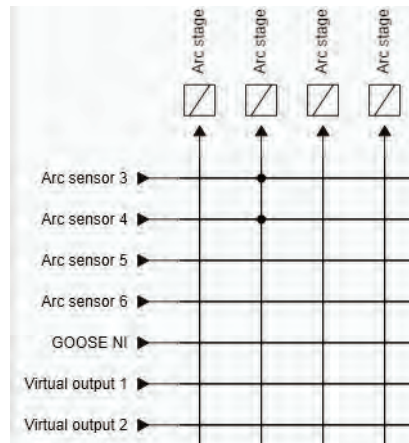


Table 100 - **Arc matrix – light** parameter group

Item	Default	Range	Description
Arc_matrix_light	-	On, Off	Internal arc flash sensor 1–10
GOOSE NI	-	On, Off	Goose network input
Virtual output 1 – 6	-	On, Off	Virtual output
Arc stage 1 – 8	-	On, Off	Arc protection stage 1–8

Arc matrix – output

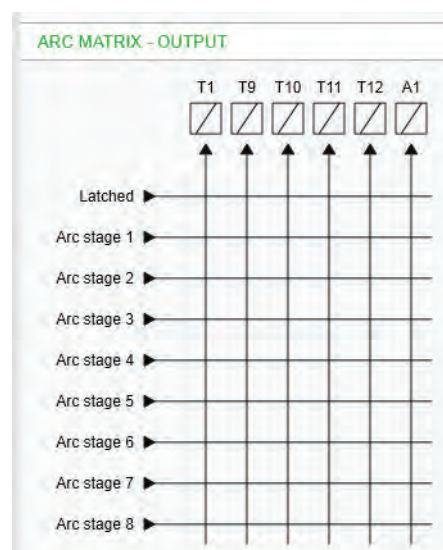Figure 141 - Example view of **Arc matrix – output**



NOTE: The arc output matrix must be configured in the **Arc matrix - output** setting view instead of the **Output matrix** view.

In the **Arc matrix – output** setting view, the used Arc stages (1–8) are connected to the required outputs. A possible latched function per output is also determined in this view. The available outputs depend on the order code.

The matrix connection done in the **Arc matrix – output** view also becomes visible in the output matrix.

Table 101 - **Arc matrix – output** parameter group


Item	Default	Range	Description
Latched	-	On, Off	Output latch
Arc stage 1–8	-	On, Off	Arc protection stage 1–8
T1–4	-	On, Off	Trip digital output 1–4
A1	-	On, Off	Signal alarm relay 1

MATRIX correlation principle

When determining the activating conditions for a certain arc stage, a logical AND operator is made between the outputs from the arc light matrix and arc current matrix.

If an arc stage has selections in only one of the matrixes, the stage operates on a light-only or on current-only principle.

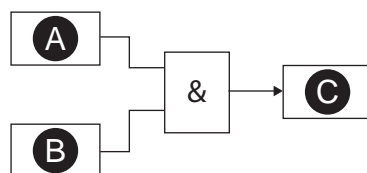Figure 142 - Matrix correlation principle with the logical AND operator



A. Arc matrix – light C. Arc matrix – output
 B. Arc matrix – current

Arc event enabling

Figure 143 - Example view of Arc event enabling

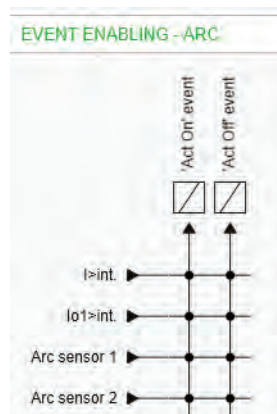


Table 102 - Arc event enabling parameter group

Item	Default	Range	Description
I>int.	On	On, Off	Internal I overcurrent signal
Io>int.	On	On, Off	Internal Io overcurrent signal
Arc sensor 1 – 2	On	On, Off	Arc flash sensor 1–2
Arc stage 1 – 8	On	On, Off	Arc protection stage 1–8
'Act On' event	On	On, Off	Event enabling
'Act Off' event	On	On, Off	Event enabling

6.34.3 Configuration example of arc flash detection

Installing the arc flash sensors and I/O units

1. Go to **Protection > Arc protection**.
2. Under **Settings**, click the **Install arc sensors** drop-down list and select **Install**.
3. Wait until the **Installation state** shows **Ready**. The communication between the system components is created.
4. The installed sensors and units can be viewed at the bottom of the **Arc protection** group view.

Figure 144 - Installed arc sensors

Local Arc Sensors Installed	
Sensor	Arc sensor status
3	OK
4	OK
5	OK
6	OK

On the Easergy Pro group list, select **Arc protection**.

5. Click the Arc Stages 1, 2, and select Stage 1 and 2 'On'.
6. Click the Trip delay[ms] value, set it to for example '0' and press Enter.
7. Click the DI block value, set it to for example '-' and press Enter.

Configuring the current start values

The **General > Scaling** setting view contains the primary and secondary values of the CT. However, the **Arc protection** menu calculates the primary value only after the **I start setting** value is given.


For example:

1. Go to **General > Scaling**.
2. Click the **CT primary** value, set it to for example *1200 A*, and press **Enter**.
3. Click the **CT secondary** value, set it to for example *5 A*, and press **Enter**.
4. On the Easergy Pro group list, select **Protection > Arc protection**.
5. Define the **I start setting** value for the relay.
6. Define the **Io start setting** in a similar manner.

Figure 145 - Example of setting the current transformer scaling values

SCALING	
CT primary	1200 A
CT secondary	5 A
Nominal input	5 A

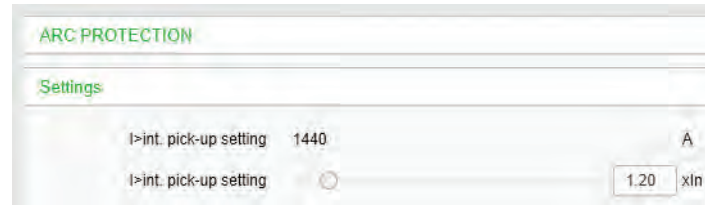Figure 146 - Example of defining the I start setting value



Configuring the current matrix


Define the current signals that are received in the arc flash detection system’s relay. Connect currents to Arc stages in the matrix.

For example:

The arc flash fault current is measured from the incoming feeder, and the current signal is linked to **Arc stage 1** in the current matrix.

1. Go to **Matrix > Arc matrix - Current**
2. In the matrix, select the connection point of **Arc stage 1** and **I>int.**
3. On the **Communication** menu, select **Write Changed Settings To Device.**

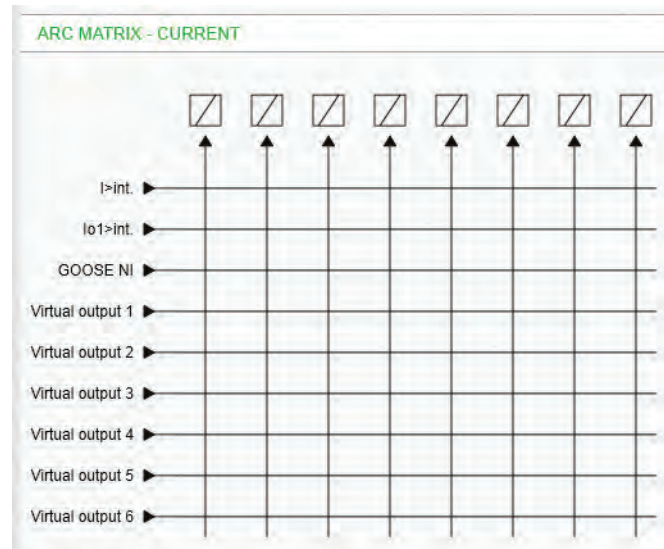Figure 147 - Configuring the current matrix – an example




Configuring the light matrix

Define what light sensor signals are received in the detection system. Connect the light signals to the arc stages in the matrix.

For example:

1. Go to **Matrix > Arc matrix - Light.**
2. In the matrix, select the connection point of **Arc sensor 1** and **Arc stage 2.**
3. Select the connection point of **Arc sensor 2** and **Arc stage 2.**
4. On the **Communication** menu, select **Write Changed Settings To Device.**

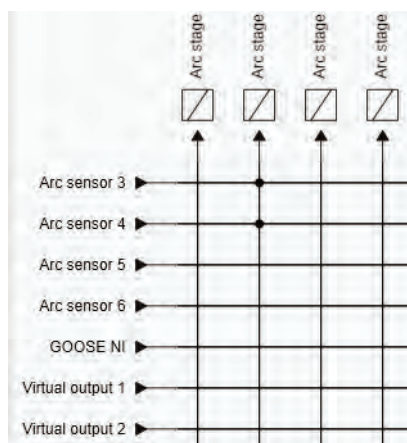Figure 148 - Configuring the light arc matrix



Configuring the output matrix

Define the trip relays that the current and light signals affect.


For example:

1. Go to **Matrix > Arc matrix - Output**.
2. In the matrix, select the connection point of **Arc stage 1** and **T1**.
3. Select the connection points of **Latched** and **T1** and **T9**.
4. Select the connection point of **Arc stage 2** and **T9**.
5. On the **Communication** menu, select **Write Changed Settings To Device**.

NOTE: It is recommended to use latched outputs for the trip outputs.

Arc output matrix includes only outputs which are directly controlled by FPGA.

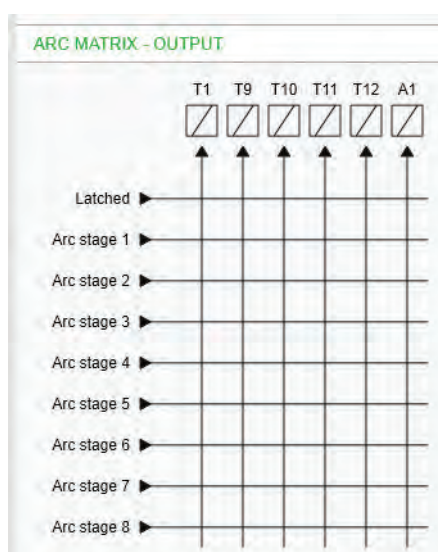Figure 149 - Configuring the output matrix - an example




Configuring the arc events

Define which arc events are written to the event list in this application.

For example:

1. Go to **Logs > Event enabling - Arc**.
2. In the matrix, enable both '**Act On**' event and '**Act Off**' event for **Arc sensor 1**, **Arc stage 1**, and **Arc stage 2**.
3. On the **Communication** menu, select **Write Changed Settings To Device**.

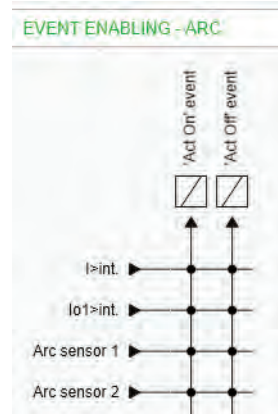Figure 150 - Configuring the arc events – an example



6.34.4 Arc flash detection characteristics

The operation of the arc detection depends on the setting value of the $I > \text{int}$ and $I_{01} > \text{int}$ current limits.

The arc current limits cannot be set, unless the relay is provided with the optional arc protection card.

Table 103 - Arc flash detection characteristics

Start current:	
Phase currents	0.50–8.00 x I _N (step 0.01)
Residual current	0.10–5.00 x I _N (step 0.01)
Operate time	
High break trip relays (T1, T9–T12)	
- Light only	≤9 ms
- 4 x I _{set} and light	≤9 ms
Trip relays (T2, T3 and T4)	
- Light only	≤7 ms
- 4 x I _{set} and light	≤7 ms
Semiconductor outputs (HSO1 – HSO2)	
- Light only	≤2 ms
- 4 x I _{set} and light	≤2 ms
- Arc stage delay	0 – 255 ms
Inaccuracy:	
Current	±5% of the set value
Delayed operation time	+≤10 ms of the set value

6.35 Programmable stages (ANSI 99)

Description

For special applications, you can build your own protection stages by selecting the supervised signal and the comparison mode.

The following parameters are available:

- **Priority:** Protection task execution cycle. If operate times less than 80 milliseconds are needed, select 10 ms. For operate times under one second, 20 ms is recommended. For longer operation times and THD signals, 100 ms is recommended.
- **Time-base for input value A:** "Instant" is the latest available value of the measurement. The other ones are average values of the measurement during the given time. The average values are calculated for different purposes all the time, for example, the 200 ms value is used to update the local display.

NOTE: Pay attention to selecting these timing values. For example, having a short operate time but 1 minute time base does not necessarily give the expected result. Using long time bases gives the possibility to use a filtered value to avoid unnecessary operations.
- **Coupling A:** The selected supervised signal in ">" and "<" mode. The available signals are shown in the table below.
- **Coupling B:** The selected supervised signal in "Diff" and "AbsDiff" mode. This selection becomes available once "Diff" or "AbsDiff" is chosen for Coupling A.
- **Compare condition:** Compare mode. '>' for over or '<' for under comparison, "Diff" and "AbsDiff" for comparing Coupling A and Coupling B.
- **AbsDiff | d |:** Coupling A – coupling B. The stage activates if the difference is greater than the start setting.
- **Diff d:** Coupling A – coupling B. The stage activates if the sign is positive and the difference greater than the start setting.
- **Start:** Limit of the stage. The available setting range and the unit depend on the selected signal.
- **Operation delay:** Definite time operation delay
- **Hysteresis:** Dead band (hysteresis). For more information, see [6.4 General features of protection stages](#).
- **No Compare limit for mode < :** Only used with compare mode under ('<'). This is the limit to start the comparison. Signal values under NoCmp are not regarded as fault.

Table 104 - Available signals to be supervised by the programmable stages

I_{L1}, I_{L2}, I_{L3}	Phase currents (RMS values)
U_{12}, U_{23}, U_{31}	Line-to-line voltages
I_0	Earth fault overcurrent
U_{L1}, U_{L2}, U_{L3}	Line-to-neutral voltages
U_0	Neutral displacement voltage
f	Frequency
P	Active power

Q	Reactive power
S	Apparent power
Cos Phi	Cosine φ
I_0 Calc	Phasor sum $I_{L1} + I_{L2} + I_{L3}$
I1	Positive sequence current
I2	Negative sequence current
I2/I1	Relative negative sequence current
I2/In	Negative sequence current in pu
U ₁	Positive sequence overvoltage
U ₂	Negative sequence overvoltage
U ₂ /U ₁	Relative negative sequence voltage
IL	Average $(I_{L1} + I_{L2} + I_{L3}) / 3$
Tan Phi	Tangent φ [= $\tan(\arccos\varphi)$]
PRMS	Active power RMS value
QRMS	Reactive power RMS value
SRMS	Apparent power RMS value
THDIL1	Total harmonic distortion of I_{L1}
THDIL2	Total harmonic distortion of I_{L2}
THDIL3	Total harmonic distortion of I_{L3}
THDU _A	Total harmonic distortion of input U _A
THDU _B	Total harmonic distortion of input U _B
THDU _C	Total harmonic distortion of input U _C
fy	Frequency behind circuit breaker
fz	Frequency behind 2nd circuit breaker
IL1RMS	I_{L1} RMS for average sampling
IL2RMS	I_{L2} RMS for average sampling
IL3RMS	I_{L3} RMS for average sampling
ILmin, ILmax	Minimum and maximum of phase currents

ULNmin, ULNmax	Minimum and maximum of line-to-neutral voltages
VAI1, VAI2, VAI3, VAI4, VAI5	Virtual analog inputs 1, 2, 3, 4, 5 (GOOSE)

Signals available depending on slot 8 options.

Eight independent stages

The relay has eight independent programmable stages. Each programmable stage can be enabled or disabled to fit the intended application.

Setting groups

There are four settings groups available.

See [6.4 General features of protection stages](#) for more details.

7 Supporting functions

7.1 Event log

Event log is a buffer of event codes and time stamps including date and time. For example, each start-on, start-off, trip-on or trip-off of any protection stage has a unique event number code. Such a code and the corresponding time stamp is called an event.

As an example, a typical event of programmable stage trip event is shown in [Table 105](#).

Table 105 - Example of Pgr1 stage trip on event and its visibility in local panel and communication protocols

EVENT	Description	Local panel	Communication protocols
Code: 01E02	Channel 1, event 2	Yes	Yes
Prg1 trip on	Event text	Yes	No
2.7 x In	Fault value	Yes	No
2007-01-31	Date	Yes	Yes
08:35:13.413	Time	Yes	Yes

Events are the major data for a SCADA system. SCADA systems are reading events using any of the available communication protocols. The Event log can also be scanned using the front panel or Easergy Pro. With Easergy Pro, the events can be stored to a file especially if the relay is not connected to any SCADA system.

Only the latest event can be read when using communication protocols or Easergy Pro. Every reading increments the internal read pointer to the event buffer. (In case of communication interruptions, the latest event can be reread any number of times using another parameter.) On the local panel, scanning the event buffer back and forth is possible.

Event enabling/masking

An uninteresting event can be masked, which prevents it to be written in the event buffer. By default, there is room for 200 latest events in the buffer. The event buffer size can be modified from 50 to 2000. The existing events are lost if the event buffer size is changed.

You can make this modification in the **Local panel conf** setting view.

An indication screen (popup screen) can also be enabled in the same menu in Easergy Pro. The oldest event is overwritten when a new event occurs. The shown resolution of a time stamp is one millisecond, but the actual resolution depends on the particular function creating the event. For example, most protection stages create events with 5 ms, 10 ms or 20 ms resolution. The

absolute accuracy of all time stamps depends on the relay's time synchronization. See [7.4 System clock and synchronization](#) for system clock synchronizing.

Event buffer overflow

The normal procedure is to poll events from the relay all the time. If this is not done, the event buffer could reach its limits. In that case, the oldest event is deleted and the newest displayed with OVF (overflow) code on the front panel.

Table 106 - Setting parameters for events

Parameter	Value	Description	Note
Count		Number of events	
ClrEv	- Clear	Clear event buffer	Set
Order	Old-New New-Old	Order of the event buffer for local display	Set
FVScal		Scaling of event fault value	Set
	PU	Per unit scaling	
	Pri	Primary scaling	
Display Alarms	On Off	Indication display is enabled No indication display	Set
Sync		Controls event time format	
	On Off	Event time shown normally if relay is synchronized Event time is shown in brackets if relay is not synchronized	
FORMAT OF EVENTS ON THE LOCAL DISPLAY			
Code: CHENN		CH = event channel, NN=event code (channel number is not shown in case channel is zero)	
Event description		Event channel and code in plain text	

Parameter	Value	Description	Note
yyyy-mm-dd		Date (for available date formats, see 7.4 System clock and synchronization)	
hh:mm:ss.nnn		Time	

7.2 Disturbance recording

The disturbance recorder (DR) can be used to record all the measured signals, that is, currents, voltage and the status information of digital inputs (DI) and digital outputs (DO). If the sample rate is slower than 1/10 ms, also the calculated signals like active power, power factor, negative sequence overcurrent and so on can be recorded. For a complete list of signals, see [Table 107](#).

The digital inputs also include the arc protection signals.

The available recording channels depend on the voltage measurement mode, too. If a channel is added for recording and the added signal is not available because of the used settings, the signal is automatically rejected from the recording channel list.

NOTE: When protection stages are enabled or disabled or the recorder signals or recording time changed, the disturbance recordings are deleted from the relay's memory. Therefore, before activating or deactivating stages, store the recordings on your PC.

Triggering the recording

The recording can be triggered by any start or trip signal from any protection stage, by a digital input, logic output or GOOSE signals. The triggering signal is selected in the output matrix (vertical signal DR). The recording can also be triggered manually. All recordings are time-stamped.


Reading recordings

The recordings can be uploaded with Easergy Pro program. The recording is in COMTRADE format. This also means that other programs can be used to view and analyse the recordings made by the relay.

Number of channels

A maximum of 24 records can be stored. Up to 12 channels per record can be stored. Both the digital inputs and the digital outputs (including all inputs and outputs) use one channel out of the total of 12.

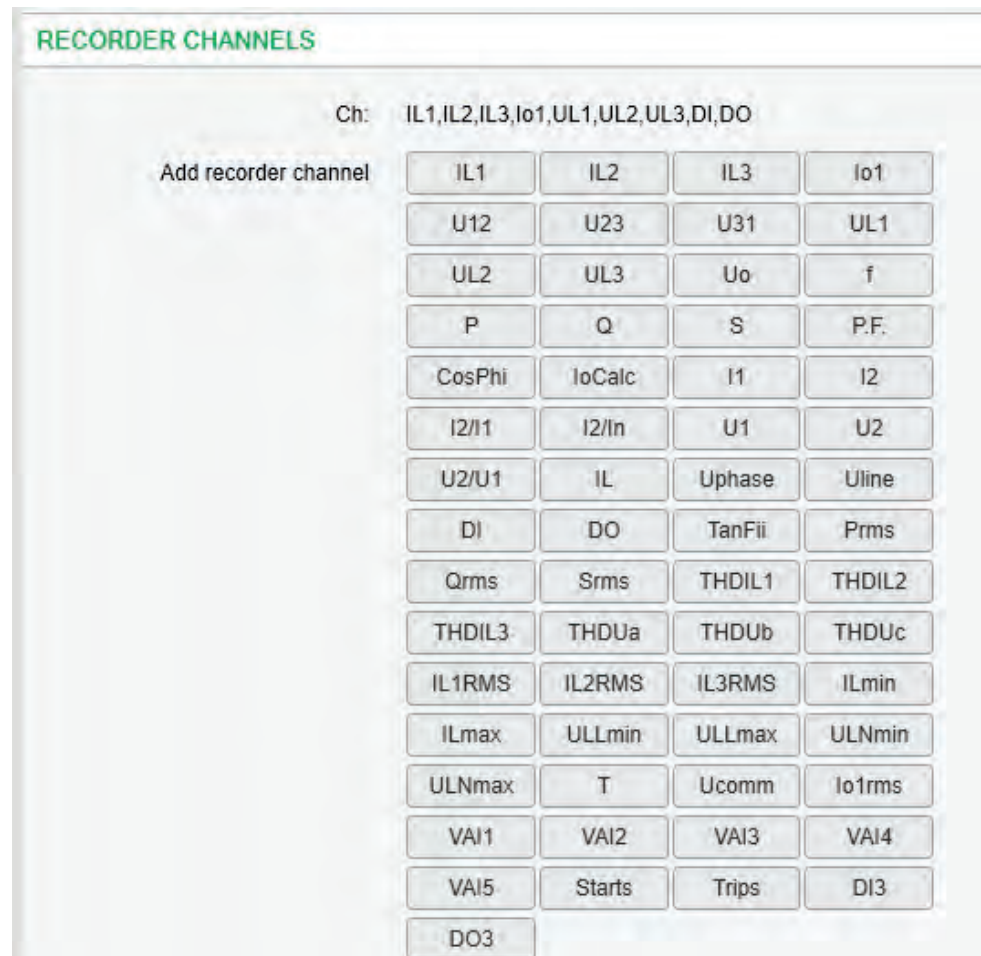Figure 151 - Recorder channels



Parameters

Table 107 - Disturbance recording parameters

Parameter	Value	Unit	Description	Note
Mode			Behavior in memory full situation:	Set ⁷¹⁾
	Saturated		No more recordings are accepted	
	Overflow		The oldest recording is overwritten	
SR			Sample rate	Set
	32/cycle		Waveform	
	16/cycle		Waveform	
	8/cycle		Waveform	
	1/10ms		One cycle value ⁷²⁾	
	1/20ms		One cycle value ⁷³⁾	
	1/200ms		Average	

Parameter	Value	Unit	Description	Note
	1/1s		Average	
	1/5s		Average	
	1/10s		Average	
	1/15s		Average	
	1/30s		Average	
	1/1min		Average	
Time		s	Recording length	Set
PreTrig		%	Amount of recording data before the trig moment	Set
MaxLen		s	Maximum time setting. This value depends on the sample rate, number and type of the selected channels and the configured recording length.	
ReadyRec			Readable recordings	
Status			Status of recording	
	-		Not active	
	Run		Waiting a triggering	
	Trig		Recording	
	FULL		Memory is full in saturated mode	
ManTrig	-, Trig		Manual triggering	Set
ReadyRec	n/m		n = Available recordings / m = maximum number of recordings The value of 'm' depends on the sample rate, number and type of the selected channels and the configured recording length.	

⁷¹⁾ Set = An editable parameter (password needed).

⁷²⁾ This is the fundamental frequency rms value of one cycle updated every 10 ms.

⁷³⁾ This is the fundamental frequency rms value of one cycle updated every 20 ms.

Table 108 - Disturbance recording parameters

Parameter	Value	Unit	Description	Average	Wave-form
ClrCh	-, Clear		Remove all channels		
AddCh			Add one channel. The maximum number of channels used simultaneously is 12.		
	IL1, IL2, IL3		Phase current	X	X

Parameter	Value	Unit	Description	Average	Wave-form
	I_0		Measured earth fault overcurrent	X	X
	U12, U23, U31		Line-to-line voltage	X	X
	UL1, UL2, UL3		Phase-to-neutral voltage	X	X
	U_0		Neutral displacement voltage	X	X
	f		Frequency	X	
	P, Q, S		Active, reactive, apparent power	X	
	P.F.		Power factor	X	
	CosPhi		$\cos\phi$	X	
	I_0 Calc		Phasor sum $I_0 = (I_{L1} + I_{L2} + I_{L3})/3$	X	
	I_1		Positive sequence current	X	
	I_2		Negative sequence current	X	
	I_2/I_1		Relative current unbalance	X	
	I_2/I_{MOT}		Negative sequence overcurrent [$\times I_{MOT}$]	X	
	I_L		Average $(I_{L1} + I_{L2} + I_{L3}) / 3$	X	
	DI		Digital inputs: DI1–20, F1, F2, BIOin, VI1-4, Arc1, Arc2	X	X
	DI_2		Digital inputs: DI21–40	X	X
	DI_3		Virtual inputs: VI5–20, A1–A5, VO1–VO6	X	X
	DO		Digital outputs: T1–15	X	X
	DO_2		Rest of the outputs	X	X
	DO_3		Virtual outputs, VO7–VO20	X	X
	TanPhi		$\tan\phi$	X	
	THDIL1, THDIL2, THDIL3		Total harmonic distortion of IL1, IL2 or IL3	X	
				X	
	Prms		Active power rms value	X	

Parameter	Value	Unit	Description	Average	Wave-form
	Qrms		Reactive power rms value	X	
	Srms		Apparent power rms value	X	
	fy		Frequency behind circuit breaker	X	
	fz		Frequency behind 2nd circuit breaker	X	
	IL1RMS, IL2MRS, IL3RMS		IL1, IL2, IL3 RMS for average sampling	X	
	Arc ⁷⁴⁾		Arc protection signals	X	
	Starts		Protection stage start signals	X	X
	Trips		Protection stage trip signals	X	X

⁷⁴⁾ Arc events are polled in every 5 ms.

Signal available depending on the slot 8 options.

NOTE: The selection of signals depends on the relay type, the used voltage connection and the scaling mode.

Characteristics

Table 109 - Disturbance recording

Mode of recording	Saturated / Overflow
Sample rate:	-
- Waveform recording	32/cycle, 16/cycle, 8/cycle
- Trend curve recording	10, 20, 200 ms 1, 5, 10, 15, 30 s 1 min
Recording time (one record)	0.1 s–12 000 min (According recorder setting)
Pre-trigger rate	0–100%
Number of selected channels	0–12
File format	IEEE Std C37.111-1999

The recording time and the number of records depend on the time setting and the number of selected channels.

7.2.1 Configuring the disturbance recorder


NOTE: The DR configuration can only be edited when connected to the device via Easergy Pro

1. To select the channels and sample rate for the disturbance recorder:
 - a. In Easergy Pro, go to **General > Disturbance recorder**.
 - b. Click the recorder channels you want to add.
 - c. Click the **Sample rate** drop-down list, and select the desired rate.
2. To download the disturbance recorder file, select **Tools > Download disturbance records**.

NOTE: The default (pre-configured) settings for DR are:

- all analog inputs supported by the device
- DI, DO
- Sampling rate: 32 s/c
- Recording length: 1 s'
- Output matrix: connection in every trip line to DR

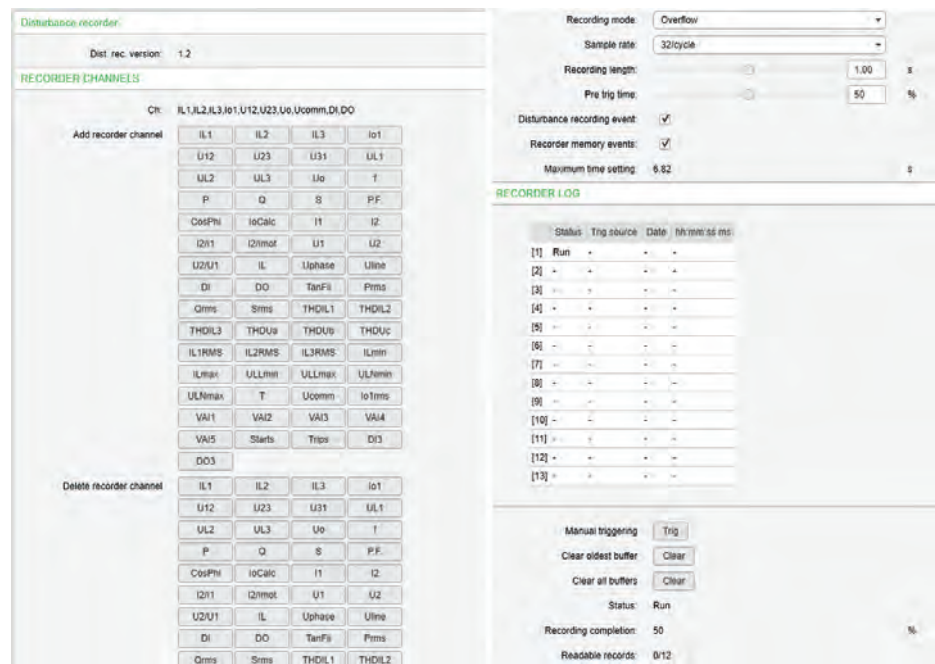Figure 152 - Configuring the disturbance recorder



3. To write the setting to the device, on the Easergy Pro toolbar, select **Write settings > Write all settings**.

NOTE: To save the relay's configuration information for later use, also save the Easergy Pro setting file on the PC. Use WaweWin or another customer preferred tool to analyze disturbance recorder file.

4. To save the setting file on your PC:
 - a. On the Easergy Pro toolbar, click the **Save** icon. The **Save a file** window opens.
 - b. Browse to the folder where you want to save the file. Type a descriptive file name, and click **Save**.

NOTE: By default, the setting file *.epz is saved in the Easergy Pro folder.

7.3 Cold load start and magnetizing inrush

Cold load start

A situation is regarded as cold load when all the three phase currents have been below a given idle value and then at least one of the currents exceeds a given start level within 80 ms. In such a case, the cold load detection signal is activated for the time set as **Maximum time** or until the measured signal returns below the value set as **Pickup current**. This signal is available for the output matrix and blocking matrix. Using virtual outputs of the output matrix setting group control is possible.

Application for cold load detection

Right after closing a circuit breaker, a given amount of overload can be allowed for a given limited time to take care of concurrent thermostat-controlled loads. The cold load start function does this, for example, by selecting a more coarse setting group for overcurrent stages. It is also possible to use the cold load detection signal to block any set of protection stages for a given time.

Magnetizing inrush detection

Magnetizing inrush detection is quite similar to the cold load detection but it also includes a condition for second harmonic content of the currents. When all phase currents have been below a given idle value and then at least one of them exceeds a given start level within 80 ms and the second harmonic ratio to fundamental frequency, I_{f2}/I_{f1} , of at least one phase exceeds the given setting, the inrush detection signal is activated. This signal is available for the output matrix and blocking matrix. Using virtual outputs of the output matrix setting group control is possible.


By setting the second harmonic start parameter for I_{f2}/I_{f1} to zero, the inrush signal will behave equally with the cold load start signal.

Application for inrush current detection

The inrush current of transformers usually exceeds the start setting of sensitive overcurrent stages and contains a lot of even harmonics. Right after closing a circuit breaker, the start and tripping of sensitive overcurrent stages can be avoided by selecting a more coarse setting group for the appropriate overcurrent stage with an inrush detect signal. It is also possible to use the detection signal to block any set of protection stages for a given time.

NOTE: Inrush detection is based on the fundamental component calculation which requires a full cycle of data for analyzing the harmonic content. Therefore, when using the inrush blocking function, the cold load start starting conditions are used for activating the inrush blocking when the current rise is noticed. If a significant ratio of second harmonic components is found in the signal after the first cycle, the blocking is continued. Otherwise, the second-harmonic-based blocking signal is released. Inrush blocking is recommended to be used on time-delayed overcurrent stages while the non-blocked instant overcurrent stage is set to 20 % higher than the expected inrush current. By this scheme, a fast reaction time in short circuit faults during the energization can be achieved while time-delayed stages are blocked by the inrush function.

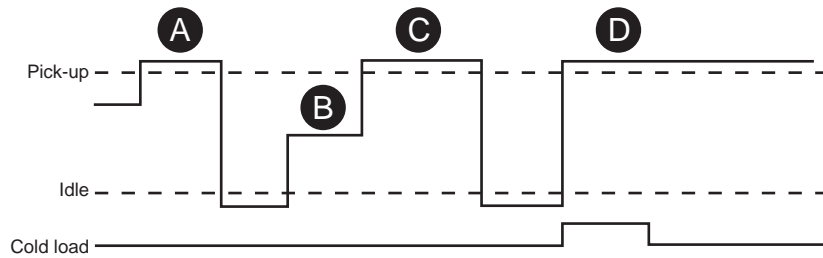Figure 153 - Functionality of cold load / inrush current feature.



- A. No activation because the current has not been under the set I_{DLE} current.
- B. Current dropped under the I_{DLE} current level but now it stays between the I_{DLE} current and the start current for over 80 ms.
- C. No activation because the phase two lasted longer than 80 ms.
- D. Now we have a cold load activation which lasts as long as the operate time was set or as long as the current stays above the start setting.

Characteristics

Table 110 - Magnetizing inrush detection

Cold load settings:	
- Current input	IL or I'L
- Idle current	0.01–0.50 x I_N
- Start current	0.30–10.00 x I_N
- Maximum time	0.01 ⁷⁵⁾ – 300.00 s (step 0.01 s)
Inrush settings:	
- Start for 2nd harmonic	0–99%

⁷⁵⁾ This is the instantaneous time, that is, the minimum total operate time including the fault detection time and the operate time of the trip contacts. Use the **Accept zero delay** setting in the protection stage setting view in Easergy Pro to accept the zero operate time setting for the DT function.

7.4 System clock and synchronization

Description

The relay's internal clock is used to time-stamp events and disturbance recordings.

The system clock should be externally synchronised to get comparable event time stamps for all the relays in the system.

The synchronizing is based on the difference of the internal time and the synchronizing message or pulse. This deviation is filtered and the internal time is corrected softly towards a zero deviation.

Time zone offsets

Time zone offset (or bias) can be provided to adjust the relay's local time. The offset can be set as a Positive (+) or Negative (-) value within a range of -15.00 to +15.00 hours and a resolution of 0.01/h. Basically, resolution by a quarter of an hour is enough.

Daylight saving time (DST)

The relay provides automatic daylight saving adjustments when configured. A daylight saving time (summer time) adjustment can be configured separately and in addition to a time zone offset.

Figure 154 - **System clock** view

System clock

Date: 2020-01-26

Day of week: Sunday

Time of day: 05:57:47

Date style: y-m-d

Time zone: 0.00 h

Enable DST:

Event enabling:

Status of DST

Status of DST: inactive

Next DST changes

Next DSTbegin date: 2020-03-29

DSTbegin hour: 03:00

Next DSTend date: 2020-10-25

DSTend hour (DST): 04:00

Daylight time standards vary widely throughout the world. Traditional daylight/summer time is configured as one (1) hour positive bias. The new US/Canada DST standard, adopted in the spring of 2007 is one (1) hour positive bias, starting at 2:00am on the second Sunday in March, and ending at 2:00am on the first Sunday in November. In the European Union, daylight change times are defined relative to the UTC time of day instead of local time of day (as in U.S.) European customers, carefully check the local country rules for DST.

The daylight saving rules are by default UTC +2:00 (24-hour clock):

- Daylight saving time start: Last Sunday of March at 03.00
- Daylight saving time end: Last Sunday of October at 04.00

Figure 155 - DST end and begin rules

DSTbegin rule

DSTbegin month:

Ordinal of day of week:

Day of week:

Hour:

DSTend rule

DSTend month:

Ordinal of day of week:

Day of week:

DSTend hour (DST): DST

To ensure proper hands-free year-around operation, automatic daylight time adjustments must be configured using the “Enable DST” and not with the time zone offset option.

Adapting the auto-adjust function

During tens of hours of synchronizing, the relay learns its average deviation and starts to make small corrections by itself. The target is that when the next synchronizing message is received, the deviation is already near zero. Parameters "AAIntv" and "AvDrft" show the adapted correction time interval of this ±1 ms auto-adjust function.

Time drift correction without external sync

If any external synchronizing source is not available and the system clock has a known steady drift, it is possible to roughly correct the clock deviation by editing the parameters "AAIntv" and "AvDrft". The following equation can be used if the previous "AAIntv" value has been zero.

$$AAIntv = \frac{604.8}{DriftInOneWeek}$$

If the auto-adjust interval "AAIntv" has not been zero, but further trimming is still needed, the following equation can be used to calculate a new auto-adjust interval.

$$AAIntv_{NEW} = \frac{1}{\frac{1}{AAIntv_{PREVIOUS}} + \frac{DriftInOneWeek}{604.8}}$$

The term *DriftInOneWeek/604.8* may be replaced with the relative drift multiplied by 1000 if some other period than one week has been used. For example, if the drift has been 37 seconds in 14 days, the relative drift is 37*1000/(14*24*3600) = 0.0306 ms/s.

Example 1

If there has been no external sync and the relay's clock is leading sixty-one seconds a week and the parameter *AAIntv* has been zero, the parameters are set as

$$AvDrft = Lead$$

$$AAIntv = \frac{604.8}{61} = 9.9s$$

With these parameter values, the system clock corrects itself with -1 ms every 9.9 seconds which equals -61.091 s/week.

Example 2

If there is no external sync and the relay's clock has been lagging five seconds in nine days and the *AAIntv* has been 9.9 s, leading, then the parameters are set as

$$AAIntv_{NEW} = \frac{1}{\frac{1}{9.9} - \frac{5000}{9 \cdot 24 \cdot 3600}} = 10.6$$

$$AvDrft = Lead$$

When the internal time is roughly correct – the deviation is less than four seconds – no synchronizing or auto-adjust turns the clock backwards. Instead, if the clock is leading, it is softly slowed down to maintain causality.

Table 111 - System clock parameters

Parameter	Value	Unit	Description	Note
Date			Current date	Set
Time			Current time	Set
Style			Date format	Set
	y-d-m		Year-Month-Day	
	d.m.y		Day.Month.Year	
	m/d/y		Month/Day/Year	
SyncDI	Possible values depends on the types of I/O cards		The digital input used for clock synchronization.	76)
	-		DI not used for synchronizing	
			Minute pulse input	

Parameter	Value	Unit	Description	Note
TZone	-15.00 – +15.00 ⁷⁷⁾		UTC time zone for SNTP synchronization. Note: This is a decimal number. For example for state of Nepal the time zone 5:45 is given as 5.75	Set
DST	No; Yes		Daylight saving time for SNTP	Set
SySrc			Clock synchronization source	
	Internal		No sync recognized since 200s	
	DI		Digital input	
	SNTP		Protocol sync	
	SpaBus		Protocol sync	
	ModBus		Protocol sync	
	ModBus TCP		Protocol sync	
	ProfibusDP		Protocol sync	
	IEC101		Protocol sync	
	IEC103		Protocol sync	
	DNP3		Protocol sync	
	IRIG-B003		IRIG timecode B003 ⁷⁸⁾	
MsgCnt	0 – 65535, 0 – etc.		The number of received synchronization messages or pulses	

Parameter	Value	Unit	Description	Note
Dev	± 32767	ms	Latest time deviation between the system clock and the received synchronization	
SyOS	± 10000.000	s	synchronization correction for any constant deviation in the synchronizing source	Set
AAIntv	± 1000	s	Adapted auto-adjust interval for 1 ms correction	Set ⁷⁹⁾
AvDrft	Lead; Lag		Adapted average clock drift sign	Set ⁷⁹⁾
FilDev	± 125	ms	Filtered synchronization deviation	

⁷⁶⁾ Set the DI delay to its minimum and the polarity such that the leading edge is the synchronizing edge.

⁷⁷⁾ A range of -11 h – +12 h would cover the whole earth but because the International Date Line does not follow the 180° meridian, a more wide range is needed.

⁷⁸⁾ Relay needs to be equipped with suitable hardware option module to receive IRIG-B clock synchronization signal. ([13.2 Accessories](#)).

⁷⁹⁾ If external synchronization is used, this parameter is set automatically.

Set = An editable parameter (password needed).

Synchronization with DI

The clock can be synchronized by reading minute pulses from digital inputs, virtual inputs or virtual outputs. The sync source is selected with the **SyncDI** setting. When a rising edge is detected from the selected input, the system clock is adjusted to the nearest minute. The length of the digital input pulse should be at least 50 ms. The delay of the selected digital input should be set to zero.

Synchronization correction

If the sync source has a known offset delay, it can be compensated with the **SyOS** setting. This is useful for compensating hardware delays or transfer delays of communication protocols. A positive value compensates a lagging external sync and communication delays. A negative value compensates any leading offset of the external synch source.

Sync source

When the relay receives new sync message, the sync source display is updated. If no new sync messages are received within the next 1.5 minutes, the relay switches over to internal sync mode.


Sync source: IRIG-B

IRIG standard time formats B003 and B004 are supported with a dedicated communication option (See [13.2 Accessories](#)).

IRIG-B input clock signal voltage level is TLL. The input clock signal originated in the GPS receiver must be taken to multiple relays through an IRIG-B distribution module. This module acts as a centralized unit for a point-to-multiple point connection.

NOTE: Daisy chain connection of IRIG-B signal inputs in multiple relays must be avoided.

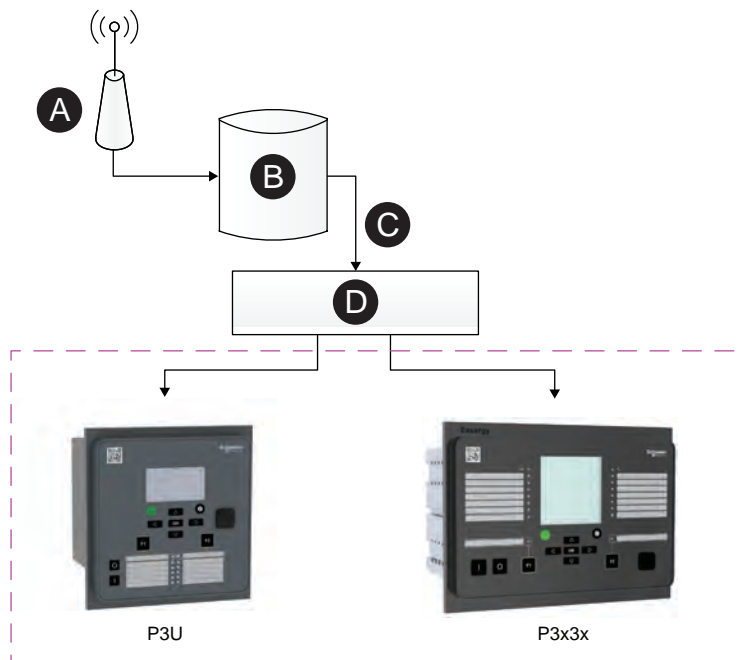Figure 156 - Easergy P3 relays with IRIG-B synchronization capability



- A. Antenna
- B. GPS clock
- C. IRIG-B signal from clock
- D. IRIG-B distribution module

The recommended cable must be shielded and either of coaxial or twisted pair type. Its length must not exceed 10 meters.

Deviation

The time deviation means how much the system clock time differs from the sync source time. The time deviation is calculated after receiving a new sync message. The filtered deviation means how much the system clock was really adjusted. Filtering takes care of small deviation in sync messages.

Auto-lag/lead

The relay synchronizes to the sync source, meaning that it starts automatically leading or lagging to stay in perfect sync with the master. The learning process takes a few days.

7.5 Voltage sags and swells

Description

The power quality of electrical networks has become increasingly important. Sophisticated loads (for example computers) require an uninterruptible supply of “clean” electricity. The Easergy P3M30 and P3M32 protection platform provides many power quality functions that can be used to evaluate and monitor the quality and alarm on the basis of the quality. One of the most important power quality functions is voltage sag and swell monitoring.

Easergy P3M30 and P3M32 provides separate monitoring logs for sags and swells. The voltage log is triggered if any voltage input either goes under the sag limit (U<) or exceeds the swell limit (U>). There are four registers for both sags and swells in the fault log. Each register contains start time, phase information, duration and the minimum, average and maximum voltage values of each sag and swell event. Furthermore, it contains the total number of sags and swells counters as well as the total number of timers for sags and swells.

The voltage power quality functions are located under the submenu “U”.

Table 112 - Setting parameters of sags and swells monitoring

Parameter	Value	Unit	Default	Description
U>	20 – 150	%	110	Setting value of swell limit
U<	10 – 120	%	90	Setting value of sag limit
Delay	0.04 – 1.00	s	0.06	Delay for sag and swell detection
SagOn	On; Off	-	On	Sag on event
SagOff	On; Off	-	On	Sag off event
SwelOn	On; Off	-	On	Swell on event
SwelOf	On; Off	-	On	Swell off event

Table 113 - Recorded values of sags and swells monitoring

	Parameter	Value	Unit	Description
Recorded values	Count		-	Cumulative sag counter
	Total		-	Cumulative sag time counter
	Count		-	Cumulative swell counter
	Total		-	Cumulative swell time counter
Sag / swell logs 1 – 4	Date		-	Date of the sag/ swell
	Time		-	Time stamp of the sag/swell
	Type		-	Voltage inputs that had the sag/swell
	Time		s	Duration of the sag/swell
	Min1		% U_N	Minimum voltage value during the sag/ swell in the input 1
	Min2		% U_N	Minimum voltage value during the sag/ swell in the input 2
	Min3		% U_N	Minimum voltage value during the sag/ swell in the input 3
	Ave1		% U_N	Average voltage value during the sag/swell in the input 1

	Parameter	Value	Unit	Description
	Ave2		% U_N	Average voltage value during the sag/swell in the input 2
	Ave3		% U_N	Average voltage value during the sag/swell in the input 3
	Max1		% U_N	Maximum voltage value during the sag/swell in the input 1
	Max2		% U_N	Maximum voltage value during the sag/swell in the input 2
	Max3		% U_N	Maximum voltage value during the sag/swell in the input 3

Characteristics

Table 114 - Voltage sag & swell

Voltage sag limit	10 –120% U_N (step 1%)
Voltage swell limit	20 –150% U_N (step 1%)
Definite time function: - Operate time	DT 0.08–1.00 s (step 0.02 s)
Low voltage blocking	0–50%
Reset time	< 60 ms
Reset ration: - Sag - Swell	1.03 0.97

Block limit	0.5 V or 1.03 (3%)
Inaccuracy:	
- Activation	±0.5 V or 3% of the set value
- Activation (block limit)	±5% of the set value
- Operate time at definite time function	±1% or ±30 ms

If one of the line-to-line voltages is below sag limit and above block limit but another line-to-line voltage drops below block limit, blocking is disabled.

7.6 Voltage interruptions

Description

The relay includes a simple function to detect voltage interruptions. The function calculates the number of voltage interruptions and the total time of the voltage-off time within a given calendar period. The period is based on the relay's real-time clock. The available periods are:

- 8 hours, 00:00–08:00, 08:00–16:00, 16:00–24:00
- one day, 00:00–24:00
- one week, Monday 00:00 – Sunday 24:00
- one month, the first day 00:00 – the last day 24:00
- one year, 1st January 00:00 – 31st December 24:00


After each period, the number of interruptions and the total interruption time are stored as previous values. The interruption counter and the total time are cleared for a new period. Previous values are overwritten.

Voltage interruption is based on the value of the positive sequence voltage U_1 and a limit value you can define. Whenever the measured U_1 goes below the limit, the interruption counter is increased, and the total time counter starts increasing.

The shortest recognized interruption time is 40 ms. If the voltage-off time is shorter, it may be recognized depending on the relative depth of the voltage dip.

If the voltage has been significantly over the limit $U_{1<}$ and then there is a small and short under-swing, it is not recognized (*Figure 157*).

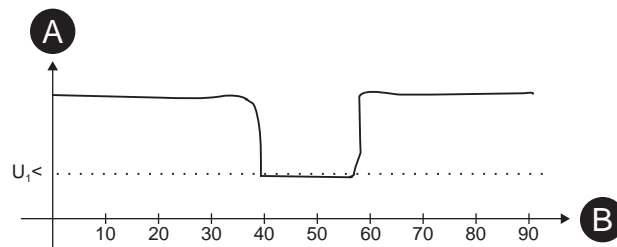
Figure 157 - A short voltage interruption which is probably not recognized



A. Voltage U_1 B. Time (ms)

On the other hand, if the limit $U_{1<}$ is high and the voltage has been near this limit, and then there is a short but very deep dip, it is not recognized (*Figure 158*).

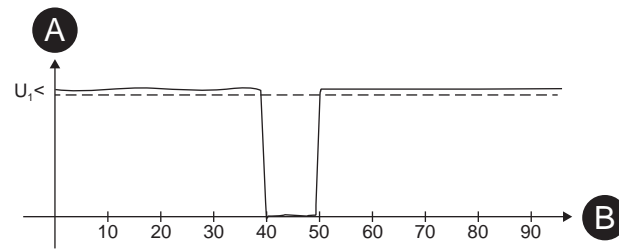Figure 158 - A short voltage interrupt that will be recognized



A. Voltage U_1 B. Time (ms)

Table 115 - Setting parameters of the voltage sag measurement function

Parameter	Value	Unit	Default	Description
$U_{1<}$	10.0–120.0	%	64	Setting value
Period	8h Day Week Month	-	Month	Length of the observation period
Date		-	-	Date
Time		-	-	Time

Table 116 - Measured and recorded values of voltage sag measurement function

	Parameter	Value	Unit	Description
Measured value	Voltage	LOW; OK	-	Current voltage status
	U_1		%	Measured positive sequence voltage

	Parameter	Value	Unit	Description
Recorded values	Count		-	Number of voltage sags during the current observation period
	Prev		-	Number of voltage sags during the previous observation period
	Total		s	Total (summed) time of voltage sags during the current observation period
	Prev		s	Total (summed) time of voltage sags during the previous observation period

Characteristics

Table 117 - Voltage interruptions

Voltage low limit (U_1)	10–120% U_N (step 1%)
Definite time function: - Operate time	DT < 60 ms (Fixed)
Reset time	< 60 ms
Reset ratio	1.03
Inaccuracy: - Activation	3% of the set value

7.7 Current transformer supervision (ANSI 60)

Description

The relay supervises the current transformers (CTs) and the external wiring between the relay terminals and the CTs. This is a safety function as well, since an open secondary of a CT causes dangerous voltages.

The CT supervision function measures phase currents. If one of the three phase currents drops below the $I_{MIN}<$ setting while another phase current exceeds the $I_{MAX}>$ setting, the function issues an alarm after the operation delay has elapsed.

Table 118 - Setting parameters of CT supervision

Parameter	Value	Unit	Default	Description
$I_{max}>$	0.0 – 10.0	xIn	2.0	Upper setting for CT supervision current scaled to primary value, calculated by relay
$I_{min}<$	0.0 – 10.0	xIn	0.2	Lower setting for CT supervision current scaled to primary value, calculated by relay
$t>$	0.02 – 600.0	s	0.10	Operation delay
CT on	On; Off	-	On	CT supervision on event
CT off	On; Off	-	On	CT supervision off event

Table 119 - Measured and recorded values of CT

	Parameter	Value	Unit	Description
Measured value	I_{Lmax}		A	Maximum of phase currents
	I_{Lmin}		A	Minimum of phase currents
Display	$I_{max}>$, $I_{min}<$		A	Setting values as primary values

	Parameter	Value	Unit	Description
Recorded values	Date		-	Date of CT supervision alarm
	Time		-	Time of CT supervision alarm
	I _{max}		A	Maximum phase current
	I _{min}		A	Minimum phase current

Characteristics

Table 120 - Current transformer supervision

I _{MAX} > setting	0.00 – 10.00 x I _N (step 0.01)
I _{MIN} < setting	0.00 – 10.00 x I _N (step 0.01)
Definite time function:	DT
- Operate time	0.04 – 600.00 s (step 0.02 s)
Reset time	< 60 ms
Reset ratio I _{MAX} >	0.97
Reset ratio I _{MIN} <	1.03
Inaccuracy:	-
- Activation	±3% of the set value
- Operate time at definite time function	±1% or ±30 ms

7.8 Voltage transformer supervision (ANSI 60FL)

Description

The relay supervises the voltage transformers (VTs) and VT wiring between the relay terminals and the VTs. If there is a fuse in the voltage transformer circuitry, the blown fuse prevents or distorts the voltage measurement. Therefore, an alarm should be issued. Furthermore, in some applications, protection functions using voltage signals should be blocked to avoid false tripping.

The VT supervision function measures three line-to-line voltages and currents. The negative sequence voltage U_2 and the negative sequence current I_2 are calculated. If U_2 exceed the $U_2>$ setting and at the same time, I_2 is less than the $I_2<$ setting, the function issues an alarm after the operation delay has elapsed.

Table 121 - Setting parameters of VT supervision

Parameter	Value	Unit	Default	Description
U2>	0.0 – 200.0	% Un	34.6	Upper setting for VT supervision
I2<	0.0 – 200.0	% In	100.0	Lower setting for VT supervision
t>	0.02 – 600.0	s	0.10	Operation delay
VT on	On; Off	-	On	VT supervision on event
VT off	On; Off	-	On	VT supervision off event

Table 122 - Measured and recorded values of VT supervision

	Parameter	Value	Unit	Description
Measured value	U2		%U _N	Measured negative sequence voltage
	I2		%I _N	Measured negative sequence current
Recorded Values	Date		-	Date of VT supervision alarm
	Time		-	Time of VT supervision alarm
	U2		%U _N	Recorded negative sequence voltage
	I2		%I _N	Recorded negative sequence current

Characteristics

Table 123 - Voltage transformer supervision

U ₂ > setting	0.0 – 200.0% (step 0.1%)
I ₂ < setting	0.0 – 200.0% (step 0.1%)
Definite time function: - Operate time	DT 0.04 – 600.00 (step 0.02s)
Reset time	< 60 ms
Reset ratio	3% of the start value
Inaccuracy: - Activation U ₂ > - Activation I ₂ < - Operate time at definite time function	- ±1%-unit ±1%-unit ±1% or ±30 ms

7.9 Circuit breaker wear

Description

Circuit breaker (CB) wear is a function that monitors CB wear by calculating how much wear the CB can sustain. It raises an alarm about the need for CB maintenance before the condition of the CB becomes critical.

This function records the peak symmetrical current⁸⁰⁾ from each phase⁸¹⁾, and uses that magnitude as the breaking current for that phase to estimate the amount of wear on the CB. The function then calculates the estimated number of cycles or trips remaining before the CB needs to be replaced or serviced.

Permissible cycle diagram


The permissible cycle diagram is usually available in the documentation of the CB manufacturer. This diagram specifies the permissible number of cycles as a function of the breaking current, that is, how much wear occurs in the CB when it trips with a given breaking current. So the maximum number of cycles a CB can trip with this breaking current is used as the measure of wear.

The condition monitoring function must be configured according to this diagram. In the configuration, this diagram is called **Breaker curve**.

⁸⁰⁾ The used peak current is the magnitude of the fundamental frequency component. This magnitude does not include a possible DC component.

⁸¹⁾ The current is sampled every 10 milliseconds, starting from the moment the monitored trip relay is asserted and ending when the current of every phase has decreased below one quarter of the phase's breaking current or after 500 milliseconds have elapsed, whichever happens first.

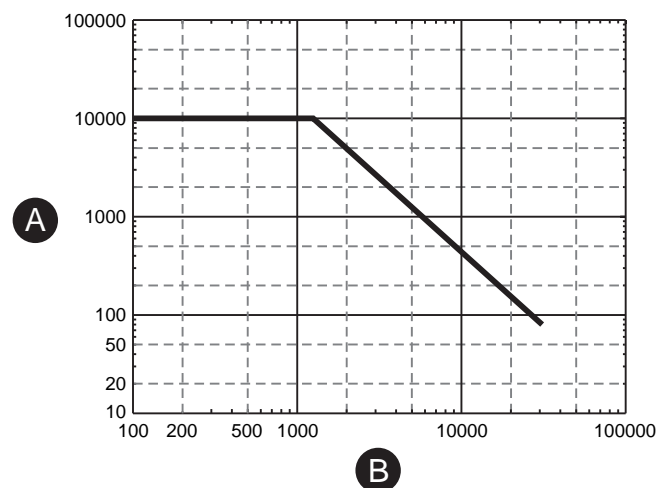Figure 159 - Example permissible cycle diagram



A. Number of permitted operations B. Breaking current (A)

Up to eight points can be selected from the diagram and entered to the device. Each point specifies a breaking current and the associated maximum number of permitted operations. The device assumes there is a straight line between each two consecutive points in the log-log diagram (that is, uses logarithmic interpolation between the points), and thus forms an approximation of the permissible cycle diagram. It should be possible to accurately describe most permissible cycle diagrams in this way.

The values in the example match the diagram in [Figure 159](#).

Table 124 - An example of circuit breaker wear characteristics

Point	Interrupted current (kA)	Number of permitted operations
1	0 (mechanical age)	10000
2	1.25 (rated current)	10000
3	31.0 (maximum breaking current)	80
4	100	1
5	100	1
6	100	1
7	100	1
8	100	1

Alarm points

Two alarm points can be configured to notify about the approaching need for CB maintenance.

The number of permissible CB cycles depends on the breaking current that is interrupted by the CB. Larger currents lead to greater wear on the CB and thus to fewer operating cycles.⁸²⁾

An alarm point specifies a breaking current and an associated number of permissible cycles. An alarm is raised if the remaining number of permissible cycles at the given breaking current falls below this limit.

The table in the **Operations left** setting view shows the number of operation cycles left before the alarm points are reached. The number of remaining cycles is tracked for each phase separately, and the alarm is raised when any phase runs out of cycles.

Figure 160 - Operations left

Phase	Alarm1	Alarm2
1	10000	945
2	10000	945
3	10000	945

CB wear alarm 1: -

CB wear alarm 2: -

Clear counters Clear

The first alarm point can be set, for example, to the CB’s nominal current and the second alarm point to a typical fault current.

When an alarm is raised, a signal is asserted in the output matrix. Also, an event is created depending on the settings given in the **Event enabling** setting view.

Logarithmic interpolation

The permitted number of operations for the currents between the defined points is logarithmically interpolated:

Equation 24

$$C = \frac{a}{I^n}$$

C = permitted operations

I = interrupted current

a = constant according to [Equation 25](#)

n = constant according to [Equation 26](#)

Equation 25

$$a = C_k I_k^2$$

⁸²⁾ Each cycle causes mechanical wear on the CB. In addition, large enough currents create arcs inside the CB, which causes erosion of the electrical contacts for each phase. The larger the current, the greater the erosion, and thus the greater the wear on the CB. A worn CB has fewer cycles left at any breaking current.

Equation 26

$$n = \frac{\ln \frac{C_k}{C_{k+1}}}{\ln \frac{I_{k+1}}{I_k}}$$

ln = natural logarithm function

 C_k, C_{k+1} = permitted operationsk = rows 2–7 in [Table 124](#) I_k, I_{k+1} = corresponding currentk = rows 2–7 in [Table 124](#)**Example of the logarithmic interpolation**

Alarm 2 current is set to 6 kA. The maximum number of operations is calculated as follows.

The current 6 kA lies between points 2 and 3 in the table. That gives value for the index k. Using

$$k = 2$$

$$C_k = 10000$$

$$C_{k+1} = 80$$

$$I_{k+1} = 31 \text{ kA}$$

$$I_k = 1.25 \text{ kA}$$

and [Equation 26](#) and [Equation 25](#), the device calculates

Equation 27

$$n = \frac{\ln \frac{10000}{80}}{\ln \frac{31000}{1250}} = 1.5038$$

Equation 28

$$a = 10000 \cdot 1250^{1.5038} = 454 \cdot 10^6$$

Using [Equation 24](#), the device gets the number of permitted operations for current 6 kA.

Equation 29

$$C = \frac{454 \cdot 10^6}{6000^{1.5038}} = 945$$

Thus, the maximum number of current-breaking operations at 6 kA is 945. This can be verified with the original CB curve in [Figure 159](#). The figure shows that at 6 kA, the operation count is between 900 and 1000. In this case, a useful alarm level for the operations left is 50, for example, which is about 5 percent of the maximum.

Example of operation counter decrementing when the CB breaks a current

Alarm 2 is set to 6 kA. The CB failure protection supervises trip relay T1, and a trip signal of an overcurrent stage detecting a two-phase fault is connected to this trip relay T1. The interrupted phase currents are 12.5 kA, 12.5 kA and 1.5 kA. By what number are Alarm2 counters decremented?

Using [Equation 24](#) and values n and a from the previous example, the device gets the number of permitted operations at 10 kA.

Equation 30

$$C_{10kA} = \frac{454 \cdot 10^6}{12500^{1.5038}} = 313$$

At alarm level 2, 6 kA, the corresponding number of operations is calculated according to:

Equation 31

$$\Delta = \frac{C_{AlarmMax}}{C}$$

$$\Delta_A = \Delta_B = \frac{945}{313} = 3$$

Thus, Alarm2 counters for phases L1 and L2 are decremented by 3. In phase L1, the current is less than the alarm limit current 6 kA. For such currents, the decrement is 1.

$$\Delta_{L3} = 1$$

Table 125 - Local panel parameters of the CBWEAR function

Parameter	Value	Unit	Description	Set ⁸³⁾
CBWEAR STATUS				
AI1L1			Operations left for	
AI1L2			- Alarm 1, phase L1	
AI1L3			- Alarm 1, phase L2	
AI2L1			- Alarm 1, phase L3	
AI2L2			- Alarm 2, phase L1	
AI2L3			- Alarm 2, phase L2	
			- Alarm 2, phase L3	
Latest trip				
Date time			Time stamp of the latest trip operation	
IL1		A	Broken current of phase L1	
IL2		A	Broken current of phase L2	
IL3		A	Broken current of phase L3	
CBWEAR SET				
Alarm1				
Current	0.00–100.00	kA	Alarm1 current level	Set
Cycles	100000–1		Alarm1 limit for operations left	Set
Alarm2				
Current	0.00–100.00	kA	Alarm2 current level	Set
Cycles	100000–1		Alarm2 limit for operations left	Set
CBWEAR SET2				

Parameter	Value	Unit	Description	Set ⁸³⁾
Al1On	On; Off		'Alarm1 on' event enabling	Set
Al1Off	On; Off		'Alarm1 off' event enabling	Set
Al2On	On; Off		'Alarm2 on' event enabling	Set
Al2Off	On; Off		'Alarm2 off' event enabling	Set
Clear	-; Clear		Clearing of cycle counters	Set

⁸³⁾ Set = An editable parameter (password needed)

7.10 Circuit breaker condition monitoring

Description

Circuit breaker (CB) condition monitoring monitors the CB wear with the help of the cumulative breaking current. It raises an alarm about the need for CB maintenance before the CB's condition becomes critical. This function has two stages.

The approach to calculating the CB condition is different from the approach used by the CB wear function described in [7.9 Circuit breaker wear](#). CB condition monitoring also provides some additional features for integrating the device with other Schneider Electric products. These functions are based on data analytics for integration into EcoStruxure Asset Advisor cloud-based offers.


Cumulative breaking current

CB monitoring is activated when the monitored CB opens, and the breaking current is added to the cumulative breaking current. This sum is calculated for each phase separately. This way of estimating the wear on the CB is opposite to the permissible cycles diagram used by the CB wear function. The permissible cycles diagram describes how much more wear the CB can sustain, and this approach describes how much wear the CB has accumulated.

To approximate the shape of the permissible cycles diagram, the cumulative breaking current is also calculated for 5 different bins, so that each bin tracks breaking currents within a given range (see [Figure 161](#)). If a phase's breaking current is within the range of a given bin, this current is added to the phase's cumulative breaking current on that bin.

Each bin also has three counters (one for each phase). Each counter tracks the number of times the CB has opened and something was added to the corresponding sum on that bin (see [Figure 161](#)).

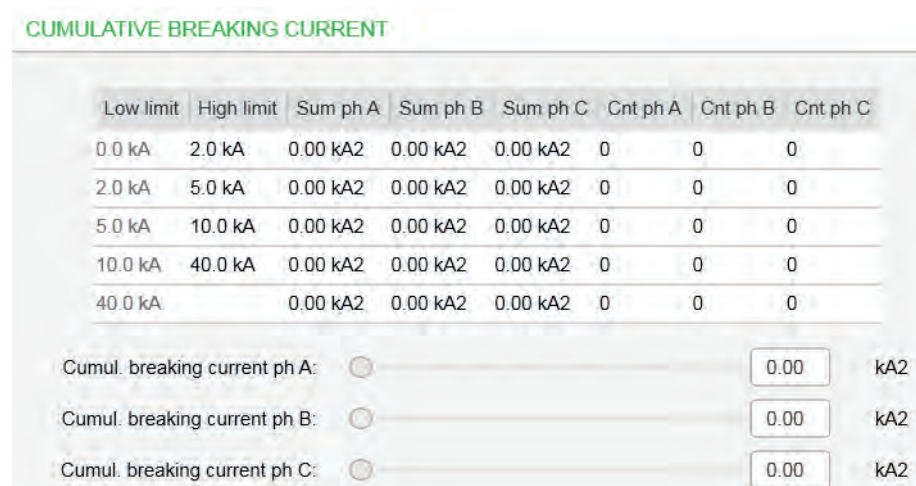Figure 161 - Cumulative breaking current



If all cumulative breaking currents for the bins are zero when the value of the CT primary parameter is changed in the **Scaling** setting view, the breaking current ranges for the bins are automatically set to their default values relative to the new CT primary value. The lower limit for the first bin is set to zero and the upper limit to two times the CT primary value. There is no upper limit for the fifth bin.

The cumulative breaking currents are tracked with greater precision than what is visible on the setting tool, that is, there are hidden decimals stored for each sum. A non-zero sum that is too small to be visible in the setting tool may prevent the bin ranges from getting their default values when the CT primary value is changed.

Each breaking current can be added to one bin.

The cumulative breaking currents can be read over the Modbus protocol as floating-point values (IEEE 754, binary32). These values are represented in two consecutive holding registers, so that the register in the lower address contains the MSB 16 bits. To change the sum by writing a floating-point value, the MSB 16 bits must be written first.


The cumulative breaking currents can be cleared by writing value zero to them.

Counters for mechanical operations

This function includes a counter that tracks the number of times the monitored CB is opened, and a second counter that tracks how many of those operations were caused by a protection stage trip. This requires that one of the controllable objects (see [5.6 Controllable objects](#)) has been configured to represent the CB and this object has been selected in the **Monitored object** parameter.

Internally, each object has its own open counter and the counter for the monitored object is shown under **Opening counts**, **Trip counts** and **Rack-out counter** (see [Figure 162](#)). These open counters are incremented even when this function has been disabled. In contrast, the trip counter is incremented when the monitored object is opened by a protection stage trip and this function is enabled. Thus, if you change the monitored object, the open counter value switches to the counter of the new object, but the trip counter continues from its current value. Both counters' values can be changed.

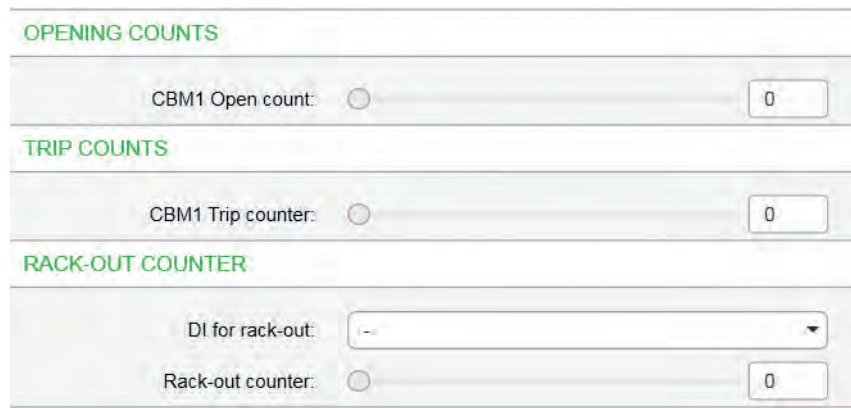Figure 162 - Counters for mechanical operations



The number of times the monitored CB is racked out from the bay is tracked by its own counter. This requires that a digital input is set up to indicate when the CB is racked out⁸⁴). This digital input is selected under **Rack-out counter**. Each digital input has its own counter. The same counter is also found in the **Digital inputs** setting view.


Operate times logs

This function records the completion times for the eight previous open, close, and charge operations of the monitored CB. Each operate time is recorded with a timestamp indicating when the operation was completed. This function also keeps a cumulative moving average of 20 previous operate times for each of the three categories.

The completion times are recorded even if this function has been disabled, provided that the monitored object has been selected.

All three logs of completion times can be cleared by the **Clear logs** command.

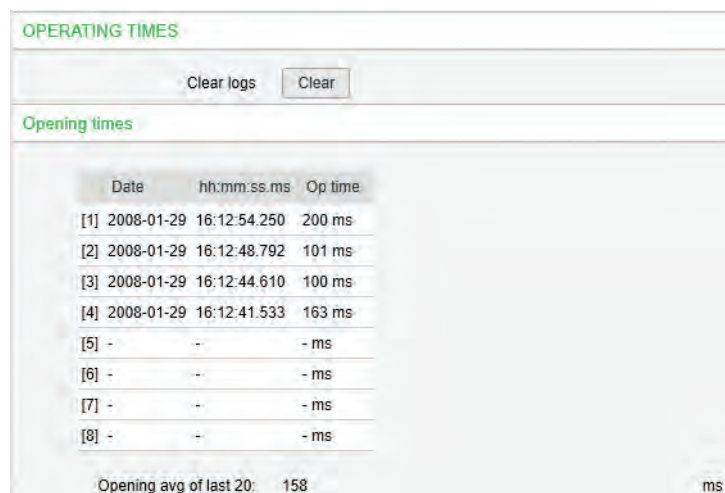Figure 163 - CB opening times



The charging times are recorded in seconds whereas the opening and closing times are recorded in milliseconds.

⁸⁴) When the CB r is in the bay, this digital input has logical value *false*, and when the CB is racked out, this input has logical value *true*.

The operate times can be read over the Modbus protocol as floating-point values (IEEE 754, binary32), so that a range of holding registers is used to represent all operate times of a given category, from the newest to oldest. Each operate time is represented in two consecutive holding registers, so that the register in the lower address contains the MSB 16 bits.

Empty or unused cells in the log give value zero.


If an opening time or a closing time is greater than 300 milliseconds, this value is given as NaN (not-a-number) when it is read as a floating-point value. Similarly, charging times greater than 60 seconds are given as NaN.

7.11 Energy pulse outputs

Description

The relay can be configured to send a pulse whenever a certain amount of energy has been imported or exported. The principle is presented in [Figure 164](#). Each time the energy level reaches the pulse size, a digital output is activated and the relay is active as long as defined by a pulse duration setting.

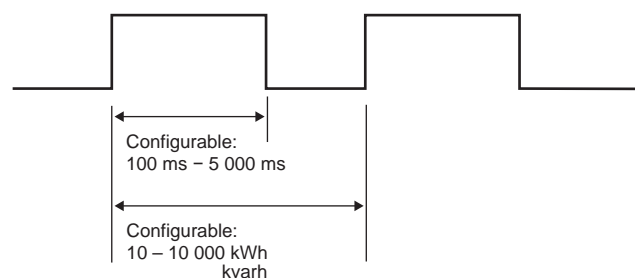Figure 164 - Principle of energy pulses



The relay has four energy pulse outputs. The output channels are:

- active exported energy
- reactive exported energy
- active imported energy
- reactive imported energy

Each channel can be connected to any combination of the digital outputs using the output matrix. The parameters for the energy pulses can be found in the ENERGY menu "E" under the submenus E-PULSE SIZES and E-PULSE DURATION.

Table 126 - Energy pulse output parameters

	Parameter	Value	Unit	Description
E-PULSE SIZES	E+	10 – 10 000	kWh	Pulse size of active exported energy
	Eq+	10 – 10 000	kvarh	Pulse size of reactive exported energy
	E-	10 – 10 000	kWh	Pulse size of active imported energy
	Eq-	10 – 10 000	kvarh	Pulse size of reactive imported energy
E-PULSE DURATION	E+	100 – 5000	ms	Pulse length of active exported energy
	Eq+	100 – 5000	ms	Pulse length of reactive exported energy
	E-	100 – 5000	ms	Pulse length of active imported energy
	Eq-	100 – 5000	ms	Pulse length of reactive imported energy

Scaling examples

1. The average active exported power is 250 MW.

The peak active exported power is 400 MW.

The pulse size is 250 kWh.

The average pulse frequency is $250/0.250 = 1000$ pulses/h.

The peak pulse frequency is $400/0.250 = 1600$ pulses/h.

Set pulse length to $3600/1600 - 0.2 = 2.0$ s or less.

The lifetime of the mechanical digital output is $50 \times 10^6 / 1000$ h = 6 a.

This is not a practical scaling example unless a digital output lifetime of about six years is accepted.

2. The average active exported power is 100 MW.

The peak active exported power is 800 MW.

The pulse size is 400 kWh.

The average pulse frequency is $100/0.400 = 250$ pulses/h.

The peak pulse frequency is $800/0.400 = 2000$ pulses/h.

Set pulse length to $3600/2000 - 0.2 = 1.6$ s or less.

The lifetime of the mechanical digital output is $50 \times 10^6 / 250$ h = 23 a.

3. Average active exported power is 20 MW.

Peak active exported power is 70 MW.

Pulse size is 60 kWh.

The average pulse frequency is $25/0.060 = 416.7$ pulses/h.

The peak pulse frequency is $70/0.060 = 1166.7$ pulses/h.

Set pulse length to $3600/1167 - 0.2 = 2.8$ s or less.

The lifetime of the mechanical digital output is $50 \times 10^6 / 417$ h = 14 a.

4. Average active exported power is 1900 kW.

Peak active exported power is 50 MW.

Pulse size is 10 kWh.

The average pulse frequency is $1900/10 = 190$ pulses/h.

The peak pulse frequency is $50000/10 = 5000$ pulses/h.

Set pulse length to $3600/5000 - 0.2 = 0.5$ s or less.

The lifetime of the mechanical digital output is $50 \times 10^6 / 190$ h = 30 a.

Figure 165 - Application example of wiring the energy pulse outputs to a PLC having common plus and using an external wetting voltage

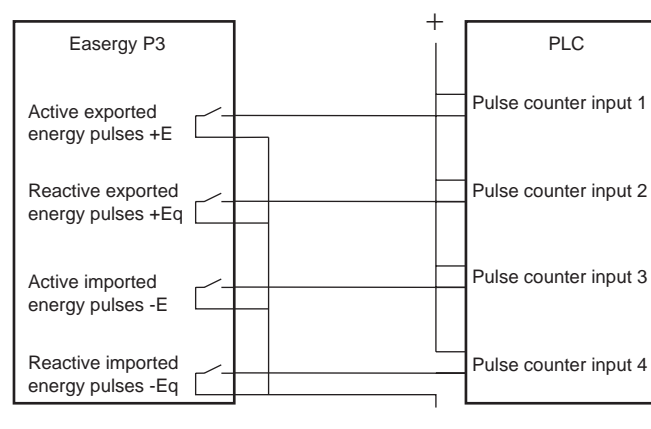


Figure 166 - Application example of wiring the energy pulse outputs to a PLC having common minus and using an external wetting voltage


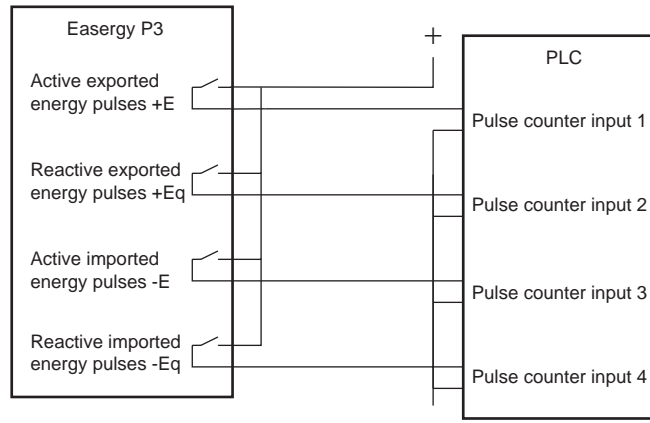


Figure 167 - Application example of wiring the energy pulse outputs to a PLC having common minus and an internal wetting voltage.

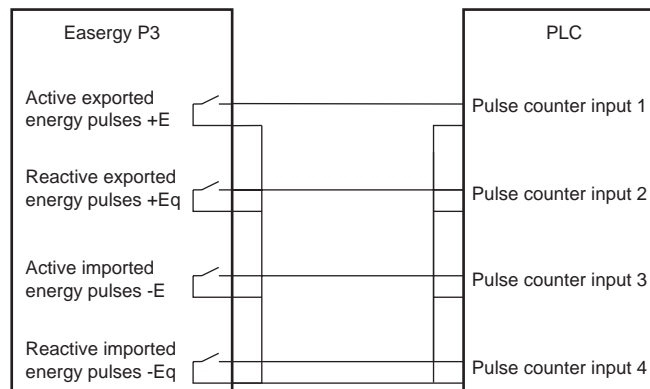

7.12 Running hour counter

Description

The running hour counter is typically used to monitor the service time of the motor or appropriate feeder. This function calculates the total active time of the selected digital input, virtual I/O function button, GOOSE signal, POC signal or output matrix output signal. The resolution is ten seconds and the data is stored in the non-volatile memory.

Parameters

Table 127 - Running hour counter parameters

Parameter	Value	Unit	Description	Note
Runh	0...876000	h	Total active time, hours Note: The label text "Runh" can be edited with Easergy Pro.	(Set) ⁸⁵⁾
Runs	0...3599	s	Total active time, seconds	(Set)
Starts	0...65535		Activation counter	(Set)
Status	Stop Run		Current status of the selected digital signal	
Started at			Date and time of the last activation	
Stopped at			Date and time of the last inactivation	


⁸⁵⁾ (Set) = An informative value which can be edited as well.

7.13 Timers

Description

The Easergy P3 protection platform includes four settable timers that can be used together with the user's programmable logic or to control setting groups and other applications that require actions based on calendar time. Each timer has its own settings. The selected on-time and off-time is set, after which the activation of the timer can be set to be as daily or according to the day of the week (See the setting parameters for details). The timer outputs are available for logic functions and for the block and output matrix.

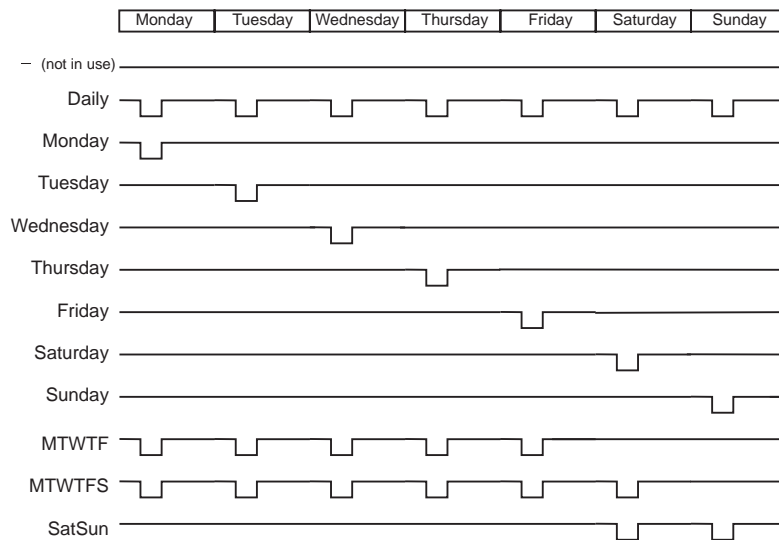Figure 168 - Timer output sequence in different modes



You can force any timer, which is in use, on or off. The forcing is done by writing a new status value. No forcing flag is needed as in forcing for example the digital outputs.

The forced time is valid until the next forcing or until the next reversing timed act from the timer itself.

The status of each timer is stored in the non-volatile memory when the auxiliary power is switched off. At startup, the status of each timer is recovered.

Table 128 - Setting parameters of timers

Parameter	Value	Description
TimerN	-	Timer status
	-	Not in use
	0	Output is inactive
	1	Output is active
On	hh:mm:ss	Activation time of the timer
Off	hh:mm:ss	De-activation time of the timer
Mode		For each four timers there are 12 different modes available:
	-	The timer is off and not running. The output is off i.e. 0 all the time.
	Daily	The timer switches on and off once every day.
	Monday	The timer switches on and off every Monday.

Parameter	Value	Description
	Tuesday	The timer switches on and off every Tuesday.
	Wednesday	The timer switches on and off every Wednesday.
	Thursday	The timer switches on and off every Thursday.
	Friday	The timer switches on and off every Friday.
	Saturday	The timer switches on and off every Saturday.
	Sunday	The timer switches on and off every Sunday.
	MTWTF	The timer switches on and off every day except Saturdays and Sundays
	MTWTFS	The timer switches on and off every day except Sundays.
	SatSun	The timer switches on and off every Saturday and Sunday.

7.14 Combined overcurrent status

Description

This function collects faults, fault types and registered fault currents of all enabled overcurrent stages and shows them in the event log.

The combined overcurrent status can be used as an indication of faults.

Combined o/c indicates the amplitude of the last occurred fault. Also, a separate indication of the fault type is informed during the start and the trip. Active phases during the start and the trip are activated in the output matrix. After the fault is switched off, the active signals release after the set delay "clearing delay" has passed. The combined o/c status refers to the following over current stages: $I >$, $I >>$, $I >>>$, $I_{\varphi} >$, $I_{\varphi} >>$, $I_{\varphi} >>>$ and $I_{\varphi} >>>>$.

Table 129 - Line fault parameters

Parameter	Value	Unit	Description	Note
IFtLas			Current of the latest overcurrent fault	(Set)
LINE ALARM				
AlrL1 AlrL2 AlrL3	- 0 1		Start (=alarm) status for each phase. 0 = No start since alarm ClrDly 1 = Start is on	
OCs	- 0 1		Combined overcurrent start status. AlrL1 = AlrL2 = AlrL3 = 0 AlrL1 = 1 or AlrL2 = 1 or AlrL3 = 1	
LxAlarm	- On Off		'On' Event enabling for AlrL1 – 3 Events are enabled Events are disabled	Set
LxAlarmOff	- On Off		'Off' Event enabling for AlrL1...3 Events are enabled Events are disabled	Set
OCArm	- On Off		'On' Event enabling for combined o/c starts Events are enabled Events are disabled	Set

Parameter	Value	Unit	Description	Note
OCArmOff	- On Off		'Off' Event enabling for combined o/c starts Events are enabled Events are disabled	Set
IncFltEvnt	- On Off		Disabling several start <u>and</u> trip events of the same fault Several events are enabled ⁸⁶⁾ Several events of an increasing fault is disabled ⁸⁷⁾	Set
ClrDly	0 – 65535	s	Duration for active alarm status AlrL1, Alr2, AlrL3 and OCs	Set

⁸⁶⁾ Used with IEC 60870-105-103 communication protocol. The alarm screen shows the latest fault current if it is the biggest registered fault current, too. Not used with Spabus because Spabus masters usually do not like to have unpaired On/Off events.

⁸⁷⁾ Used with SPA-bus protocol because most SPA-bus masters need an off-event for each corresponding on-event.

Parameter	Value	Unit	Description	Note
LINE FAULT				
FltL1	-		Fault (=trip) status for each phase. 0 = No fault since fault ClrDly 1 = Fault is on	
FltL2	0			
FltL3	1			

Parameter	Value	Unit	Description	Note
OCT	- 0 1		Combined overcurrent trip status. FltL1 = FltL2 = FltL3 = 0 FltL1 = 1 or FltL2 = 1 or FltL3 = 1	
LxTrip	- On Off		'On' Event enabling for FltL1 – 3 Events are enabled Events are disabled	Set
LxTripOff	- On Off		'Off' Event enabling for FltL1...3 Events are enabled Events are disabled	Set
OCTrip	- On Off		'On' Event enabling for combined o/c trips Events are enabled Events are disabled	Set
OCTripOff	- On Off		'Off' Event enabling for combined o/c starts Events are enabled Events are disabled	Set

Parameter	Value	Unit	Description	Note
IncFltEvnt	- On Off		Disabling several events of the same fault Several events are enabled ⁸⁸⁾ Several events of an increasing fault is disabled ⁸⁹⁾	Set
ClrDly	0 – 65535		Duration for active alarm status FltL1, Flt2, FltL3 and OCt	Set

⁸⁸⁾ Used with IEC 60870-105-103 communication protocol. The alarm screen shows the latest fault current if it is the biggest registered fault current, too. Not used with Spabus because Spabus masters usually do not like to have unpaired On/Off events.

⁸⁹⁾ Used with SPA-bus protocol because most SPA-bus masters need an off-event for each corresponding on-event.

Figure 169 - Combined o/c status

Combined o/c status

Last fault current:	<input type="text" value="3.18"/>	xIn
Last EF current:	<input type="text" value="0.00"/>	xIn
Line 1 alarm:	<input type="text" value="1"/>	
Line 2 alarm:	<input type="text" value="1"/>	
Line 3 alarm:	<input type="text" value="0"/>	
Overcurrent alarm:	<input type="text" value="1"/>	
Earth Fault alarm:	<input type="text" value="0"/>	
Clearing delay for alarm value:	<input type="text" value="60"/>	s
Line 1 fault:	<input type="text" value="1"/>	
Line 2 fault:	<input type="text" value="1"/>	
Line 3 fault:	<input type="text" value="0"/>	
Overcurrent trip:	<input type="text" value="1"/>	
Earth Fault trip:	<input type="text" value="0"/>	
Clearing delay for fault value:	<input type="text" value="60"/>	s

The fault that can be seen in the [Figure 169](#) was 3.18 times to nominal and it increased in to a two phase short circuit L1-L2. All signals those are stated as “1” are also activated in the output matrix. After the fault disappears, the activated signals release.

The combined overcurrent status can be found from Easergy Pro through **Protection > Protection stage status 2**.

7.15 Trip circuit supervision (ANSI 74)

Description

Trip circuit supervision is used to ensure that the wiring from the protective relay to a circuit breaker (CB) is in order. Even though the trip circuit is unused most of the time, keeping it in order is important so that the CB can be tripped whenever the relay detects a fault in the network.

The digital inputs of the relay can be used for trip circuit monitoring.

Also the closing circuit can be supervised using the same principle.

NOTE: Apply trip circuit supervision using a digital input and its programmable time delay.


7.15.1 Trip circuit supervision with one digital input

The benefits of this scheme are that only one digital inputs is needed and no extra wiring from the relay to the circuit breaker (CB) is needed. Also, supervising a 24 Vdc trip circuit is possible.

The drawback is that an external resistor is needed to supervise the trip circuit on both CB positions. If supervising during the closed position only is enough, the resistor is not needed.

- The digital input is connected parallel to the trip contacts (see [Figure 170](#)).
- The digital input is configured as normal closed (NC).
- The digital input delay is configured to be longer than the maximum fault time to inhibit any superfluous trip circuit fault alarm when the trip contact is closed.
- The digital input is connected to a relay in the output matrix giving out any trip circuit alarm.
- The trip relay must be configured as non-latched. Otherwise, a superfluous trip circuit fault alarm follows after the trip contact operates, and the relay remains closed because of latching.
- By utilizing an auxiliary contact of the CB for the external resistor, also the auxiliary contact in the trip circuit can be supervised.

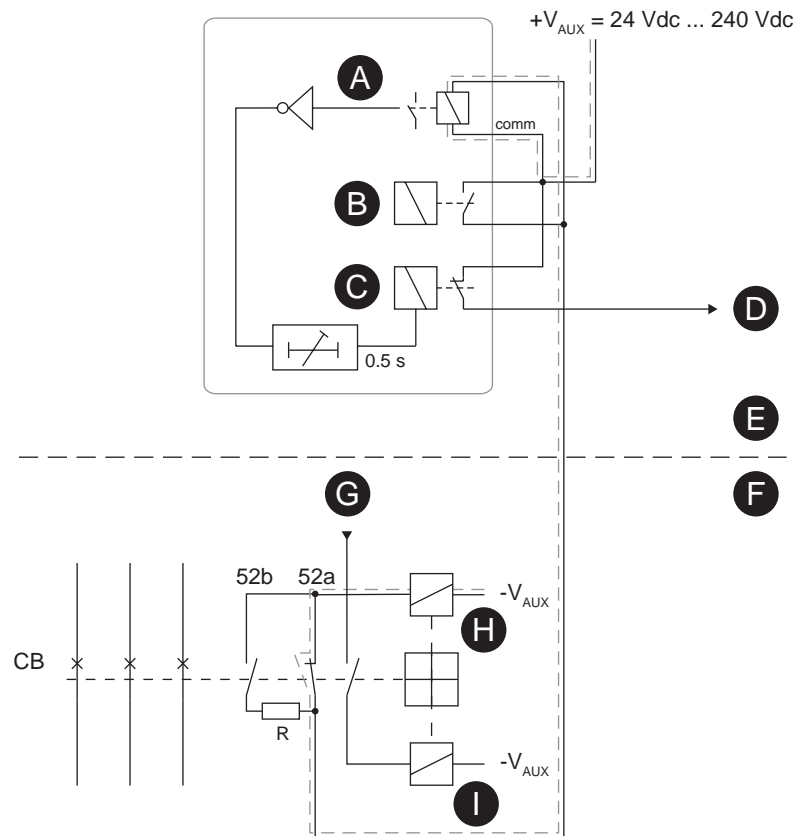Figure 170 - Trip circuit supervision using a single digital input and an external resistor R




- | | |
|---|--------------------------------|
| A. Digital input 1 | F. Circuit breaker compartment |
| B. Trip relay | G. Close control |
| C. Alarm relay for trip circuit failure | H. Open coil |
| D. Trip circuit failure alarm | I. Close coil |
| E. Relay compartment | |

The circuit-breaker is in the closed position. The supervised circuitry in this CB position is double-lined. The digital input is in active state when the trip circuit is complete.

This is applicable to any digital inputs.

NOTE: The need for the external resistor R depends on the application and circuit breaker manufacturer's specifications.

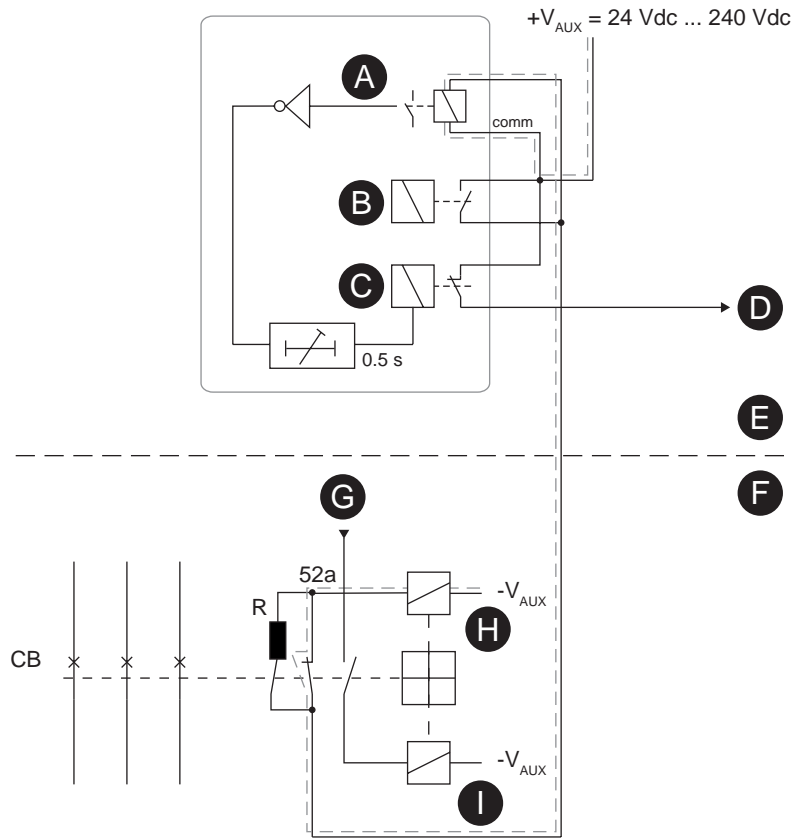Figure 171 - Alternative connection without using circuit breaker 52b auxiliary contacts




- A. Digital input 1
- B. Trip relay
- C. Alarm relay for trip circuit failure
- D. Trip circuit failure alarm
- E. Relay compartment
- F. Circuit breaker compartment
- G. Close control
- H. Open coil
- I. Close coil

Trip circuit supervision using a single digital input and an external resistor R. The circuit breaker is in the closed position. The supervised circuitry in this CB position is double-lined. The digital input is in active state when the trip circuit is complete.


Alternative connection without using circuit breaker 52b auxiliary contacts. This is applicable for any digital inputs.

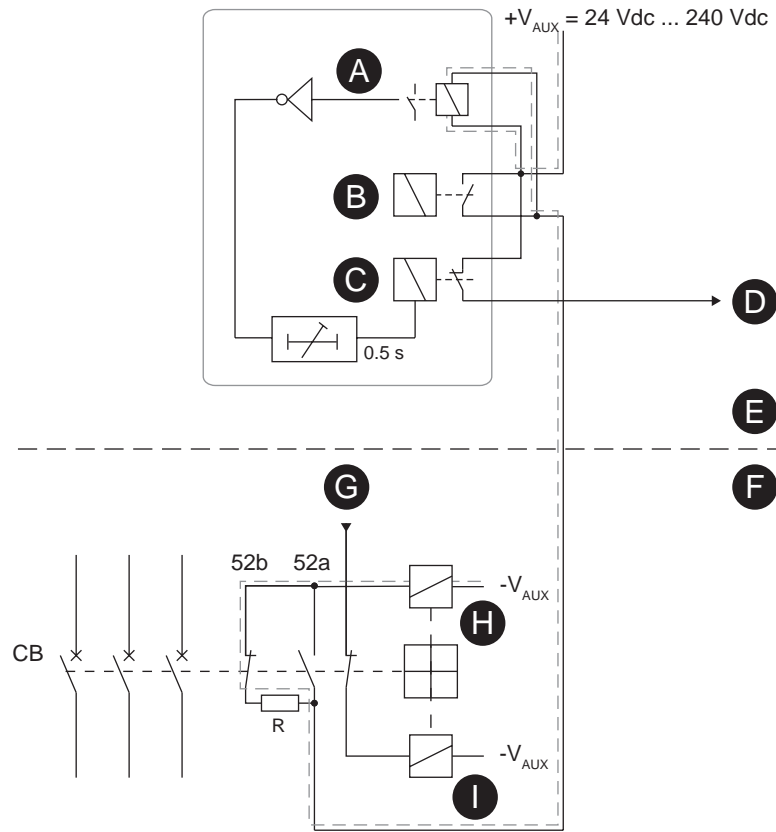Figure 172 - Trip circuit supervision using a single digital input when the circuit breaker is in open position



- | | |
|--|---------------------------------------|
| A. Digital input 1 | F. Circuit breaker compartment |
| B. Trip relay | G. Close control |
| C. Alarm relay for trip circuit failure | H. Open coil |
| D. Trip circuit failure alarm | I. Close coil |
| E. Relay compartment | |

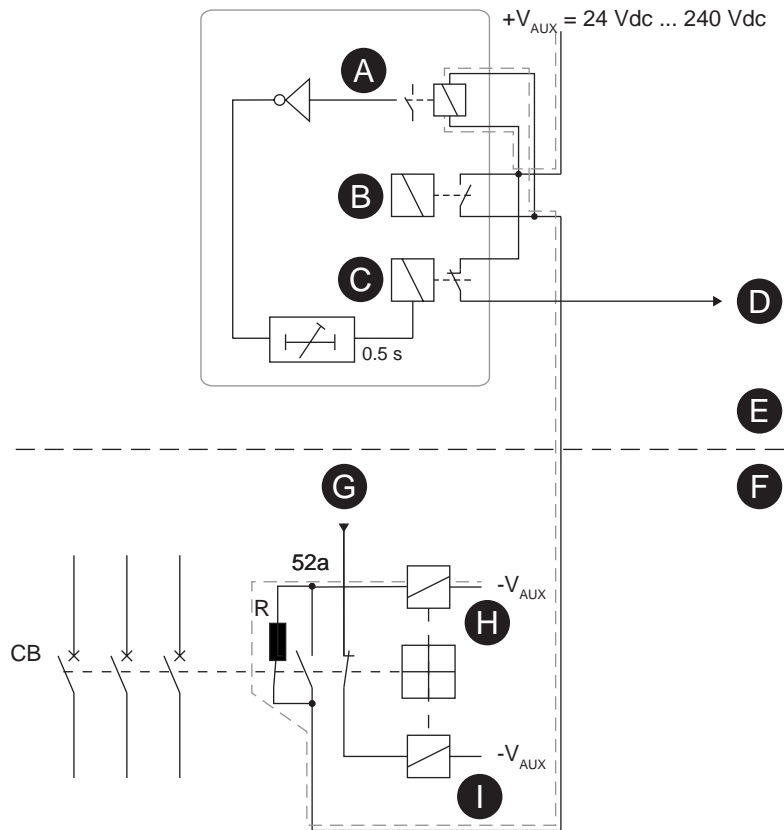Figure 173 - Alternative connection without using circuit breaker 52b auxiliary contacts. Trip circuit supervision using a single digital input, when the circuit breaker is in open position




- A. Digital input 1
- B. Trip relay
- C. Alarm relay for trip circuit failure
- D. Trip circuit failure alarm
- E. Relay compartment
- F. Circuit breaker compartment
- G. Close control
- H. Open coil
- I. Close coil

Figure 174 - Example of digital input DI7 configuration for trip circuit supervision with one digital input

Digital inputs

Input	State	Polarity	Delay	On Event	Off Event	Alarm display	Counters
1	0	NO	0.00 s	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0
2	0	NO	0.00 s	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0
3	0	NO	0.00 s	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0
4	0	NO	0.00 s	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0
5	0	NO	0.00 s	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0
6	0	NO	0.00 s	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0
7	0	NC	0.00 s	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1

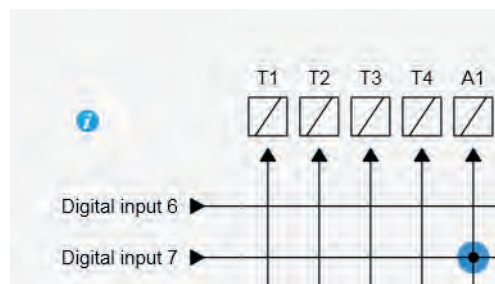Figure 175 - Example of output matrix configuration for trip circuit supervision with one digital input



Example of dimensioning the external resistor R

$U_{AUX} = 110 \text{ Vdc} - 20\% + 10\%$, Auxiliary voltage with tolerance

$U_{DI} = 18 \text{ Vdc}$, Threshold voltage of the digital input

$I_{DI} = 3 \text{ mA}$, Typical current needed to activate the digital input including a 1 mA safety margin.

$P_{COIL} = 50 \text{ W}$, Rated power of the open coil of the circuit breaker. If this value is not known, 0Ω can be used for the R_{COIL} .

$$U_{MIN} = U_{AUX} - 20\% = 88 \text{ V}$$

$$U_{MAX} = U_{AUX} + 10\% = 121 \text{ V}$$

$$R_{COIL} = U_{AUX}^2 / P_{COIL} = 242 \Omega.$$

The external resistance value is calculated using [Equation 32](#):

Equation 32

$$R = \frac{U_{MIN} - U_{DI} - I_{DI} \cdot R_{Coil}}{I_{DI}}$$

$$R = (88 - 18 - 0.003 \times 242) / 0.003 = 23.1 \text{ k}\Omega$$

In practice, the coil resistance has no effect.

By selecting the next smaller standard size, we get **22 kΩ**.

The power rating for the external resistor is estimated using [Equation 33](#) and [Equation 34](#).

The [Equation 33](#) is for the CB open situation including a 100 % safety margin to limit the maximum temperature of the resistor:

Equation 33

$$P = 2 \cdot I_{DI}^2 \cdot R$$

$$P = 2 \times 0.003^2 \times 22000 = 0.40 \text{ W}$$

Select the next bigger standard size, for example **0.5 W**.

When the trip contacts are still closed and the CB is already open, the resistor has to withstand much higher power (*Equation 34*) for this short time:

Equation 34

$$P = \frac{U_{MAX}^2}{R}$$

$$P = 121^2 / 22000 = 0.67 \text{ W}$$

A 0.5 W resistor is enough for this short time peak power, too. However, if the trip relay is closed for longer than a few seconds, a 1 W resistor should be used.

7.15.2 Trip circuit supervision with two digital inputs

The benefit of this scheme is that no external resistor is needed.


The drawbacks are that two digital inputs (DIs) and two extra wires from the relay to the CB compartment are needed. Additionally, the minimum allowed auxiliary voltage is 48 V dc which is more than twice the threshold voltage of the digital input because when the CB is in open position, the two digital inputs are in series.

When two DIs are connected in a series, the switching threshold value used with one DI is too high. Therefore, a lower value must be selected: 24 V if the nominal operation voltage for DI inputs is 110 V or 110 V if the nominal operation voltage is 220 V.

- The first digital input is connected parallel to the auxiliary contact of the circuit breaker's open coil.
- Another auxiliary contact is connected in series with the circuitry of the first digital input. This makes it possible to supervise also the auxiliary contact in the trip circuit.
- The second digital input is connected in parallel with the trip contacts.
- Both inputs are configured as normal closed (NC).
- The user's programmable logic is used to combine the digital input signals with an AND port. The delay is configured to be longer than the maximum fault time to inhibit any superfluous trip circuit fault alarm when the trip contact is closed.
- The output from the logic is connected to a relay in the output matrix giving out any trip circuit alarm.

In *Figure 176*, the supervised circuitry in this CB position is double-lined. The digital input is in active state when the trip circuit is complete. This is applicable for all digital inputs.

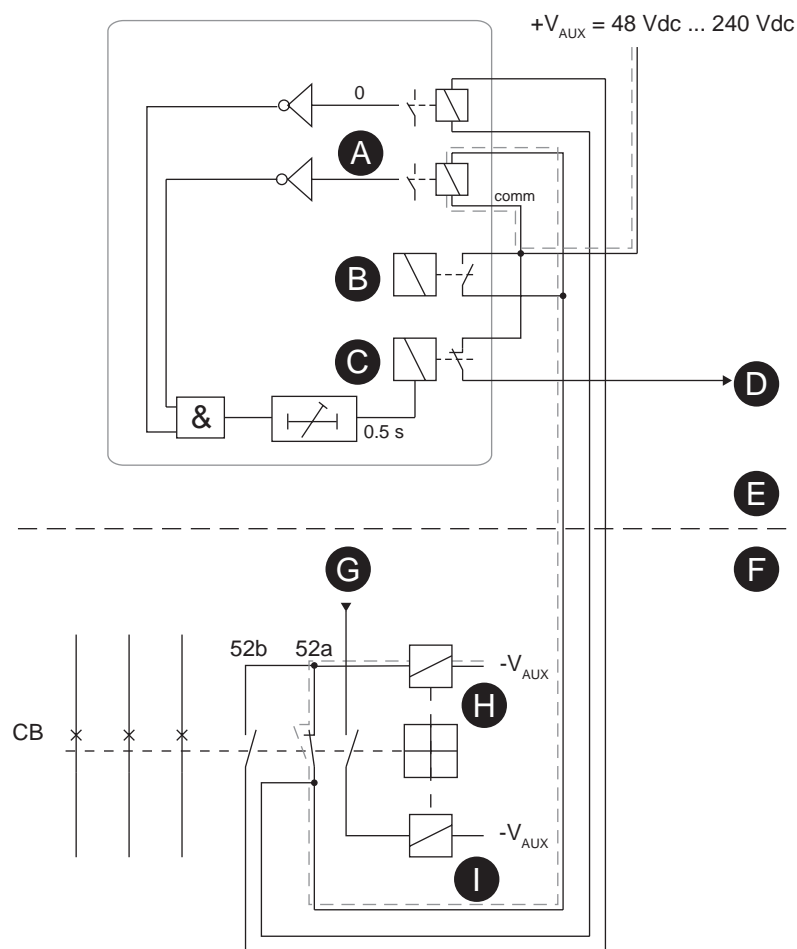
Figure 176 - Trip circuit supervision with two digital inputs and closed CB



- | | |
|--|---------------------------------------|
| A. Digital input 1 | F. Circuit breaker compartment |
| B. Trip relay | G. Close control |
| C. Alarm relay for trip circuit failure | H. Open coil |
| D. Trip circuit failure alarm | I. Close coil |
| E. Relay compartment | |

In [Figure 177](#), the two digital inputs are in series.

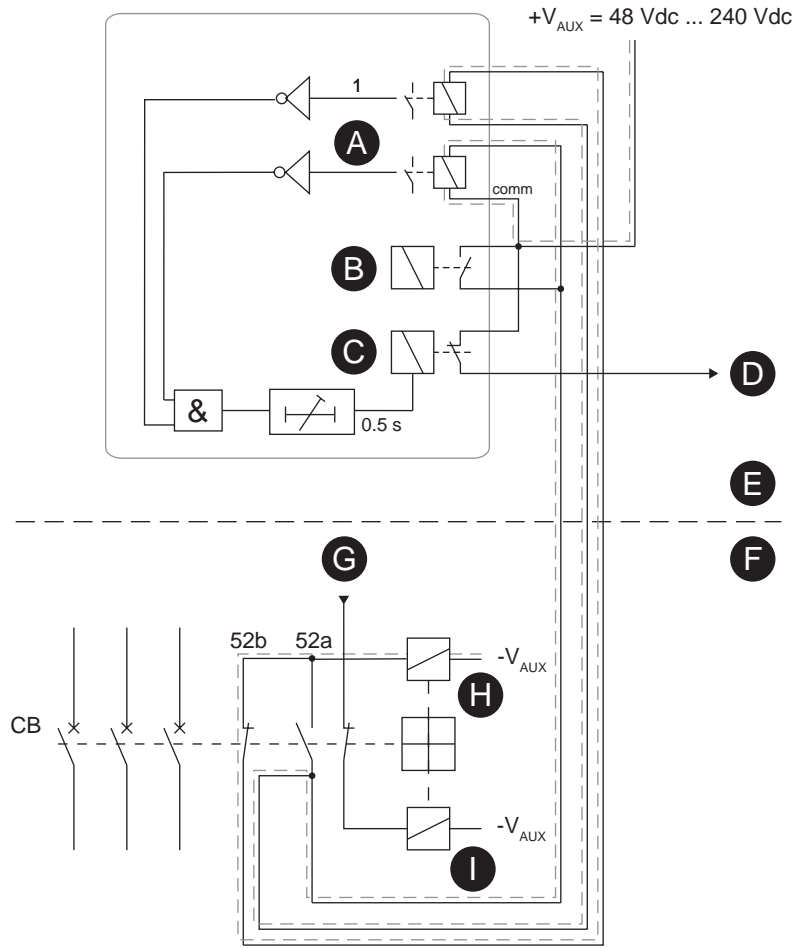Figure 177 - Trip circuit supervision with two digital inputs and CB in open position



- A.** Digital input 1
- B.** Trip relay
- C.** Alarm relay for trip circuit failure
- D.** Trip circuit failure alarm
- E.** Relay compartment
- F.** Circuit breaker compartment
- G.** Close control
- H.** Open coil
- I.** Close coil

Figure 178 - An example of digital input configuration for trip circuit supervision with two digital inputs DI1 and DI2

DIGITAL INPUTS

Mode: DC

Counters max value: 16 bit

DIGITAL INPUTS

Input	Slot	State	Polarity	Delay	On Event	Off Event	Alarm display	Counters
1	2	1	NC	0.00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1
2	2	1	NC	0.00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1
3	2	0	NO	0.00	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1
4	2	0	NO	0.00	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1

Figure 179 - An example of logic configuration for trip circuit supervision with two digital inputs DI1 and DI2.


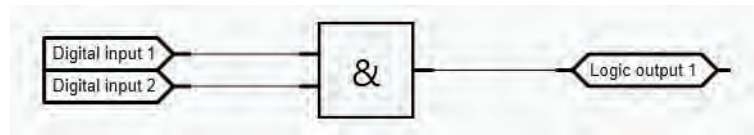


Figure 180 - An example of output matrix configuration for trip circuit supervision with two digital inputs

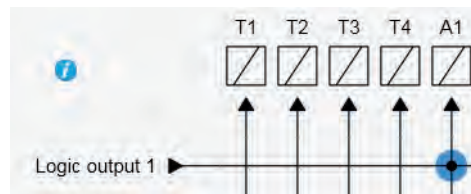

8 Communication and protocols

8.1 Cybersecurity

According to a classic model of information security, the three security goals are:

- confidentiality (prevention of unauthorized disclosure of information)
- integrity (prevention of unauthorized modification of information)
- availability (ensuring that information is always available to authorized users)

These goals may be used as a starting point in designing security solutions for electric power distribution.

We recommend that:

- Computer systems used to design or operate electric power distribution systems are designed with the *principle of least privilege*, in other words, that users only have those access rights that they needs to perform their duties.
- All workstations and servers have an effective antimalware solution, such as a virus scanner.
- Computer systems are protected with adequate physical security measures to prevent physical tampering of the devices or networks.

NOTICE

CYBERSECURITY HAZARD

To improve cybersecurity:

- Change all passwords from their default values when taking the protection device into use.
- Change all passwords regularly.
- Ensure a minimum level of password complexity according to common password guidelines.

Failure to follow these instructions can increase the risk of unauthorized access.

Related topics

[2.4 Access to device configuration](#)

8.2 Communication ports

The relay has one fixed communication port: a USB port on the front panel for connection to Easergy Pro setting and configuration tool.

Optionally, the relay may have up to two serial ports, COM 3 and COM 4, for serial protocols (for example IEC 103) and one Ethernet port for Ethernet-based communication protocols (for example IEC 61850).

The number of available serial ports depends on the type of the communication option cards.

Each communication port can be individually enabled or disabled with the Configurator access level via:

- the front panel of the Easergy P3 protection device
- Easergy Pro
- the web HMI

NOTE: By default and when the device comes from the factory, Ethernet Protocol 1 is enabled and the default protocol is IEC-61850. Also Ethernet Protocol 2 is enabled and the default protocol is Modbus TCPs.

Figure 181 - Ethernet protocol default setting

The image shows two sections of a web HMI interface for configuring Ethernet protocols. The top section is titled "Ethernet Protocol 1" and the bottom section is titled "Ethernet Protocol 2".


Ethernet Protocol 1 settings:

- Enable: (with a power icon)
- Protocol: IEC-61850 (dropdown menu, with a power icon)
- Port number: 102 (input field, with a power icon)
- Set port number: - (dropdown menu)
- Message counter: 0 (input field) with a "Clear" button
- Error counter: 0 (input field) with a "Clear" button
- Timeout counter: 0 (input field) with a "Clear" button

Ethernet Protocol 2 settings:

- Enable: (with a power icon)
- Protocol: ModBusTCPs (dropdown menu, with a power icon)
- Port number: 502 (input field, with a power icon)
- Set port number: - (dropdown menu)
- Message counter: 0 (input field) with a "Clear" button
- Error counter: 0 (input field) with a "Clear" button
- Timeout counter: 0 (input field) with a "Clear" button

Figure 182 - Ethernet, COM 1 and COM 2 ports



NOTE: It is possible to have up to 2 serial communication protocols simultaneously in the same D9 and Ethernet connector but restriction is that same protocol can be used only once.

The **Protocol configuration** setting view contains selection for the protocol, port settings and message/error/timeout counters. Only serial communication protocols are valid with RS-232 interface.

Figure 183 - Protocol configuration setting view

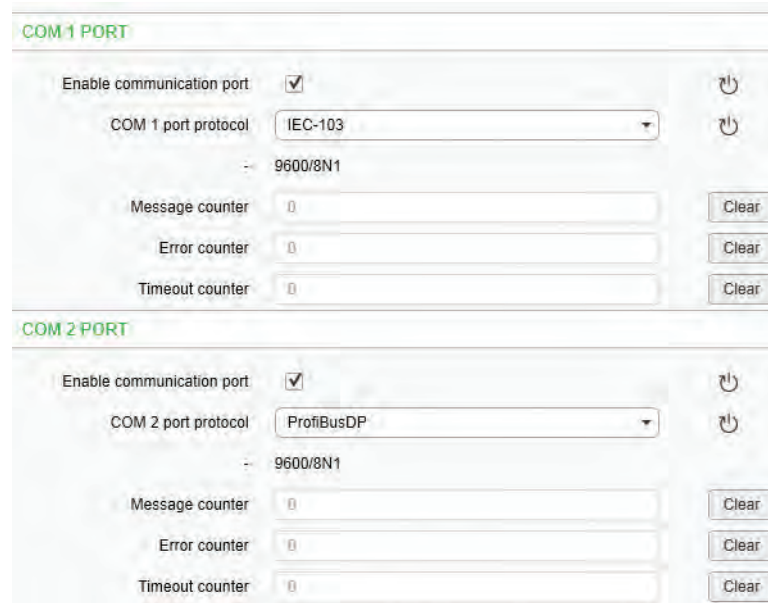


Table 130 - Parameters

Parameter	Value	Unit	Description	Note
Protocol			Protocol selection for COM port	Set
	None		-	
	SPA-bus		SPA-bus (slave)	
	ProfibusDP		Interface to Profibus DB module VPA 3CG (slave)	
	ModbusSlv		Modbus RTU slave	
	IEC-103		IEC-60870-5-103 (slave)	
	ExternalIO		Modbus RTU master for external I/O-modules	
	IEC 101		IEC-608670-5-101	
	DNP3		DNP 3.0	

Parameter	Value	Unit	Description	Note
	GetSet		Communication protocols for Easergy Pro interface	
Msg#	$0-2^{32} - 1$		Message counter since the relay has restarted or since last clearing	Clr
Errors	$0-2^{16} - 1$		Protocol interruption since the relay has restarted or since last clearing	Clr
Tout	$0-2^{16} - 1$		Timeout interruption since the relay has restarted or since last clearing	Clr
	speed/DPS		Display of current communication parameters. speed = bit/s D = number of data bits P = parity: none, even, odd S = number of stop bits	1.

Set = An editable parameter (password needed)

Clr = Clearing to zero is possible

1. The communication parameters are set in the protocol specific menus. For the local port command line interface the parameters are set in configuration menu.

8.2.1 Ethernet port

The Ethernet port is used for Ethernet protocols like IEC61850 and Modbus TCP.

The physical interface is described in [10.5 Connections](#).

The parameters for the port can be set via the device's front panel or using Easergy Pro. Two different protocols can be used simultaneously – both protocols use the same IP address and MAC address (but different port number).

8.2.2 Disabling the Ethernet communication

NOTICE

CYBERSECURITY HAZARD

- To improve cybersecurity, disable the Ethernet communication in environments where effective antimalware solutions have not been taken into use.
- The device is not capable of transmitting data encrypted using Ethernet protocols. If other users gain access to your network, transmitted information can be disclosed or subject to tampering.
- For transmitting data over an internal network, segment the network physically or logically and restrict access using standard controls such as firewalls and other relevant features supported by your device such as IPTable whitelisting.
- For transmitting data over an external network, encrypt protocol transmissions over all external connections using an encrypted tunnel, TLS wrapper or a similar solution.

Failure to follow these instructions can increase the risk of unauthorized access.

1. To disable all Ethernet-based protocols:
 - a. In Easergy Pro, go to **Communication > Protocol configuration**.
 - b. Under **Ethernet**, disable the Ethernet port by unselecting the **Enable Ethernet communication** checkbox.

Figure 184 - Disabling the Ethernet port

The screenshot shows the 'ETHERNET' configuration page. At the top, the title 'ETHERNET' is in green. Below it, the 'Enable Ethernet Communication' checkbox is checked (blue square). To the right of this checkbox is a refresh icon. Below this, the MAC address is '001AD3011B35'. There are two unchecked checkboxes: 'Enable DHCP service' and 'Enable IP verification service'. The IP Address is '10.10.6.100' and the NetMask is '255.255.255.0'. The Gateway ARP max tryouts is a slider set to '5'. The Gateway is '0.0.0.0'. The NTP server is '0.0.0.0' with a refresh icon to its right. The NTP server (BackUp) is '0.0.0.0' with a refresh icon to its right. The TCP keepalive interval is a slider set to '0' with a refresh icon to its right. Below these are statistics: 'Ethernet packets received: 0' and 'Ethernet packets sent: 0'. At the bottom, 'Eth Port status: Link down'.

This disables all the Ethernet-based protocols (FTP, HTTP, Telnet, and Ethernet protocols).

2. To disable FTP, HTTP, Telnet, or Ethernet protocols separately:
 - a. Under **Ethernet**, select the **Enable Ethernet communication** checkbox.
 - b. Unselect the **Enable...** checkbox for the servers or protocols you want to disable.

Figure 185 - Disabling individual Ethernet-based protocols

FTP SERVER	
Enable FTP server:	<input type="checkbox"/> ↻
FTP password:	<input type="text" value="config"/>
FTP max speed:	<input type="range" value="4"/> 4 kB/s
Enable HTTP server	
Enable HTTP server:	<input type="checkbox"/> ↻
HTTP server port:	<input type="range" value="80"/> 80 ↻
HTTP server access:	<input type="text" value="ReadWrite"/>
Enable Telnet	
Enable Telnet:	<input type="checkbox"/> ↻
TCP port for setting tool:	<input type="range" value="23"/> 23 ↻
Advanced Ethernet options	
Send Gratuitous ARP:	<input type="checkbox"/>
Storm protection limit:	<input type="range" value="1.00"/> 1.00 %
Storm protection:	<input type="checkbox"/>
Ethernet Protocol 1	
Enable:	<input type="checkbox"/> ↻
Protocol:	<input type="text" value="None"/> ↻
Port number:	<input type="range" value="502"/> 502 ↻
Set port number:	<input type="text" value="-"/>
Message counter:	<input type="text" value="0"/> Clear
Error counter:	<input type="text" value="0"/> Clear
Timeout counter:	<input type="text" value="0"/> Clear
Ethernet Protocol 2	
Enable:	<input type="checkbox"/> ↻
Protocol:	<input type="text" value="None"/> ↻
Port number:	<input type="range" value="502"/> 502 ↻
Set port number:	<input type="text" value="-"/>
Message counter:	<input type="text" value="0"/> Clear
Error counter:	<input type="text" value="0"/> Clear
Timeout counter:	<input type="text" value="0"/> Clear

8.3 Storm protection


Storm protection limits the number of broadcast messages, for example, address resolution protocol (ARP) messages that are forwarded to the central processing unit (CPU) or to the protection device's second Ethernet interface. Storm protection may be necessary if the Ethernet network contains devices that may send a big amount of ARP requests when starting up or during the normal operation. If storm protection is not enabled, the protection devices can be overloaded with the big number of ARP messages.

The storm protection limit defines how big percentage of the broadcast messages are forwarded to the CPU.

Storm protection level 0.01% means 15 packets per second in a 100 Mbps network. Broadcast traffic forwarded to CPU can be limited down to 15% for 100 Mbps. This is based on a theoretical maximum of 100 packets per second that the CPU can receive and process.

Storm protection can be enabled in the **Advanced Ethernet options** setting view with the **Storm protection on Port1** and **Storm protection on Port2** parameters.

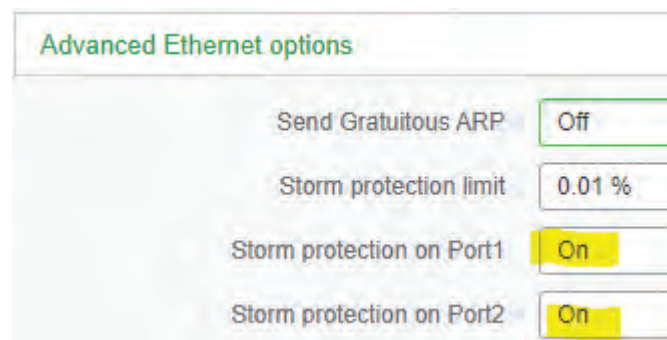Figure 186 - Storm protection properties



8.4 Parallel Redundancy Protocol

The Parallel Redundancy Protocol (PRP) implemented in Easergy P3 devices is specified in the IEC62439-3 (Clause 4) standard and is available when a dual-port, 100 Mbps Ethernet interface card is used.

PRP properties:

- Ethernet redundancy method independent of any industrial Ethernet protocol or topology (tree, ring or mesh)
- seamless switchover and recovery in case of failure (no delay)
- continuous supervision of redundancy for better management of network devices
- suitable for hot swap - 24 hour/365 day operation in substations
- allows mixing of devices with single and dual network interfaces on the same local area network (LAN)
- allows HMI devices (laptops, workstations) to be connected to the network using standard Ethernet adapters
- particularly suited for hard real-time systems such as substation automation, high-speed drives and transportation

For additional information, see application note *Parallel Redundancy Protocol for Easergy P3Ux and Easergy P3x3x relays with dual-port 100 Mbps Ethernet interface (P3/EN ANCOM/A004)*.

Figure 187 - **Redundancy protocol for Ethernet** setting view

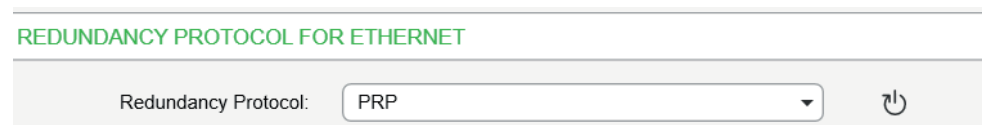


Figure 188 - Parallel Redundancy Protocol setting view



8.5 Communication protocols

The communication protocols enable the transfer of the following type of data:

- events
- status information
- measurements
- control commands
- clock synchronization
- some settings through SPA bus, IEC-103, Modbus and IEC-61850 protocols
- disturbance recordings through IEC-103, Modbus and IEC-61850 protocols

This product contains software developed by Viola Systems.

8.5.1 Modbus RTU and Modbus TCP

Modbus RTU and Modbus TCP protocols are often used in power plants and industrial applications. The difference between these two protocols is the media. Modbus TCP uses Ethernet and Modbus RTU uses RS-485, optic fibre, or RS-232.

Easergy Pro shows a list of all available data items for Modbus. They are also available as a zip file ("Communication parameter protocol mappings.zip").

The information available via Modbus RTU and Modbus TCP includes:

- status values
- control commands
- measurement values
- events
- protection settings
- disturbance recordings

The Modbus communication is activated via a menu selection with the parameter "Protocol". See [8.2 Communication ports](#).

For more information on Modbus configuration, see the document *P3APS18025EN Modbus configuration instructions*.

For the Ethernet interface configuration, see [8.2.1 Ethernet port](#).

8.5.2 Profibus DP

The Profibus DP protocol is widely used in the industry. An external VPA 3CG and VX072 cables are required.

Device profile "continuous mode"

In this mode, the relay is sending a configured set of data parameters continuously to the Profibus DP master. The benefit of this mode is the speed and easy access to the data in the Profibus master. The drawback is the maximum buffer size of 128 bytes, which limits the number of data items transferred to the master. Some PLCs have their own limitation for the Profibus buffer size, which may further limit the number of transferred data items.

Device profile "Request mode"

Using the request mode, it is possible to read all the available data from the Easergy P3 relay and still use only a very short buffer for Profibus data transfer. The drawback is the slower overall speed of the data transfer and the need of increased data processing at the Profibus master as every data item must be separately requested by the master.

NOTE: In the request mode, it is not possible to read continuously only one single data item. At least two different data items must be read in turn to get updated data from the relay.

There is a separate manual for VPA 3CG for the continuous mode and request mode. The manual is available for downloading on our website.

Available data

Easergy Pro shows the list of all available data items for both modes. A separate document "Communication parameter protocol mappings.zip" is also available.

The Profibus DP communication is activated usually for remote port via a menu selection with parameter "Protocol". See [8.2 Communication ports](#).

8.5.3 SPA-bus

The relay has full support for the SPA-bus protocol including reading and writing the setting values. Also, reading multiple consecutive status data bits, measurement values or setting values with one message is supported.

Several simultaneous instances of this protocol, using different physical ports, are possible, but the events can be read by one single instance only.

There is a separate document "Communication parameter protocol mappings.zip" of SPA-bus data items available.

8.5.4 IEC 60870-5-103 (IEC-103)

The IEC standard 60870-5-103 "*Companion standard for the informative interface of protection equipment*" provides a standardized communication interface to a primary system (master system).

The unbalanced transmission mode of the protocol is used, and the relay functions as a secondary station (slave) in the communication. Data is transferred to the primary system using the "data acquisition by polling" principle.

The IEC functionality includes application functions:

- station initialization
- general interrogation
- clock synchronization
- command transmission.

It is also possible to transfer parameter data and disturbance recordings via the IEC 103 protocol interface.

The following application service data unit (ASDU) types can be used:

- ASDU 1: Time-tagged message
- ASDU 3: Measurands I
- ASDU 5: Identification message
- ASDU 6: Time synchronization
- ASDU 8: Termination of general interrogation
- ASDU 10: Generic data

The relay accepts:

- ASDU 6: Time synchronization
- ASDU 7: Initiation of general interrogation
- ASDU 10: Generic data
- ASDU 20: General command
- ASDU 21: Generic command
- ASDU 23: Disturbance recorder file transfer

The data in a message frame is identified by:

- type identification
- function type
- information number.

These are fixed for data items in the compatible range of the protocol, for example, the trip of I> function is identified by:

- type identification = 1
- function type = 160
- information number = 90

"Private range" function types are used for such data items that are not defined by the standard (for example, the status of the digital inputs and the control of the objects).

The function type and information number used in private range messages is configurable. This enables flexible interfacing to different master systems.

For more information on IEC 60870-5-103 in Easergy P3 relays, see the "IEC 103 Interoperability List.pdf" and "Communication parameter protocol mappings.zip" documents.

8.5.5 DNP 3.0

The relay supports communication using the DNP 3.0 protocol. The following DNP 3.0 data types are supported:

- binary input
- binary input change
- double-bit input
- binary output
- analog input
- counters

For more information, see the "DNP 3.0 Device Profile Document" and "Communication parameter protocol mappings.zip". DNP 3.0 communication is activated via menu selection. RS-485 interface is often used but also RS-232 and fibre optic interfaces are possible.

8.5.6 IEC 60870-5-101 (IEC-101)

The IEC 60870-5-101 standard is derived from the IEC 60870-5 protocol standard definition. In Easergy P3 relays, the IEC 60870-5-101 communication protocol is available via menu selection. The relay works as a controlled outstation (slave) unit in unbalanced mode.

The supported application functions include process data transmission, event transmission, command transmission, general interrogation, clock synchronization, transmission of integrated totals, and acquisition of transmission delay.

For more information on IEC 60870-5-101 in Easergy P3 relays, see the "Communication parameter protocol mappings.zip" document.

8.5.7 IEC 61850

The IEC 61850 protocol is available with the optional communication module. It can be used to read or write static data from the relay or to receive events and to receive or send GOOSE messages from or to other relays.

The IEC 61850 server interface includes the following features:

- configurable data model: selection of logical nodes corresponding to active application functions
- configurable pre-defined data sets
- supported dynamic data sets created by clients
- supported reporting function with buffered and unbuffered report control blocks
- support for changing selected setting parameters of the protection functions
- sending analogue values over GOOSE
- supported control modes:
 - direct with normal security
 - direct with enhanced security
 - select before operation with normal security
 - select before operation with enhanced security

- supported horizontal communication with GOOSE: configurable GOOSE publisher data sets, configurable filters for GOOSE subscriber inputs, GOOSE inputs available in the application logic matrix
- 32 data points can be published with GOOSE (two gose control blocks with maximum 16 data points).
- 64 binary data points and five analog data points can be subscribed in GOOSE (maximum five different MAC addresses).
- The maximum number of clients is eight (the maximum number of BRCBs is eight and the maximum number of URCBs is eight).
- Both Ed1 and Ed2 are supported and can be selected with a parameter.

For additional information, see separate documents:

- *IEC 61850 Edition 2 Certificate for Easergy P3*
- *Easergy P3 communication protocol parameter mapping*
- *IEC 61850 configuration instructions*

Figure 189 - IEC 61850 default settings

Instantiated RCBs:	<input type="checkbox"/>
ResvTms included in BRCBs:	<input checked="" type="checkbox"/>
Owner included in RCBs:	<input checked="" type="checkbox"/>
Control mode for object nodes:	DirNorSec
SDO allowed in DS:	<input checked="" type="checkbox"/>
Type of BCR:	64BIT
Type of SBO:	VisStr129

8.5.8 Ethernet/IP

The relay supports communication using the Ethernet/IP protocol which is a part of the Common Industrial Protocol (CIP) family. The Ethernet/IP protocol is available with the optional in-built Ethernet port. The protocol can be used to read or write data from or to the relay using request / response communication or via cyclic messages transporting data assigned to assemblies (sets of data).

For more detailed information and parameter lists for Ethernet/IP, refer to a separate application note "EtherNet/IP configuration instructions.pdf".

For the complete data model of Ethernet/IP, see the document "DeviceNet and EtherNetIP data model.pdf" and "Communication parameter protocol mappings.zip".

8.5.9 HTTP server – Webset

The Webset HTTPS configuration interface provides the option to configure the relay with a standard web browser such as Internet Explorer, Mozilla Firefox, or Google Chrome. The feature is available when the communication option C, D, N or R is in use.

A subset of the relays's features is available in the Webset interface. The group list and group view from the relay are provided, and most groups, except the LOGIC and the MIMIC groups are configurable.

8.6 IP filter

Easergy P3 devices contain a simple IP filter (IP firewall), which can be used to filter incoming TCP/IP connections. This filtering applies only to Modbus TCP, DNP3, and Ethernet/IP, and can be configured via Easergy Pro.

Figure 190 - IP firewall setting view

IP firewall

Enable IP firewall:

Index	Enable	Action	Name	IP address	Counter
1	<input type="checkbox"/>	Allow	-	-	0
2	<input type="checkbox"/>	Allow	-	-	0
3	<input type="checkbox"/>	Allow	-	-	0
4	<input type="checkbox"/>	Allow	-	-	0
5	<input type="checkbox"/>	Allow	-	-	0
6	<input type="checkbox"/>	Allow	-	-	0
7	<input type="checkbox"/>	Allow	-	-	0
8	<input type="checkbox"/>	Allow	-	-	0
9	<input type="checkbox"/>	Allow	-	-	0
10	<input type="checkbox"/>	Allow	-	-	0

Default action:

Clear counters

The IP filter works based on configured rules. Incoming IP packets are compared against the rules, and when a matching rule is found, the packet is handled using the action specified for the rule. If none of the rules matches the packet, the default action is taken on the packet. The IP filter records how many times a packet has matched a rule. The number is shown in the **Counter** column.

On TCP connections, the rules are mostly applied only when a connection is opened.

8.6.1 Configuring the IP filter

You can configure up to 10 rules for the IP filter via Easergy Pro and enable each rule individually.

1. In Easergy Pro, go to **Communication > Protocol configuration**.
2. In the **IP firewall** setting view, select the **Enable IP firewall** checkbox to enable the firewall.

Figure 191 - IP firewall setting view

IP firewall

Enable IP firewall:

Index	Enable	Action	Name	IP address	Counter
1	<input type="checkbox"/>	Allow	-	-	0
2	<input type="checkbox"/>	Allow	-	-	0
3	<input type="checkbox"/>	Allow	-	-	0
4	<input type="checkbox"/>	Allow	-	-	0
5	<input type="checkbox"/>	Allow	-	-	0
6	<input type="checkbox"/>	Allow	-	-	0
7	<input type="checkbox"/>	Allow	-	-	0
8	<input type="checkbox"/>	Allow	-	-	0
9	<input type="checkbox"/>	Allow	-	-	0
10	<input type="checkbox"/>	Allow	-	-	0

Default action:

Clear counters

3. In the **IP firewall** setting view, create a rule.
 - a. In the **Name** column, give the rule a name (maximum 32 characters) that describes its purpose .
 - b. In the **IP address** column, specify an IP address.

The IP address is used to filter the incoming IP packets based on the (apparent) IP address of the source device. There are four options.

Table 131 - IP address for the IP filter

IP address	Description
Any	By writing a dash or value zero in this column, the rule is set to match any source IP address. The column shows a dash.
Single IP address	If a single IP address (such as 192.168.0.10) is written here, the packets (or connections) must originate from this IP address to match the rule.
IP subnet	If all IP addresses in a subnet should match this rule, write the subnet here using the CIDR notation. For example, notation 192.168.0.0/24 matches all IP addresses in the range 192.168.0.0–192.168.0.255.
IP address range	If a range of IP addresses (for example, 192.168.0.20–192.168.0.30) is written here, packets from these addresses match the rule. Both end points of this range are inclusive.

NOTE: If the matching range of IP addresses can be expressed using the CIDR notation, the range is expressed in this format, regardless of how the range was entered into the configuration. As a result, the presentation format of the configuration as it is read from the device might not match the format in which it was entered. This may cause problems with Easergy Pro because this tool expects the presentation format to match exactly. To work around this issue, select the **Reset and read current view** command in Easergy Pro after writing the configuration. This is required to handle the large number of different input formats supported.

- c. In the **Action** column, specify an action for the rule.

There are four options.

Table 132 - Actions for IP filter

Action	Description
Allow	The packet is allowed to continue normally. This means that the specified source devices can use the specified services on the P3 device.
Reject ⁹⁰⁾	The packet is blocked and the remote peer is informed about this decision.
Drop	The packet is blocked without informing the remote peer.
Cont.	The processing of the other rules continues on this packet normally.

⁹⁰⁾ Because of the implementation details in the Easergy P3 TCP/IP stack, rules that are given the Reject action sometimes behave as if their action was Drop.

8.6.2 Unexpected packets

The IP filter also can also detect unexpected packets. For example, if a client attempts to close a connection that does not exist, this is considered an unexpected packet.

Certain techniques used by hackers produce unexpected packets, but such packets may also appear on the network if some packets are lost or dropped because of a malfunctioning network device. Some devices may also have programming errors or bugs produce unexpected packets in their TCP/IP stack.

The unexpected packets feature attempts to distinguish between these two sources based on the number of unexpected packets detected within a configurable “recent period”. If the number of these packets is greater than the configured limit, the selected alarm signal is triggered.

Figure 192 - Unexpected packets setting view

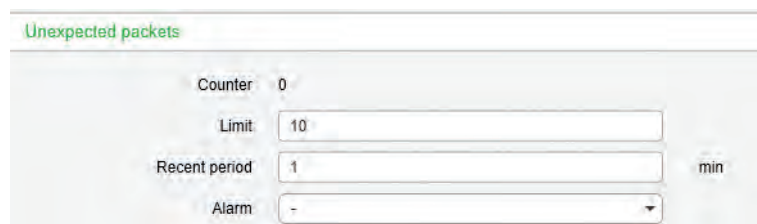



Table 133 - Parameters for unexpected packages

Parameter	Description
Counter	Counts the number of unexpected packets detected within the configured recent period.
Limit	The limit after which an alarm is given
Recent period	The number of unexpected packets counted within this period is compared to the configured limit value <ul style="list-style-type: none"> • Default value: 1 minute • Maximum value: 65535 minutes (45 days)
Alarm	Select which CS alarm signal (CS Alarm 1/CS Alarm 2) is activated when the set limit is exceeded. The alarms can be assigned to other signals in the output matrix.

8.6.3 Alarms

Active cybersecurity (CS) alarms can be viewed in the **Alarms** view. When an alarm signal has been asserted, it remains active until it is cleared with the **Clear alarms** command.

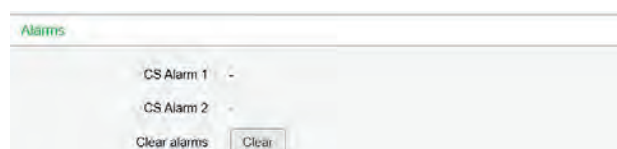Figure 193 - Alarms



9 Applications and configuration examples


This chapter describes the protection functions in different protection applications.

The relay can be used for line/feeder protection of medium voltage networks with a grounded, low-resistance grounded, isolated or a compensated neutral point. The relays have all the required functions to be applied as a backup relay in high-voltage networks or to a transformer differential relay. In addition, the relay includes all the required functions to be applied as a motor protection relay for rotating machines in industrial protection applications.

The relays provide a circuit breaker control function. Additional primary switching relays (earthing switches and disconnecter switches) can also be controlled from the front panel or the control or SCADA/automation system. A programmable logic function is also implemented in the relay for various applications, for example interlockings schemes.

9.1 Industrial motor protection

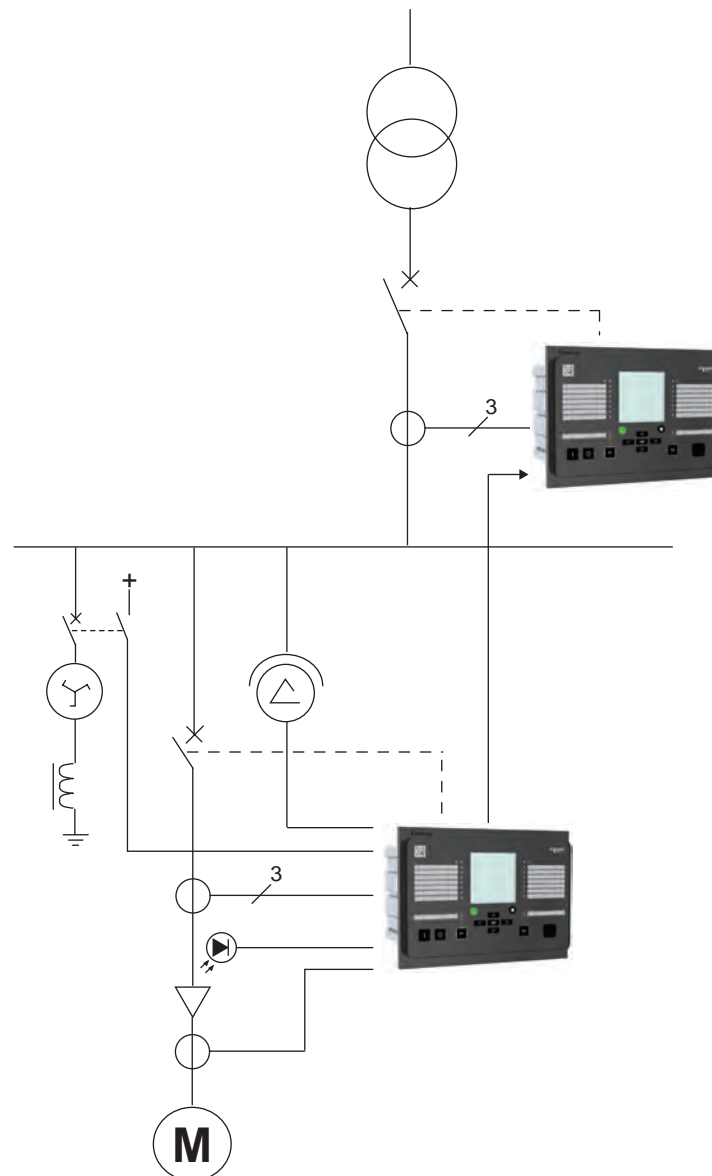Figure 194 - Easergy P3M30 and P3M32 used in cable protection of an industry plant network




The relay supports directional earth fault protection and three-phase overcurrent protection that is required in a cable feeder. Furthermore, the thermal stage can be used to protect the cable against overloading. All necessary motor protection functions are supported when using motor application mode. This example also includes fast arc protection.

9.2 Rotor earth fault protection (ANSI 64R)

Rotor earth fault protection can be utilized with an injection source connected between earth and one side of the field circuit with a capacitive coupling. The field circuit is subjected to an alternating potential at substantially the same level throughout. An earth fault anywhere in the field system gives rise to a current that is detected by the protection relay.


This scheme is suitable for synchronous motors that incorporate brushes in the main generator field winding.

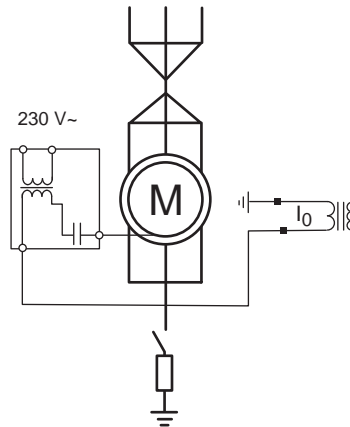Figure 195 - Rotor earth-fault protection principle of field circuit by alternating current injection



9.3 Arc flash detection

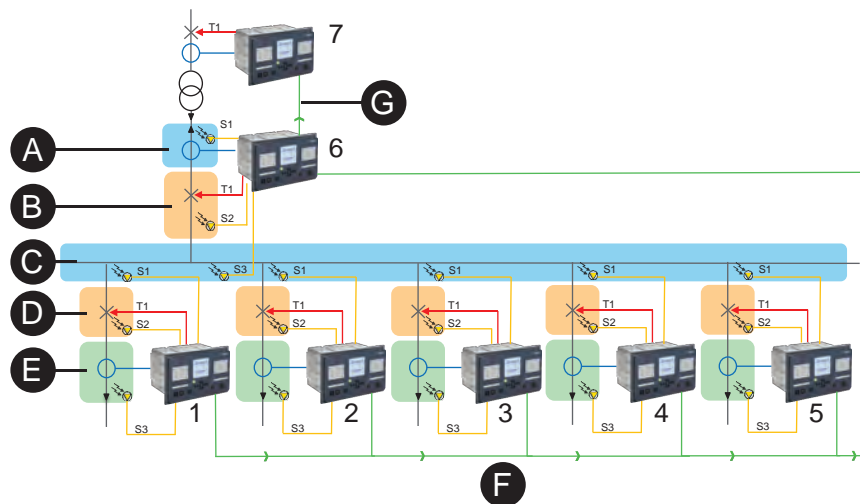Figure 196 - Typical arc flash detection scheme with integrated arc flash option card



- A. Incomer cable zone
- B. Incomer circuit breaker zone
- C. Busbar zone
- D. Feeder circuit breaker zone
- E. Feeder cable zone
- F. Light information via hard-wired BIO L+ (feeder cable and circuit breaker)
- G. Light information via hard-wired BIO L+ (incomer busbar and circuit breaker)

In this application example, the arc flash sensor for zone E is connected to device 1. If the sensor detects a fault and simultaneously, device 1 detects an overcurrent signal, zone E is isolated by the outgoing feeder breaker.


The arc flash sensor for the second feeder zone E is connected to device 2, and it operates the same way. The arc flash sensors for zones C and D are connected to device 1, 2, 3, 4, or 5. If a sensor detects a fault in zone C or D, the light-only

signal is transferred to device 6 which also detects the overcurrent and then trips the main circuit breaker.

An arc flash fault in zone A or B does not necessarily activate the current detection in device 6. However, arc flash detection can be achieved by using the light-only principle. If an arc flash occurs in the cable termination or incomer circuit breaker in zone A or B, the fault is cleared by an overcurrent signal.

⚠ WARNING
HAZARD OF UNWANTED OPERATION
Do not route the BIO line close to primary power circuits.
Failure to follow these instructions can result in death, serious injury, or equipment damage.

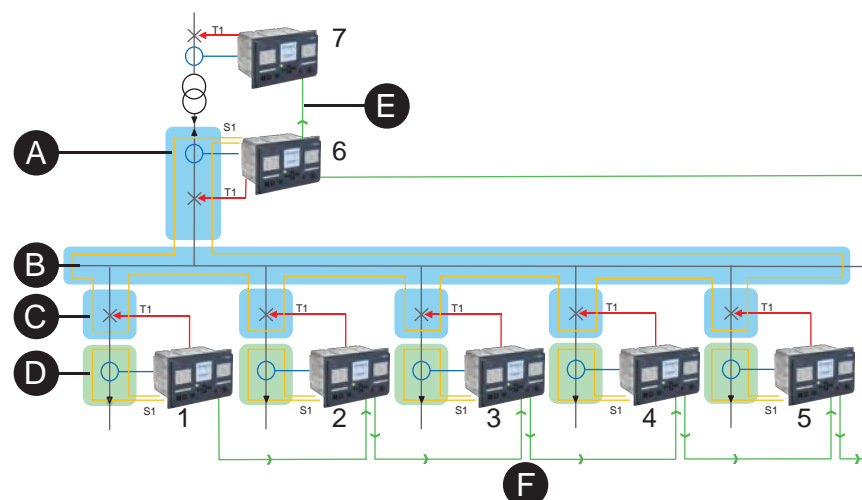Figure 197 - Arc flash detection application example – fiber



- | | |
|---------------------------------------|---|
| A. Incomer cable zone | D. Feeder cable zone |
| B. Busbar zone | E. Light information via optical BIO L> (incomer busbar and circuit breaker) |
| C. Feeder circuit breaker zone | F. Light information via optical BIO L> (feeder cable and circuit breaker) |

The fiber-loop arc flash sensor for zone D is connected to device 1. If the sensor detects a fault and simultaneously, device 1 detects an overcurrent signal, zone D is isolated by the outgoing feeder breaker.

For the other feeders, the fiber-loop arc flash sensors monitoring zone D are connected to the appropriate feeder relays and they operate the same way as feeder 1.

The fiber loop arc flash sensors for zones C, B and A are connected to device 6. If a sensor detects a fault in zone C, B or A and simultaneously, device 6 detects an overcurrent signal, the fault is cleared by the incoming breaker operation.

Device 7 measures the overcurrent and receives light detection signals from zones A, B, and C. It trips the substation if device 6 is unable to measure the overcurrent.


⚠ WARNING

HAZARD OF UNWANTED OPERATION

Do not route the BIO line close to primary power circuits.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

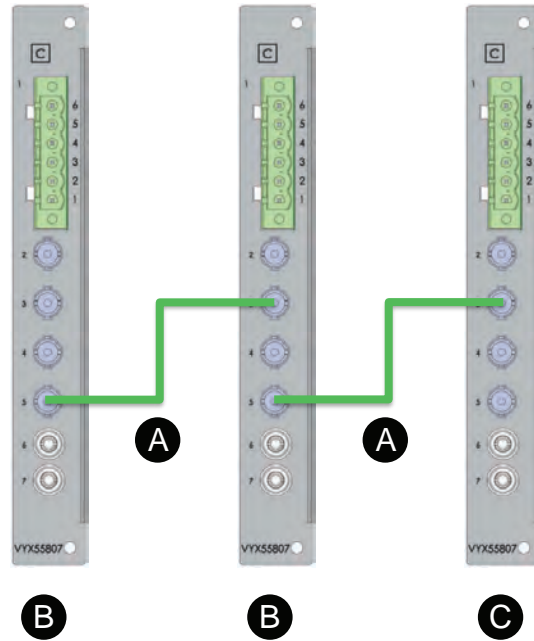Figure 198 - Arc flash detection application example – fiber connections



- A. L > (BB & CB) via fibre-optic link
- B. Feeder
- C. Incomer

Figure 199 - Arc matrix – light


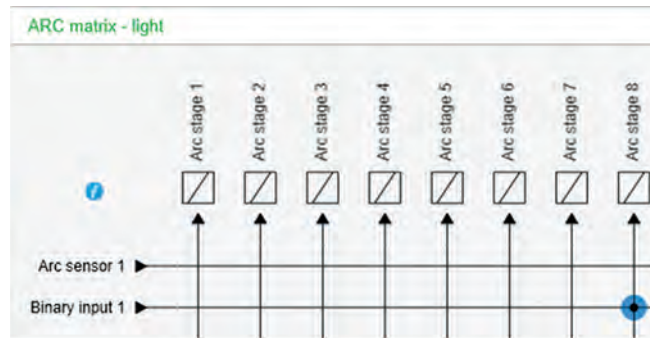


Figure 200 - Arc matrix – output

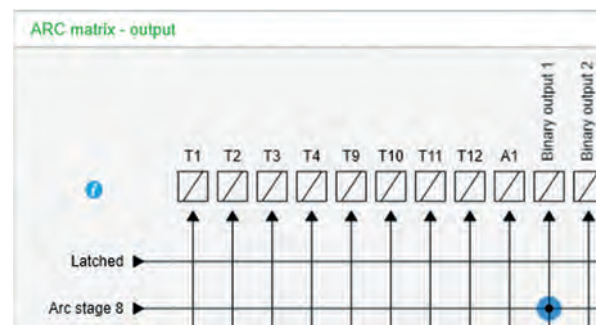

9.4 Using CSH120 and CSH200 with I_{02} 0.2 A / 1 A core balance CT input

General

The CSH120 and CSH200 core balance CTs are for direct earth fault overcurrent measurement. The only difference between them is the diameter. Because of their low-voltage insulation, they can only be used on cables.


These core balance CTs can be connected to the Easergy P3 protection device range when 0.2 A I_0 input is used. This needs to be determined when ordering the protection device (select 0.2 A for the earth fault current input in the order code).

Settings in the Easergy P3 protection device

When CSH120 or CSH200 is connected to an Easergy P3 protection device, to secure correct operation of the protection functions and measurement values, use the following values in the **Scaling** setting view:

- I_{0X} CT primary: 470 A
- I_{0X} CT secondary: 1 A
- Nominal I_{0X} input: 0.2 A

NOTE: X refers to the I_0 input channel number (1 or 2).

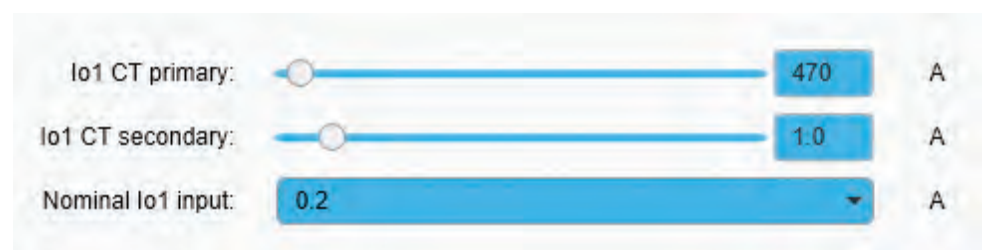Figure 201 - Scalings view for I_{02} input

Lower scaling values

The device also allows selecting ten times lower scaling values. Set the values to:

- I_{0X} CT primary: 47 A
- I_{0X} CT secondary: 0.1 A
- Nominal I_{0X} input: 0.2 A

The minimum setting for the primary current is then $0.005 \times 47 \text{ A} = 0,235 \text{ A}$.

Measuring specifications

When CSH120 or CSH200 is used with Easergy P3 protection devices the measuring range is 0.2 A–300 A of primary current. The minimum setting for primary current is $0.005 \times I_0$ which in this case means $0.005 \times 470 \text{ A} = 2.35 \text{ A}$ of primary current.

Figure 202 - Earth fault overcurrent setting view

E/F overcurrent $I_0 > 50N/51N$

Enable for $I_0 >$:

I_0 input:

I_0 1 residual current: 0.000 pu

Status:

Estimated time to trip: 0.0 s

Start counter:

Trip counter:

Set group 1 DI control:

Set group 2 DI control:

Set group 3 DI control:

Set group 4 DI control:

Group

	Group 1	Group 2	Group 3	Group 4
Pick-up setting [A]	0.50	0.50	0.50	0.50
Pick-up setting [pu]	0.005	0.050	0.050	0.050
Delay curve family	DT	DT	DT	DT
Delay type	DT	DT	DT	DT
Operation delay [s]	1.00	1.00	1.00	1.00

9.5 Using CSH120 and CSH200 with I_{02} CSH (2 / 20 A) core balance CT input

General

The CSH120 and CSH200 core balance CTs are dedicated accessories for Schneider Electric's specially designed devices. They are used for direct earth fault overcurrent measurement. The only difference between them is the diameter. Because of their low-voltage insulation, they can only be used on cables.

These core balance CTs can be connected to the Easergy P3 protection device range when 2 A / 20 A I_{02} input is used. This needs to be determined when ordering the protection device (select 2 A / 20 A for the earth fault current input I_{02} in the order code).

Settings in the Easergy P3 protection device

When CSH120 or CSH200 is connected to an Easergy P3 protection device, to secure correct operation of the protection functions and measurement values, use the following values in the **Scaling** setting view:

In the Easergy P3 Advanced device, the CSH input can only be configured for I_{02} . In this case, two primary windings are used to select the nominal input range: 2 A or 20 A.

Figure 203 - Example of the scaling I_{02} CSH primary: 2 A

I01 CT primary:	<input type="text" value="500"/>	A
I01 CT secondary:	<input type="text" value="5.0"/>	A
Nominal I01 input:	<input type="text" value="5.0"/>	A
I02 CSH primary:	<input type="text" value="2"/>	A

Figure 204 - Example of the scaling I_{02} CSH primary: 20 A

I01 CT primary:	<input type="text" value="500"/>	A
I01 CT secondary:	<input type="text" value="5.0"/>	A
Nominal I01 input:	<input type="text" value="5.0"/>	A
I02 CSH primary:	<input type="text" value="20"/>	A

Measuring specifications

When CSH120 or CSH200 is used with Easergy P3 protection devices, the measuring range is $0.02\text{--}42 \times I_N$. The minimum earth fault setting range is 0.05 to $8 \times I_N$ for primary current.

Two primary windings are used to select the nominal input range 2 A or 20 A. Set the device parameter I_{02} CSH primary to 20 A or 2 A.

If I_{02} CSH primary = 2 A, the minimum setting for primary current is then 0.05×2 A = 0.10 A.

If I_{02} CSH primary = 20 A, the minimum setting for primary current is then 0.05×20 A = 1.00 A.

Figure 205 - Earth fault overcurrent setting view when I_{02} CSH primary = 2 A

E/F overcurrent Io> 50N/51N

Enable for Io>:

Io input:

Io2 residual current: 0.000 pu

Status:

Estimated time to trip: 0.0 s

Start counter:

Trip counter:

Set group 1 DI control:

Set group 2 DI control:

Set group 3 DI control:

Set group 4 DI control:

Group

	Group 1	Group 2	Group 3	Group 4
Pick-up setting [A]	0.10	0.10	0.10	0.10
Pick-up setting [pu]	<input type="text" value="0.050"/>	<input type="text" value="0.050"/>	<input type="text" value="0.050"/>	<input type="text" value="0.050"/>
Delay curve family	<input type="text" value="DT"/>	<input type="text" value="DT"/>	<input type="text" value="DT"/>	<input type="text" value="DT"/>
Delay type	<input type="text" value="DT"/>	<input type="text" value="DT"/>	<input type="text" value="DT"/>	<input type="text" value="DT"/>
Operation delay [s]	<input type="text" value="1.00"/>	<input type="text" value="1.00"/>	<input type="text" value="1.00"/>	<input type="text" value="1.00"/>

10 Installation

10.1 Checking the consignment

Check that the unit packaging and the seal are intact at the receipt of the delivery. Our products leave the factory in closed, sealed packaging. If the transport packaging is open or the seal is broken, the confidentiality and authenticity of the information contained in the products cannot be ensured.

10.2 Product identification

Each Easergy P3 relay is delivered in a separate package containing:


- Easergy P3 protection relay with the necessary terminal connectors
- Production testing certificate
- Quick Start manual

Optional accessories are delivered in separate packages.

To identify an Easergy P3 protection relay, see the labels on the package and on the side of the relay.

Serial number label

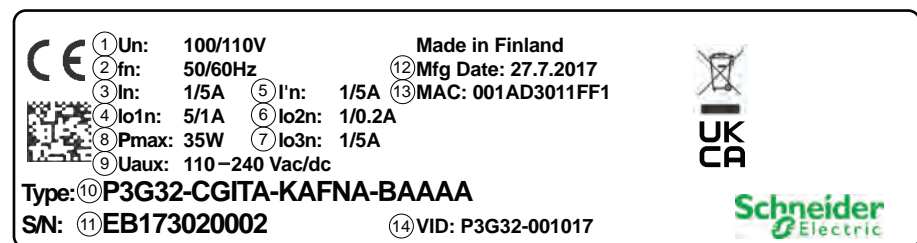Figure 206 - Serial number label




1. Rated voltage U_n
2. Rated frequency f_n
3. Rated phase current I_n
4. Rated earth fault current I_{01n}
5. Rated phase current I'_n *)
6. Rated earth fault current I_{02n}
7. Rated earth fault current I_{03n} ⁹¹⁾ *)
8. Power consumption P_{max}
9. Power supply operating range U_{AUX}
10. Order code
11. Serial number
12. Manufacturing date

⁹¹⁾ *) Available in P3M32, P3T32 and P3G32 models only

13. MAC address for TCP/IP communication
14. Production identification

Unit package label

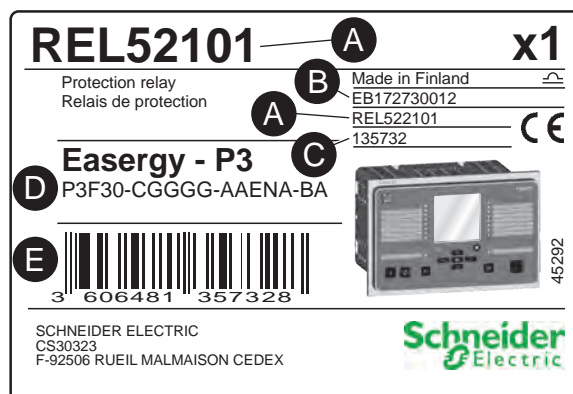Figure 207 - P3x3x Unit package label



- | | |
|---------------------------------|--------------------------|
| A. Short order code | D. Order code |
| B. Serial number | E. EAN13 bar code |
| C. Internal product code | |

10.3 Storage

Store the relay in its original packaging in a closed, sheltered location with the following ambient conditions:

- ambient temperature: -40 °C to +70 °C (or -40 °F to +158 °F)
- humidity < 90 %.

Check the ambient conditions and the packaging yearly.

10.4 Mounting

DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Wear your personal protective equipment (PPE) and comply with the safe electrical work practices. For clothing refer applicable local standards.
- Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.
- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it. Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing relay to ensure that all power is off.
- Do not open the secondary circuit of a live current transformer.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

CAUTION

HAZARD OF CUTS


Trim the edges of the cut-out plates to remove any jagged edges.

Use protective gloves when moving and mounting the device.

Failure to follow these instructions can result in injury.

Panel mounting

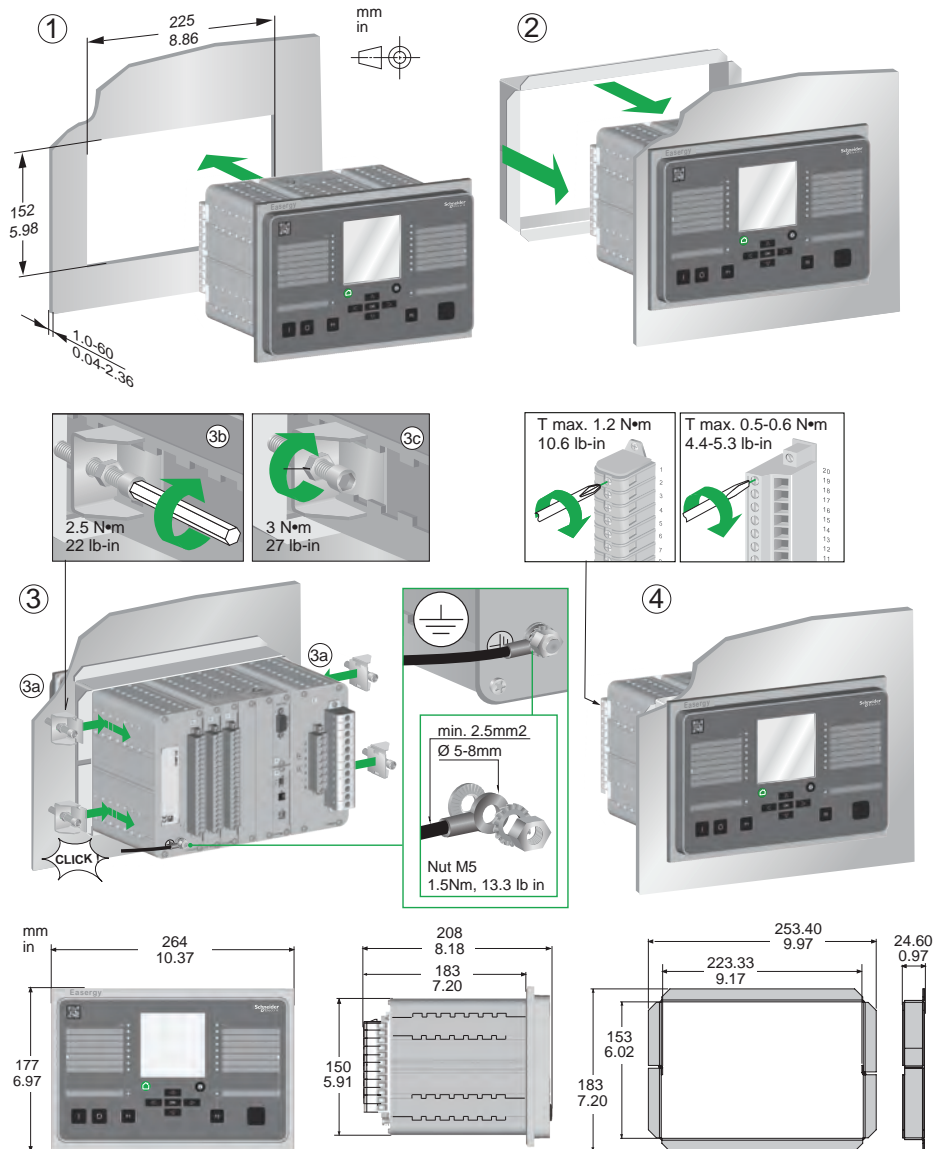
Figure 208 - Panel mounting



The conventional mounting technique has always been installing the relay on the secondary compartment's door. A limitation of this approach could be that the door construction is not strong enough for the relay's weight and wiring a large amount of secondary and communication cabling could be challenging.

Panel mounting with detachable display

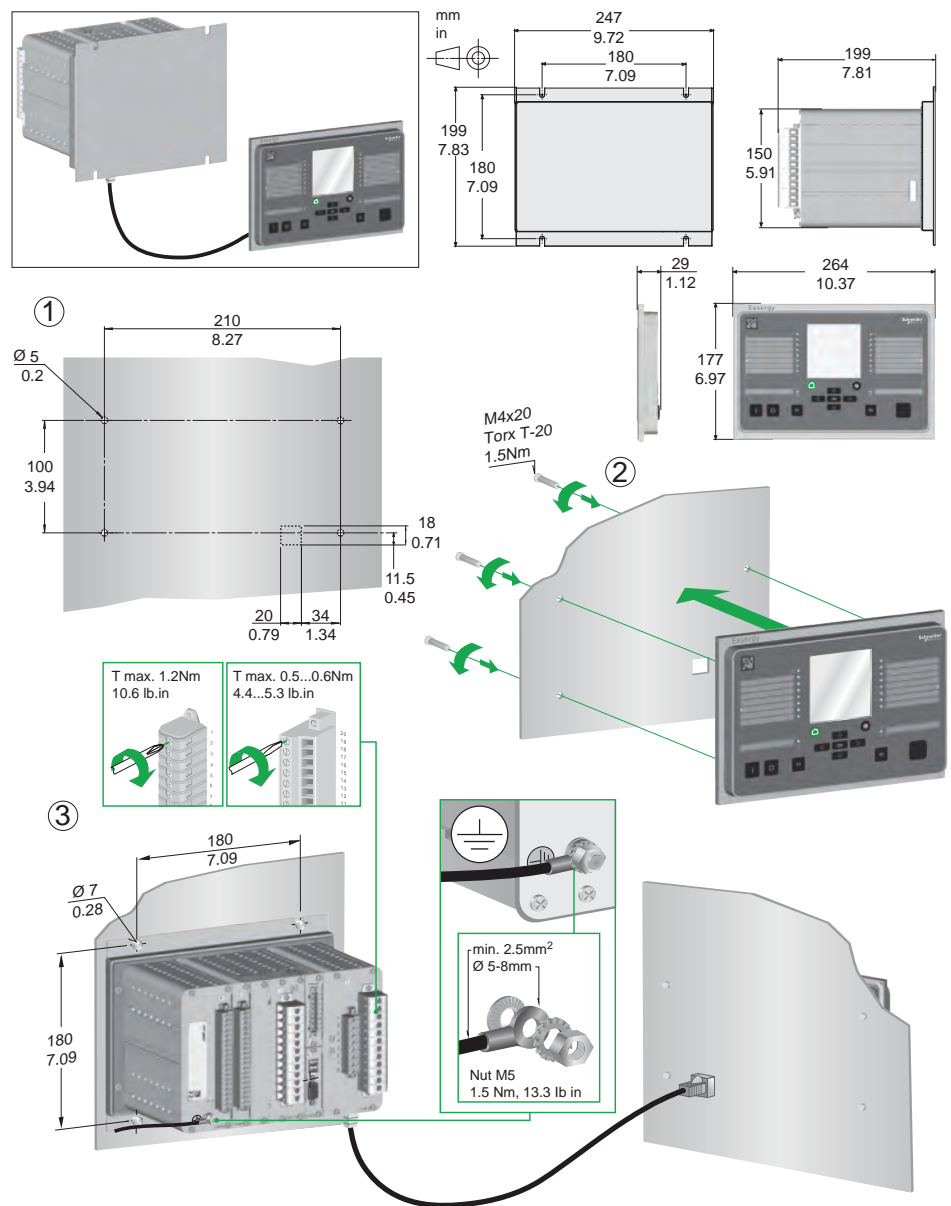
Figure 209 - Panel mounting with detachable display



This mounting technique allows the door to be lighter as the relay's frame is installed on the back of the secondary compartment. Normally, the relay is mounted by the terminal blocks, hence the secondary wiring is short. Communication cabling is easier, too, as the door movement does not need to be considered. In this case, only the communication between relay base and display have to be wired.


Projection mounting

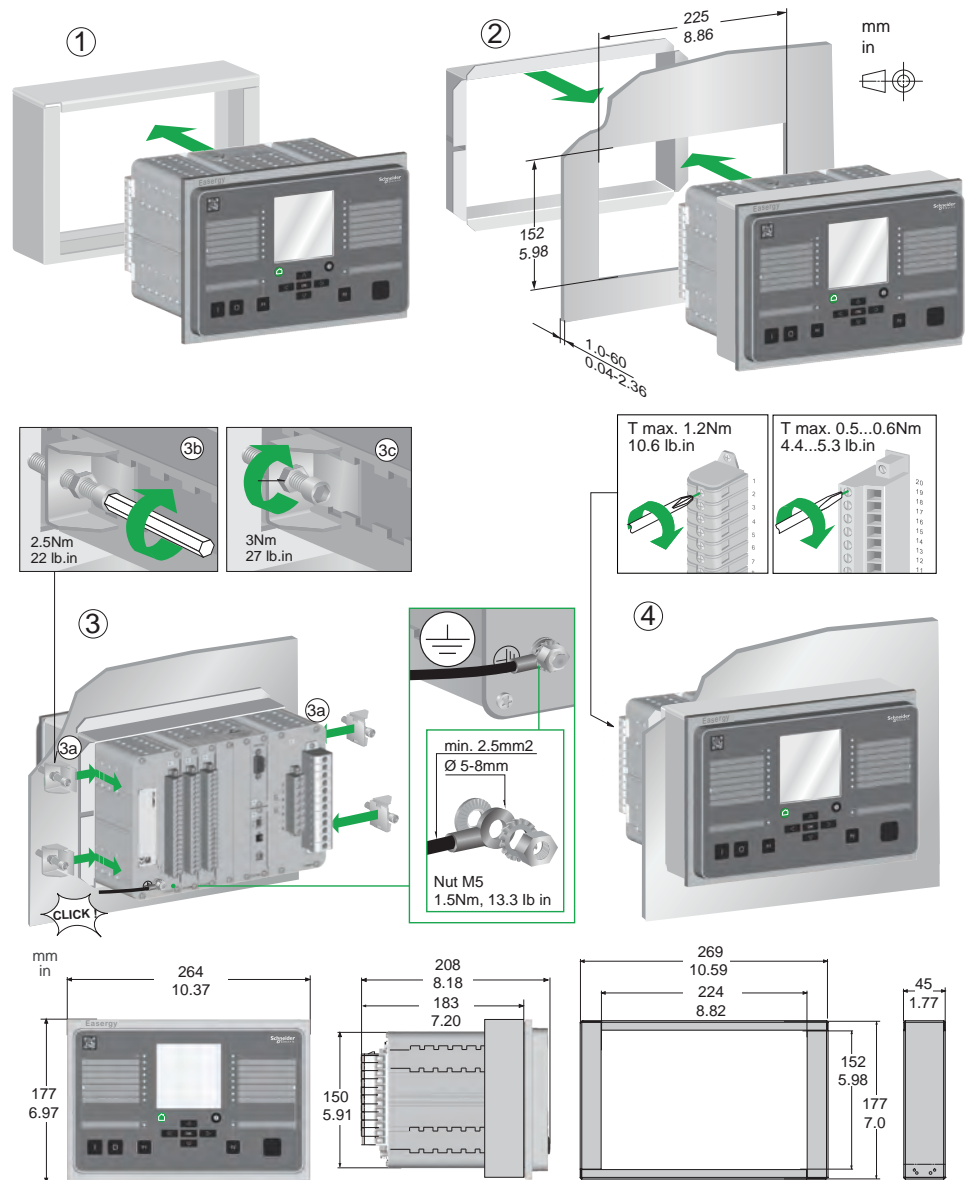Figure 210 - Projection mounting



If the depth dimension behind the compartment door is limited, the relay can be equipped with a frame around the collar. This arrangement reduces the depth inside the compartment by 45 mm. For more details, see [11.5 Environmental conditions](#).

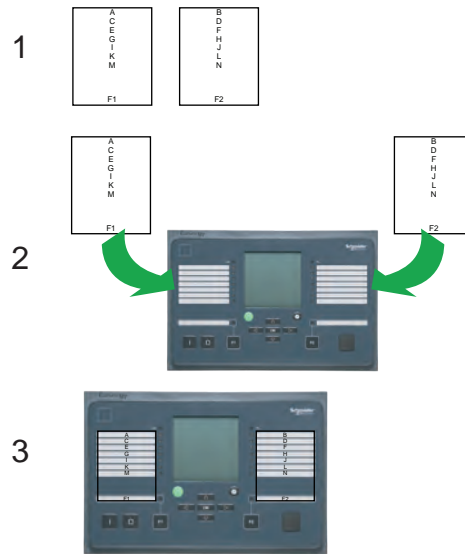Example of the P3 alarm facial label insertion



See "P3 Advanced Series facial label instruction" document for more information.

Protective film

NOTICE
<p>RISK OF DESTRUCTION OF THE RELAY</p> <p>The protective film on the relay's display is plastic and can melt if exposed to high temperatures intensive sunlight. Remove the protective film after mounting the relay.</p> <p>Failure to follow these instructions can result in equipment damage.</p>

10.5 Connections

The Easergy P3M30 and P3M32 has a fixed combination of analog interface, power supply, digital input and output, communication and arc flash detection cards as per the chosen order code. Do not remove cards from the relay's card slots in any circumstances.

<p>CARD SLOT ARRANGEMENT</p> <p>WARNING! DO NOT REMOVE CARDS!</p>	
	<p>ATTENTION</p> <p>OBSERVE PRECAUTIONS FOR HANDLING ELECTROSTATIC SENSITIVE DEVICES</p> <p>VY197B</p>

10.5.1 Supply voltage cards

Auxiliary voltage

⚡ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK

Before connecting the devices, disconnect the supply voltage to the unit.

Failure to follow these instructions will result in death or serious injury.

The external auxiliary voltage U_{AUX} (110–240 V ac/dc, or optionally 24–48 V dc) of the relay is connected to the pins 1/C/1:1–2 or 1/D/1:1–2.

NOTE: When an optional 24–48 V dc power module is used, the polarity is as follows: 1/D/2:2 positive (+), 1/D/2:1 negative (-).

NOTICE

LOSS OF PROTECTION OR RISK OF NUISANCE TRIPPING

- If the relay is no longer supplied with power or is in permanent fault state, the protection functions are no longer active and all the Easergy P3 digital outputs are dropped out.
- Check that the operating mode and SF relay wiring are compatible with the installation.

Failure to follow these instructions can result in equipment damage and unwanted shutdown of the electrical installation.

Figure 211 - Example of supply voltage card Power C 110-240

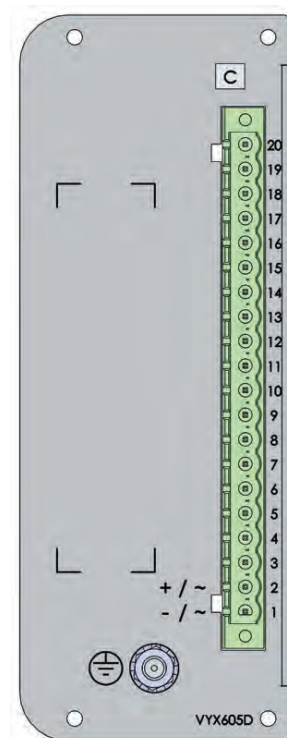


Table 134 - Supply voltage card Power C 110-240 & Power D 24-48

Pin No.	Symbol	Description
20	T12	Heavy duty trip relay 12 for arc protection
19	T12	Heavy duty trip relay 12 for arc protection
18	T11	Heavy duty trip relay 11 for arc protection
17	T11	Heavy duty trip relay 11 for arc protection
16	T10	Heavy duty trip relay 10 for arc protection
15	T10	Heavy duty trip relay 10 for arc protection
14	T9	Heavy duty trip relay 9 for arc protection
13	T9	Heavy duty trip relay 9 for arc protection
12	T1	Heavy duty trip relay 1 for arc protection
11	T1	Heavy duty trip relay 1 for arc protection
10	A1 NO	Signal relay 1, normal open connector
9	A1 NC	Signal relay 1, normal closed connector
8	A1 COMMON	Signal relay 1, common connector
7	SF NC	Service status output, normal closed
6	SF NO	Service status output, normal open
5	SF COMMON	Service status output, common
4		No connection
3		No connection
2	L / + / ~	Auxiliary voltage
1	N / - / ~	Auxiliary voltage

DANGER

HAZARD OF ELECTRICAL SHOCK

Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow these instructions will result in death or serious injury.

10.5.2 Analog measurement cards

⚡ ⚠ DANGER

HAZARD OF ELECTRICAL SHOCK

Do not open the secondary circuit of a live current transformer.

Disconnecting the secondary circuit of a live current transformer may cause dangerous overvoltages.

Failure to follow these instructions will result in death or serious injury.


10.5.2.1 Analog measurement cards E , N, 1 and 5 (slot 8)

This card contains connections for current transformers for measuring of the phase currents L1–L3 and two earth fault overcurrents I_0 , and four voltage transformers for measuring the U_0 , ULL or ULN.

The relay is able to measure three phase currents, and two earth fault overcurrents. It also measures up to four voltage signals: line-to-line, line-to-neutral, neutral displacement voltage and voltage from another side (synchrocheck). See the voltage modes selection below:


- 3LN, 3LN+ U_0 , 3LN+ LL_γ , 3LN+ LN_γ
- 2LL+ U_0 , 2LL+ U_0 + LL_γ , 2LL+ U_0 + LN_γ
- LL+ U_{00} + LL_γ + LL_z , LN+ U_0 + LN_γ + LN_z

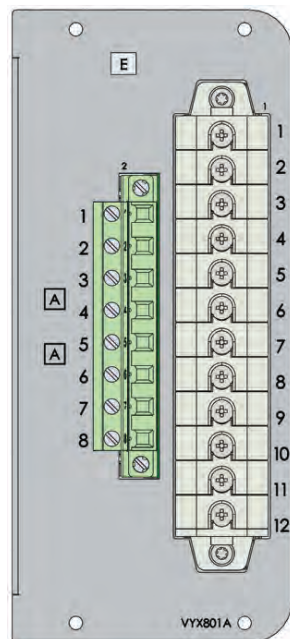Figure 212 - Analog measurement card E / N (N only for P3x30 models)



$$E = 3L (5 A) + 2 I_0 (5/1 A + 1/0,2 A) + 4U \quad N = 3L (5 A) + I_{01} (5/1 A) + I_{02} CSH (2 /20 A) + 4U$$

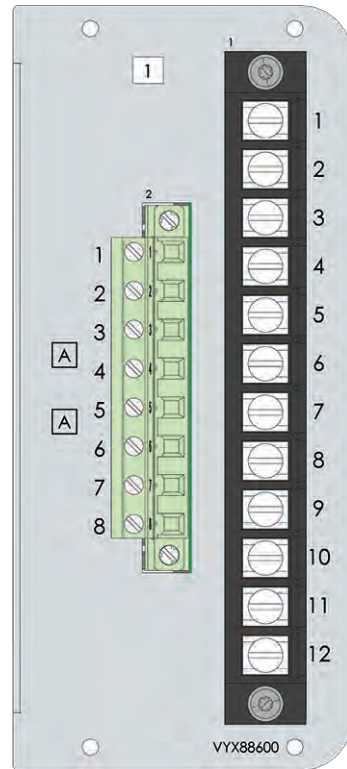Figure 213 - Analog measurement card 1 / 5 (5 only for P3x30 models)



1 = 3L (5/1 A) + 2 I₀ (5/1 A+1/0,2 A) ring lug + 5 = 3L (5 A) + I₀ (5 A) + I₀₂ CSH (2/20 A) RL + 4U
4U

Table 135 - Terminal pins for cards E, N, 1, and 5

Pin No.	Symbol	Description	Card N or 5 (only for P3x30 models)
1	I _{L1} (S1)	Phase current L1 5 A (S1)	
2	I _{L1} (S2)	Phase current L1 5 A (S2)	
3	I _{L2} (S1)	Phase current L2 5 A (S1)	
4	I _{L2} (S2)	Phase current L2 5 A (S2)	
5	I _{L3} (S1)	Phase current L3 5 A (S1)	
6	I _{L3} (S2)	Phase current L3 5 A (S2)	
7	I ₀₁ (S1)	Earth fault overcurrent I ₀₁ (S1) common for 5 A and 1 A	
8	I ₀₁ (S2)	Earth fault overcurrent I ₀₁ 5 A (S2)	
9	I ₀₁ (S2)	Earth fault overcurrent I ₀₁ 1 A (S2)	
10	I ₀₂ (S1)	Earth fault overcurrent I ₀₂ (S1) common for 1 A and 0.2 A	CSH 2/20 A
11	I ₀₂ (S2)	Earth fault overcurrent I ₀₂ 1 A (S2)	CSH 20 A
12	I ₀₂ (S2)	Earth fault overcurrent I ₀₂ 0.2 A (S2)	CSH 2 A

Table 136 - Terminal pins for cards E and 1

Pin No.	Symbol	Description
1	ULL/ULN	Voltage ULL (a) /ULN (a)
2	ULL/ULN	Voltage ULL (b) /ULN (n)
3	ULL/ULN	Voltage ULL (a) /ULN (a)
4	ULL/ULN	Voltage ULL (b) /ULN (n)
5	U_0 /ULL/ULN	Voltage U_0 (a) / ULL (a) /ULN (a)
6	U_0 /ULL/ULN	Voltage U_0 (b) /ULL (b) /ULN (n)
7	U_0 /ULN/ULL	Voltage U_0 (da) / ULL (a) / ULN (n)
8	U_0 /ULN/ULL	Voltage U_0 (dn) / ULL (b) / ULN (n)

10.5.2.2 Analog measurement cards F, O, 2 and 6 (slot 8)


This card contains connections for current transformers for measuring the phase currents L1–L3 and two earth fault overcurrents I_0 and four voltage transformers for measuring the U_0 , ULL or ULN.

The relay is able to measure three phase currents, and two earth fault overcurrents. It also measures up to four voltage signals: line-to-line, line-to-neutral, zero-sequence voltage and voltage from another side (synchro-check).

See the voltage modes selection below:


- 3LN, 3LN+ U_0 , 3LN+LL $_{\gamma}$, 3LN+LN $_{\gamma}$
- 2LL+ U_0 , 2LL+ U_0 +LL $_{\gamma}$, 2LL+ U_0 +LN $_{\gamma}$
- LL+ U_0 +LL $_{\gamma}$ +LL $_{z}$, LN+ U_0 +LN $_{\gamma}$ +LN $_{z}$

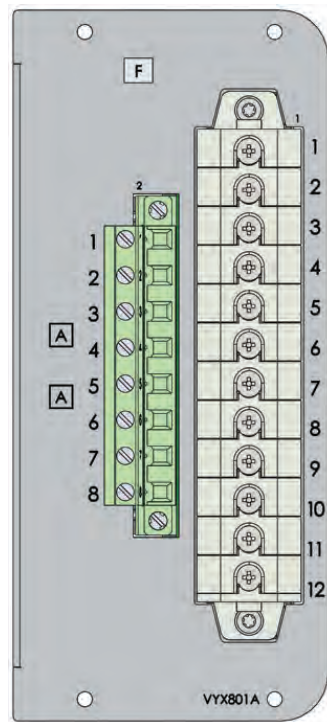Figure 214 - Analog measurement card F or O (O only for P3x30 models)



$$F = 3L (1 A) + 2 I_0 (5/1 A + 1/0.2 A) + 4U \quad O = 3L (1 A) + I_{01} (5/1 A) + I_{02} CSH (2/20 A) + 4U$$

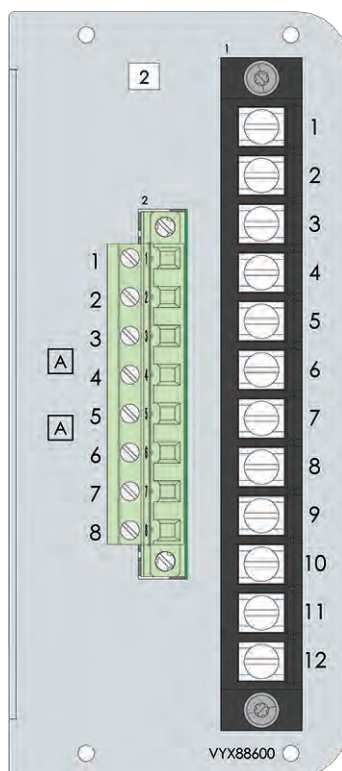Figure 215 - Analog measurement card 2 or 6 (6 only for P3x30 models)



$$2 = 3L (1 A) + 2 I_0 (5/1 A + 1/0.2 A) \text{ ring lug} + 4U \quad 6 = 3L (1 A) + I_0 (5A) + I_{02} CSH (2/20 A) RL + 4U$$

Table 137 - Terminal pins for cards F, O, 2 and 6

Pin No.	Symbol	Description	Card O or 6 (only for P3x30 models)
1	I_{L1} (S1)	Phase current L1 1 A (S1)	
2	I_{L1} (S2)	Phase current L1 1 A (S2)	
3	I_{L2} (S1)	Phase current L2 1 A (S1)	
4	I_{L2} (S2)	Phase current L2 1 A (S2)	
5	I_{L3} (S1)	Phase current L3 1 A (S1)	
6	I_{L3} (S2)	Phase current L3 1 A (S2)	
7	I_{01} (S1)	Earth fault overcurrent I_{01} (S1) common for 5 A and 1 A	
8	I_{01} (S2)	Earth fault overcurrent I_{01} 5 A (S2)	
9	I_{01} (S2)	Earth fault overcurrent I_{01} 1 A (S2)	
10	I_{02} (S1)	Earth fault overcurrent I_{02} (S1) common for 1 A and 0.2 A	CSH 2/20 A
11	I_{02} (S2)	Earth fault overcurrent I_{02} 1 A (S2)	CSH 20 A
12	I_{02} (S2)	Earth fault overcurrent I_{02} 0.2 A (S2)	CSH 2 A

Table 138 - Terminal pins 8/F/2:1–8 and 8/2/2:1–8

Pin No.	Symbol	Description
1	ULL/ULN	Voltage ULL (a) /ULN (a)
2	ULL/ULN	Voltage ULL (b) /ULN (n)
3	ULL/ULN	Voltage ULL (a) /ULN (a)
4	ULL/ULN	Voltage ULL (b) /ULN (n)
5	ULL/ULN	Voltage ULL (a) /ULN (a)
6	ULL/ULN	Voltage ULL (b) /ULN (n)
7	U_0 /ULL/ULN	U_0 (da) / ULL (a) / ULN (a)
8	U_0 /ULL/ULN	U_0 (dn) / ULL (b) / ULN (n)

10.5.2.3 Analog measurement cards T and 1 (slot 4)

This card contains connections for current measurement transformers for measuring the phase currents L1, L2 and L3 and earth fault overcurrent I_0 .

Totally, the relay is able to measure six phase currents, three earth fault overcurrents and additionally four voltages.

Figure 216 - Analog measurement card "T = 3xl (5/1A) + I_0 (5/1A)"

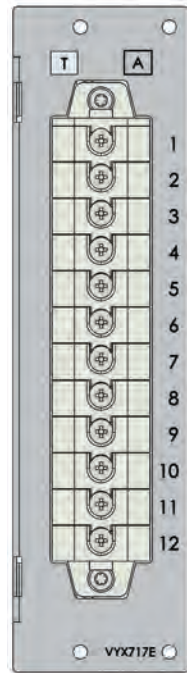


Figure 217 - Analog measurement card "1 = 3xl (5/1A) ring lug + I_0 (5/1A)"

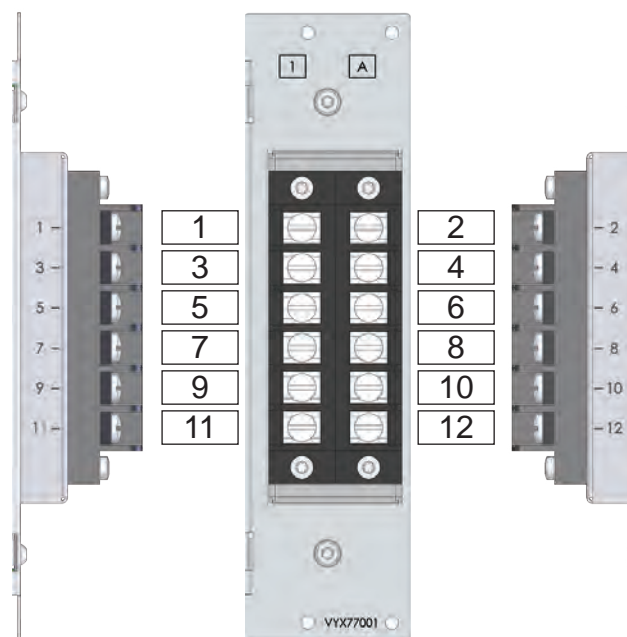


Table 139 - Pins 4/T/1:1–12 and 4/1/1:1–12

Pin No.	Symbol	Description
1	I'L1	Phase current I'L1 (S1), common for 1 A and 5 A
2	I'L1 / 5A	Phase current I'L1 (S2)
3	I'L1 / 1A	Phase current I'L1 (S2)
4	I'L2	Phase current I'L2 (S1), common for 1 A and 5 A
5	I'L2 / 5A	Phase current I'L2 (S2)
6	I'L2 / 1A	Phase current I'L2 (S2)
7	I'L3	Phase current I'L3 (S1), common for 1 A and 5 A
8	I'L3 / 5A	Phase current I'L3 (S2)
9	I'L3 / 1A	Phase current I'L3 (S2)
10	I ₀₃	Earth fault overcurrent I ₀₃ (S1), common for 1 A and 5 A
11	I ₀₃ / 5A	Earth fault overcurrent I ₀₃ (S2)
12	I ₀₃ / 1A	Earth fault overcurrent I ₀₃ (S2)

10.5.3 I/O cards

10.5.3.1 I/O card “B = 3BIO+2Arc”

This card contains connections to two arc light sensors (for example, VA 1 DA), three binary inputs and three binary outputs.

The option card also has three normal open trip contacts that can be controlled either with the relay's normal trip functions or using the fast arc matrix.

Figure 218 - I/O card "B = 3BIO+2Arc"



Table 140 - Slots 2/B/1:1–20

Pin no.	Symbol	Description
20	T4	Trip relay 4 for arc detection (normal open)
19	T4	Trip relay 4 for arc detection (normal open)
18	T3	Trip relay 3 for arc detection (normal open)
17	T3	Trip relay 3 for arc detection (normal open)
16	T2	Trip relay 2 for arc detection (normal open)
15	T2	Trip relay 2 for arc detection (normal open)
14	BI3	Binary input 3
13	BI3	Binary input 3
12	BI2	Binary input 2
11	BI2	Binary input 2
10	BI1	Binary input 1
9	BI1	Binary input 1
8	BO COMMON	Binary output 1–3 common GND
7	BO3	Binary output 3, +30 V dc
6	BO2	Binary output 2, +30 V dc
5	BO1	Binary output 1, +30 V dc
4	Sen 2 -	Arc sensor channel 2 negative terminal
3	Sen 2 +	Arc sensor channel 2 positive terminal

Pin no.	Symbol	Description
2	Sen 1 -	Arc sensor channel 1 negative terminal
1	Sen 1 -	Arc sensor channel 1 positive terminal

10.5.3.2 I/O card “C = F2BIO+1Arc”

This card contains connections to one arc fiber sensor, two fiber binary inputs, two fiber binary outputs and three fast trip relays.

Arc loop sensor input is used with Arc-SLM sensor. The sensor’s sensitivity can be set in the **Arc protection** setting view in Easergy Pro.

Binary inputs and outputs are designed to be used with 50/125 μm, 62.5/125 μm, 100/140 μm, and 200 μm fiber sizes (Connector type: ST).

The option card also has three normal open trip contacts that can be controlled either with the relay’s normal trip functions or using the fast arc matrix.

Figure 219 - I/O card “C = F2BIO+1Arc”



Table 141 - Fiber 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4 I/O card pins (slot 2)

Connector / Pin no.	Symbol	Description
1:6	T4	Trip relay 4 for arc detection (normal open)
1:5	T4	Trip relay 4 for arc detection (normal open)
1:4	T3	Trip relay 3 for arc detection (normal open)
1:3	T3	Trip relay 3 for arc detection (normal open)
1:2	T2	Trip relay 2 for arc detection (normal open)

Connector / Pin no.	Symbol	Description
1:1	T2	Trip relay 2 for arc detection (normal open)
2	BI2	Fiber binary input 2
3	BI1	Fiber binary input 1
4	BO2	Fiber binary output 2
5	BO1	Fiber binary output 1
6	Arc sensor 1	Arc sensor 1 Rx
7	Arc sensor 1	Arc sensor 1 Tx

10.5.3.3 I/O card “D = 2IGBT”

This card contains two semiconductor outputs.

Figure 220 - I/O card “D = 2IGBT”


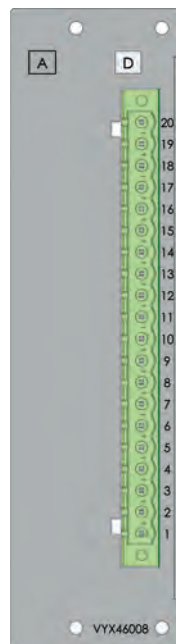


Table 142 - Slots 4/D/1:1–20

Pin no.	Symbol	Description
19–20	NC	No connection
18 ⁹²⁾	HSO2	HSO output 2 terminal 2
17 ⁹²⁾		
16 ⁹²⁾		HSO output 2 terminal 1
15 ⁹²⁾		
8–14	NC	No connection

Pin no.	Symbol	Description
7	HSO1	HSO output 1 terminal 2
6		
5		HSO output 1 terminal 1
4		
1-3	NC	No connection



⁹²⁾ Terminals 18-17 and 16-15 are interconnected, so it is sufficient to connect the wiring to terminals 15 and 17 or 16 and 18 only.

10.5.3.4 I/O option card “D=4Arc”

This card contains four arc point connections to four arc light sensors (for example. VA 1 DA). The card provides sensors 3 to 6.

Figure 221 - I/O option card “D= 4Arc”



Table 143 - Pins 6/D/1:1-8 (slot 6)

Pin no.	Symbol	Description
8	Sen 6 -	Arc sensor 6 negative terminal
7	Sen 6 +	Arc sensor 6 positive terminal
6	Sen 5 -	Arc sensor 5 negative terminal
5	Sen 5 +	Arc sensor 5 positive terminal
4	Sen 4 -	Arc sensor 4 negative terminal
3	Sen 4 +	Arc sensor 4 positive terminal
2	Sen 3 -	Arc sensor 3 negative terminal
1	Sen 3 +	Arc sensor 3 positive terminal

10.5.3.5 I/O card “G = 6DI+4DO”

This card provides six digital inputs and four relay outputs. The threshold level is selectable in the order code.

The card is equipped with six dry digital inputs with hardware-selectable activation/threshold voltage and four trip contacts. Input and output contacts are normally open.

Figure 222 - I/O card "G = 6DI+4DO"



Table 144 - Channel numbering for "C" or "D" power module and four "G" cards in slots 2–5/G-G-G-G

Pin no.	Trip "T" output numbering				
	Power supply	Slot 2	Slot 3	Slot 4	Slot 5
Card type	C or D	G	G	G	G
19, 20	12	16	20	24	28
17, 18	11	15	19	23	27
15, 16	10	14	18	22	26
13, 14	9	13	17	21	25
11, 12	1				
	DI channel numbering				
11, 12		6	12	18	24
9, 10		5	11	17	23
7, 8		4	10	16	22
5, 6		3	9	15	21
3, 4		2	8	14	20
1, 2		1	7	13	19

NOTE: Digital inputs are polarity-free, which means that you can freely choose "-" and "+" terminals for each digital input.

Table 145 - Channel numbering for "C" or "D" power module, "B" or "C" arc sensor interface card and three "G" cards in slots 3–5/G-G-G

Pin no.	Trip "T" output numbering					
	Power supply	Slot 2		Slot 3	Slot 4	Slot 5
Card type	C or D	B	C	G	G	G
19, 20	12	4				
17, 18	11	3				
15, 16	10	2				
13, 14	9					
11, 12	1					
5, 6			4			
3, 4			3			
1, 2			2			
19, 20				16	20	24
17, 18				15	19	23
15, 16				14	18	22
13, 14				13	17	21
DI channel numbering						
11, 12				6	12	18
9, 10				5	11	17
7, 8				4	10	16
5, 6				3	9	15
3, 4				2	8	14
1, 2				1	7	13

NOTE: Digital inputs are polarity-free, which means that you can freely choose "-" and "+" terminals for each digital input.

10.5.3.6 I/O card "H = 6DI + 4DO (NC)"

This card provides six digital inputs and four relays outputs that are normally closed (NC). The threshold level is selectable in the order code.

The 6xDI+4xDO option card is equipped with six dry digital inputs with hardware-selectable activation/threshold voltage and four normally closed (NC) trip contacts.

Figure 223 - I/O card "H = 6DI + 4DO (NC)"



Table 146 - Slots 2–5/G/1:1–20

Pin no.	Symbol	Description
20	Tx	Trip relay
19		
18	Tx	Trip relay
17		
16	Tx	Trip relay
15		
14	Tx	Trip relay
13		
12	DIx	Digital input
11		
10	DIx	Digital input
9		
8	DIx	Digital input
7		

Pin no.	Symbol	Description
6	DIx	Digital input
5		
4	DIx	Digital input
3		
2	DIx	Digital input
1		

10.5.3.7 I/O card "I = 10DI"

This card provides 10 digital inputs. The threshold level is selectable in the order code.

Figure 224 - I/O card "I = 10DI"



Table 147 - Channel numbering for slots 2–5/G-I-I-I/1:1–20 when one "G" and three "I" cards are used

Pin no.	DI numbering			
	Slot 2	Slot 3	Slot 4	Slot 5
Card type	G	I	I	I
19, 20		16	26	36
17, 18		15	25	35
15, 16		14	24	34

Pin no.	DI numbering			
13, 14		13	23	33
11, 12	6	12	22	32
9, 10	5	11	21	31
7, 8	4	10	20	30
5, 6	3	9	19	29
3, 4	2	8	18	28
1, 2	1	7	17	27

NOTE: Digital inputs are polarity-free, which means that you can freely choose "-" and "+" terminals for each digital input.

10.5.4 Arc flash sensor

⚠ DANGER


HAZARD OF NON-DETECTED LIGHT

Clean the arc sensor periodically as instructed in this user manual and after an arc flash fault.

Failure to follow these instructions will result in death or serious injury.

VA 1 DA is a point-type arc flash sensor. The sensor activated by strong light. It transforms the light information into the current signal that is used by the device to detect arc flash light.

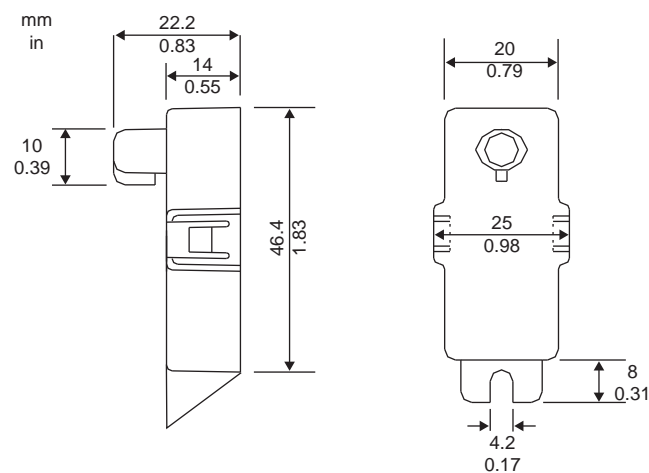Figure 225 - Sensor dimensions



The sensor features include:

- standard 8000–10000 lux visible light sensitivity
- wide area arc flash detection
- maximum 2 ms detection time

- standard cable length 6 m (236.22 in) or 20 m (787.40 in) (cut to length on site)
- easy to install (two-wired non-polarity sensitive connection)

DANGER

HAZARD OF NON-DETECTED LIGHT

Never attempt to extend the length of arc flash sensor cables.

Failure to follow these instructions will result in death or serious injury.

10.5.4.1 Mounting the sensors to the switchgear

DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Apply appropriate personal protective equipment (PPE) and follow safe electrical work practices. See NFPA 70E, NOM-029-STPS-2011, or CSA Z462.
- The arc fault detection system is not a substitute for proper PPE when working on or near equipment being monitored by the system.
- Information on this product is offered as a tool for conducting arc flash hazard analysis. It is intended for use only by qualified persons who are knowledgeable about power system studies, power distribution equipment, and equipment installation practices. It is not intended as a substitute for the engineering judgement and adequate review necessary for such activities.
- Only qualified personnel should install and service this equipment. Read this entire set of instructions and check the technical characteristics of the device before performing such work.
- Perform wiring according to national standards (NEC) and any requirements specified by the customer.
- Observe any separately marked notes and warnings.
- NEVER work alone.
- Before performing visual inspections, tests, or maintenance on this equipment, disconnect all sources of electric power. Assume all circuits are live until they are completely de-energized, tested, and tagged. Pay particular attention to the design of the power system. Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing relay to ensure that all power is off.
- The equipment must be grounded.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.
- Do not open the device. It contains no user-serviceable parts.
- Install all devices, doors and covers before turning on the power to this device.

Failure to follow these instructions will result in death or serious injury.

Install arc flash sensors inside the switchgear. There are two options for mounting the sensors:

- in customer-drilled holes on the switchgear
- on VYX001 Z-shape or VYX002 L-shape mounting plates available from Schneider Electric or locally fabricated from supplied drawings

Figure 226 - VYX 001 mounting plate for sensor

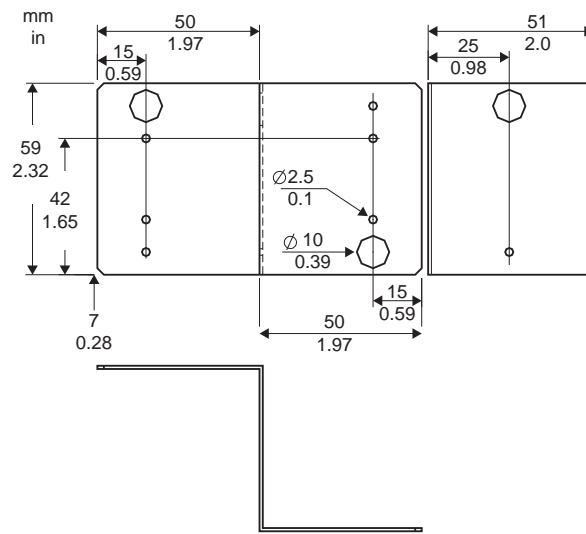


Figure 227 - VYX 002 mounting plate for sensor


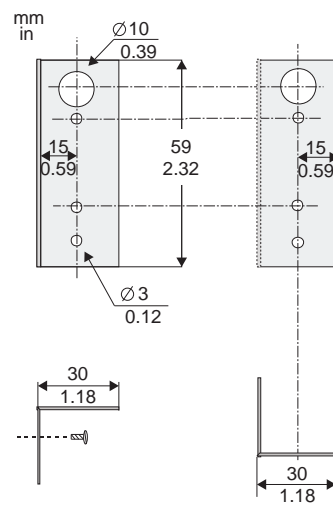


Figure 228 - Mounting the sensor

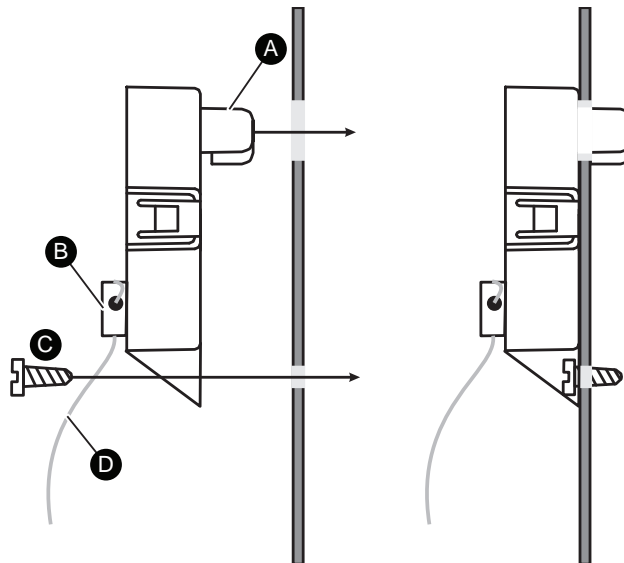

- A. Active part of the sensor
- B. Cable clamp
- C. Fastening screw 4 x 15 mm
- D. Sensor cable

1. Press the active part of the sensor through the 10 mm hole in the panel surface.
2. Fix it using a 4 mm screw.

10.5.4.2 Connecting the sensors to the device

The sensors are delivered with 6 or 20 m cables.

⚠ DANGER

HAZARD OF NON-DETECTED LIGHT

Never attempt to extend the length of arc flash sensor cables.

Failure to follow these instructions will result in death or serious injury.

NOTE: Use sensor type VA1DA-6W or VA1DA-20W when a shielded cable is required.

After mounting the sensors, connect them to the device.

1. Route the wire to the nearest device using the shortest route possible.

Cut the wire to a suitable length.

Take into account the wiring methods inside the equipment. This should be compliant with local regulations.

2. Connect the arc sensors to the screw terminals.

The polarity of the arc sensor cables is not critical.

NOTE: For the connection terminals, see section *I/O cards*.

3. If using a shielded cable, connect the cable shield to ground at the sensor end.

Related topics




10.5.3.1 I/O card "B = 3BIO+2Arc"




10.5.3.2 I/O card "C = F2BIO+1Arc"



10.5.3.4 I/O option card "D=4Arc"


10.5.5 Communication cards



Table 148 - Communication card types and their pin numbering



Type	Communication ports	Signal levels	Connectors	Pin usage
P = Fibre PP (slot 9)	Plastic fibre interface COM 3 port (if slot 9 card)		Versatile Link fiber 	
R = Fibre GG (slot 9)	Glass fibre interface (62.5/125 µm) COM 3 port (if slot 9 card)		ST 	
K = RS-232 (slot 6)	COM 1 / COM 2	RS-232	D-connector 	1 = TX COM 2 2 = TX COM 1 3 = RX COM 1 4 = IRIG-B 5 = IRIG-B GND 7 = GND 8 = RX COM 2 9 = +12V

Type	Communication ports	Signal levels	Connectors	Pin usage
B = RS-232 (slot 9)	COM 3 / COM 4	RS-232	D-connector 	1 = TX COM 4 2 = TX COM 3 3 = RX COM 3 4 = IRIG-B 5 = IRIG-B GND 6 = 7 = GND 8 = RX COM 4 9 = +12V
C = RS-232+Eth RJ (slot 9)	COM 3 / COM 4	RS-232	D-connector 	1 = TX COM 4 2 = TX COM 3 3 = RX COM 3 4 = IRIG-B 5 = IRIG-B GND 6 = 7 = GND 8 = RX COM 4 9 = +12V
	Ethernet	Ethernet 100 Mbps	RJ-45 	1 = Transmit + 2 = Transmit - 3 = Receive + 4 = 5 = 6 = Receive - 7 = 8 =

Type	Communication ports	Signal levels	Connectors	Pin usage
D = RS-232+Eth LC (slot 9)	COM 3 / COM 4	RS-232	D-connector 	1 = TX COM 4 2 = TX COM 3 3 = RX COM 3 4 = IRIG-B 5 = IRIG-B GND 6 = 7 = GND 8 = RX COM 4 9 = +12V
	Ethernet	Light 100 Mbps	LC fiber connector 	1 = Receive 2 = Transmit

Type	Communication ports	Signal levels	Connectors	Pin usage
E = 2 x RS-485 (slot 9)	COM 3 (RS-485 interface 1) COM 4 (RS-485 interface 2)	RS-485		<p>S2 DIP switch for termination resistors of the RS-485 interface 2</p> <p>8 = RS-485 interface 2 cable shield connection</p> <p>7 = RS-485 interface 2 “-“ connection</p> <p>6 = RS-485 interface 2 “+“ connection</p> <p>5 = RS-485 interface 2 ground terminal</p> <p>4 = RS-485 interface 1 “-“ connection</p> <p>3 = RS-485 interface 1 “+“ connection</p> <p>2 = RS-485 interface 1 ground terminal</p> <p>1 = RS-485 interface 1 cable shield connection</p> <p>S1 DIP switch for termination resistors of the RS-485 interface 1</p> <p>* RS-485 interfaces 1 and 2 galvanically isolated from each other</p>


Type	Communication ports	Signal levels	Connectors	Pin usage
<p>F = RS-485+RJ (slot 9)</p>	<p>Ethernet COM 3 (RS-485 interface 1)</p>	<p>Ethernet 100 Mbps RS-485</p>		<p>RJ45 connector from top:</p> <p>1 = Transmit+</p> <p>2 =Transmit-</p> <p>3 =Receive+</p> <p>4 =</p> <p>5 =</p> <p>6 = Receive-</p> <p>7 =</p> <p>8=</p> <p>DIP switch for termination resistors of the RS-485 interface 1</p> <p>4 = RS-485 interface 1 “-“ connection</p> <p>3 = RS-485 interface 1 “+“ connection</p> <p>2 = RS-485 interface 1 ground terminal</p> <p>1 = RS-485 interface 1 cable shield connection</p>
<p>G = RS-485+LC (slot 9)</p>	<p>Ethernet COM 3 (RS-485 interface 1)</p>	<p>Light 100 Mbps RS-485</p>		<p>LC connector from top:</p> <p>1 = Receive</p> <p>2 = Transmit</p> <p>DIP switch for termination resistors of the RS-485 interface 1</p> <p>4 = RS-485 interface 1 “-“ connection</p> <p>3 = RS-485 interface 1 “+“ connection</p> <p>2 = RS-485 interface 1 ground terminal</p> <p>1= RS-485 interface 1 cable shield connection</p>

Type	Communication ports	Signal levels	Connectors	Pin usage
N = 2EthRJ (slot 9)	100 Mbps Ethernet interface with IEC 61850	Ethernet 100 Mbps	2 x RJ-45 	1=Transmit+ 2=Transmit- 3=Receive+ 4= 5= 6=Receive- 7= 8=
O = 2EthLC (slot 9)	100 Mbps Ethernet fibre interface with IEC 61850	Light 100 Mbps	2 x LC 	LC-connector from top: -Port 2 Rx -Port 2 Tx -Port 1 Rx -Port 1 Tx

NOTE: When a communication option module of type B, C, D, E, F or G are used in slot 9, serial ports COM 3 / COM 4 are available.

RS-485 connections

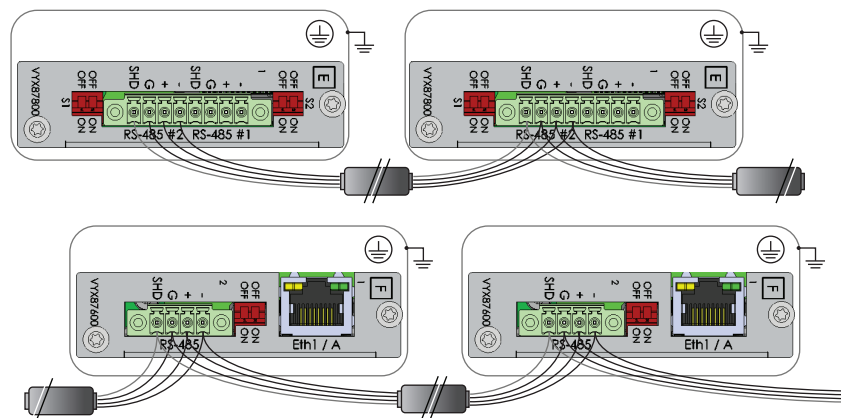Figure 229 - All shields connected through and grounded at one end



DIP switches

Figure 230 - DIP switches in optic fibre options



Table 149 - DIP switches in optic fibre options

DIP switch number	Switch position	Function Fibre optics
1	Left	Echo off
1	Right	Echo on
2	Left	Light on in idle state
2	Right	Light off in idle state
3	Left	Not applicable
3	Right	Not applicable
4	Left	Not applicable
4	Right	Not applicable

10.5.5.1 COM 1 port

The COM 1 port is for serial communication protocols. The type of the physical interface on this port depends on the type of the selected communication option module. The use of some protocols may require a certain type of option module. The parameters for this port are set via the front panel or with Easergy Pro in the **COM 1** setting view.

Table 150 - COM 1 port

Type	External module	Order code	Cable	Typically used protocols
RS-232 (slot 6)	VPA3CG	VPA3CG	VX068	None Profibus DP

10.5.5.2 COM 3 – COM 4 ports

COM 3 and COM 4 are ports for serial communication protocols. The type of the physical interface on these ports depends on the type of the selected communication option module. The use of some protocols may require a certain type of option module. The parameters for these ports are set via the front panel or with Easergy Pro in the **COM 3 PORT – COM 4 PORT** setting views.

Communication information is normally sent to the control system (SCADA), but it is also possible to use certain communication-related notifications internally, for example alarms. This is can be done for example via the logic and different matrices.

Figure 231 - Communication-related notifications can be connected to trip contacts in the Output matrix setting view

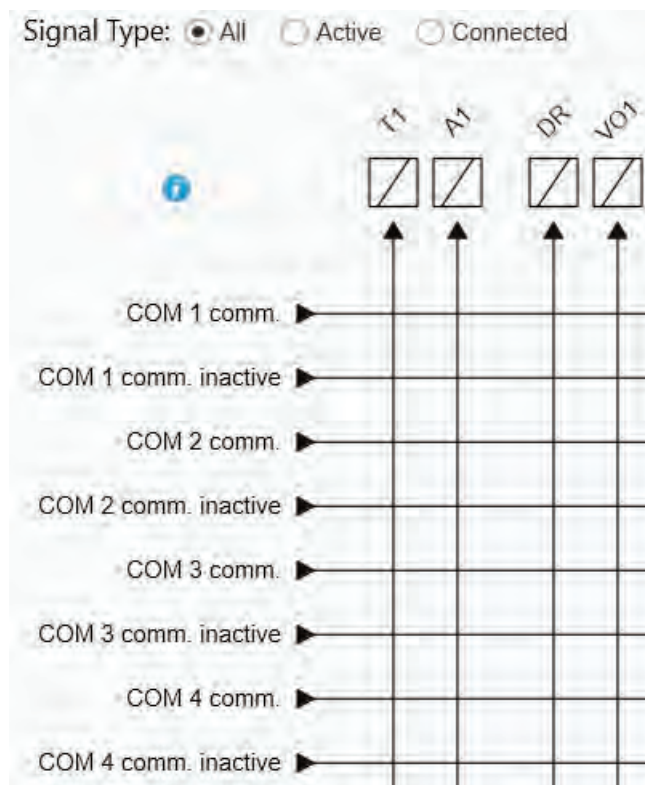




Table 151 - COM 3 port

Type	External module	Order code	Cable / order code	Typically used protocols
232+00 or 232+Eth RJ or 232+Eth LC (Slot 9)	None	None	None	- None - IEC-101 - IRIG-B - GetSet
	VIO12-AB and VSE-002	VIO 12 AB - VSE002	None	- None - ExternalIO
	VIO12-AC and VSE-002	VIO 12 AC - VSE002	None	- None - ExternalIO

Type	External module	Order code	Cable / order code	Typically used protocols
	VIO12-AD and VSE-002	VIO 12 AD - VSE002	None	- None - ExternalIO
	VSE-001	VSE001	None	- None - IEC-103 - ModbusSlv - SpaBus
	VSE-002	VSE002	None	- None - IEC-103 - ModbusSlv - SpaBus - DNP3
	VPA-3CG	VPA3CG	VX072	- None - ProfibusDP


Table 152 - COM 4 port

Type	External module	Order code	Cable / order code	Typically used protocols
232+00 or 232+Eth RJ or 232+Eth LC +VX067 (Split cable) (Slot 9)	None	None	None	- None - IEC-101 - IRIG-B - GetSet
	VIO12-AB and VSE-002	VIO 12 AB - VSE002	None	- None - ExternalIO
	VIO12-AC and VSE-002	VIO 12 AC - VSE002	None	- None - ExternalIO
	VIO12-AD and VSE-002	VIO 12 AD - VSE002	None	- None - ExternalIO

Type	External module	Order code	Cable / order code	Typically used protocols
	VSE-001	VSE001	None	- None - IEC-103 - ModbusSlv - SpaBus
	VSE-002	VSE002	None	- None - IEC-103 - ModbusSlv - SpaBus - DNP3

To be able to use COM 3 and COM 4 ports, the RS-232 communication interface (option B, C or D) has to be split in two by using a VX067 cable.

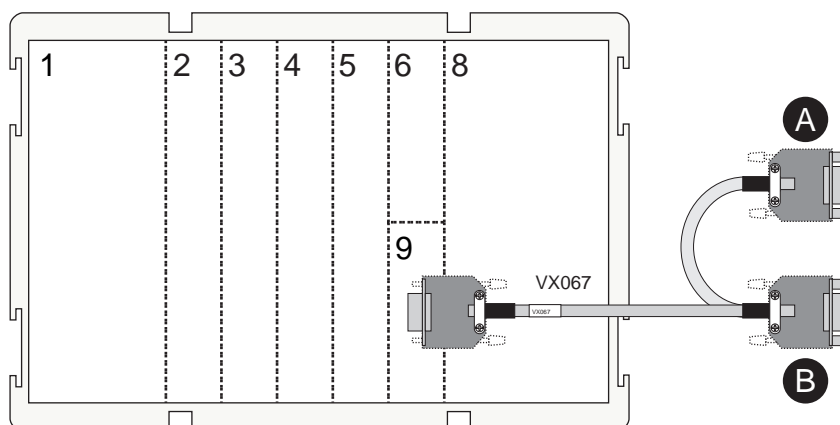Figure 232 - VX067 cable on the D-connector of slot 9 option card



A. COM 3 port B. COM 4 port

NOTE: It is possible to use two serial communication protocols simultaneously, but the restriction is that the same protocol can be used only once.

Use a VX086 cable to interface simultaneously with two protocols and IRIG-B.

The **Communication > Protocol configuration** setting view contains the selection for the protocol, port settings and message/error/timeout counters. Only serial communication protocols are valid with the RS-232 interface.

Figure 233 - Protocol configuration setting view

COM 1 PORT

Enable communication port ↻

COM 1 port protocol ↻

-- 9600/8N1

Message counter Clear

Error counter Clear

Timeout counter Clear

COM 2 PORT

Enable communication port ↻

COM 2 port protocol ↻

-- 9600/8N1

Message counter Clear

Error counter Clear

Timeout counter Clear

Table 153 - Parameters

Parameter	Value	Unit	Description	Note
Protocol			Protocol selection for COM port	Set
	None		-	
	SPA-bus		SPA-bus (slave)	
	ProfibusDP		Interface to Profibus DB module VPA 3CG (slave)	
	ModbusSlv		Modbus RTU slave	
	IEC-103		IEC-60870-5-103 (slave)	
	ExternalIO		Modbus RTU master for external I/O-modules	
	IEC 101		IEC-608670-5-101	
	DNP3		DNP 3.0	

Parameter	Value	Unit	Description	Note
	GetSet		Communication protocols for interface	
Msg#	$0-2^{32} - 1$		Message counter since the relay has restarted or since last clearing	Clr
Errors	$0-2^{16} - 1$		Protocol interruption since the relay has restarted or since last clearing	Clr
Tout	$0-2^{16} - 1$		Timeout interruption since the relay has restarted or since last clearing	Clr
	speed/DPS		Display of current communication parameters. speed = bit/s D = number of data bits P = parity: none, even, odd S = number of stop bits	1.

Set = An editable parameter (password needed). Clr = Clearing to zero is possible.

1. The communication parameters are set in the protocol-specific menus. For the local port command line interface, the parameters are set in the configuration menu.

10.5.6 Local port

The relay has a USB port in the front panel.

Protocol for the USB port

The front panel USB type B port is always using the command line protocol for Easergy Pro.

The speed of the interface is defined in the CONF/DEVICE SETUP menu via the front panel. The default settings for the relay are 38400/8N1.

It is possible to change the front USB port's bit rate. This setting is visible only on the relay's local display. The bit rate can be set between 1200 and 187500. This changes the bit rate of the relay, and the Easergy Pro bit rate has to be set separately. If the bit rate in the setting tool is incorrect, it takes a longer time to establish the communication.

NOTE: Use the same bit rate in the relay and the Easergy Pro setting tool.

10.5.7 Connection data

Table 154 - Auxiliary power supply

U _{AUX}	110 (-20%) – 240 (+10%) V ac/dc 110/120/220/240 V ac 110/125/220 V dc or 24–48 ±20% V dc 24/48 V dc
Power consumption - Normal state ⁹³⁾ - All digital outputs activated - All digital outputs activated and two (2) external communication devices powered	< 20 W < 28 W < 35 W
Terminal block: - MSTB 2.5–5.08	Wire cross section: Maximum 2.5 mm ² (13–14 AWG) Minimum 1.5 mm ² (15–16 AWG) Wire type: single strand or stranded with insulated crimp terminal

⁹³⁾ Power on, communications, measurements, display, LED's and SF output active.

Table 155 - Digital inputs technical data

Number of inputs	As per the order code
Voltage withstand	255 V ac/dc

(as per the order code letters) Nominal operation voltage for DI inputs	A: 24–230 V ac/dc (max. 255 V ac/dc) B: 110–230 V ac/dc (max. 255 V ac/dc) C: 220–230 V ac/dc (max. 255 V ac/dc)
Typical switching threshold (as per order code letters)	A: 12 V dc B: 75 V dc C: 155 V dc NOTE: For trip circuit supervision with two digital inputs, select a lower switching threshold (24 V or 110 V).
Current drain	< 4 mA (typical approx. 3mA)
Cycle time	10 ms
Activation time dc/ac	< 11 ms / < 15 ms
Reset time dc/ac	< 11 ms / < 15 ms
Terminal block: - MSTB2.5–5.08	Wire cross section: Maximum 2.5 mm ² (13–14 AWG) Minimum 1.5 mm ² (15–16 AWG) Wire type: single strand or stranded with insulated crimp terminal

NOTE: Set the dc/ac mode according to the used voltage in Easergy Pro.

Table 156 - Trip contact, high break

Number of contacts	5 normal open contacts
Rated voltage	250 V ac/dc
Continuous carry	5 A
Minimum making current	100 mA @ 24 Vdc
Make and carry, 0.5 s at duty cycle 10%	30 A
Make and carry, 3 s at duty cycle 10%	15 A
Breaking capacity, AC	2 000 VA
Breaking capacity, DC (L/R = 40 ms)	
at 48 V dc:	5 A
at 110 V dc:	3 A
at 220 V dc	1 A

Contact material	AgNi 90/10
Terminal block: - MSTB2.5–5.08	Wire cross section: Maximum 2.5 mm ² (13–14 AWG) Minimum 1.5 mm ² (15–16 AWG) Wire type: single strand or stranded with insulated crimp terminal

NOTE: High-break trip contacts exist in power module C and D only.

Table 157 - Trip contact, Tx

Number of contacts	As per the order code
Rated voltage	250 V ac/dc
Continuous carry	5 A
Minimum making current	100 mA at 24 Vdc
Make and carry, 0.5 s	30 A
Make and carry, 3 s	15 A
Breaking capacity, ac	2 000 VA
Breaking capacity, dc (L/R = 40 ms)	
at 48 V dc:	1.15 A
at 110 V dc:	0.5 A
at 220 V dc:	0.25 A
Contact material	AgNi 90/10
Terminal block: - MSTB2.5 - 5.08	Wire cross section: Maximum 2.5 mm ² (13–14 AWG) Minimum 1.5 mm ² (15–16 AWG) Wire type: single strand or stranded with insulated crimp terminal

Table 158 - Signal contact, A1 and SF

Number of contacts:	1
Rated voltage	250 V ac/dc
Continuous carry	5 A
Minimum making current	100 mA at 24 V ac/dc

Make and carry, 0.5 s	30 A
Make and carry, 3 s	15 A
Breaking capacity, ac	2 000 VA
Breaking capacity, dc (L/R = 40 ms)	
at 48 V dc:	1 A
at 110 V dc:	0.3 A
at 220 V dc:	0.15 A
Contact material	AgNi 0.15
Terminal block - MSTB2.5–5.08	Wire cross section Maximum 2.5 mm ² (13–14 AWG) Minimum 1.5 mm ² (15–16 AWG) Wire type: single strand or stranded with insulated crimp terminal

Table 159 - Solid-state outputs, HSO

Number of contacts	As per order code
Rated voltage	250 V ac/dc
Continuous carry	5 A
Maximum making current	-
Make and carry, 0.5 s	30 A
Make and carry, 3 s	15 A
Typical operate time (applies only to arc output matrix controlled outputs)	2 ms
Breaking capacity, DC (L/R = 40 ms)	
at 48 V dc	5 A
at 110 V dc	3 A
at 220 V dc	1 A
Solid state	IGBT
Terminal block • MSTB2.5–5.08	Wire dimension: Maximum 2.5 mm ² (13–14 AWG) Minimum 1.5 mm ² (15–16 AWG)

Table 160 - Local serial communication port

Number of ports	1 on front
Electrical connection	USB

Data transfer rate	200 – 187 500 b/s
Protocols	GetSet

Table 161 - COM 3-4 serial communication port

Number of physical ports	0–1 on rear panel (option)
Electrical connection	RS-232 (option, IRIG-B included) RS-485 (option) Profibus (option, external module) Glass fibre connection (option, external module)
Protocols	Modbus RTU, master Modbus RTU, slave Spabus, slave IEC 60870-5-103 IEC 61870-5-101 Profibus DP DNP 3.0 IRIG-B

Table 162 - Ethernet communication port

Number of ports	0–2 on rear panel (option)
Electrical connection	RJ-45 100 Mbps (option) LC 100Mbps (option)
Protocols	IEC 61850 Modbus TCP DNP 3.0 Ethernet/IP IEC 61870-5-101

Table 163 - Fiber Ethernet communication port

Number of ports	0 or 2 on rear panel (option)
Connection type	LC 100 Mbps

Optical characteristics	<p>Operates with 62.5/125 μm and 50/125 μm multimode fiber</p> <p>Center Wavelength: 1300 nm typical</p> <p>Output Optical Power:</p> <ul style="list-style-type: none"> • Fiber: 62.5/125 μm, NA = 0.275 23.0 dBm • Fiber: 50/125 μm, NA = 0.20 26.0 dBm <p>Input Optical Power: -31 dBm</p>
Protocols	<p>IEC 61850</p> <p>Modbus TCP</p> <p>DNP 3.0</p> <p>Ethernet/IP</p> <p>IEC 61870-5-101</p>

Table 164 - BIO inputs/outputs, slot 2 option B

Rated output voltage	+30 V dc
Rated input voltage	+18–265 V dc
Rated current (BO)	20 mA
Rated current (BI)	5 mA
BI line (IN)	3 pcs
BO lines (OUT)	3 pcs
Connection cable	<p>Twisted pair with shield. Shield shall be grounded at both ends.</p> <p>Maximum distance: 500 m (at 20 mA load)</p> <p>Cable cross-section 0.5 mm²</p>

Table 165 - BIO inputs/outputs, slot 2 option C

Connector	ST
Fibre	50/125 μm , 62.5/125 μm , 100/140 μm , and 200 μm
Max link distance	2 km (62.5/125 μm)
Max link attenuation	7 db
BI line (IN)	2 pcs
BO lines (OUT)	2 pcs

Table 166 - Arc sensor inputs

Number of inputs	As per the order code
Supply to sensor	Isolated 12 V dc

Table 167 - Measuring circuits – standard CT/VT inputs

Phase current inputs I' (5/1 A)	Slot 4: $T = 3 \times I (5/1A) + I_0 (5/1A)$	
Rated phase current	5 A	1 A
- Current measuring range	0.05–250 A	0.02–50 A
- Thermal withstand	<ul style="list-style-type: none"> • 20 A (continuously) • 100 A (10 s) • 500 A (1 s) • 1250 A (10 ms) 	<ul style="list-style-type: none"> • 4 A (continuously) • 20 A (10 s) • 100 A (1 s) • 250 A (10 ms)
- Burden	0.075 VA	0.02 VA
- Impedance	0.003 Ohm	0.02 Ohm
I_0 input (5A and 1A)		
Rated earth fault overcurrent	5 A	1 A
- Current measuring range	0.05–250 A	0.02–50 A
- Thermal withstand	<ul style="list-style-type: none"> • 20 A (continuously) • 100 A (10 s) • 500 A (1 s) 	<ul style="list-style-type: none"> • 4 A (continuously) • 20 A (10 s) • 100 A (1 s)
- Burden	0.075 VA	0.02 VA
- Impedance	0.003 Ohm	0.02 Ohm
Phase current inputs I (1 A, 5 A)	Slot 8: $E = 3L (5A) + 4U + 2I_0 (5/1A+1/0.2A)$	$F = 3L (1 A) + 4U + 2I_0 (5/1A+1/0.2A)$
Rated phase current	5 A	1 A
- Current measuring range	0.05–250 A	0.02–50 A
- Thermal withstand	<ul style="list-style-type: none"> • 20 A (continuously) • 100 A (10 s) • 500 A (1 s) • 1250 A (10 ms) 	<ul style="list-style-type: none"> • 4 A (continuously) • 20 A (10 s) • 100 A (1 s) • 250 A (10 ms)
- Burden	0.075 VA	0.02 VA
- Impedance	0.003 Ohm	0.02 Ohm
I_0 input (5 A)	Slot 8: $E = 3L (5/1A) + 4U + 2I_0 (5/1A+1/0.2A)$	
Rated earth fault overcurrent	5 A	

- Current measuring range	0.015–50 A
- Thermal withstand	<ul style="list-style-type: none"> • 20 A (continuously) • 100 A (10 s) • 500 A (1 s)
- Burden	0.075 VA
- Impedance	0.003 Ohm
I₀ input (1 A)	Slot 8: E = 3L (5/1A) + 4U + 2I₀ (5/1A+1/0.2A)
Rated earth fault overcurrent	1 A (configurable for CT secondaries 0.1–10.0 A)
- Current measuring range	0.003–10 A
- Thermal withstand	<ul style="list-style-type: none"> • 4 A (continuously) • 20 A (10 s) • 100 A (1 s)
- Burden	0.02 VA
- Impedance	0.02 Ohm
I₀ input (0.2 A)	Slot 8: E = 3L (5/1A) + 4U + 2I₀ (5/1A+1/0.2A)
Rated earth fault overcurrent	0.2 A (configurable for CT secondaries 0.1 – 10.0 A)
- Current measuring range	0.0006–2 A
- Thermal withstand	<ul style="list-style-type: none"> • 0.8 A (continuously) • 4 A (10 s) • 20 A (1 s)
- Burden	0.02 VA
- Impedance	0.02 Ohm
I₀₂ CHS (2/20A) (CSH available only in P3M30)	Slot 8: N = 3L (5/1A) + I₀₁ (5/1A) + I₀₂ CSH (2/20A) + 4U O = 3L (1A) + I₀₁ (5/1A) + I₀₂ CSH (2/20A) + 4U P = 3LPCT + I₀₁ (5/1A) + I₀₂ CSH (2/20A) + 4LPVT 5 = 3L(5/1A) + I₀₁ (5A) + I₀₂ CSH (2/20A) RL + 4U 6 = 3L(1A) + I₀₁ (5A) + I₀₂ CSH (2/20A) RL + 4U
Rated earth fault overcurrent	2 A and 20 A
Measurement range	0.02 – 42 x I _n
Accuracy	+/-2 % (from setting value) or 0.005 x I _n
Continuous thermal withstands	1.8 A rms
1 second thermal withstands	40 A rms
Insulation	300 V overvoltage cat 3

Voltage inputs	
Rated voltage U_N	100 V (configurable for VT secondaries 50–250 V)
- Voltage measuring range	0.5–190 V
- Thermal withstand	250 V (continuously) 600 V (10 s)
- Burden	<0.015 VA (110 V), <0.06 VA (250 V)
Frequency	
Rated frequency f_N	45–65 Hz (protection operates accurately)
Measuring range	16–95 Hz < 44Hz / > 66Hz (other protection is not steady except frequency protection)

Table 168 - Measuring circuits – LPCT inputs

Rated nominal current	10 A – 1 kA
Range	0.025–45 x I_N (protection nominal current)
Accuracy	$I \leq 1.5 \times I_N$: $\pm 0.5\%$ of value or ± 15 mA $I > 1.5 \times I_N$: $\pm 3\%$ of value
Rated secondary voltage	22.5 mV
Protection nominal current	10–1600 A
Dynamic	45 x I_N (protection nominal current)

Table 169 - Measuring circuits – LPVT inputs

Rated primary voltage	50–500 000 V
Rated secondary voltage	3.25 V
Network voltage	50–500 000 V

Table 170 - LPCT inputs

Nominal current	2.5 A to 20 kA
LPCT rated nominal current	25, 50, 80, 100 A
LPCT rated primary current	10 A to 5 kA
LPCT rated secondary current	22.5 mV
Current factor	0.25; 0.50; 1.00; 1.25; 1.33; 2.00; 2.50; 3.20; 4.00; 5.00; 6.30; 6.66; 10; 16; 20; 25; 31.5
Dynamic	45 x nominal current
Protection nominal current	51–1600 A

Input impedance	2 MOhms / 500 pF
Thermal withstand	60 V

Table 171 - LPVT inputs

Nominal voltage	50 V – 500 kV
LPVT rated primary voltage	50 V – 500 kV
LPVT rated secondary voltage	$3.25 \text{ V} / \sqrt{3}$
Voltage factor	0.25 to 1.5
Rated voltage	$3.25 \text{ V} / \sqrt{3}$
Extender rated voltage	10 MOhms / 15 pF
Input impedance	0.25 to 1.5 rated voltage
Thermal withstand	25 V

Analog interface cross section and tightening torque

Table 172 - Analog interface cross-section and tightening torque

Terminal characteristics			
	Current inputs		Voltage inputs
	Screw clamp	Ring lug	
Maximum wire cross-section, mm ² (AWG)	4 (10-12)	(12–22)	2.5 (13-14)
Maximum wiring screw tightening torque Nm (lb-in)	1.2 (10.6)	0.79 (7)	0.5-0.6 (4.4-5.3)
Maximum connector retention tightening torque Nm (lb-in)	-		0.3-0.4 (2.7-3.5)
Wire type	Single strand or stranded with insulated crimp terminal		
Ring lug width (mm) and screw size	-	8.0, M3.5	

10.5.8 External option modules

10.5.8.1 VSE-001 fiber-optic interface module

⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- This equipment must only be installed or serviced by qualified electrical personnel.
- Turn off all power supplying this device and the equipment in which it is installed before working on the device or equipment.
- Connect protective earth before turning on any power supplying this device.

Failure to follow these instructions will result in death or serious injury.

An external fiber-optic module VSE-001 is used to connect the device to a fiber-optic loop or a fiber-optic star. There are four different types of serial fiber-optic modules:


- VSE001PP (Plastic-plastic)
- VSE001GG (Glass-glass)

The modules provide a serial communication link up to 1 km (0.62 miles) with VSE 001 GG. With a serial-fibre interface module, it is possible to have the following serial protocols in use:

- None
- IEC-103
- Modbus slave
- SpaBus

The power for the module is taken from pin 9 of the D-connector or from an external power supply interface.

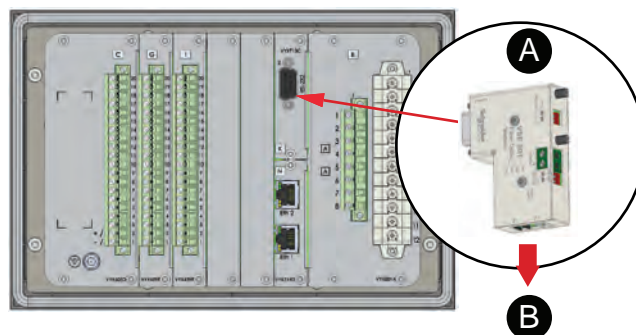Figure 234 - VSE-001 module



A. VSE-001 B. Communication bus

Module interface to the device

The physical interface of the VSE-001 is a 9-pin D-connector. The signal level is RS-232.

NOTE: The product manual for VSE-001 can be found on our website.

10.5.8.2 VSE-002 RS-485 interface module

⚡ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- This equipment must only be installed or serviced by qualified electrical personnel.
- Turn off all power supplying this device and the equipment in which it is installed before working on the device or equipment.
- Connect protective earth before turning on any power supplying this device.


Failure to follow these instructions will result in death or serious injury.

An external RS-485 module VSE-002 (VSE002) is used to connect Easergy P3 protection devices to RS-485 bus. With the RS-485 serial interface module, the following serial protocols can be used:

- None
- IEC-103
- ModbusSlv
- SpaBus

The power for the module is taken from pin 9 of the D-connector or from an external power supply interface.

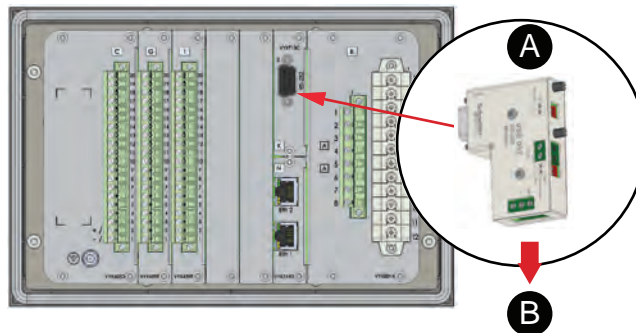Figure 235 - VSE-002 module



A. VSE-002 B. Communication bus

Module interface to the device

The physical interface of the VSE-002 is a 9-pin D-connector. The signal level is RS-232 and therefore, the interface type for the module has to be selected as **RS-232**.

It is possible to connect multiple devices in daisychain. "Termination" has to be selected as **on** for the last unit in the chain. The same applies when only one unit is used.

Figure 236 - RS-232 and TTL interface

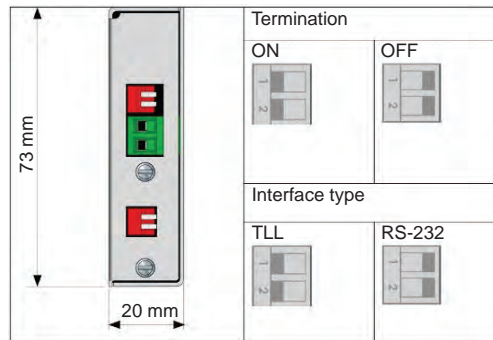


Table 173 - RS-232 and TTL interface

Pin number	TTL mode	RS-232 mode
1	-	-
2	RXD (in)	RXD (in)
3	TXD (out)	TXD (out)
4	RTS (in)	RTS (in)
5		
6		
7	GND	GND
8		
9	+8V (in)	+8V (in)

10.5.8.3 VPA-3CG Profibus interface module

⚡ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- This equipment must only be installed or serviced by qualified electrical personnel.
- Turn off all power supplying this device and the equipment in which it is installed before working on the device or equipment.
- Connect protective earth before turning on any power supplying this device.


Failure to follow these instructions will result in death or serious injury.

Easergy P3M30 and P3M32 can be connected to Profibus DP by using an external Profibus interface module VPA-3CG (VPA3CG). The device can then be monitored from the host system. VPA-3CG is attached to the RS-232 D-connector at the back of the device with a VX-072 (VX072) cable. With the Profibus interface module, the following protocols can be used:

- None
- ProfibusDP

The power for the module is taken from an external power supply interface.

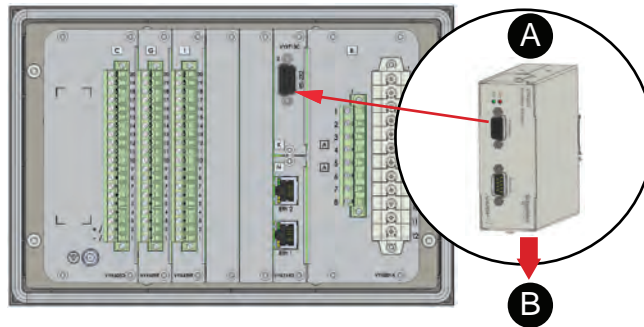Figure 237 - VPA-3CG module



A. VPA-3CG B. Communication bus

Module interface to the device

The physical interface of the VPA-3CG Profibus interface module is a 9-pin D-connector.

Profibus devices are connected in a bus structure. Up to 32 stations (master or slave) can be connected in one segment. The bus is terminated by an active bus terminator at the beginning and end of each segments. When more than 32 stations are used, repeaters (line amplifiers) must be used to connect the individual bus segments.

The maximum cable length depends on the transmission speed and cable type. The specified cable length can be increased by the use of repeaters. The use of more than 3 repeaters in a series is not recommended.

A separate product manual for VPA-3CG can be found on our website.

10.5.8.4 VIO 12A RTD and analog input / output modules

VIO 12A I/O modules can be connected to Easergy P3M30 and P3M32 using VSE 001 or VSE 002 interface modules.


VIO 12A I/O modules can be connected to Easergy P3U20 and P3U30 using RS-485 connection in interface modules. Alternatively VIO 12A I/O modules can be connected to Easergy P3U20 and P3U30 using RS-232 connection. If RS-232 connection is used a separate VX082 or VX083 connection cable and VSE001 or VSE002 option module are needed.

A separate product manual for VIO 12A is available.

10.5.9 Block diagrams

The status of the output contacts is shown when the relay is energized but none of the protection, controlling or self-supervision elements are activated.

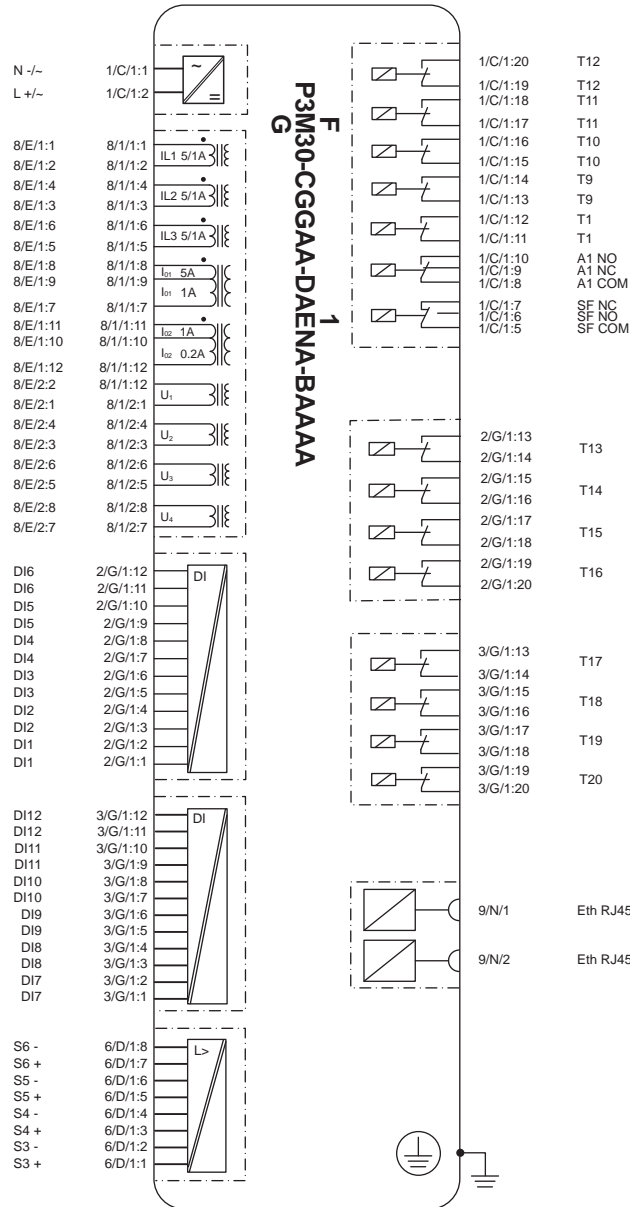Figure 238 - Typical block diagram for P3F30, P3M30 and P3G30 relays




⚠ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

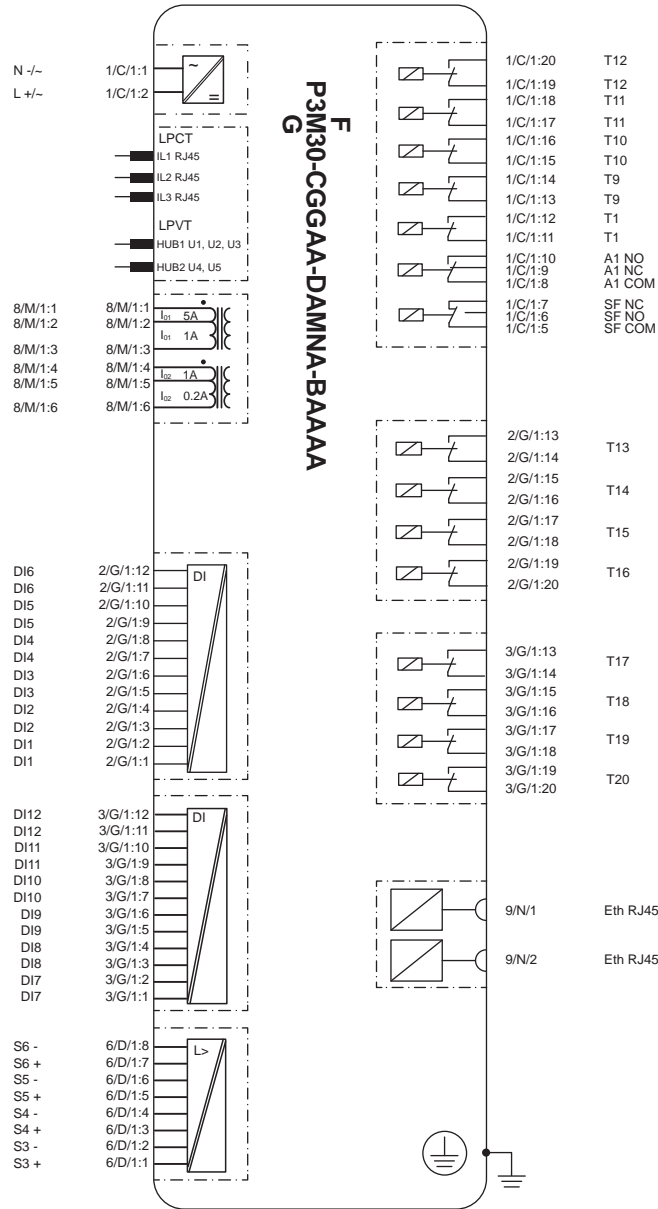Figure 239 - P3F30 and P3M30 block diagram – LPIT




⚠️ ⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

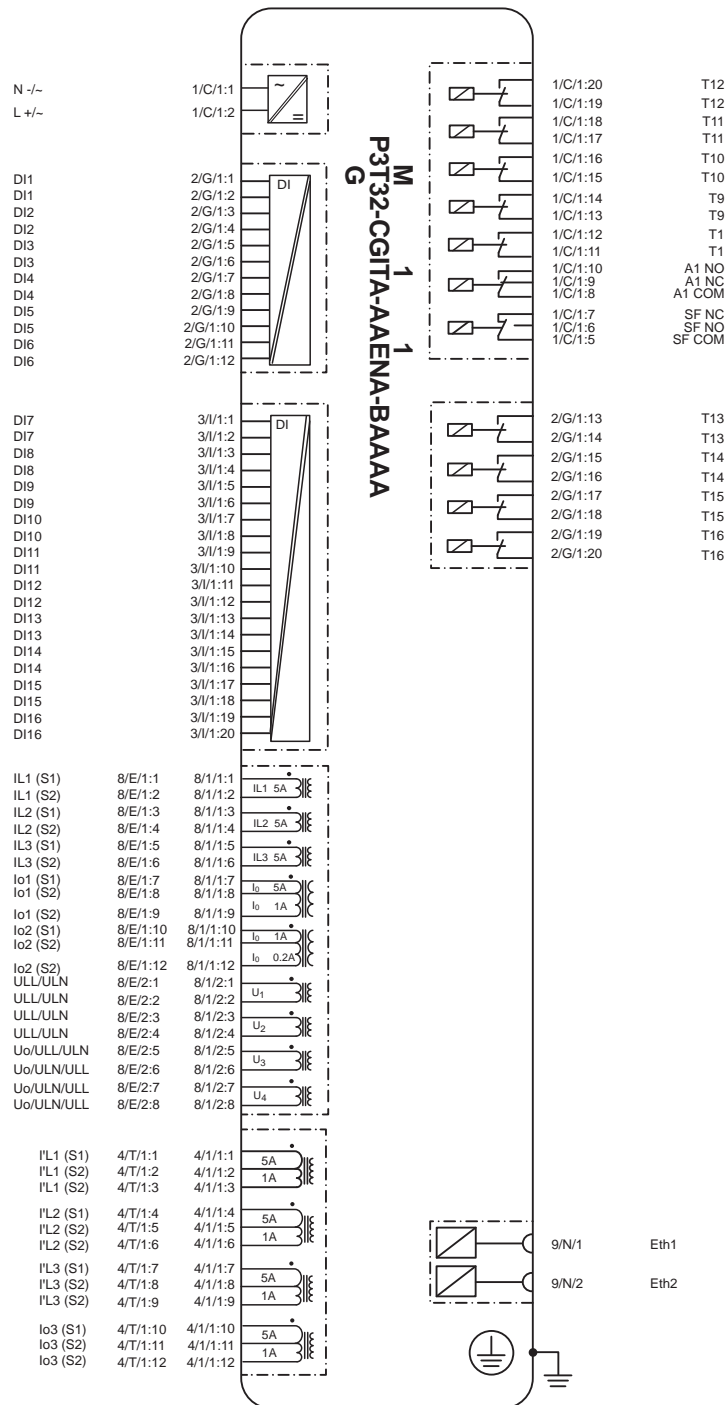Figure 240 - Typical block diagram for P3M32, P3T32 and P3G32 relays



⚠️ DANGER


HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

10.5.10 Connection examples

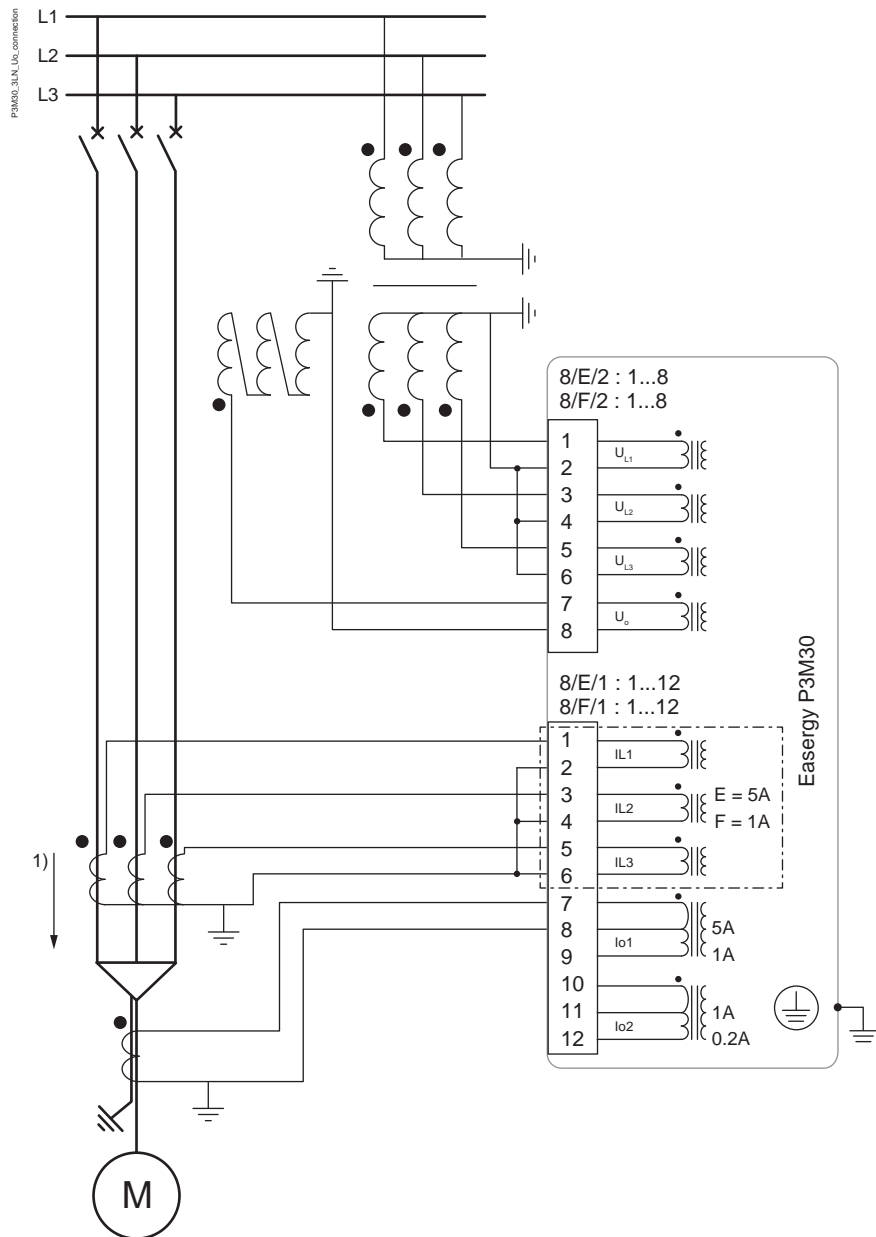Figure 241 - P3M30 connection for motor protection



1) Positive current and exported energy direction


⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

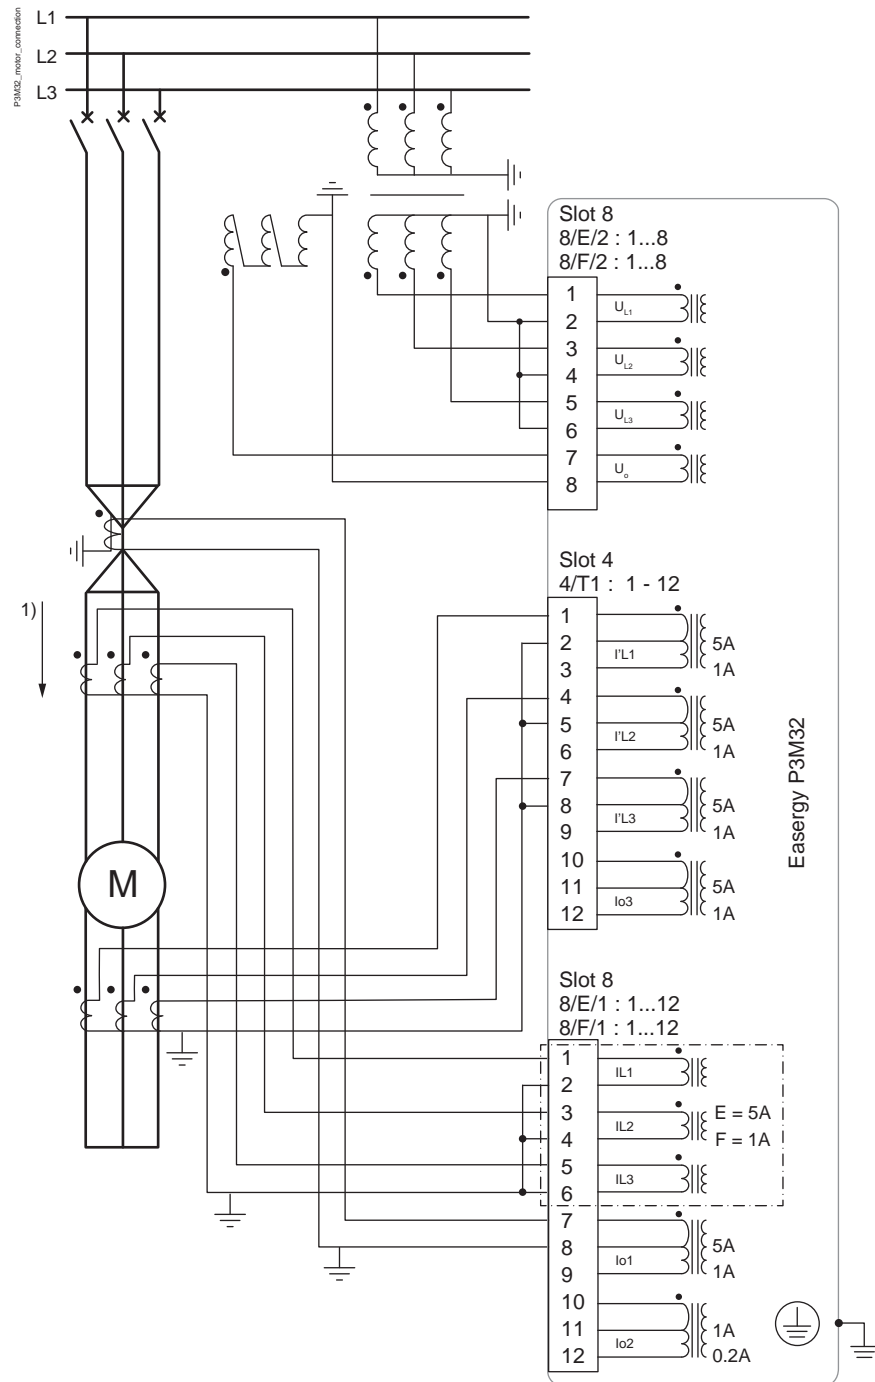Figure 242 - P3M32 connection for motor differential application



1) Positive current and exported energy direction

⚡ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.


Failure to follow this instruction will result in death or serious injury.

Three-phase current measurement – LPCT

Applications and limitations:

- all types of three-phase networks
- all current-based protection functions available
- earth fault overcurrent can be calculated by the relay

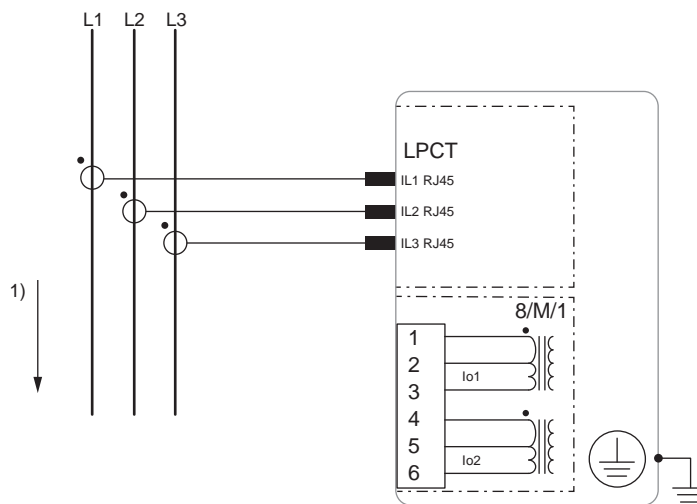Figure 243 - Three-phase current measurement – LPCT



1) Positive CT current flow

⚡ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH


- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

Three line-to-neutral LPVTs

NOTE: If one or two LPVTs are connected to the LPVT hub connector, a termination accessory delivered with the protection device needs to be plugged on the second and third input.

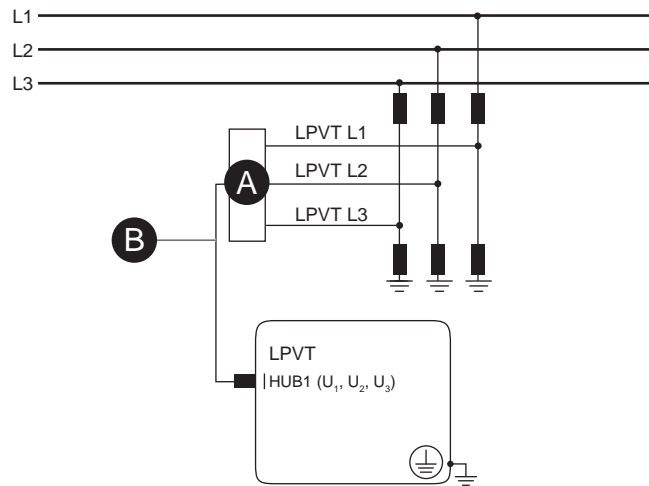Figure 244 - Three line-to-neutral LPVTs



A. LPVT hub connector (EMS59573)

B. Cable < 10 m


⚡ ⚡ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

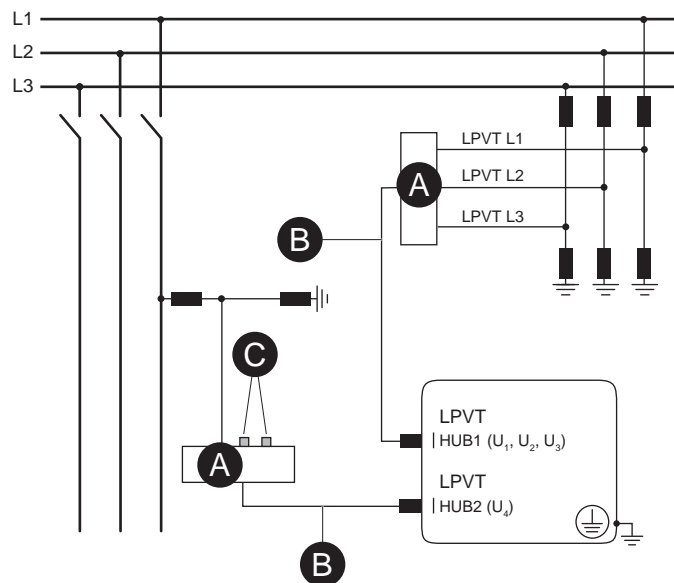Figure 245 - Three line-to-neutral LPVTs + one line-to-neutral LPVT



A. LPVT hub connector (EMS59573)

C. Termination accessories

B. Cable < 10 m

⚡⚠ DANGER**HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH**

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

10.5.11 Low-power instrument transformers

Protection devices need current and voltage data from the equipment to be protected. For technical, economic and safety reasons, this data cannot be obtained directly from the equipment's medium-voltage (MV) power supply. For this purpose, low-power instrument transformers (LPITs) can be used. LPITs:

- reduce the size of value to be measured
- provide galvanic separation
- supply the power needed to process the data or even for the protection device to work

There are two types of LPITs:

- low-power current transformers (LPCTs) that are connected on the MV network primary circuit and supply a reduced current value to the secondary circuit, proportional to the network current on which they are installed.
- low-power voltage transformers (LPVTs) that are connected to the MV network primary and supply the secondary circuit with a reduced voltage value, proportional to the network voltage on which they are installed.


Using LPITs has many benefits compared to using traditional CTs or VTs:

- improved personal safety during testing and operation
- one LPCT replaces the dedicated measurement CTs and protection CTs
- the LPCT primary rating is no longer to be as close as possible to the nominal current
- time and money savings during project planning and execution
- reduced environmental impact because of reduced instrument transformer size

LPITs compliant with the standards IEC 60044 and IEC 61869 can be connected to the LPIT inputs of Easergy P3 devices.

10.5.11.1 Low-power instrument transformer measurement card M and P (slot 8)

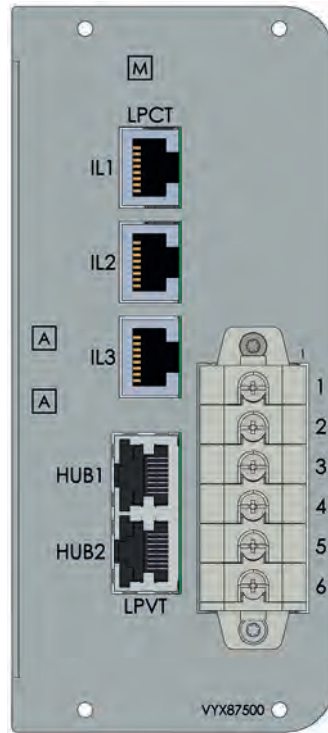Figure 246 - LPIT measurement card M / P (P only for P3x30 models)



$$M = 3 \text{ LPCT} + 2 I_0 (5/1 \text{ A} + 1/0.2 \text{ A}) + 4 \text{ LPVT} \quad P = 3 \text{ LPCT} + I_{01} (5/1 \text{ A}) + I_{02} \text{ CSH} (2/20 \text{ A}) + 4 \text{ LPVT}$$

NOTE: If the LPCT sensor is disconnected, the current becomes zero, and an alarm is raised in diagnosis log.


Table 174 - Terminal pins for cards M and P (P only for P3x30 models)

Connector / Pin no.	Symbol	Description	Card P (only for P3x30 models)
I _{L1}	I _{L1}	LPCT sensor L1	
I _{L2}	I _{L2}	LPCT sensor L2	
I _{L3}	I _{L3}	LPCT sensor L3	
HUB1	U _{LL} /U _{LN}	Interface for LPVT HUB1 for connecting VLVT sensors U1–U3	
HUB2	U ₀ /U _{LL} /U _{LN}	Interface for LPVT HUB2 for connecting VLVT sensors U4	
1	I ₀₁ (S1)	Earth fault overcurrent I01 (S1) common for 5 A and 1 A	

Connector / Pin no.	Symbol	Description	Card P (only for P3x30 models)
2	I_{01} (S2)	Earth fault overcurrent I01 5 A (S2)	
3	I_{01} (S2)	Earth fault overcurrent I01 1 A (S2)	
4	I_{02} (S1)	Earth fault overcurrent I02 (S1) common for 1 A and 0.2 A	CSH 2/20 A
5	I_{02} (S2)	Earth fault overcurrent I02 1 A (S2)	CSH 20 A
6	I_{02} (S2)	Earth fault overcurrent I02 0.2 A (S2)	CSH 2 A

The Easergy P3 protection devices with the LPCT option are delivered with 2 pieces of termination accessories, to be used with the LPVT hub for voltage measurements.

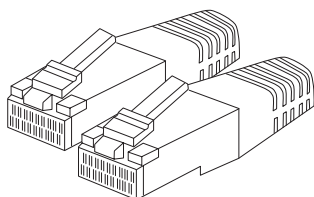Figure 247 - LPCT termination accessories



10.5.12 Voltage adapter

The voltage transformer adapter (EMS59572) is made with 4-resistor bridges used to interface conventional voltage transformers (VTs) with the Easergy P3 protection devices equipped for LPCT/LPVT sensors (order the sensors separately from Schneider Electric).

Connections


NOTICE

INCORRECT VOLTAGE MEASUREMENT

- The earth of the connection diagrams below must be the same of the whole Easergy P3 protection device. The 0 V of the Easergy P3 power supply input must be connected to this earth.
- The AC voltage adapter's earth connection point must be connected to the VT sensor's (LV transformer) isolated ground. For other wiring cases, consult Schneider Electric.


Failure to follow these instructions can result in measurement error.

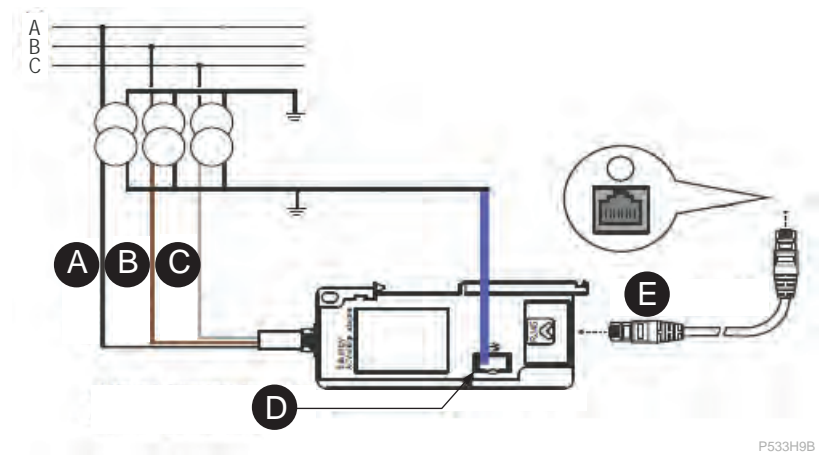Figure 248 - 3 phase-to-neutral voltages connection




- A. Black D. Earth connection point of voltage adapter
- B. Brown E. RJ45 cable
- C. Grey

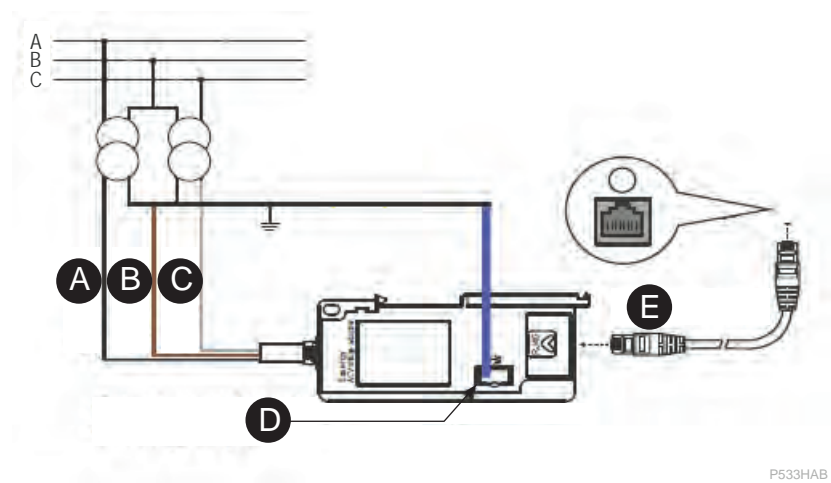Figure 249 - 2 line-to-line voltages connection



- A. Black D. Earth connection point of voltage adapter
- B. Brown E. RJ45 cable
- C. Grey

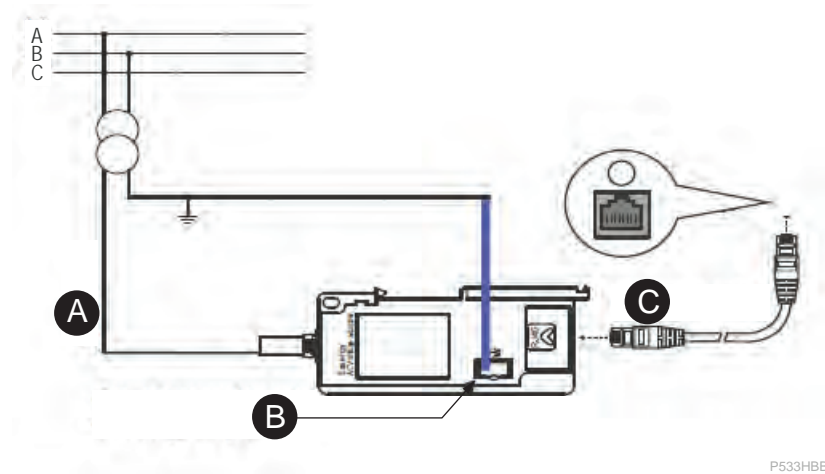
Figure 250 - 1 additional line-to-line voltage connection



P533HBB

- A. Black
- B. Earth connection point of voltage adapter
- C. RJ45 cable

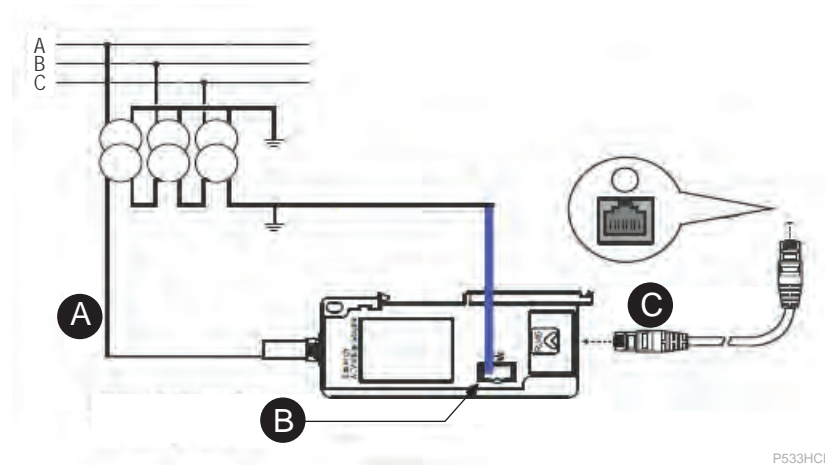
Figure 251 - Open-delta connection 1



P533HCB

- A. Black
- B. Earth connection point of voltage adapter
- C. RJ45 cable

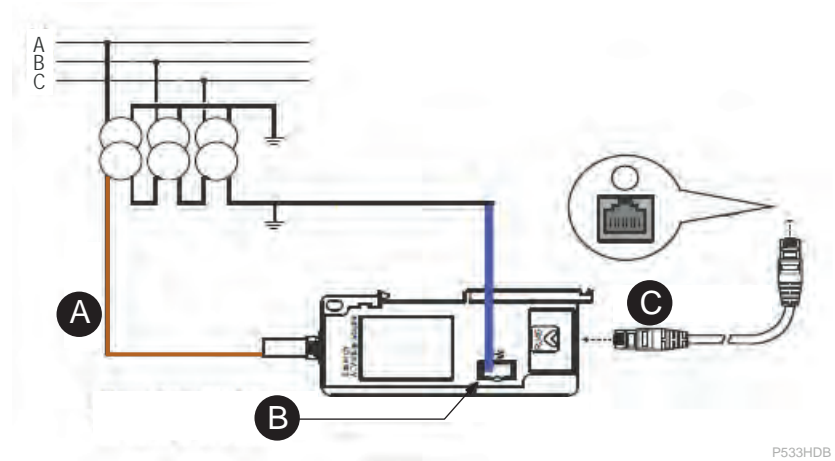Figure 252 - Open-delta connection 2



- A. Brown
- B. Earth connection point of voltage adapter
- C. RJ45 cable


The Ethernet RJ45 cable is connected to the Easergy P3 protection device. The cable length is maximum 4 m (13.12 ft).

- CCA770 - 0.6 m (1.97 ft) (reference: 59660)
- CCA772 - 2 m (6.56 ft) (reference: 59961)
- CCA774 - 4 m (13.12 ft) (reference 59962)

NOTE: The voltage adapter is delivered with black, brown, grey and light blue cables. The light blue cable in the voltage transformer adapter input is not used.

Dimensions

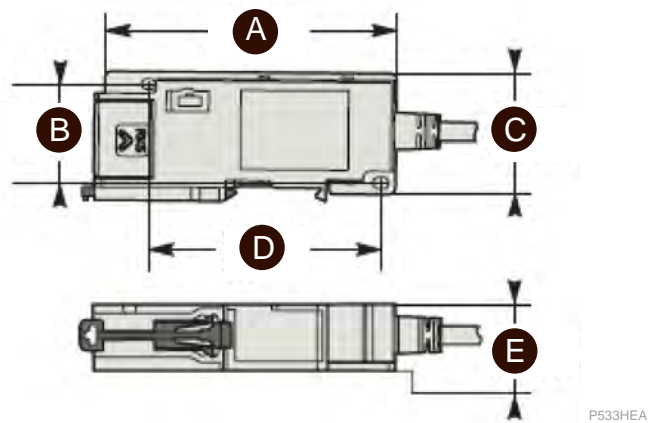Figure 253 - Voltage adapter dimensions




- A. 120 mm (4.72 in)
- B. 38 mm (1.49 in)
- C. 52 mm (2.04 in)
- D. 90 mm (3.54 in)
- E. 25 mm (0.98 in)

10.5.12.1 Mounting the voltage adapter

There are three ways to mount the voltage adapter:


- DIN rail mounting
- Fastening with collar
- Mounting on Telequick grid

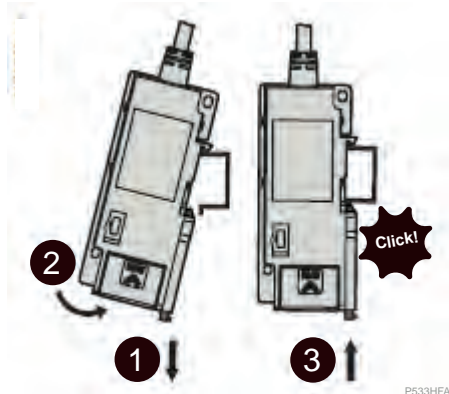Figure 254 - Mounting on DIN rail




Mount the adapter by its fixture structure on rail.

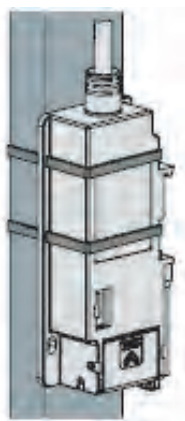Figure 255 - Fastening with collar



Mount the adapter using two fastening collars (width: 4 mm/0.16 in).

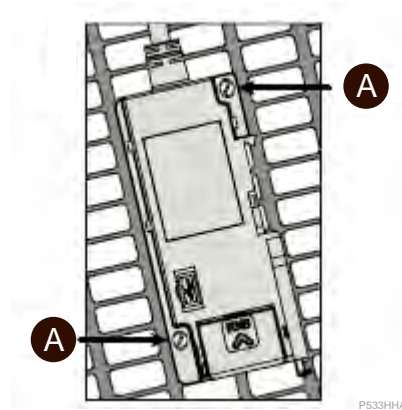Figure 256 - Mounting on Telequick grid



A. Screw

Mount the adapter on Telequick grid using two screws (4 mm/0.16 in).

10.5.12.2 RJ45 terminal locking

You can lock the voltage transformer adapter's RJ45 input in open or closed position by placing a seal in the hole marked with a lock symbol. This allows to lock the RJ45 connector of the Ethernet cable in its slot or helps to prevent its connection.

Figure 257 - Locked in closed position





Figure 258 - Locked in open position



10.5.12.3 Voltage adapter parameters

Table 175 - Voltage adapter characteristics

Parameter	Standard	Value
Input voltage		50 V AC to 200 V AC (line-to-line)
Voltage max.		600 V max. permanent
Network frequency		50/60 Hz
Ambient air temperature for operation	IEC 60068-2-1 IEC 60068-2-2	-40°C to 70°C (-40°F to 158°F)
Ambient air temperature for storage	IEC 60068-2-1 IEC 60068-2-2	-40°C to 85°C (-40°F to 185°F)
Humidity	IEC 60068-2-30	95% HR; 144 hours (6 cycles of 12 hours at 55°C (131°F) and another 12 hours at 25°C (77°F))
Salt spray	IEC 60068-2-11	168 hours
Vibration	IEC 60068-2-6	10 Hz to 2000 Hz; 10 cycles at 2g (peak value)
Bump	IEC 60068-2-29	20 g/16 ms/1000 bumps, module de-energized
Shock	IEC 60068-2-27	10 Gn; 11 ms; 3 pulses, module in operation
Earthquake	IEC 60255-21-3	Class 2 - module in operation: 3 to 35 Hz/15 mm/2g/1 cycle Horizontal axe 3 to 35 Hz/7 mm/1g/1 cycle Vertical axe
High voltage withstand (dielectric)	IEC 60255-27	2 kV for 1 minute
Impulse voltage distance	IEC 60255-27	1.2 μs, 50 μs, 5 kV, 0.5J
Robustness	IEC 62262	IK7, 2J
Degree of protection	IEC 60529	IP20, module body (without wires)
Weight		150 g (0.33 lb)
Mounting support		Symmetrical DIN rail

10.6 Arc flash detection system setup and testing

10.6.1 Setting up the arc flash system

⚠️⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Apply appropriate personal protective equipment (PPE) and follow safe electrical work practices. See NFPA 70E, NOM-029-STPS-2011, or CSA Z462.
- The arc fault detection system is not a substitute for proper PPE when working on or near equipment being monitored by the system.
- Information on this product is offered as a tool for conducting arc flash hazard analysis. It is intended for use only by qualified persons who are knowledgeable about power system studies, power distribution equipment, and equipment installation practices. It is not intended as a substitute for the engineering judgement and adequate review necessary for such activities.
- Only qualified personnel should install and service this equipment. Read this entire set of instructions and check the technical characteristics of the device before performing such work.
- Perform wiring according to national standards (NEC) and any requirements specified by the customer.
- Observe any separately marked notes and warnings.
- NEVER work alone.
- Before performing visual inspections, tests, or maintenance on this equipment, disconnect all sources of electric power. Assume all circuits are live until they are completely de-energized, tested, and tagged. Pay particular attention to the design of the power system. Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing relay to ensure that all power is off.
- The equipment must be grounded.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.
- Do not open the device. It contains no user-serviceable parts.
- Install all devices, doors and covers before turning on the power to this device.

Failure to follow these instructions will result in death or serious injury.

Before setting up the arc flash system:

- Mount and connect all components and sensors.
 - Make sure that you understand the customer application.
1. Identify the wiring connection of sensors to the device's connectors.
 2. Identify the wiring connection to breaking devices.
 3. Identify binary I/O wiring connections.
 4. Proceed with configuration in Easergy Pro with consideration of the customer application.
 5. Power up the device.

6. Reset the device by pushing the reset button.
7. Verify LED indication as described with consideration of the customer application.
8. If connecting two devices through MT in and MT out:

⚠ DANGER

HAZARD OF LOSS OF SIGNAL

The MT in and MT out connections are not monitored. You must to determine if external monitoring is required to detect broken or disconnected wires.


Failure to follow these instructions will result in death or serious injury.

- a. Verify the MT in MT out connections.
- b. Set the related dip switch configuration.
- c. Verify the LED indications.

10.6.2 Commissioning and testing

This section contains the commissioning testing instructions. The figure below shows the testing sequence.

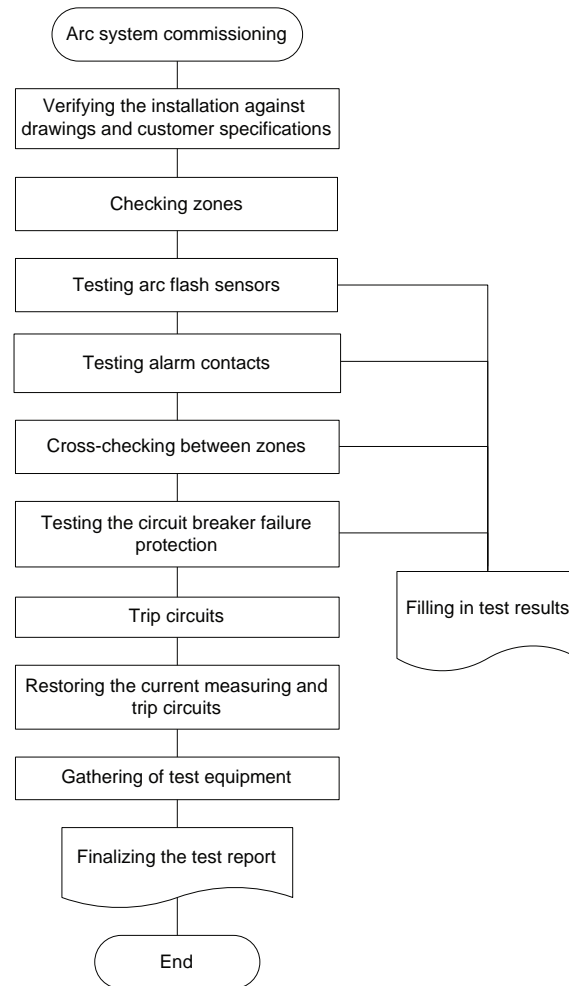Figure 259 - Testing sequence



10.6.2.1 Checking zones

1. Check the protected zones where sensors have been installed and compare them against the drawings.
2. Consult the customer if the configuration does not match with the drawings.

10.6.2.2 Disconnecting trip circuits

⚡⚡ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Removing trip wires may cause loss of protection. Review system drawings and diagrams before disconnecting trip circuits.

Failure to follow this instruction will result in death or serious injury.

- Disconnect the trip signals to the circuit breakers that may disturb other parts of the system during the test.

- Also disconnect trip signals routed to other parts of the system, such as the breaker failure (ANSI 50BF) backup trip to upstream breakers and the transfer trip signals.
- Test the disconnected trip signals with a multimeter.

10.6.2.3 Sensor testing

⚠️⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Apply appropriate personal protective equipment (PPE) and follow safe electrical work practices. See NFPA 70E, NOM-029-STPS-2011, or CSA Z462.
- The arc fault detection system is not a substitute for proper PPE when working on or near equipment being monitored by the system.
- Information on this product is offered as a tool for conducting arc flash hazard analysis. It is intended for use only by qualified persons who are knowledgeable about power system studies, power distribution equipment, and equipment installation practices. It is not intended as a substitute for the engineering judgement and adequate review necessary for such activities.
- Only qualified personnel should install and service this equipment. Read this entire set of instructions and check the technical characteristics of the device before performing such work.
- Perform wiring according to national standards (NEC) and any requirements specified by the customer.
- Observe any separately marked notes and warnings.
- NEVER work alone.
- Before performing visual inspections, tests, or maintenance on this equipment, disconnect all sources of electric power. Assume all circuits are live until they are completely de-energized, tested, and tagged. Pay particular attention to the design of the power system. Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing relay to ensure that all power is off.
- The equipment must be grounded.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.
- Do not open the device. It contains no user-serviceable parts.
- Install all devices, doors and covers before turning on the power to this device.

Failure to follow these instructions will result in death or serious injury.

Testing the arc flash sensors with the light-only criteria operates the trip outputs of the device or the I/O units for the protected zone.

Testing the arc flash sensors with the light and current criteria, without an injected current, only generates an indication on the unit that protects the zone. The indication of the arc fault is registered by the possible main unit and I/O unit.

NOTE: Testing the arc flash sensors using a light source can trip the neighboring zones.

NOTE: For more information on viewing and resetting indications, see the corresponding sensor user manual or se.com.

NOTE: Because of their placement, some sensors cannot be tested without dismantling parts of the system. After completing the testing, reassemble the parts and validate the compliance with original mounting. Consult the equipment manufacturer before dismantling any parts.


10.6.2.3.1 Testing the sensors

Test the sensors with the main device. See *VAMP 125 Arc Flash Protection Device User Manual*.

Reset the main device before the test.

NOTE: Because of their placement, some sensors cannot be tested without dismantling parts of the system. After completing the testing, reassemble the parts and validate the compliance with original mounting. Consult the equipment manufacturer before dismantling any parts.

Figure 260 - Testing point sensors




1. Point light to each arc flash sensor, one at a time, with a powerful light source such as camera flash unit or flashlight.
2. Check the light sensor indication from the device.
3. Check the light sensor address from the device.
4. Compare the light sensor address information from the device with the sensor location map.
5. Fill in the test result in the test report.
See *VAMP Arc Flash Protection Testing Manual*.
6. Reset the device.
7. Repeat the procedure with the next sensor.

10.6.2.3.2 Testing the sensor supervision

Test the sensors with the main device.

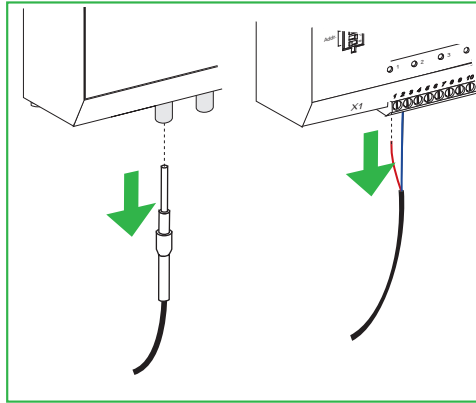Figure 261 - Testing the sensor's self-supervision



1. Disconnect one wire from one point sensor, one for each unit, to see that the self-supervision system recognizes the fault in the sensor.
2. Wait until the arc fault indication appears.
Depending on the device, this can take several minutes. See *HMI functions and indications* in the device user manual.
3. Check that the service status output operates.
4. Fill in the test results in the test report.
See the test report template in *VAMP Arc Flash Protection Testing Manual*.
5. Reconnect the wire and reset the system.
6. Repeat the procedure with the other units.

10.6.2.3.3 Testing the binary I/O connectivity

BI/O signals such as light and overcurrent information are transmitted between devices through dedicated inputs/output.

1. Activate the signal outputs in the binary I/O by generating arc fault light signal, overcurrent pickup or both.
2. Check the configuration modes used for the customer application.
3. Fill in the test result in the test report.
4. Reset the main unit.
5. Repeat the procedure with all connected I/O's.

10.6.3 Test report

10.6.3.1 Filling in the test report

1. Download the test report template from the Schneider Electric website.
2. Fill in all the required information about the system, the tested arc flash units and the test results.

10.6.3.2 Test report example

Figure 262 - Test report example

Easergy P3x3x Arc stage commissioning and testing report						
Customer Information	Customer name			Substation		
	Customer address			Bay		
Unit	Device name:		Device location:			
	Serial number:		Order code:			
	Program version:		IP Address:			
	NetMask:		Gateway:			
	MAC address:		NTP Server:			
Scaling	CT primary current input:		A	Pick-up setting: xIn		
	CT secondary current input:		A	Pick-up value: A		
	CT residual current primary input:		A	Pick-up setting: xIn		
	CT residual current secondary input:		A	Pick-up value: A		
Arc sensors	Sensor	Arc sensor status		Tested	Remarks	
	1	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	2	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	3	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	4	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	5	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	6	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
Arc stages	Stage number	Activation criteria			Tested	Remarks
	1	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
	2	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
	3	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
	4	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
	5	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
	6	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
	7	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
	8	<input type="checkbox"/> Light	<input type="checkbox"/> I>int	<input type="checkbox"/> IoI>int	<input type="checkbox"/>	
CBFP	Stage number	Delay setting / ms		Tested	Remarks	
	1			<input type="checkbox"/>		
	2			<input type="checkbox"/>		
	3			<input type="checkbox"/>		
	4			<input type="checkbox"/>		
	5			<input type="checkbox"/>		
	6			<input type="checkbox"/>		
	7			<input type="checkbox"/>		
	8			<input type="checkbox"/>		
Trip relays	Trip relay	Tested		CBFP	Remarks	
	T1	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	T2	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	T3	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	T4	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	T9	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	T10	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	T11	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	T12	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
	HS01	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>		
HS02	<input type="checkbox"/> OK	<input type="checkbox"/> NA	<input type="checkbox"/>			
Led indications	Led name	Tested		Led name	Tested	
	A	<input type="checkbox"/> Yes	<input type="checkbox"/> NA	B	<input type="checkbox"/> Yes <input type="checkbox"/> NA	
	C	<input type="checkbox"/> Yes	<input type="checkbox"/> NA	D	<input type="checkbox"/> Yes <input type="checkbox"/> NA	
	E	<input type="checkbox"/> Yes	<input type="checkbox"/> NA	F	<input type="checkbox"/> Yes <input type="checkbox"/> NA	
	G	<input type="checkbox"/> Yes	<input type="checkbox"/> NA	H	<input type="checkbox"/> Yes <input type="checkbox"/> NA	
	I	<input type="checkbox"/> Yes	<input type="checkbox"/> NA	J	<input type="checkbox"/> Yes <input type="checkbox"/> NA	
	K	<input type="checkbox"/> Yes	<input type="checkbox"/> NA	L	<input type="checkbox"/> Yes <input type="checkbox"/> NA	
	M	<input type="checkbox"/> Yes	<input type="checkbox"/> NA	N	<input type="checkbox"/> Yes <input type="checkbox"/> NA	
Testing device	Device			Calibration date		
Signatures	Commissioner(s)					
	Supervisor					
	Date					

10.6.4 Troubleshooting

This table describes some common problems in the arc flash system and how they can be solved.

Table 176 - Troubleshooting

Problem	Possible cause	Solution
The trip signal does not reach the circuit breaker.	Faulty trip circuit wiring	Check that the wiring of the trip circuit is not faulty.
The protection does not trip even when a sufficient light signal is provided.	The protection needs both light and current information to trip.	Check the dip switch configuration. The protection may be configured to require both the light and current condition to trip.
Faulty sensor wiring detected by the self-supervision	Loose sensor wire	Check the sensor wiring. The sensor wire may have loosened in the terminal blocks.
Error message indicating blocked sensor channel	Light pulse to the arc flash sensor is too long.	<p>Check that the light pulse to the arc flash sensor is not too long.</p> <p>If light is supplied to the arc flash sensor for more than three seconds, the self-supervision function activates and switches the light sensor channel to daylight blocking mode, and the sensor channel is blocked. The sensor channel indication activates an error message indication on the LED.</p> <p>Remove the light source to reset the blocked channel.</p>


10.7 Low-power instrument transformer testing

These tests verify that the accuracy of the low-power instrument transformer (LPIT) measurements are within acceptable tolerances.

Figure 263 shows the connection diagram that includes the Easergy P3 protection relay and a low-frequency generator as described in *10.7.1 Testing tools and equipment*.

NOTE: To avoid any slow fluctuation of current measurements during testing, disconnect the signal generator earth/ground link or use an isolator transformer.

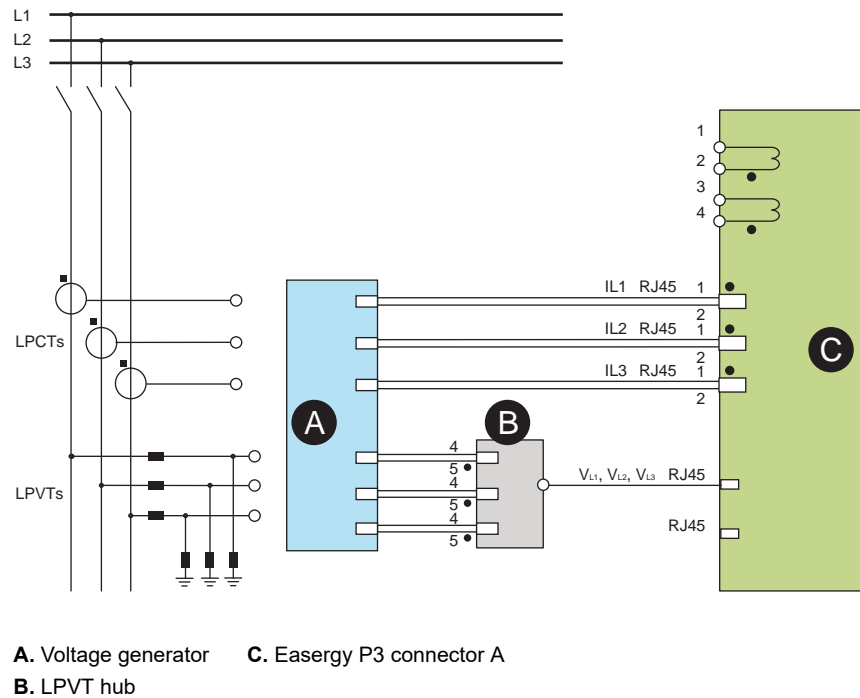Figure 263 - Connection diagram for testing the LPIT



10.7.1 Testing tools and equipment

The following tools and equipment are needed in the commissioning:

- AC current and voltage injection sources
 - For the secondary injection test on LPCT and LPVT, to check the protection relay functions, the injection source should be at such a rating that the voltage is adjustable up to at least 10 V for LPVT and at least 30 V for LPCT to be able to test with the maximum setting ranges.
 - If the primary injection test is necessary to check the CT/LPCT, VT/LPVT primary connection and polarity, the injection source should be at such a rating that the minimum current at the CT secondary is larger than 20 mA (2% of the nominal current) and the minimum voltage at the secondary is larger than 750 mV (1% of the nominal voltage).
- For LPCT/LPVT, test plug for secondary injection testing:
 - cable with RJ45 terminal compliant with IEC 61869-10/11, with pins 3–6 shorted on the protection device end to enable sensor channel measurements
 - LPVT hub connector (to be used if the LPVT hub connector installed in the cubicle is not accessible)

10.7.2 Testing the low-power current transformer measurements

This test verifies that the accuracy of the low-power current transformer (LPCT) measurement is within acceptable tolerances.

1. Disconnect the LPCT secondary from the Easergy P3 device.
2. Use a generator with low-voltage output (maximum 30 V), and connect it directly to the Easergy P3 device as described in [10.7.1 Testing tools and equipment](#).

3. Apply voltage equal to the related LPCT rated secondary voltage.
4. Check its magnitude using a multimeter or reading from the test equipment.
5. Check the current magnitude displayed on the local panel of the Easergy P3 device.
6. Calculate the LPCT measurement accuracy, it shall be within $\pm 1\%$.

NOTE: To be sure everything is well reconnected after the test, perform a primary injection at low level.

10.7.3 Testing the low-power voltage transformer measurements

This test verifies that the accuracy of the low-power voltage transformer (LPVT) measurement is within acceptable tolerances.

1. Disconnect the secondary of LPVTs from the LPVT hub.
If the LPVT hub is not accessible inside the cubicle, disconnect the secondary of the LPVT hub from the Easergy P3 device, and connect another one to replace it during the tests.
2. Use a generator with low voltage output (10 V max) and connect it directly to the LPVT hub as described in [10.7.1 Testing tools and equipment](#).

NOTE: If you have only one cable connected to the LPVT hub, you must use the provided termination accessory in the empty channels to enable measurement.

3. Apply voltage equal to the related LPVT rated secondary voltage.
4. Check its magnitude using a multimeter or reading from the test equipment.
5. Check the voltage magnitude on the local panel of the Easergy P3 device.
6. Calculate the LPVT measurement accuracy.
It must be within $\pm 1\%$.

NOTE: To be sure everything is well reconnected after the test, perform a primary injection at low level.

10.8 Voltage measurement modes

Depending on the application and available voltage transformers, the relay can be connected either to zero-sequence voltage, line-to-line voltage or line-to-neutral voltage. The configuration parameter "Voltage measurement mode" must be set according to the type of connection used.

Voltage measuring modes correlation for E and F analogue measurement cards

U1, U2, U3 and U4 are voltage channels for the relay.

The physical voltage transformer connection in the Easergy P3M30 and P3M32 depends on the used voltage transformer connection mode. This setting is defined in the **Scaling** setting view. See [Table 177](#).

Figure 264 - Example of terminal 8/E/1 and 8/E/2

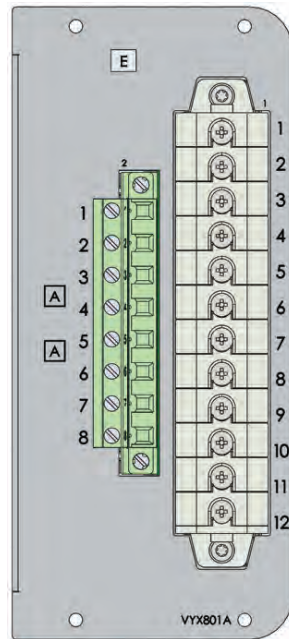


Table 177 - Correlation between voltage measuring mode and physical voltage input in Terminals 8/E/1 and 8/F/2 – conventional VT

Terminal	1	2	3	4	5	6	7	8
Voltage channel	U₁		U₂		U₃		U₄	
Mode / Used voltage								
3LN	U _{L1}		U _{L2}		U _{L3}		Not in use	
3LN+U ₀							U ₀	
3LN+LLy							LLy	
3LN+LNy							LNy	
2LL+U ₀	U ₁₂		U ₂₃		U ₀		Not in use	
2LL+U ₀ +LLy							LLy	
2LL+U ₀ +LNy							LNy	
LL+LLy+U ₀ +LLz			U _{12z}					
LN+LNy+U ₀ +LNz	U _{L1}		U _{L1y}				U _{L1z}	

Voltage measuring modes correlation for M analogue measurement card (LPIT)

U1, U2, U3, and U4 are voltage channels for the protection device.

Figure 265 - Terminals 8/M/Hub 1 and 8/M/Hub 2 – LPVT

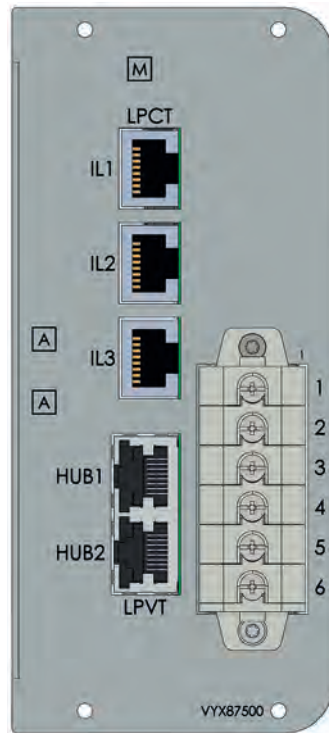


Table 178 - Correlation between voltage measuring mode and physical voltage input in terminals 8/M/Hub 1 and 8/M/Hub 2 – LPVT

Terminal	Hub 1, Pin 4 & 5	Hub 1, Pins 1 & 2	Hub 1, Pins 8 & 7 Hub 2	Hub 2, Pins 4 & 5
Voltage channel	U_1	U_2	U_3	U_4
Mode / Used voltage				
3LN				Not in use
3LN+ U_0	U_{L1}	U_{L2}	U_{L3}	U_0
3LN+LN _y				LN _y
LN+LN _y + U_0 +LN _z	U_{L1}	U_{L1y}		U_{L1z}

10.8.1 Multiple channel voltage measurement – conventional VT

Slot 8 can accommodate one of four different types of analogue measurement cards. Each of them have four voltage measurement channels.


This section introduces various voltage connections and the required voltage measuring modes for the connections. The settings are defined in the **Scalings** view.

3LN

- Voltages measured by VTs: : U_{L1} , U_{L2} , U_{L3}
- Values calculated: U_{L12} , U_{L23} , U_{L31} , U_1 , U_2 , U_2/U_1 , f , U_0

- Measurements available: All
- Protection functions not available: ANSI 25

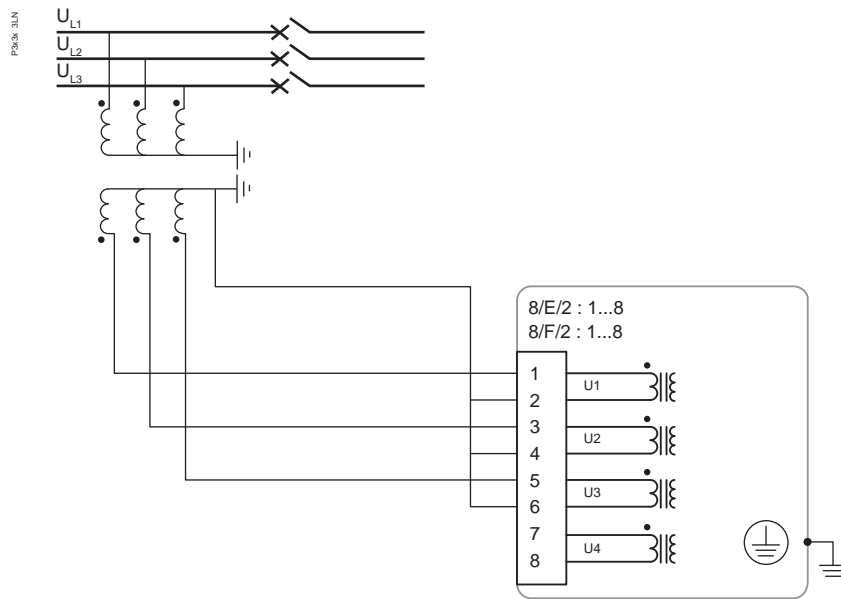Figure 266 - 3LN



⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.


Failure to follow this instruction will result in death or serious injury.

3LN+U₀

This connection is typically used for feeder and motor protection schemes.

- Voltages measured by VTs: U_{L1} , U_{L2} , U_{L3} , U_0
- Values calculated: U_{L12} , U_{L23} , U_{L31} , U_1 , U_2 , U_2/U_1 , f
- Measurements available: All
- Protection functions not available: ANSI 25

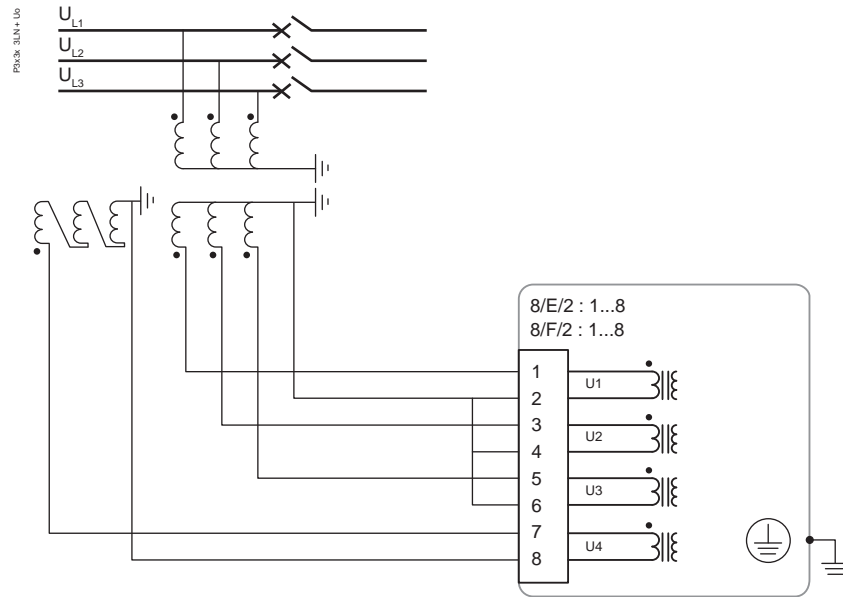Figure 267 - 3LN+U₀



⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.


Failure to follow this instruction will result in death or serious injury.

3LN+LLy

Connection of voltage transformers for synchrocheck application. The other side of the CB has line-to-line connection for reference voltage.

- Voltages measured by VTs: U_{L1} , U_{L2} , U_{L3} , U_{L12y}
- Values calculated: U_{L12} , U_{L23} , U_{L31} , U_1 , U_2 , U_2/U_1 , f , U_0
- Measurements available: All
- Protection functions not available: -

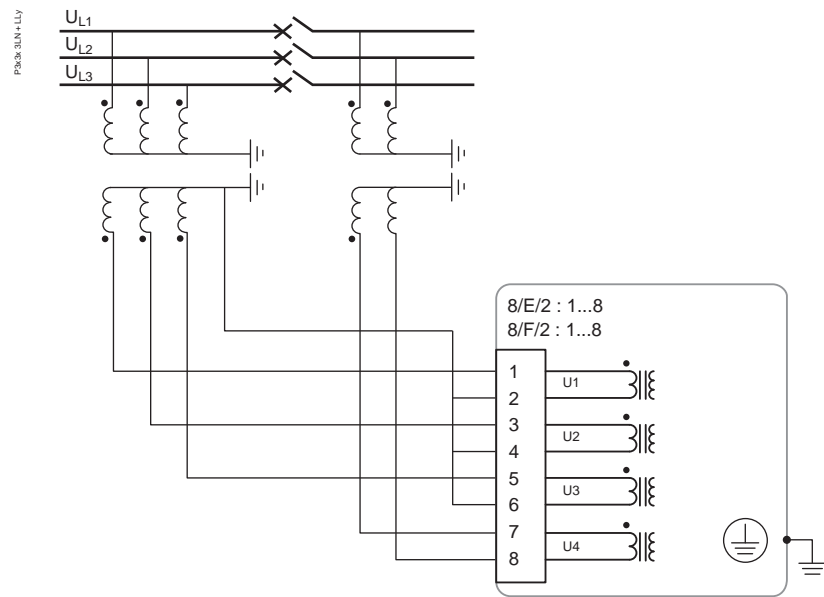Figure 268 - 3LN+LLy



⚠️ ⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.


Failure to follow this instruction will result in death or serious injury.

3LN+LNy

This connection is typically used for feeder protection scheme where line-to-neutral voltage is required for synchrocheck application.

- Voltages measured by VTs: U_{L1} , U_{L2} , U_{L3} , U_{L1y}
- Values calculated: U_{L12} , U_{L23} , U_{L31} , U_1 , U_2 , U_2/U_1 , f , U_0
- Measurements available: All
- Protection functions not available: -

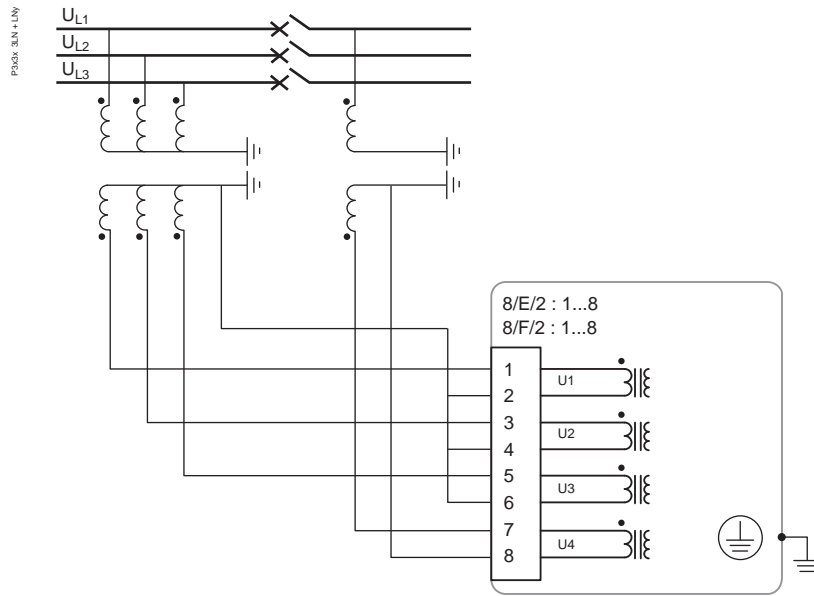Figure 269 - 3LN+LNy



⚠️ ⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH


- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

2LL+U₀

Connection of two line-to-line and neutral displacement voltage measurement schemes.

- Voltages measured by VTs: U_{L12} , U_{L23} , U_0
- Values calculated: U_{31} , U_{L1} , U_{L2} , U_{L3} , U_1 , U_2 , U_2/U_1 , f
- Measurements available: All
- Protection functions not available: ANSI 25

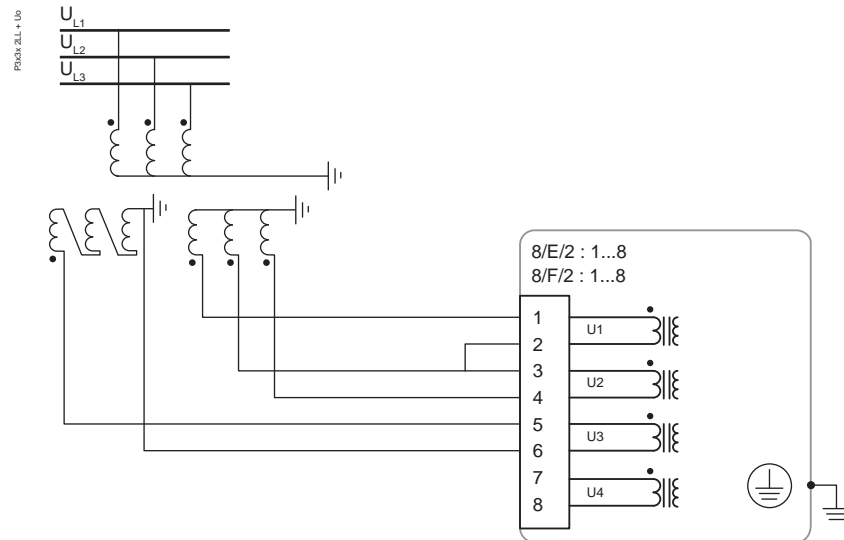Figure 270 - 2LL+U₀

⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH


- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

2LL+U₀+LLy

Connection of two line-to-line and neutral displacement voltage schemes. Line-to-line reference voltage is taken from the other side of the CB for synchrocheck scheme.

- Voltages measured by VTs: U_{L12}, U_{L23}, U₀, U_{L12y}
- Values calculated: U_{L31}, U_{L1}, U_{L2}, U_{L3}, U₁, U₂, U₂/U₁, f
- Measurements available: All
- Protection functions not available: -

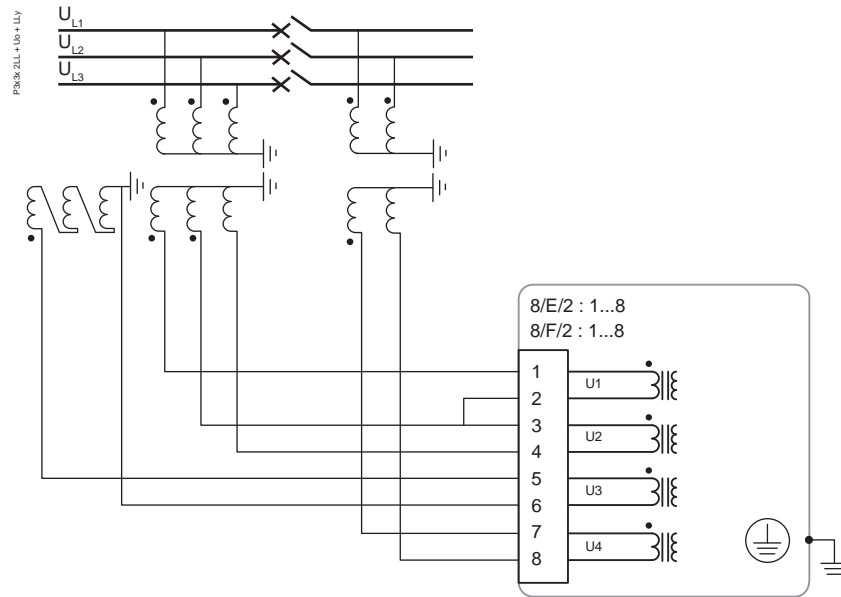Figure 271 - 2LL+U₀+LLy

⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.


Failure to follow this instruction will result in death or serious injury.

2LL+U₀+LNy

Connection of two line-to-line and neutral displacement voltage schemes. The other side of the CB has phase-to-neutral connection for synchrocheck.

- Voltages measured by VTs: U_{L12} , U_{L23} , U_0 , U_{L1y}
- Values calculated: U_{L31} , U_{L1} , U_{L2} , U_{L3} , U_1 , U_2 , U_2/U_1 , f
- Measurements available: All
- Protection functions not available: -

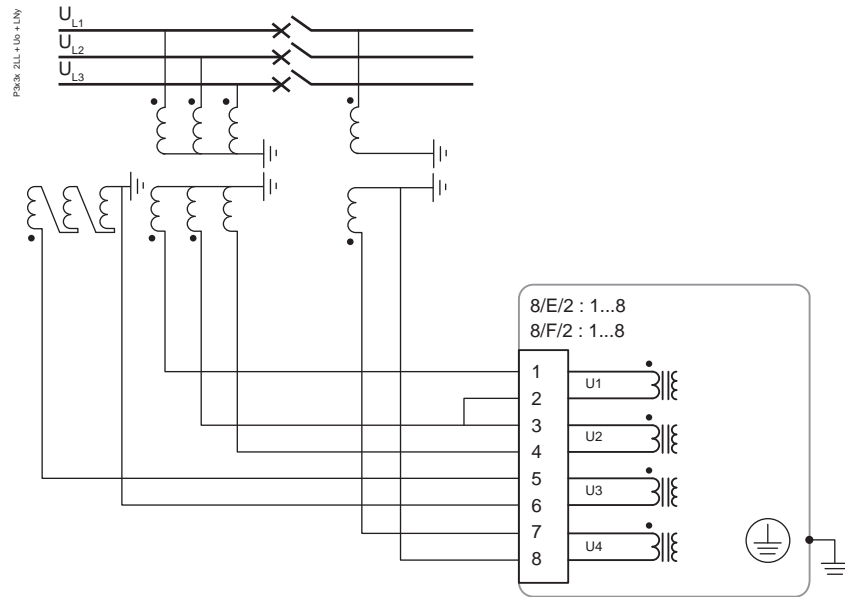Figure 272 - 2LL+U₀+LNy



⚠ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.


Failure to follow this instruction will result in death or serious injury.

LL+U₀+LLy+LLz

This scheme has two CBs to be synchronized. The left side of the bus bar has line-to-line and the right side line-to-line connection for synchrocheck's reference voltages. In the middle, the system voltages are measured by phase-to-neutral and open delta connection.

- Voltages measured by VTs: U_{L12}, U₀, U_{L12y}, U_{L12z}
- Values calculated: U_{L1}, U_{L2}, U_{L3}, f
- Measurements available: -
- Protection functions not available: ANSI 67

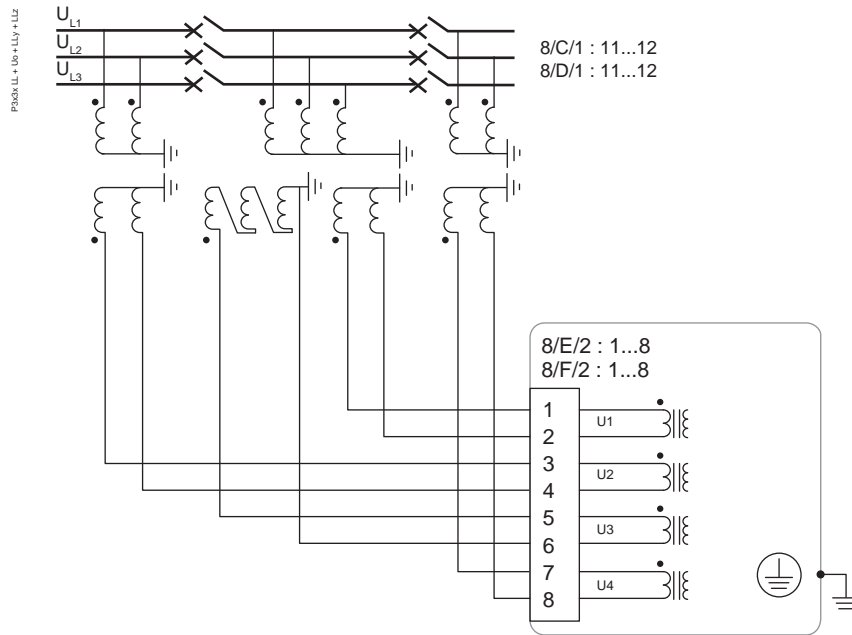Figure 273 - LL+U₀+LLy+LLz



⚡ ⚡ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH


- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

LN+U₀+LNy+LNz

This scheme has two CBs to be synchronized. The left and right sides of the bus bar have line-to-neutral connections for synchrocheck's reference voltages. In the middle, system voltages are measured by phase-to-neutral and broken delta connection.

- Voltages measured by VTs: U_L , U_0 , U_{Ly} , U_{Lz}
- Values calculated: U_{L12} , U_{L23} , U_{L31f}
- Measurements available: -
- Protection functions not available: ANSI 67

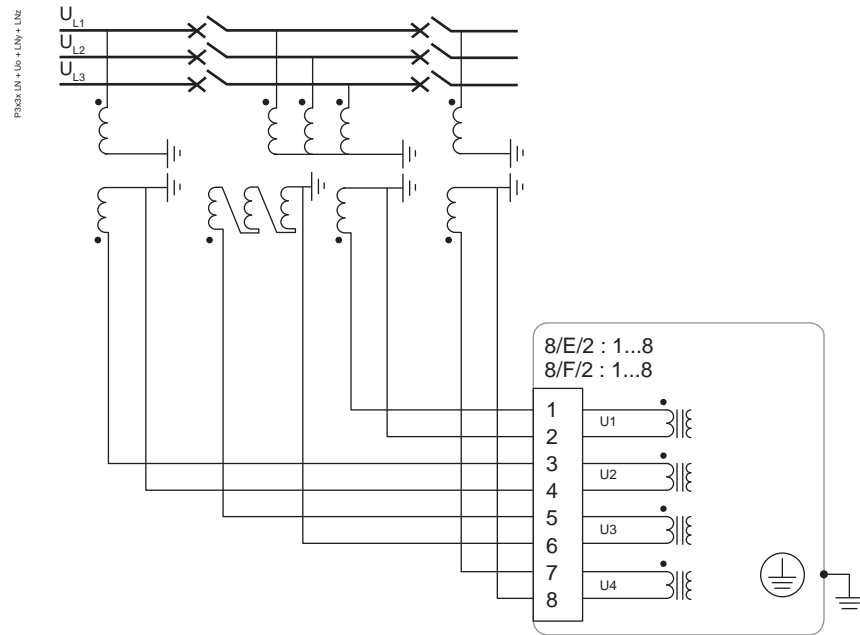Figure 274 - LN+U₀+LNy+LNz

⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

10.8.2 Multiple channel voltage measurement – LPVT

Slot 8 can accommodate two different analogue LPVT measurement cards. Each of them has four voltage measurement channels.

This section introduces various voltage connections and the required voltage measuring modes for the connections. The settings are defined in the **Scalings** view.

3LN

- Voltages measured by LPVTs: U_{L1} , U_{L2} , U_{L3}
- Values calculated: U_{L12} , U_{L23} , U_{L31} , U_1 , U_2 , U_2/U_1 , f , U_0
- Measurements available: All
- Protection functions not available: ANSI 25

3LN+U₀

This connection is typically used for feeder and motor protection schemes.

- Voltages measured by LPVTs: U_{L1} , U_{L2} , U_{L3} , U_0
- Values calculated: U_{L12} , U_{L23} , U_{L31} , U_1 , U_2 , U_2/U_1 , f
- Measurements available: All
- Protection functions not available: ANSI 25

3LN+LNy


This connection is typically used for feeder protection scheme where line-to-neutral voltage is required for synchrocheck application.

- Voltages measured by LPVTs: U_{L1} , U_{L2} , U_{L3} , U_{L1y}
- Values calculated: U_{L12} , U_{L23} , U_{L31} , U_1 , U_2 , U_2/U_1 , f , U_0
- Measurements available: All
- Protection functions not available: -

LN+U₀+LNy+LNz

This scheme has two CBs to be synchronized. The left and right sides of the bus bar have line-to-neutral connections for synchrocheck's reference voltages. In the middle, system voltages are measured by phase-to-neutral and broken delta connection.

- Voltages measured by LPVTs: U_L , U_0 , U_{Ly} , U_{Lz}
- Values calculated: -
- Measurements available: -
- Protection functions not available: ANSI 67

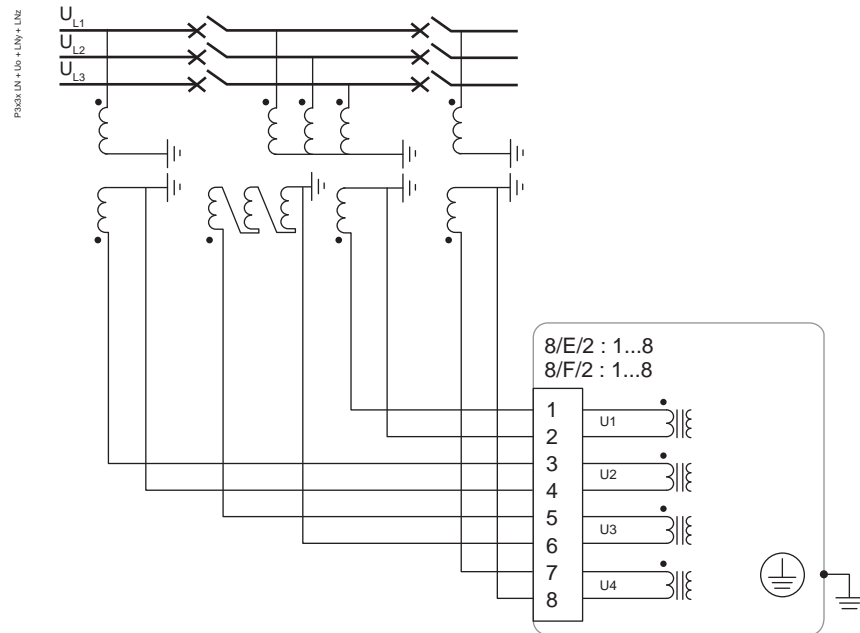Figure 275 - LN+U₀+LNy+LNz

⚠️ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

10.9 CSH120 and CSH200 Core balance CTs

Function

The specifically designed CSH120 and CSH200 core balance CTs are for direct earth fault overcurrent measurement. The difference between CSH120 and CSH200 is the inner diameter.

Because of their low-voltage insulation, they can only be used on cables.

Figure 276 - CSH120 and CSH200 core balance CTs




Characteristics

	CSH120	CSH200
Inner diameter	120 mm (4.7 in)	200 mm (7.9 in)
Weight	0.6 kg (1.32 lb)	1.4 kg (3.09 lb)
Accuracy	±5% at 20°C (68°F) ±6% max. from -25°C to 70°C (-13°F to +158°F)	
Transformation ratio	1/470	
Maximum permissible current	20 kA - 1 s	
Operating temperature	-25°C to +70°C (-13°F to +158°F)	
Storage temperature	-40°C to +85°C (-40°F to +185°F)	

Dimensions

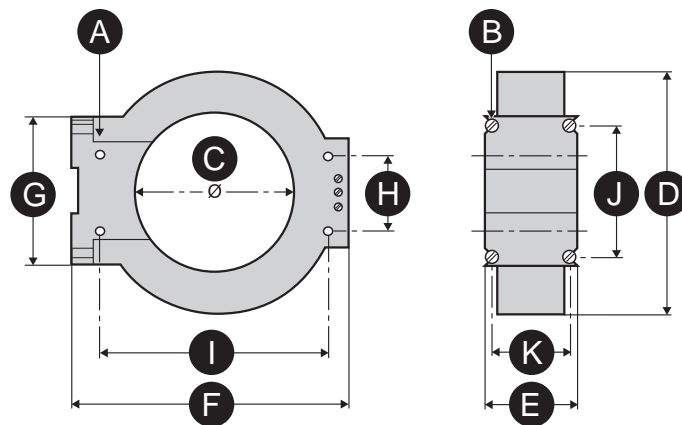Figure 277 - Dimensions



A. 4 horizontal mounting holes Ø 6 **B.** 4 vertical mounting holes Ø 6

Dimensions	C.	D.	E.	F.	G.	H.	I.	J.	K.
CSH120 (in)	120 (4.75)	164 (6.46)	44 (1.73)	190 (7.48)	80 (3.14)	40 (1.57)	166 (6.54)	65 (2.56)	35 (1.38)
CSH200 (in)	196 (7.72)	256 (10.1)	46 (1.81)	274 (10.8)	120 (4.72)	60 (2.36)	254 (10)	104 (4.09)	37 (1.46)

⚡⚡ DANGER

HAZARD OF ELECTRIC SHOCK, ELECTRIC ARC OR BURNS

- Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.
- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it. Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to confirm that all power is off.
- Only CSH120 and CSH200 core balance CTs can be used for direct earth fault overcurrent measurement.
- Install the core balance CTs on insulated cables.
- Cables with a rated voltage of more than 1000 V must also have an earthed shielding.

Failure to follow these instructions will result in death or serious injury.



Assembly

Group the MV cable (or cables) in the middle of the core balance CT.

Use non-conductive binding to hold the cables.

Remember to insert the three medium-voltage cable shielding earthing cables through the core balance CT.

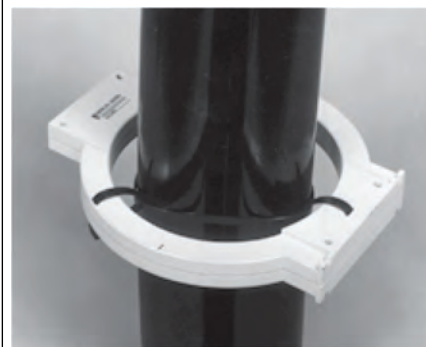Figure 278 - Assembly on MV cables



⚠ CAUTION

HAZARD OF NON-OPERATION

Connect the secondary circuit and the cable shielding of the CSH core balance CTs to earth in the shortest possible manner according to the connection diagram presented in this document.

Failure to follow these instructions can result in equipment damage.

Connection

Connection to Easergy P3M30 and P3M32

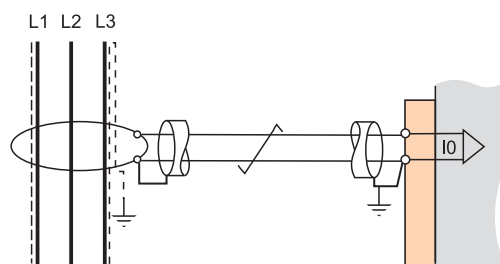
To earth fault current I_0 input, on connector X1, terminals 9 and 10 (shielding).

Recommended cable

- Sheathed cable, shielded by tinned copper braid
- Minimum cable cross-section 0.93 mm² (AWG 18)
- Resistance per unit length < 100 mΩ/m (30.5 mΩ/ft)
- Minimum dielectric strength: 1000 V (700 Vrms)
- Connect the cable shielding in the shortest manner possible to Easergy P3M30 and P3M32
- Flatten the connection cable against the metal frames of the cubicle.

The connection cable shielding is grounded in Easergy P3M30 and P3M32.

The maximum resistance of the Easergy P3M30 and P3M32 connection wiring must not exceed 4 Ω (i.e. 20 m maximum for 100 mΩ/m or 66 ft maximum for 30.5 mΩ/ft).



11 Test and environmental conditions

11.1 Disturbance tests

Table 179 - Disturbance tests

Test	Standard & Test class / level	Test value
Emission	IEC/EN 60255-26 (ed3)	
Conducted	Class A / CISPR 22	0.15–30 MHz
Emitted	Class A / CISPR 11 / IACS E10	150 k Hz – 6 GHz
Immunity	IEC/EN 60255-26 (ed3)	
Slow damped oscillatory wave 1 MHz	IEC/EN 61000-4-18 IEEE C37.90.1	±2.5kVp CM ±2.5kVp DM
Fast damped oscillatory wave 3 MHz, 10 MHz and 30 MHz	IEC/EN 61000-4-18	±2.5kVp CM
Static discharge (ESD)	IEC/EN 61000-4-2 Level 4	±8 kV contact ±15 kV air
Emitted HF field	IEC/EN 61000-4-3 Level 3 IEEE C37.90.2 / IACS E10	80 MHz – 6 GHz, 10 V/m 80–1000 MHz, 20 V/m
Fast transients (EFT)	IEC/EN 61000-4-4 Level 4 IEEE C37.90.1	±4 kV, 5/50 ns, 5 kHz
Surge	IEC/EN 61000-4-5 Level 4	±4 kV, 1.2/50 µs, CM ±2 kV, 1.2/50 µs, DM
Conducted HF field	IEC/EN 61000-4-6 Level 3	0.15–80 MHz, 10 Vrms
Power-frequency magnetic field	IEC/EN 61000-4-8	300 A/m (continuous) 1000 A/m 1–3 s
Pulse magnetic field	IEC/EN 61000-4-9 Level 5	1000 A/m, 1.2/50 µs

Test	Standard & Test class / level	Test value
ac and dc voltage dips	IEC/EN 61000-4-29, IEC/EN 61000-4-11	0% of rated voltage - Criteria A <ul style="list-style-type: none"> ac: ≥ 0.5 cycle dc: ≥ 10 ms
		40% of rated voltage - Criteria C <ul style="list-style-type: none"> ac: 10 cycles dc: 200 ms
		70% of rated voltage - Criteria C <ul style="list-style-type: none"> ac: 25 cycles dc: 500 ms
ac and dc voltage interruptions	IEC/EN 61000-4-29, IEC/EN 61000-4-11	100% interruption - Criteria C <ul style="list-style-type: none"> ac: 250 cycles dc: 5 s
Voltage alternative component	IEC/EN 61000-4-17	15% of operating voltage (dc) / 10 min

11.2 Electrical safety tests

Table 180 - Electrical safety tests

Test	Standard & Test class / level	Test value
Impulse voltage withstand	IEC/EN 60255-27, Class III	5 kV, 1.2/50 μ s, 0.5 J 1 kV, 1.2/50 μ s, 0.5 J Communication
Dielectric test	IEC/EN 60255-27, Class III	2 kV, 50 Hz 0.5 kV, 50 Hz Communication
Insulation resistance	IEC/EN 60255-27	> 100 M Ω at 500 Vdc using only electronic/brushless insulation tester
Protective bonding resistance	IEC/EN 60255-27	shall not exceed 0,1 Ω
Clearance and creepage distance	Design criteria for distances as per IEC 60255-27 Annex C (pollution degree 2, overvoltage category 3)	

Test	Standard & Test class / level	Test value
Burden	IEC 60255-1	
Contact performance	IEC 60255-1	

11.3 Mechanical tests

Table 181 - Mechanical tests

Test	Standard & Test class / level	Test value
Device in operation		
Vibrations	IEC 60255-21-1, Class II / IEC 60068-2-6, Fc	1 Gn, 10 Hz – 150 Hz
Shocks	IEC 60255-21-2, Class II / IEC 60068-2-27, Ea	10 Gn / 11 ms
Seismic	IEC 60255-21-3 Method A, Class II	2 G horizontal / 1 G vertical , 1–35 Hz
Device de-energized		
Vibrations	IEC 60255-21-1, Class II / IEC 60068-2-6, Fc	2 Gn, 10 Hz – 150 Hz
Shocks	IEC 60255-21-2, Class II / IEC 60068-2-27, Ea	30 Gn / 11 ms
Bump	IEC 60255-21-2, Class II / IEC 60068-2-27, Ea	20 Gn / 16 ms

11.4 Environmental tests

Table 182 - Environmental tests

Test	Standard & Test class / level	Test value
Device in operation		
Dry heat	EN / IEC 60068-2-2, Bd	70°C (158°F)
UL 508 ⁹⁴⁾	55°C (131°F)	
Cold	EN / IEC 60068-2-1, Ad	-40°C (-40°F)
Damp heat, cyclic	EN / IEC 60068-2-30, Db	From 25°C (77°F) to 55°C (131°F) From 93% RH to 98% RH Testing duration: 6 days

Test	Standard & Test class / level	Test value
Damp heat, static	EN / IEC 60068-2-78, Cab	40°C (104°F) 93% RH Testing duration: 10 days
Change of temperature	IEC / EN 60068-2-14, Nb	Lower temp -40°C Upper temp 70°C 5 cycles
Flowing mixed gas corrosion test, method 1	IEC 60068-2-60, Ke	25° C (77° F), 75 % RH 21 days 100 ppb H2S, 500 ppb SO2
Flowing mixed gas corrosion test, method 4	IEC 60068-2-60, Ke	25° C (77° F), 75 % RH 21 days 10 ppb H2S, 200 ppb NO2, 10 ppb CL2, 200 ppb SO2
Device in storage		
Dry heat	EN / IEC 60068-2-2, Bb	70°C (158°F)
Cold	EN / IEC 60068-2-1, Ab	-40°C (-40°F)

⁹⁴⁾ Test condition: Device operated continuously. All digital inputs and digital outputs activated with 5 s on, 30 s off duty cycle, carrying maximum rated loads.

11.5 Environmental conditions

Table 183 - Environmental conditions

Condition	Value
Ambient temperature, in-service ^{95) 96)}	-40 – 60°C (-40 – 140°F) ⁹⁷⁾
Ambient temperature, storage	-40 – 70°C (-40 – 158°F)
Relative air humidity	< 95%, no condensation allowed
Maximum operating altitude	2000 m (6561.68 ft)

⁹⁵⁾ The display contrast is affected by ambient temperatures below -25°C (-13°F).

⁹⁶⁾ After a cold start, in temperatures below -30°C (-22°F), allow the relay to stabilize for a few minutes to achieve the specified accuracy.

⁹⁷⁾ Recommended values with VYX 695 projection mounting frame:

- device with 1 x raising frame → maximum ambient temperature 55°C
- device with 2 x raising frame → maximum ambient temperature 50°C

11.6 Casing

Table 184 - Casing

Parameter	Value
Degree of protection (IEC 60529)	IP54 Front panel, IP20 rear side, IP10 rear side (if analog measurement card with ring lug connectors is used)
Dimensions (W x H x D)	270 x 176 x 230 mm / 10.63 x 6.93 x 9.06 in
Weight	4.2 kg (9.272 lb) or higher (depends of options)

12 Maintenance

⚡⚡ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Wear your personal protective equipment (PPE) and comply with the safe electrical work practices. For clothing, see applicable local standards.
- Only qualified personnel should install this equipment. Such work should be performed only after reading this entire set of instructions and checking the technical characteristics of the device.
- NEVER work alone.
- Turn off all power supplying this equipment before working on or inside it. Consider all sources of power, including the possibility of backfeeding.
- Always use a properly rated voltage sensing device to ensure that all power is off.
- Do not open the secondary circuit of a live current transformer.
- Always connect the polarity of the current transformer (CT) and the voltage transformer (VT) and their secondary ground wiring according to the connection diagrams presented in this document.
- Connect the device's protective ground to functional earth according to the connection diagrams presented in this document.

Failure to follow this instruction will result in death or serious injury.

The Easergy P3 protection relays and arc flash detection products together with their extension units, communication accessories, arc flash detection sensors and cabling, later called “device”, require maintenance in work according to their specification. Keep a record of the maintenance actions. The maintenance can include, but is not limited to:

- preventive maintenance
- periodic testing
- hardware cleaning
- system status messages
- spare parts
- self-supervision

12.1 Preventive maintenance

Check the device visually when the switch gear is de-energized. During the inspection, pay attention to:

- dirty components
- loose wire connections
- damaged wiring
- indicator lights
- other mechanical connections

Perform visual inspection every three (3) years minimum.

Related topics

[2.5.7 Testing the LEDs and LCD screen](#)

12.2 Periodic testing

Test the device periodically according to the end user's safety instructions and national safety instructions or law. Carry out functional testing every five (5) years minimum.

Conduct the testing with a secondary injection principle for the protection stages used in the device and its extension units.

In corrosive or offshore environments, carry out functional testing every three (3) years. For the testing procedures, see separate testing manuals.

12.3 Hardware cleaning

Special attention must be paid that the device do not become dirty. If cleaning is required, wipe out dirt from the units.

12.4 System status messages

If the device's self checking detects an unintended system status, it will in most cases provide an alarm by activating the service LED and indication status notification on the LCD screen. If this happens, store the possible message and contact your local representative for further guidance.

12.5 Spare parts

Use an entire unit as a spare part for the device to be replaced. Always store spare parts in storage areas that meet the requirements stated in the user documentation.

12.6 Self-supervision

NOTICE

LOSS OF PROTECTION OR RISK OF NUISANCE TRIPPING

- If the relay is no longer supplied with power or is in permanent fault state, the protection functions are no longer active and all the Easergy P3 digital outputs are dropped out.
- Check that the operating mode and SF relay wiring are compatible with the installation.

Failure to follow these instructions can result in equipment damage and unwanted shutdown of the electrical installation.

Description

The electronic parts and the associated circuitry as well as the program execution are supervised by means of a separate watchdog circuit. Besides supervising the device, the watchdog circuit attempts to restart the microcontroller in an

inoperable situation. If the microcontroller does not restart, the watchdog issues a self-supervision signal indicating a permanent internal condition.

When the watchdog circuit detects a permanent fault, it always blocks any control of other digital outputs (except for the self-supervision SF output). In addition, the internal supply voltages are supervised. Should the auxiliary supply of the device disappear, an indication is automatically given because the device status inoperative (SF) output functions on a working current principle. This means that the SF relay is energized, the 1/C/1:5–7 (or 1/D/1:5-7) contact closed, when the auxiliary supply is on and the Easergy P3M30 and P3M32 device is fully operational.

In addition to the dedicated self-supervision function, the protection relay has several alarm signals that can be connected to outputs through the output matrix. The alarms include:

- remote communication inactive
- extension I/O communication inactive
- communication Port 1 down
- communication Port 2 down
- selfdiag 1, 2 or 3 alarm
- password open

NOTE: SF output is referenced as "service status output" in the setting tool.

To get self-supervision alarms to SF output contact, they must be linked in the DIAGNOSIS setting view's section SELFDIAG SIGNAL CONFIGURATION. Required alarms are first linked to a Selfdiag1, Selfdiag2 or Selfdiag3 group (*Figure 279*).

Figure 279 - Selfdiag alarm signal configuration

SELF DIAG SIGNAL CONFIGURATION	
SecPulse	Selfdiag1
Relays	Selfdiag1
E2PROM	Selfdiag1
Stack usage	Selfdiag1
Memory check	Selfdiag1
Background task	Selfdiag1
Parameter range check	Selfdiag1
CPU load	Selfdiag1
Internal voltage +	Selfdiag1
Low auxiliary voltage	Selfdiag1
Internal temperature	Selfdiag1
ADC check 1	Selfdiag1
COM buffer	Selfdiag1
Slot card	Selfdiag1
Order code	Selfdiag1
FPGA version	Selfdiag2
FPGA configuration	Selfdiag2
Arc sensor	Selfdiag2
BI	Selfdiag2


Having the Seldiag alarm grouping made, the appropriate alarms can be assigned to SF relay. By default, selfdiag alarm 2 is linked to SF relay (*Figure 280*). The function of this default setup is the same as in the older systems where this configuration was not possible.

Figure 280 - Linking Selfdiag alarm 1-3 to SF relay

Link selfdiag 1 to SF relay	<input type="checkbox"/>
Link selfdiag 2 to SF relay	<input checked="" type="checkbox"/>
Link selfdiag 3 to SF relay	<input type="checkbox"/>

It is possible to choose what selfdiag alarms 1-3 do when activated. This option can be done through the output matrix (*Figure 281*). This allows you to categorize and prioritize actions for each selfdiag alarms individually. For example, in this configuration, selfdiag alarm 2 activates T9.

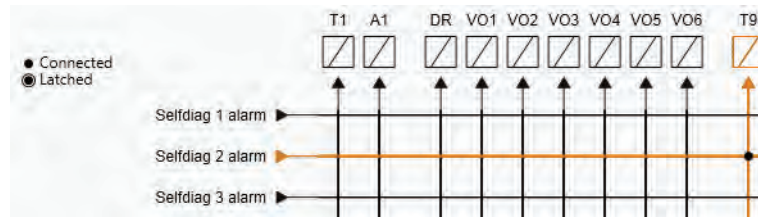Figure 281 - Selecting selfdiag 1-3 actions. The number of outputs varies depending on the device and order code



12.6.1 Diagnostics

The device runs self-diagnostic tests for hardware and software in boot sequence and also performs runtime checking.

Permanent inoperative state

If a permanent inoperative state has been detected, the device releases an SF relay contact and the service LED is set on. The local panel also displays a detected fault message. The permanent inoperative state is entered when the device is not able to handle main functions.

Temporal inoperative state

When the self-diagnostic function detects a temporal inoperative state, a Selfdiag matrix signal is set and an event (E56) is generated. If the inoperative state was only temporary, an off event is generated (E57). The self-diagnostic state can be reset via the front panel.

Diagnostic registers

There are four 16-bit diagnostic registers which are readable through remote protocols.

Table 185 - Readable registers through remote communication protocols

Register	Bit	Code	Description
SelfDiag1	0 (LSB)	(Reserved)	(Reserved)
	1	(Reserved)	(Reserved)
	2	T1	Detected digital output fault
	3	T2	
	4	T3	
	5	T4	
	6	T5	
	7	T6	

Register	Bit	Code	Description
	8	T7	
	9	T8	
	10	A1	
	11	A2	
	12	A3	
	13	A4	
	14	A5	
	15	T9	
SelfDiag2	0 (LSB)	T10	Detected digital output fault
	1	T11	
	2	T12	
	3	T13	
	4	T14	
	5	T15	
	6	T16	
	7	T17	
	8	T18	
	9	T19	
	10	T20	
	11	T21	
	12	T22	
	13	T23	
	14	T24	
SelfDiag4	0 (LSB)	+12V	Detected internal voltage fault
	1	ComBuff	BUS: detected buffer error
	2	Order Code	Detected order code error

Register	Bit	Code	Description
	3	Slot card	Detected option card error
	4	FPGA conf.	Detected FPGA configuration error
	5	I/O unit	Detected ARC I/O unit error
	6	Arc sensor	Detected faulty arc sensor
	7	QD-card error	Detected QD-card error
	8	BI	Detected ARC BI error
	9	LowAux	Low auxiliary supply voltage

The code is displayed in self-diagnostic events and on the diagnostic menu on the local panel and Easergy Pro.

NOTE: All signals are not necessarily available in every Easergy P3 product.

12.7 Arc flash detection system maintenance

The device requires maintenance to ensure that it works according to the specification. Carry out testing every four (4) years.

⚠ DANGER

HAZARD OF UNEXPECTED SYSTEM OPERATION

Carry out periodic system testing as per the testing recommendation in this manual or if the protection system scheme has been changed.

Failure to follow these instructions will result in death or serious injury.

⚠ DANGER

HAZARD OF UNEXPECTED SYSTEM OPERATION

- If the arc flash detection unit is no longer supplied with power or is in permanent non-operational state, the protection functions are no longer active and all the output contacts are dropped out.
- To detect a power-off or a permanent fault state, connect the watchdog (SF) output contact to a monitoring device such as SCADA or DCS.

Failure to follow these instructions will result in death or serious injury.

Keep record of the maintenance actions performed for the system.

The maintenance can include but is not limited to:

- visual inspection
- periodic testing
- hardware cleaning
- sensor condition and positioning check
- checking the obstruction of sensors

12.7.1 Visual inspection

Do visual inspection once every three (3) years minimum.

1. De-energize the switchgear.
2. Inspect the device, sensors and cabling.

Pay attention to:

- possible dirty arc sensors
- loose wire connections
- damaged wiring
- indicator lights (device start-up)
- other mechanical connections

12.7.2 Hardware cleaning

Pay special attention to ensure that the device, its extension units and sensors do not become dirty.

⚠ DANGER

HAZARD OF UNEXPECTED SYSTEM OPERATION

- Do not use any type of solvents or gasoline to clean the device, sensors or cables.
- When cleaning the sensor, make sure that the cleaning solution does not contact anything other than the sensor.

Failure to follow these instructions will result in death or serious injury.

- If cleaning is required, wipe out dirt from the device.
- Use a dry cleaning cloth or equivalent together with mild soapy water to clean any residues from the light sensor.

12.7.3 Sensor condition and positioning check

Always check that the sensor positioning remains as it was originally designed after:

- commissioning
- sensor replacement
- modification procedure
- cleaning
- arc flash fault
- periodic testing

Check for obstruction of the sensors.


13 Order codes and accessories

13.1 Order codes

When ordering, state:

- Order code of the relay
- Quantity
- Accessories (see the order codes in section Accessories)

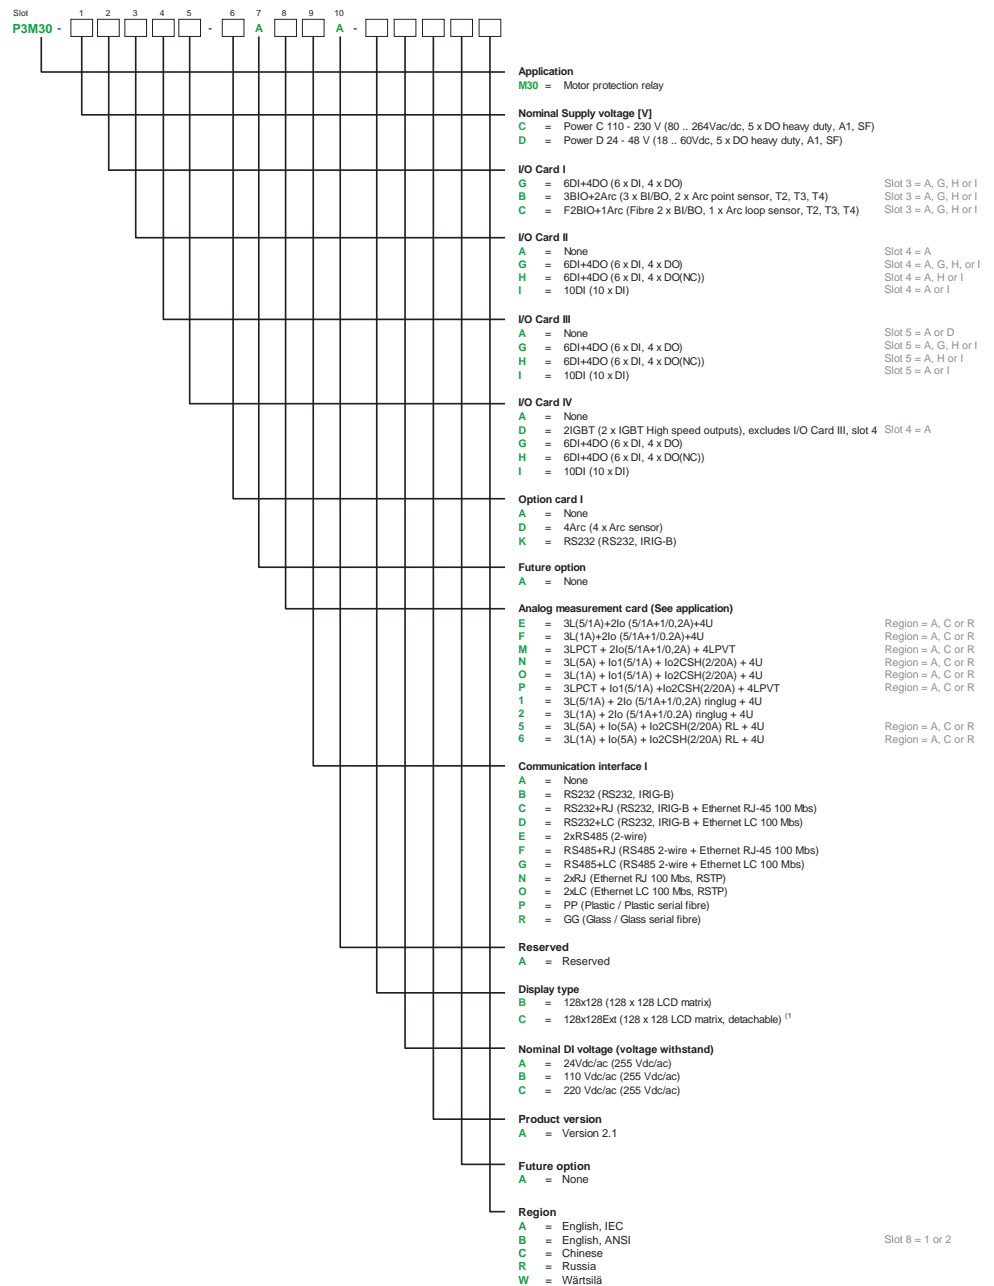
Figure 282 - P3M30 order code



- 1) Contact Schneider Electric for simultaneous use of arc option cards in slot 2 (option B or C) or slot 6 (option D).
- 2) By default, the cable length is 2 m (6.56 ft). You can order cables of other length separately: VX001-1 (1 m/3.28 ft), Vx001-3 (3 m/9.84 ft) or VX001-5 (5 m/16.40 ft).

NOTE: All PCBA cards are conformally coated.

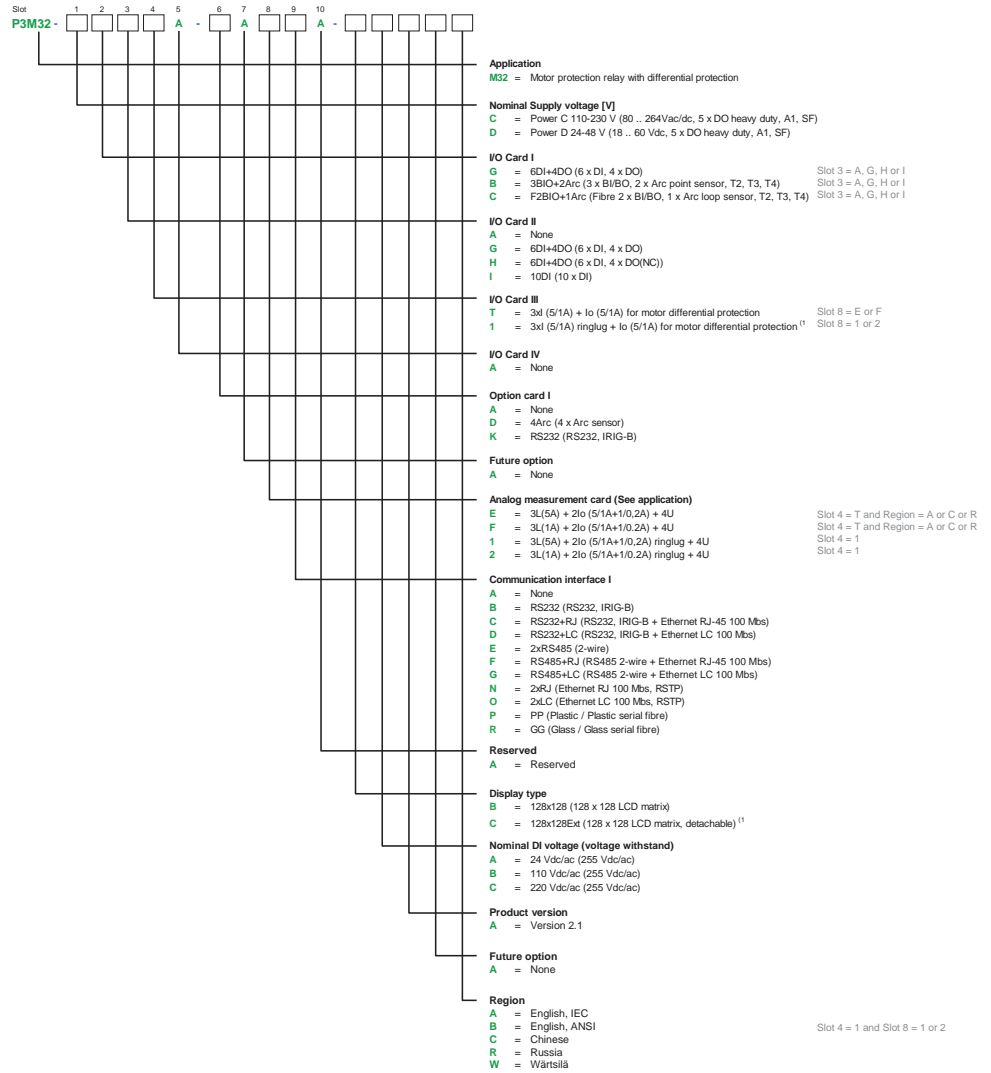Figure 283 - P3M32 order code



- 1) If slot 8 = 1 or 2, then slot 4 = 1
- 2) By default, the cable length is 2 m (6.56 ft). You can order cables of other length separately: VX001-1 (1 m/3.28 ft), Vx001-3 (3 m/9.84 ft) or VX001-5 (5 m/ 16.40 ft).

NOTE: All PCBA cards are conformally coated.

13.2 Accessories

Table 186 - Accessories for Easergy P3 Advanced

Product reference	Description	REL code	P3F30	P3L30	P3M30 / P3M32	P3G30 / P3G32	P3T32
VA1DA-20	Arc sensor, 20 m	REL52801	X	X	X	X	X
VA1DA-20S-HF	Arc sensor, 20 m, shielded, halogen free	REL52802	X	X	X	X	X
VA1DA-20S	Arc sensor, 20 m, shielded	REL52803	X	X	X	X	X
VA1DA-6	Arc sensor, 6 m connect cable	REL52804	X	X	X	X	X
VA1DA-6S-HF	Arc sensor, 6 m, halogen free	REL52805	X	X	X	X	X
VA1DA-6S	Arc sensor, 6 m, shielded	REL52806	X	X	X	X	X
VA1EH-20	Arc sensor, 20 m pipe sensor	REL52807	X	X	X	X	X
VA1EH-20S	Arc sensor, 20 m pipe sensor, shielded	REL52808	X	X	X	X	X
VA1EH-6	Arc sensor, 6 m pipe sensor	REL52809	X	X	X	X	X
VA1EH-6S	Arc sensor, 6 m pipe sensor, shielded	REL52810	X	X	X	X	X
VA1DA-6W	Arc sensor, 6 m, shielded at sensor end	REL52839	X	X	X	X	X
VA1DA-20W	Arc sensor, 20 m, shielded at sensor end	REL52840	X	X	X	X	X
VA2DV-3-SE	Arc sensor, 3 m, shielded, metal pipe	REL52851	X	X	X	X	X
VA2DV-6-SE	Arc sensor, 6 m, shielded, metal pipe	REL52852	X	X	X	X	X
ARC SLM-1	Arc fiber sensor, 1 m	REL52842	X	X	X	X	X
ARC SLM-5	Arc fiber sensor, 5 m	REL52843	X	X	X	X	X
ARC SLM-10	Arc fiber sensor, 10 m	REL52844	X	X	X	X	X
ARC SLM-15	Arc fiber sensor, 15 m	REL52845	X	X	X	X	X
ARC SLM-20	Arc fiber sensor, 20 m	REL52846	X	X	X	X	X
ARC SLM-25	Arc fiber sensor, 25 m	REL52847	X	X	X	X	X
ARC SLM-30	Arc fiber sensor, 30 m	REL52848	X	X	X	X	X
ARC SLM-40	Arc fiber sensor, 40 m	REL52849	X	X	X	X	X

Product reference	Description	REL code	P3F30	P3L30	P3M30 / P3M32	P3G30 / P3G32	P3T32
ARC SLM-50	Arc fiber sensor, 50 m	REL52850	X	X	X	X	X
VIO12AASE	RTD module, 12pcs RTD inputs, Optical Tx	REL52811	X	X	X	X	X
VIO12ABSE	RTD module, 12pcs RTD inputs, RS485	REL52812	X	X	X	X	X
VIO12ACSE	RTD module, 12pcs RTD inputs, mA in/out	REL52813	X	X	X	X	X
VIO12ADSE	RTD module, 12pcs RTD inputs, mA in/out	REL52814	X	X	X	X	X
VPA3CGSE	Profibus interface module	REL52815	X	X	X	X	X
VSE001-GGSE	Fiber optic module (Glass - Glass)	REL52816	X	X	X	X	X
VSE001-GPSE	Fiber optic module (Glass - Plastic)	REL52817	X	X	X	X	X
VSE001-PGSE	Fiber optic module (Plastic - Glass)	REL52818	X	X	X	X	X
VSE001-PPSE	Fiber optic module (Plastic - Plastic)	REL52819	X	X	X	X	X
VSE002	RS485 module	REL52820	X	X	X	X	X
VX052-3	USB programming cable (Easergy Pro)	REL52822	X	X	X	X	X
VX067	P3x split cable for COM1-2&COM3-4 ports	REL52823	X	X	X	X	X
VX072	P3x Profibus cable	REL52824	X	X	X	X	X
VYX001	Mounting plate for sensor Z-shape	REL52828	X	X	X	X	X
VYX002	Mounting plate for sensor L-shape	REL52829	X	X	X	X	X
VYX301	VSE00x Wall fastening module	REL52831	X	X	X	X	X
VYX695	Raising frame, P3x, 45 mm	REL52832	X	X	X	X	X
P3UPAV200	P3U to VAMP200-cut out adapter plate	REL52837	X	X	X	X	X
VX086	P3x (RS232) - COM1/2+3/4+IRIG-B(3xD9)	REL52838	X		X		

Product reference	Description	REL code	P3F30	P3L30	P3M30 / P3M32	P3G30 / P3G32	P3T32
EMS59572	Voltage adapter - 47... 240 V - RJ45 output	EMS59572	X		X		
EMS59573	LPVT hub connector, RJ45 input - RJ45 output	EMS59573	X		X		
CCA770	Screened Ethernet cable between LPVT hub or Voltage adapter and P3 relay, 0.6 m	59660	X		X		
CCA772	Screened Ethernet cable between LPVT hub or Voltage adapter and P3 relay, 2 m	59661	X		X		
CCA774	Screened Ethernet cable between LPVT hub or Voltage adapter and P3 relay, 4 m	59662	X		X		
VW3A8306RC	LPVT hub termination, use this if all LPVT are not present	VW3A8306 RC	X		X		

14 Firmware revision

Table 187 - Firmware revisions

FW revision	Changes
<p>Version: 30.205</p> <p>Release date: October 2021</p>	<ul style="list-style-type: none"> • Support for the new CSH sensor I₀ input (applies to P3Ux, P3F30, P3G30, P3L30, and P3M30) • Polarity of the output contacts in the power supply card is now SW selectable between NO and NC • Frequency stage improvement • Global trip line to output matrix • Phasor symbol improvement in the HMI • Local panel control no longer requires activation of the Operator access level when it is disabled in the Objects setting view • HMI password enhancement with letters and characters • Communication: <ul style="list-style-type: none"> ◦ IEC61850 new LN (LTIM) added for time management ◦ IEC61850 new LN (ZMOT) added for running hours ◦ Modbus update to access arc sensor status ◦ New timeout mechanism added for Telnet/Serial/Http connections
<p>Version: 30.204</p> <p>Release date: January 2021</p>	<ul style="list-style-type: none"> • Arc flash protection option module support for P3F30 and P3M30 when LPCT & LPVT used • Phase rotation configuration ABC to ACB for voltage and currents • Communications: <ul style="list-style-type: none"> ◦ IEC61850 and Modbus: Alarm setting and operations left parameters for circuit breaker monitoring ◦ Ethernet/IP communication protocol restored back to use
<p>Version: 30.203</p> <p>Release date: July 2020</p>	<ul style="list-style-type: none"> • LPIT support for P3M30 model <ul style="list-style-type: none"> ◦ The high-speed arc flash current (Arc I_{>}) is not supported in this release. • I_{>>>} stage latch function upgrade during the power on-off-on state • RSTP network reconstruction optimization • Adjusted time stamps for disturbance recorder and events logs • Backlight off default timeout changed to 10 min • Added Modbus registers for alarm setting of CB wear (read) and Operation left data (read) • DNP3 updates: <ul style="list-style-type: none"> ◦ Added function 24 record current time ◦ Added VO and LED status to BI data list ◦ Added the possibility to configure time reference to UTC
<p>Version: 30.202</p> <p>Release date: July 2020</p>	<ul style="list-style-type: none"> • LPIT support <ul style="list-style-type: none"> ◦ for P3U30 and P3F30 models only ◦ The high-speed arc flash current (Arc I_{>}) is not supported in this release. ◦ CT secondary in slot 8 adjustable to 1–10 A • Modbus <ul style="list-style-type: none"> ◦ Added PME/PSO support ◦ Voltage measurements descriptions

FW revision	Changes
Version: 30.201 Release date: January 2020	Cybersecurity improvements: <ul style="list-style-type: none"> • passwords are stored as salted hash • password resetting procedure changed • new user account Administrator added • editing output matrix and several communication settings through Ethernet interface blocked
Version: 30.111 Release date: October 2019	<ul style="list-style-type: none"> • Improved menu titles for COM ports and Ethernet ports in the Protocol Configuration menu • IEC-61850 speed optimizations • Added IRIG-B support for option 'K' in slot 6 • Support for eight (8) controllable objects and protocol parameters for Modbus, IEC 61850, IEC 103, IEC 101, Device Net, Profibus, DNP 3, and SPABus • Modbus: <ul style="list-style-type: none"> ◦ registers to include protection function status ◦ added LED status information
Version: 30.110 Release date: August 2019	<ul style="list-style-type: none"> • ANSI terminology • Digital inputs 33–36 added to DNP and IEC 101 protocol • Phase-wise cumulative breaking current over IEC 61850 • Temperature LN to IEC 61850 • Add VI5-20 and VO7-20 added to IEC 103 protocol mapping • Ethernet/IP protocol removed
Version: 30.109 Release date: March 2019	<ul style="list-style-type: none"> • Arc protection $I_{0>int}$. start setting changed to be relative to CT primary instead of application nominal current. • Unit for start setting of $I_{0>int}$. arc protection changed to "pu". • Negative sequence voltage $U_{2>}$, $U_{2>>}$ and $U_{2>>>}$(ANSI 47) stages added. • Maximum number of disturbance records increased from 12 to 24. • IEC 61850 logical nodes added for digital inputs 32....36. • Digital inputs 33...36 added to IEC 103 protocol. • BIO and IGBT support added to P3x3x models.

FW revision	Changes
<p>Version: 30.108</p> <p>Release date: December 2018</p>	<ul style="list-style-type: none"> • Intermittent earth fault (ANSI 67NI) changed: <ul style="list-style-type: none"> ◦ New start setting "Sensitive/Normal" and U_0 check for trip added • CB condition monitoring upgraded with opening counts and opening, closing and charging times • Fault locator enhanced to allow multiple line segments. • LED matrix in P3x3x enhanced: <ul style="list-style-type: none"> ◦ LEDs can now be configured more flexibly. ◦ It is now possible to select for each individual LED whether it should be blinking, latched, or non-volatile (keep its state over reboot). ◦ Each LED also has a configurable description, one for green color and another for red. • COMTRADE files can be read over Modbus. • Product and vendor data changed to Schneider Electric in EDS file. This change affects CIP protocols: DeviceNet and Ethernet/IP. • Pole slip protection (ANSI 78) added for P30G and P3G32. • New CBFP functions added: "CBFP1" and "CBFP2". • Restricted earth fault protection (ANSI 64REF) for P3T32 and P3G32. • Faulty phase detection added for ANSI 67N (I_0Dir) stage. • Ethernet's redundancy protocols are now in separate menus.
<p>Version: 30.106</p> <p>Release date: 16.5.2018</p>	<ul style="list-style-type: none"> • The setting "Inv. time coefficient k" in stages $I>$, $I\phi>$, $I\phi>>$, $I_0>$, $I_0\phi>$, $I_0\phi>>$, $I_0\phi>>>$ has three decimals instead of two and the minimum value for the earth fault overcurrent was changed from 0.05 to 0.025. • Communication protocol updates
<p>Version: 30.104</p> <p>Release date: 2.10.2017</p>	<p>First release</p>

Schneider Electric

35 rue Joseph Monier
92500 Rueil Malmaison - France
Phone: +33 (0) 1 41 29 70 00
www.schneider-electric.com

As standards, specifications, and designs change from time to time,
please ask for confirmation of the information given in this publication.

© 2021 Schneider Electric All Rights Reserved.

P3M/en M/H006 — 12/2021