



UPS for tower and rack usage

System configurator and order-information guide

April 2022

Contents

Configurator diagram Line Interactive UPS Fujitsu
Configurator diagram Gen2 Online UPS Fujitsu
Data Sheets Smart UPS for PRIMERGY Servers
Change Report



PRIMERGY Server

Configuration and Order Options for Uninterruptible Power Supplies (UPSs) with Fujitsu brand logo by APC (American Power Conversion)

- Uninterruptible power supplies (UPSs) as floorstand units rated at 750 and 1500 VA
- Uninterruptible power supplies (UPSs) as rack / tower convertible modules rated at 1500VA and 3000 VA.

Following software packages and cables are shipped with each UPS.

1.) Packages for all floorstand UPS

- PY LI UPS 750VA Tower, black S26361-F4542-L75
- PY LI UPS 1500VA Tower, black S26361-F4542-L150

Package is included in each UPS above :

- USB cable for one server connection, 3m cable lengst
- Black cable for the RS232-interface. (COM-signalcable for 1. server)
- Power cord (up to 4x) with IEC 320 C13 connector to the outlet of the UPS
- CD-ROM with PowerChute Business Edition:
OS support and hints please have a look into actual release copatibility chart of APC

2.) Packages for all Rack- / Tower convertible UPS

- PY LI UPS 1500VA R/T A3C40140669: (2U, incl. Network Management card),Rack / Tower convertible
- PY LI UPS 3000VA R/T A3C40140670: (2U, incl. Network Management card),Rack / Tower convertible

Package is included in each UPS above :

- Power cord with IEC320 plug for 1500VA,
- Power cord with IEC309 (CEE 16A blue) for the 3000 VA UPS, fixed connected
- USB cable for one server connection, 3m cable lengst
- Black cable for the RS232-interface. (COM-signalcable for 1. server)
- Power cord (up to 4x) with IEC 320 C13 connector to the outlet of the UPS
- CD-ROM with PowerChute Business Edition V9.x for:
OS support and hints please have a look into actual release copatibility chart of APC
APC Configuration Wizard on CD-Rom
- CD-Rom with PowerChute Network shutdown >= 3.0.x, including 24 Traps on CD for all UPS delivered with Network Management Card
OS support and hints please have a look into actual release copatibility chart of APC

The APC Products are integrated in Server View.

If you use indication over the Network management card, UPS requires only one LAN connector. Cable joints to the servers are required.

Additional components are:

*UPS Network Management adapter for 10/100 Base-T and Telnet connectors,
supports 10/100 Mbit/s autosence and the protocols Telnet, FTP, TFTP, WEB and SNMP

A

Uninterruptible power supply for 230 V

If a UPS (uninterruptible power supply) is installed, one adapter angle up to 150Kg for Fujitsu Racks 700mm wide must be ordered. If you configure a UPS with the System-Architect a adapter angle for the Fujitsu PRIMECENTER- and M1 Rack are added to the order list automatically !

UPS's with integrated **Network Management interface** make the extension of COM signals no longer necessary. Using the Network Management interface the number of nodes/ servers per UPS can easily be raised without increasing the effort in cabling or COM port extensions. For signalling via LAN is necessary only one LAN connection. However the max power of each UPS must be considered as always. A USB signal can be used, instead of the Network Management Card, as long as the respective components are ordered.

For more information about UPS configuration and notes for the UPS power calculation see UPS configurator.

All UPS until 3000VA will be connected with the provided power cord.
For 5000VA, you need a hard wired 1-phase-connector; a power cord is not provided; protection with 25 ampere.

Attention! This UPS does not support 110V - connection

Power cord for following countries:	
1,8m grey 10A	
Only for USV's < 3000 VA possible	
T26139-Y1740-E10	D, A, B, F, NL, FIN, N, S, E, P, RUS, TR
T26139-Y1743-E10	Switzerland
T26139-Y1744-E10	UK, IR
T26139-Y1745-E10	Italy
T26139-Y1746-E10	Denmark
For each UPV can be ordered a power cord.	



For all APC UPS's to 1500 VA you can order country-specific power cords additionally. For the 3000 VA UPS is needed a 16A (IEC320 C20) plug. Here a power cord with safety socket- and UK- plug is provided. The 5000 VA UPS has a 1-phase permanent connection, it must be attached by an electrician.

B

B Tower UPS only

S26361-F4542-L75 PY LI UPS 750VA Effective power 500 W USB and COM Port one Smart Slot Output : 6x IEC320 C13 (10A) Power outlet groups: 1 group non-switched no power cord IEC320 C14 input connector Tower	S26361-F4542-L150 PY LI UPS 1500VA Effective power 1000 W USB and COM Port one Smart Slot Output : 8x IEC320 C13 (10A) Power outlet groups: 2 groups, 1 switched No power cord IEC320 C14 input connector Tower
---	--

i **S26361-F4542-L75**
 750VA not for PRIMERGY 2way Server we recommend to select a 1500VA/1000 W UPS; because high power peaks might be possible when switching over to battery!
 Please pay attention to max. effective power of the attached server system

i No external power cord delivered with UPS
 Please order contry specific power cord

S26361-F4542-L75
S26361-F4542-L150
 for loose delivery

i All UPSs are equipped with the signal cable and the USB / COM port connection for the first server.
 Depending on the UPS the signalling by network require to order the Network Management Card, but no further cable.

S26113-F80-L30
 APC-UPS WEB Management Adapter
 10 / 100 Mbit autosence
 for APC-UPS use one smart slot

Extended Warranty offerings for these Tower UPS

For S26361-F4542-L75 PY LI UPS 750VA

S26361-F4542-L712 WBEXTWAR1YR-SP-02 Extended Warranty 1year for 750VA FJ LI-UPS 1year add-on	S26361-F4542-L722 WBEXTWAR3YR-SP-02 Extended Warranty 3year for 750VA FJ LI-UPS 3year add-on
--	--


For S26361-F4542-L150 PY LI UPS 1500VA

S26361-F4542-L112 WBEXTWAR1YR-SP-03 Extended Warranty 1year for 1500VA FJ LI-UPS 1year add-on	S26361-F4542-L122 WBEXTWAR3YR-SP-03 Extended Warranty 3year for 1500VA FJ LI-UPS 3year add-on
---	---

i **xx month Extended Warranty** – prolongs the Standard Warranty of the UPS (3 years). Need to be purchased within 90 days after UPS was purchased at Fujitsu and requires activation at APC within 30 days thereafter. Warranty cover time is limited to max. 6 years.
Please note: The Extended Warranty does not provide On-Site repair services; it is a material warranty only, but includes the battery.
 Delivery contains documents with warranty information, including the Service Registration Key and the link where to register at APC. Without registration there is no right to claim this service. **Available in all major Fujitsu countries, for details please have a look to the country list.**
 This warranty can be purchased for Fujitsu 750VA / 1500VA Line Interactive Tower UPS.

i Such service extensions are available for following countries, further countries please ask FTS Service Group for an offer:
 AUSTRALIA, AUSTRIA, BELGIUM, CANADA, CHINA, CROATIA, CZECH REPUBLIC, DENMARK, ESTONIA, FINLAND, FRANCE, GERMANY, GREECE, HONG KONG, HUNGARY, INDIA, IRELAND, ITALY, KOREA REPUBLIC OF, LUXEMBOURG, NETHERLANDS, NEW ZEALAND, NORWAY, POLAND, PORTUGAL, ROMANIA, RUSSIAN FEDERATION, SERBIA, SINGAPORE, SLOVAKIA, SOUTH AFRICA, SPAIN, SWEDEN, SWITZERLAND, TAIWAN, PROVINCE OF CHINA, TURKEY, UNITED ARAB EMIRATES, UNITED KINGDOM, UNITED STATES

C

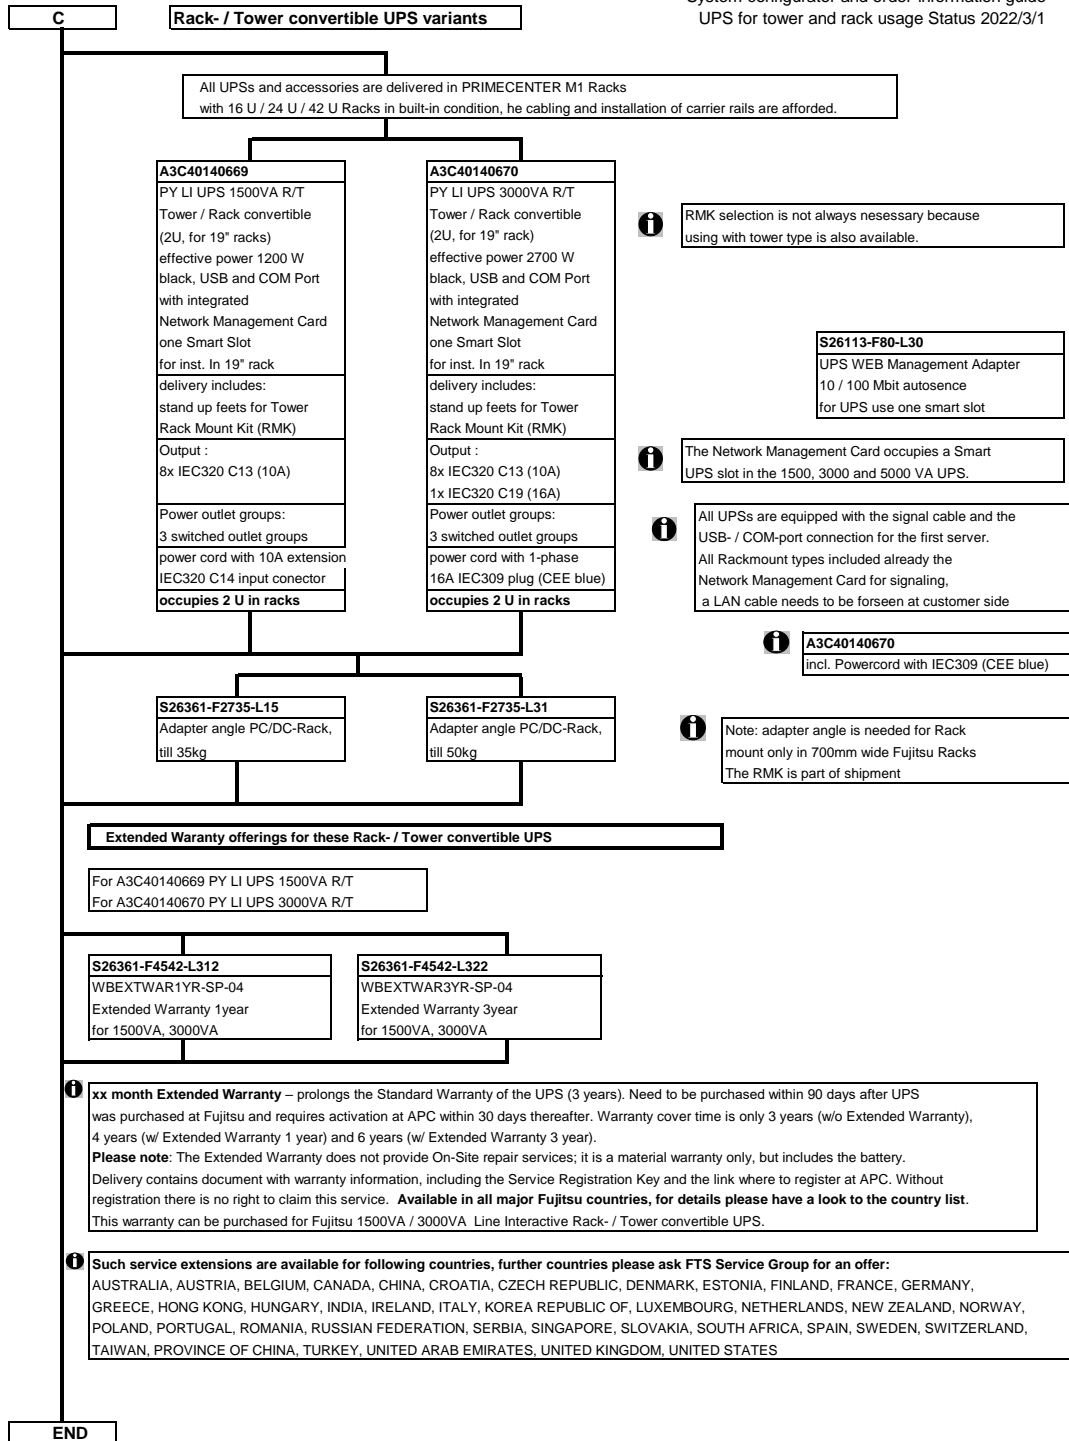

Configuration and Order Options for Uninterruptible Power Supplies (UPSs) with Fujitsu brand logo by APC (American Power Conversion)

- Uninterruptible online power supplies (UPSs) as convertible tower / rack units rated at 3000, 5000, 8000 and 10000 VA.
- as well as external battery extensions for increasing the runtime

Following software packages and cables are shipped with each UPS.

1.) Packages for all online UPS till 10.000 VA

- PY Online UPS 3kVA (Tower / Rack 3U) A3C40178823 (Power cord with IEC309 (CEE 16A blue)plug)
- PY Online UPS 5kVA (Tower / Rack 3U) A3C40178825 (hard wired, 1-phase)
- PY Online UPS 8kVA (Tower / Rack 6U) A3C40178826 (hard wired 1- phase or 3- phase selectable)
- PY Online UPS 10kVA (Tower / Rack 6U) A3C40178827 (hard wired 1- phase or 3- phase selectable)
- PY Online UPS Battery Ext. 3kVA (Tower / Rack 2U) A3C40183787, for PY Online UPS 3KVA
- PY Online UPS Battery Ext. 5kVA (Tower / Rack 3U) A3C40178829, for PY Online UPS 5kVA
- PY Online UPS Battery Ext. 8-10kVA (Tower / Rack 3U) A3C40178830, for PY Online UPS 8KVA and 10kVA

Package is included in each UPS above :

- Power cord with IEC309 (CEE 16A blue) for the 3000 VA , for 5000 VA and above, you need a hard wired single phase connection made by an electrician according to the VDE standards, no power cord is delivered
- Power cord (up to 4x) with IEC 320 C13 connector to the outlet of the UPS
- Power cord (up to 2x) with IEC 320 C19 connector to the outlet of the UPS
- APC Configuration Wizard on CD-Rom
- CD-Rom with PowerChute Network shutdown >= 3.0.1, including 24 Traps on CD for all UPS
OS support and hints please have a look into actual release copatibility chart of APC


The APC Products are integrated in Server View.


For communication and management of UPS a Ethernet connection is required to be connected to the LAN connector.


Signaling and UPS Management via LAN, no serial or USB connections release with this new UPS generation.


USB port is for FW upgrade only.


Power cable joints to the servers are required.

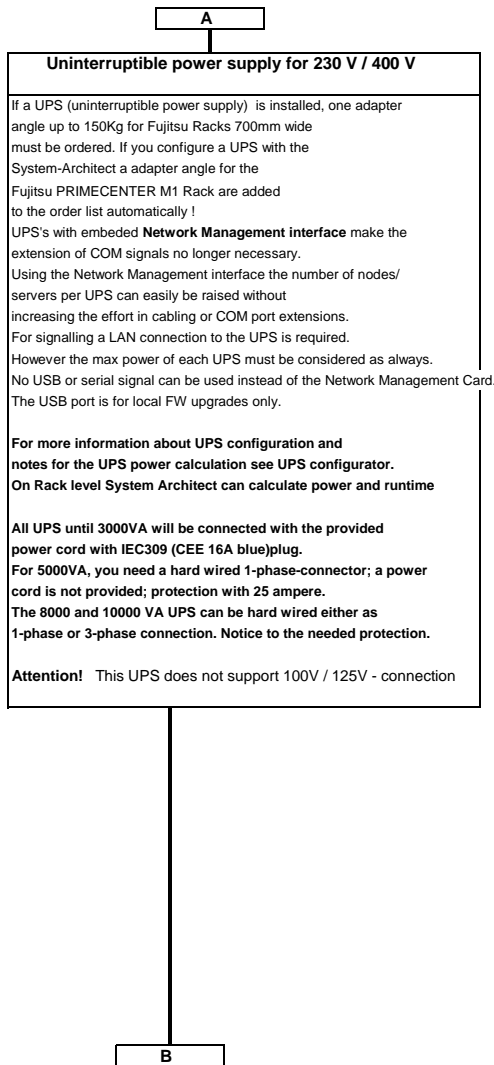

 For the 3000 VA UPS is needed a 16A (IEC320 C20) plug. Here a power cord with IEC309 (16A CEE blue) is provided.
The 5000 VA UPS has a 1-phase permanent connection, it must be attached by an electrician.

 **COM port or USB access is not supported Gen2 Online UPS via LAN port and by PCNS Management SW.**

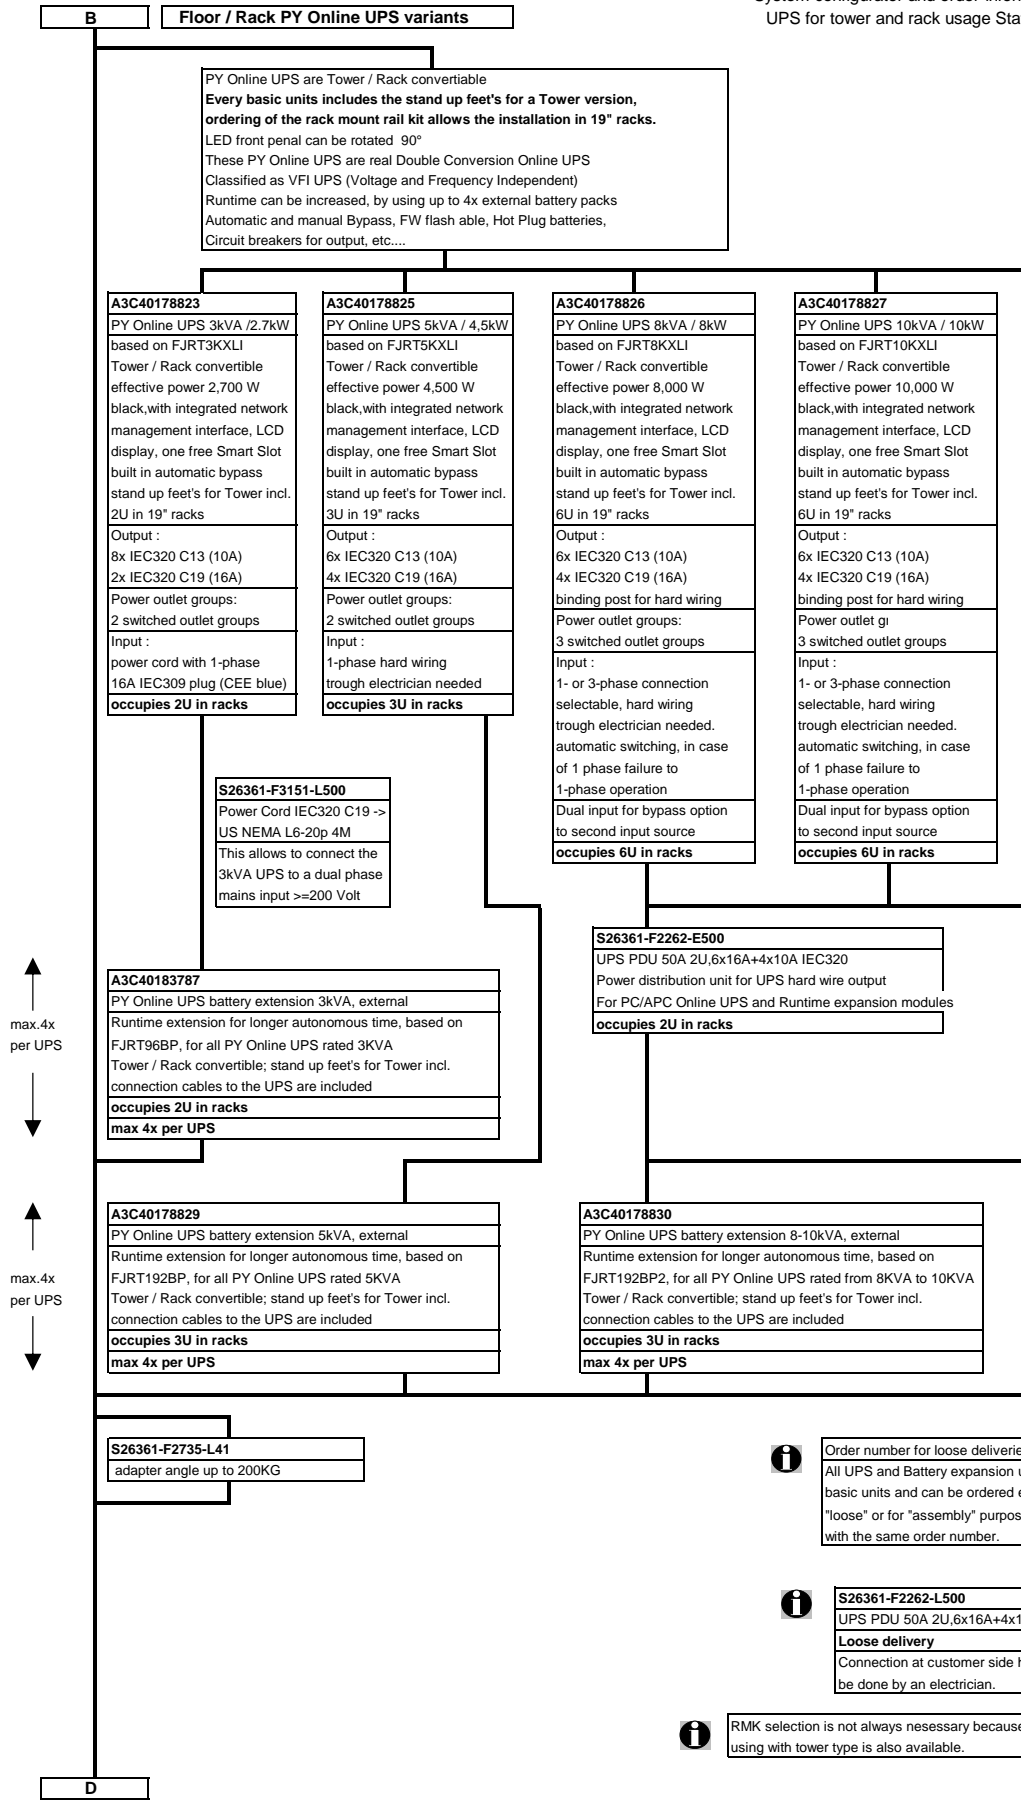

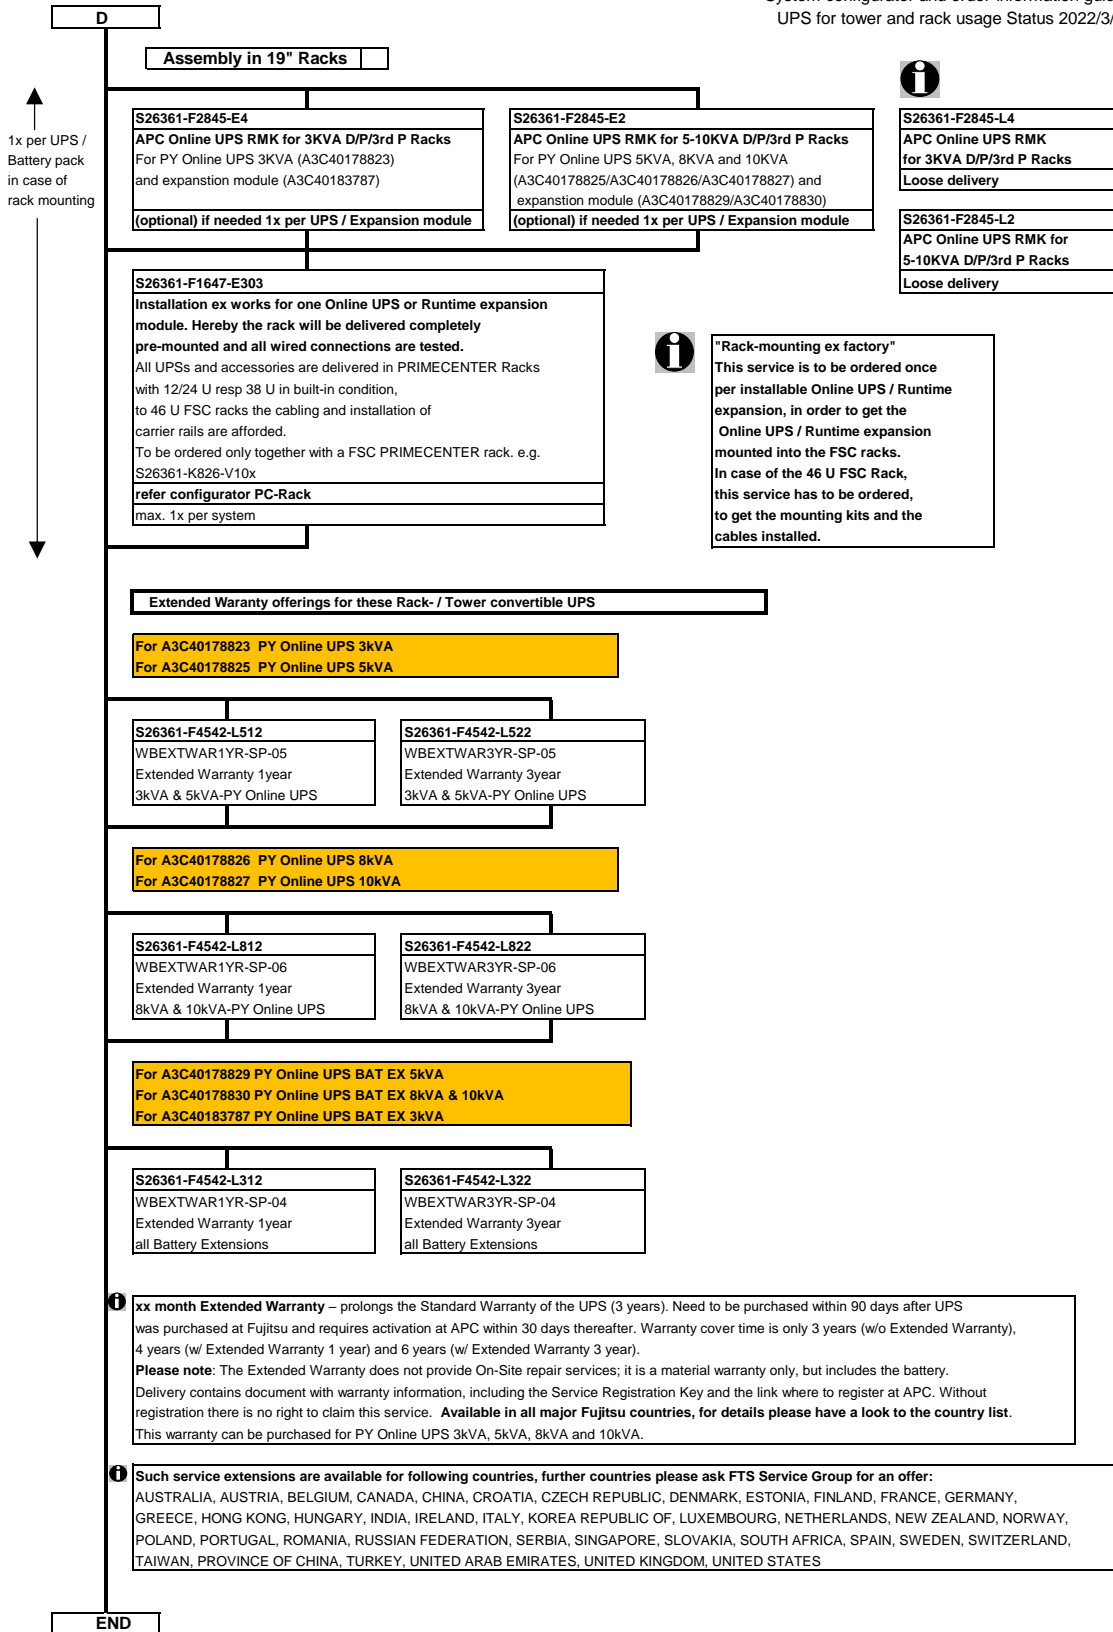

Changereport

Date	Ordernumber	Changes
2022-03-01		Added information for Tower/Rack convertible UPS corrected the description for RMK
2021-04-27	S26361-F1647-E303	Added the order number for Rack installation service
2020-11-02		Order number changed
2019-01-10		EOL products deleted Object products of UPS Warranty Extension corrected OS list updated
2018-03-22		corrected the description for PY Gen2 Online UPS Battery Extension for 3kVA (3U -> 2U)
2017-12-01		corrected the description for UPS Warranty Extension
2017-02-07	S26361-K915-V301	EOL and deleted from configurator
2017-02-07	S26361-F2845-- E2/L2/E4/L4	New RMK added on "Gen2-Online" tab
2016-11-17	S26113-F442-E50	sheet "Line interactive APC" removed; since 2015 no UPS available
2016-11-16	S26361-F4542-L5x2 / S26361-F4542-L8x2	some text errors corrected
2016-01-14	S26361-F4542-L5x2 / S26361-F4542-L8x2	New add-on warranties for PY Online UPS & updates of add-on warranties relations for all LI-UPS / Online UPS
2015-08-12	S26361-K915-V200 / V2	EOL and deleted from configurator
2015-07-10	S26361-K915-V501 / V801 / V100	EOL and deleted from configurator
2014-12-15		updates for EOL / First Release datas
2014-10-28	S26361-K915-V5	Added 3kVA Battery Extension Unit for new GEN2 Online 3KVA UPS
2014-08-15		Extended Renewal warranty will not be released
2014-07-31		Draft first input Gen" Online UPS with Fujitsu front bezel
2014-07-31		EOL hint for 5kVA Line Interactive and 20kVA Online UPS
2013-04-13		added warranty offer for Line Interactive UPS
2012-11-27		complete re-work and added specific OS versions
2011-10-13		Adding new Fujitsu Line Interactive UPS, rework APC UPS
2011-07-27		Delete COM-Port Card, Cables and connections as well as classic Rack support
2011-07-27	S26113-F80-L30	Change S26113-F80-L10 to new card S26113-F80-L30
2010-03-30		new hint for 750 VA UPS
2009-01-15		some minor changes in wordings
2008-10-21		Online UPS without serial management, W2K8 OS added
2008-06-11	S26361-K915-V200 / V2	20kVA UPS and Battery pack added
2008-04-28	S26361-F3151-L500	Power cord for 3kVA UPS and dual phase mains connection added (input >=200Volt)
2008-04-28	S26361-K915-V301	New Online UPS added with DSP (digital signal processor) technology
2008-04-28	S26361-K915-V501	New Online UPS added with DSP (digital signal processor) technology
2008-02-18	S26113-E442-E/L50	New Rack / Tover convertibel UPS added, plus 3U adapetr angle, SW description changed
2006-11-27	S26361-K915-V80	APC -Online UPS rated8.0KVA effective power 6.4 kW - as soon as available
2005-12-20	S26113-F232-E1	APC-UPS COM Cable SCO,UnixWare+ass.PCR - no longer available
2005-12-20	S26113-F82-E1	APC-UPS Slot extension box +assembly PCR - no longer available
2005-06-20		Update OS mapping for interface cabling via RS-232
2005-04-27	S26113-E399-L1	APC-UPS 3000 VA (Floorstand) - no longer available
2004-11-09	S26113-E390-L1	APC - USV with 700VA black, USB and COM Port - no longer available
2004-07-23		Some released operating systems changed
2004-03-24		Some released operating systems changed
2004-02-09	S26113-E390-L750	APC - USV with 750VA black, USB and COM Port - as soon as available
2004-01-26	S26361-K915-V100 / V75	Description connection panel changed
2003-11-14	S26361-K915-V100	APC -Online UPS rated10KVA effective power 8000 W - now available
2003-11-14	S26361-K915-V75	APC -Online UPS rated7.5KVA effective power 6000 W - now available
2003-09-23	SNP:PS-E421E1-P/-L1-P	APC-UPS 3000 VA (3U, for 19" rack) - no longer available
2003-06-25		Online UPS included