



## SDi Decades Extreme HP Specifications

Up to 16 SEER2 / 9.5 HSPF2  
R-410A VARIABLE SPEED  
IoT TECHNOLOGY

### Contents

1. Nomenclature-----	2
2. Dimensions-----	4
3. Product Data-----	6
4. Performance Sheet-----	8



### ■ ODU Features

1. **Comfort.** Side Discharge Inverter (SDi) condensing units output flexible capacity from 28%-130% to achieve your desired temperature – no more, no less.
2. **Quiet.** Compressors are equipped with noise cancelling jacket.
3. **Free match.** SDi Decades Extreme condensing units are compatible with most traditional indoor air handlers / furnaces and 24VAC controlled thermostats.

### ■ Ecoer IoT Features

1. 24/7 monitoring service (Up to 2 months history data on ESS Pro App).
2. Diagnostic and alerts service.
3. ESS Pro App reminds dealers and homeowners of valuable service.

### ■ AHU Features

1. Full Multi-position installation
2. Simplification of air volume adjustment process
2. Easy fault code checking
3. Two front panels (upper and lower) design for ease of maintenance.
4. Nitrogen Charge and Leakage Check Valve
5. Automatic Airflow Adjustment



# 1. Nomenclature

Outdoor Unit	E	S	C	A	16	H	-	36	B	A	A
	1	2	3	4	5	6	7	8	9	10	
<b>Brand</b> E: Ecoer											
<b>Product</b> S: Side Discharge Condensing Unit											
<b>Control Method</b> C: Communicating											
<b>Power</b> A: 208/230V-1Ph-60Hz											
<b>SEER2</b> 16: 16SEER2 Series											
<b>Type</b> H: Heat Pump											
<b>Capacity</b> 36: 3Ton 60: 5Ton											
<b>Series</b> A, B, C etc.											
<b>Refrigerant</b> A: R410-A B: R454-B											
<b>Revisions</b> A, B, C etc.											

Indoor Unit	E	AH	A	E	C	-	36	B	A	A
	1	2	3	4	5	6	7	8	9	
<b>Brand</b> E: Ecoer										
<b>Product</b> AH: Air Handler FC: Fan Coil										
<b>Power</b> A: 208/230V-1Ph-60Hz										
<b>Metering device</b> T: TXV E: EEV										
<b>Control Method</b> N: 24V Non-Communicating C: Communicating										
<b>Capacity</b> 36=3Ton 60=5Ton										
<b>Series</b> A, B, C etc.										
<b>Refrigerant</b> A: R410-A B: R454-B										
<b>Revisions</b> A, B, C etc.										

## 2. Dimensions

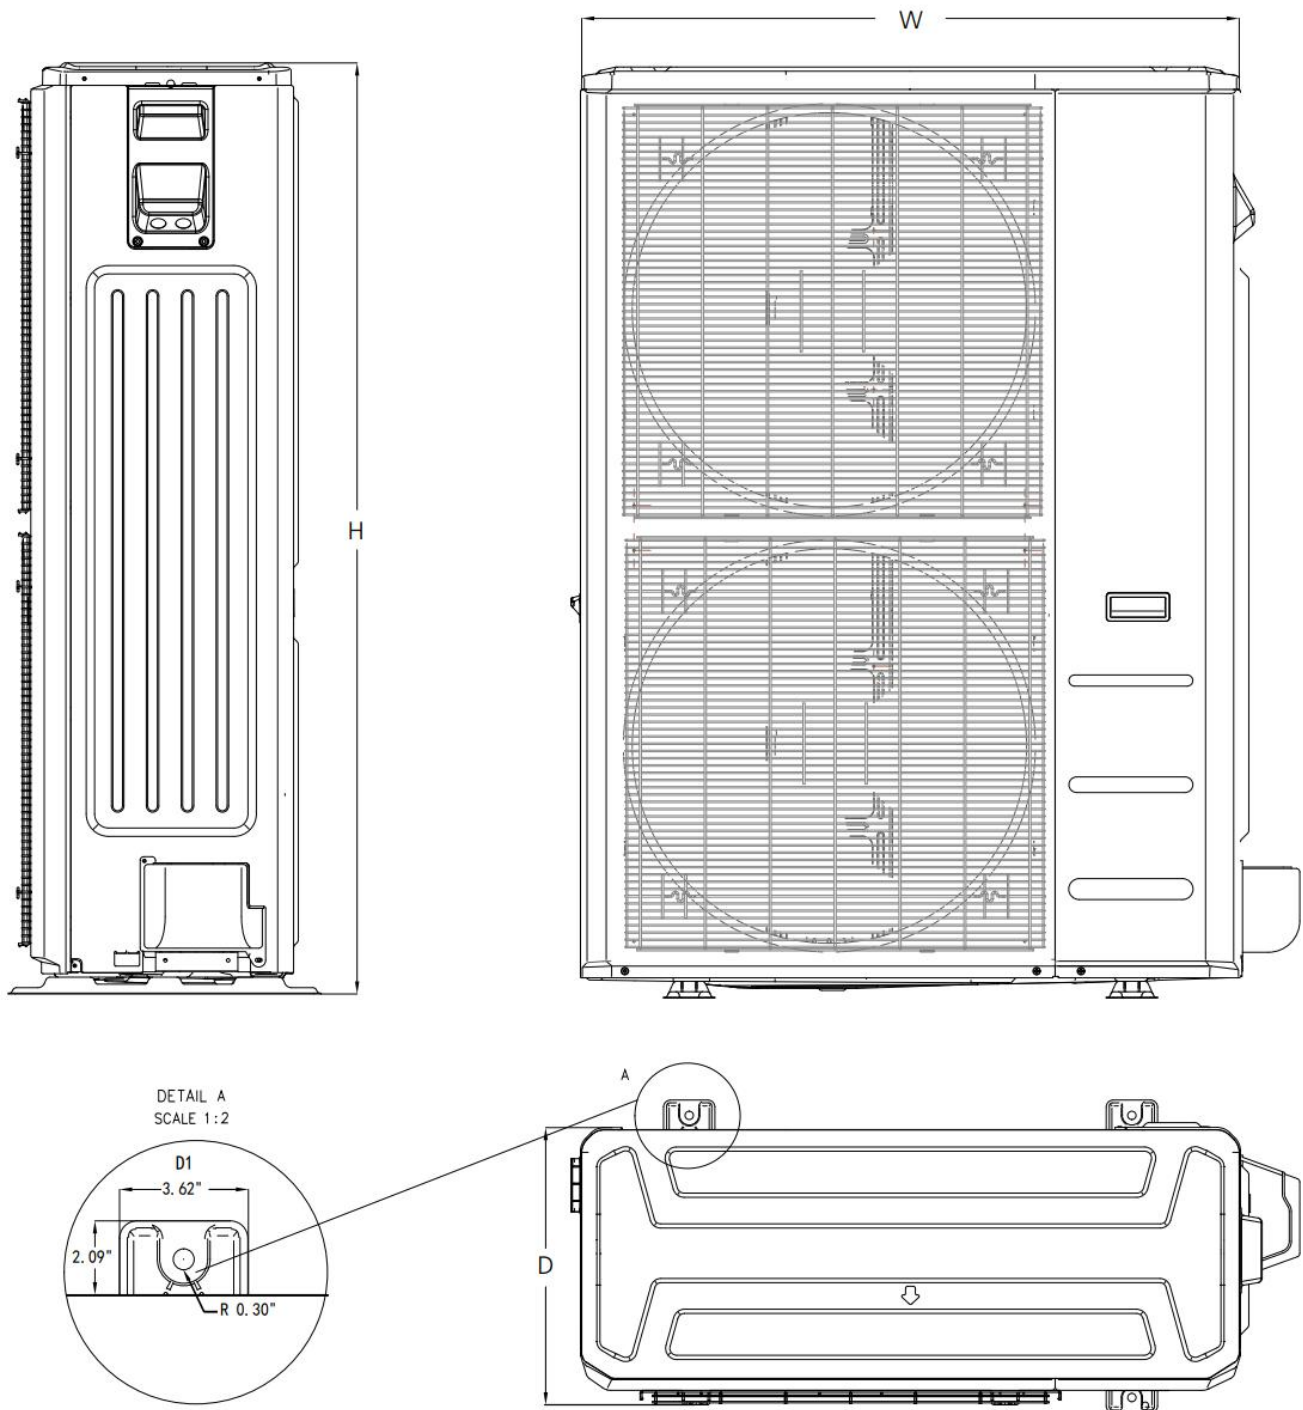


Fig 1. Condensing unit dimensions

Model	Dimensions (In. [mm])		
	H	W	D
36/60	52-1/2 [1333]	37-1/2 [952]	16-11/32 [415]

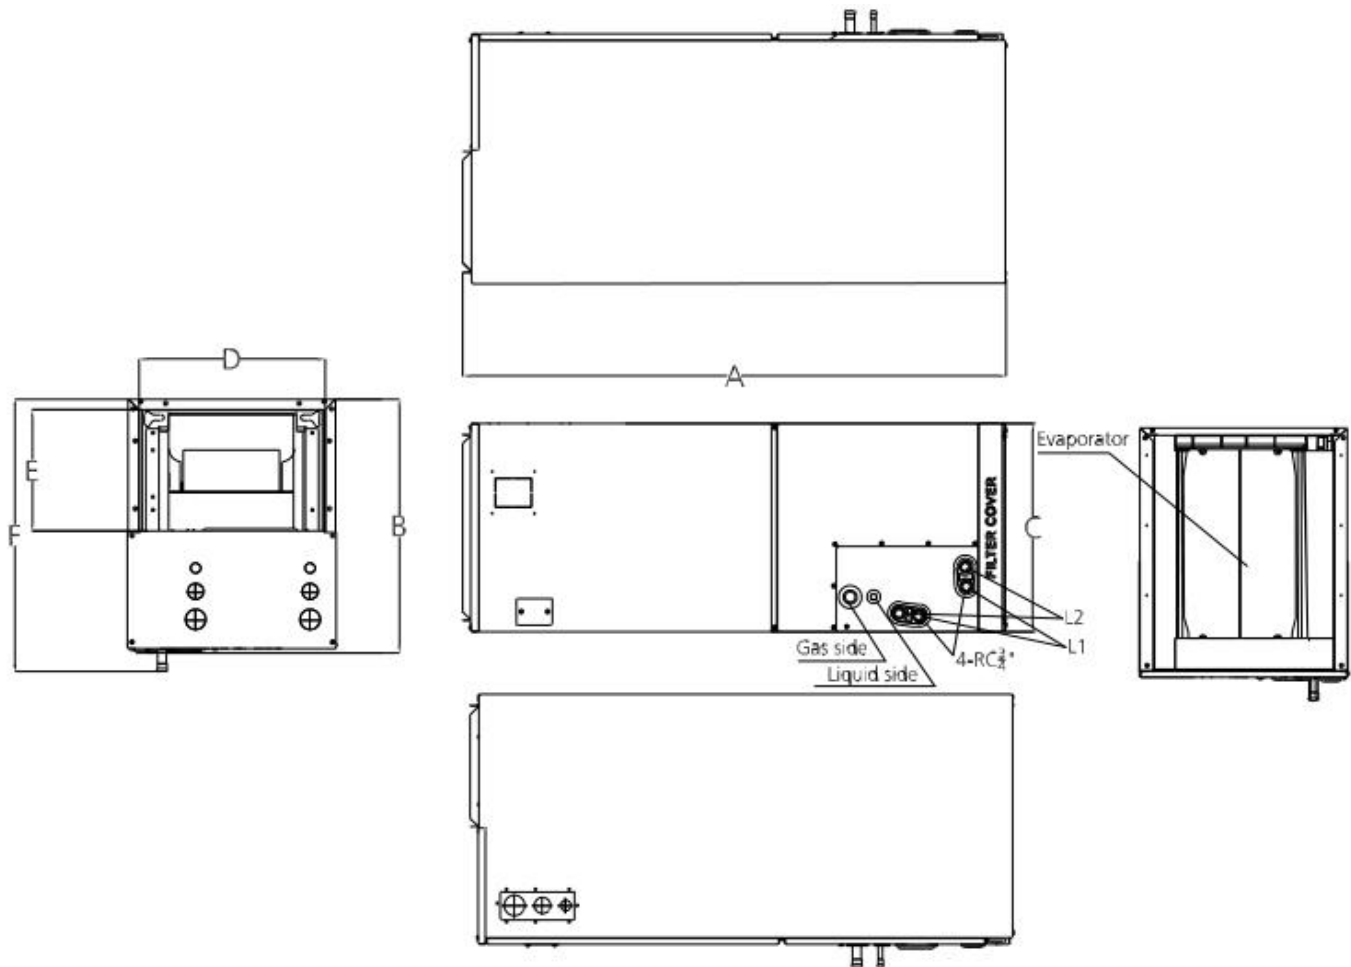


Fig 2. Air handler unit dimensions

Model	Dimension(in.[mm])						Drain hole	
	A	B	C	D	E	F	L1	L2
36k	49 [1245]	21 [534]	21 [534]	19-5/16 [490]	10-1/4 [260]	23 [585]	Primary	Secondary
60K	53 [1346]	21 [534]	24-1/2 [622]	22-7/8 [580]	10-1/4 [260]	23 [585]	Primary	Secondary

### 3. Product Data

Outdoor Unit Model	ESCA16H-36	ESCA16H-60
<b>Combination</b>	<b>3Ton</b>	<b>5Ton</b>
Indoor Unit Model	EAHAEC-36	EAHAEC-60
<b>Capacity</b> <sup>1</sup>		
Cooling (Standard conditions) (BTU/h)	36000	55000
EER2 (BTU/h/W)	10	8.8
SEER2 (BTU/h/W)	16	15.3
Heating (Standard conditions) (BTU/h)	40000	59000
HSPF2 (BTU/h/W)	9.5	9.4
Heating (5°F) (BTU/h)	34400	48500
HSPF (BTU/h/W)	1.97	1.91
<b>Operation limit</b>		
Cooling operation range	5~122°F	5~122°F
Heating operation range	-22~75°F	-22~75°F
<b>Compressor</b>		
RLA	32	26.2
<b>Condenser Fan Motor Qty</b>	2	2
Input (W)	126	126
Output (W)	85	85
RLA	1.2	1.2
<b>Refrigeration System</b>		
Refrigerant Line Size		
Liquid Line Size ("O.D.)	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	7/8"
Refrigerant Connection Size		
Liquid Line Size ("O.D.)	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	7/8"
Cooling Metering Device (Indoor Side)	EEV	EEV
Heating Metering Device	EEV	EEV
Maximum Line Length	213.25FT	213.25FT
Maximum Elevation Difference	98.4FT	98.4FT
<b>Electrical Data</b>		
Voltage-Phase-Hz	208/230-1-60	208/230-1-60
Minimum Circuit Ampacity <sup>2</sup>	41	42
Max. Over-current Protection <sup>3</sup>	50	60
Allowed Volts Range	187~253	187~253
<b>Condenser Decibels [dB(A)]<sup>4</sup></b>	64	63.5
<b>Equipment Weight (lbs)</b>	227	240
<b>Ship Weight (lbs)<sup>5</sup></b>	255.7	271.6

#### REMARKS:

1. Tested and rated in accordance with AHRI Standard 210/240-2022.
2. Wire size should be determined in accordance with National Electrical Codes.
3. Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.
4. It may vary based on the actual installation status.
5. Weight shown includes packaging.

The constant airflow volume motor is applied .So the airflow volume is constant at all ESP within stated range

Capacity	External Static Pressure Range	Fan Speed	Electric Heater kit	24V Thermostat		Wired controller		Air Flow (CFM)
				DIP Switch	24V Terminal engaged	Dip Switch	Mode	
36K	0-0.8 in.wg.	Cooling Turbo	-	SW3-4=ON	Y2/Y	-	Cool	<b>1188</b>
		Cooling High	-	SW3-4=OFF	Y2/Y	-	Cool	<b>1082</b>
		Cooling Medium	-	-	Y1	-	Cool	<b>971</b>
		Cooling Low	-	-	-	-	Cool	<b>865</b>
		Heating Turbo	-	-	-	-	Heat	<b>1112</b>
		Heating High	-	-	B+Y2/Y, W	-	Heat	<b>1059</b>
		Heating Medium	-	-	Y1	-	Heat	<b>794</b>
		Heating Low	-	-	-	-	Heat	<b>582</b>
		E-heater 0 (Default)	20kW	SW4-1=OFF SW4-2=OFF SW4-3=OFF	W1, W2, AUX	SW4-1=OFF SW4-2=OFF SW4-3=OFF	Heat+AUX, AUX	<b>1306</b>
		E-heater 1	15kW	SW4-1=OFF SW4-2=OFF SW4-3=ON	W1, W2, AUX	SW4-1=OFF SW4-2=OFF SW4-3=ON	Heat+AUX, AUX	<b>1241</b>
		E-heater 2	8/10kW	SW4-1=OFF SW4-2=ON SW4-3=OFF	W1, W2, AUX	SW4-1=OFF SW4-2=ON SW4-3=OFF	Heat+AUX, AUX	<b>1176</b>
		E-heater 3	5/8kW	SW4-1=OFF SW4-2=ON SW4-3=ON	W1, W2, AUX	SW4-1=OFF SW4-2=ON SW4-3=ON	Heat+AUX, AUX	<b>1112</b>
60K	0-0.8 in.wg.	Cooling Turbo	-	SW3-4=ON	Y2/Y	-	Cool	<b>1806</b>
		Cooling High	-	SW3-4=OFF	Y2/Y	-	Cool	<b>1582</b>
		Cooling Medium	-	-	Y1	-	Cool	<b>1359</b>
		Cooling Low	-	-	-	-	Cool	<b>1135</b>
		Heating Turbo	-	-	-	-	Heat	<b>1659</b>
		Heating High	-	-	B+Y2/Y, W	-	Heat	<b>1582</b>
		Heating Medium	-	-	Y1	-	Heat	<b>1247</b>
		Heating Low	-	-	-	-	Heat	<b>976</b>
		E-heater 0 (Default)	25kW	SW4-1=OFF SW4-2=OFF SW4-3=OFF	W1, W2, AUX	SW4-1=OFF SW4-2=OFF SW4-3=OFF	Heat+AUX, AUX	<b>2171</b>
		E-heater 1	15/20kW	SW4-1=OFF SW4-2=OFF SW4-3=ON	W1, W2, AUX	SW4-1=OFF SW4-2=OFF SW4-3=ON	Heat+AUX, AUX	<b>2029</b>
		E-heater 2	10/15kW	SW4-1=OFF SW4-2=ON SW4-3=OFF	W1, W2, AUX	SW4-1=OFF SW4-2=ON SW4-3=OFF	Heat+AUX, AUX	<b>1894</b>
		E-heater 3	10kW	SW4-1=OFF SW4-2=ON SW4-3=ON	W1, W2, AUX	SW4-1=OFF SW4-2=ON SW4-3=ON	Heat+AUX, AUX	<b>1753</b>

## 4. Performance Sheet

COOLING-3TON

Cooling	Indoor Conditions		65°F (18.3°C)			70°F (21.1°C)			75°F (23.9°C)			80°F (26.7°C)		
	WB		54°F (12.2°C)			59°F (15°C)			63°F (17.2°C)			67°F (19.4°C)		
	Capacity		TC	SC	Input	TC	SC	Input	TC	SC	Input	TC	SC	Input
Outdoor conditions (DB)	5°F	-15°C	43.37	30.69	1.84	45.42	31.97	1.81	47.56	33.31	1.79	49.54	34.48	1.78
	17°F	-8.3°C	46.07	33.00	2.17	48.50	34.58	2.16	51.48	36.53	2.18	54.02	38.14	2.18
	25°F	-3.9°C	45.81	33.24	2.46	48.68	35.12	2.47	51.13	36.70	2.46	53.88	38.47	2.47
	35°F	1.7°C	45.96	33.40	2.78	48.43	35.01	2.81	51.14	36.77	2.83	53.72	38.41	2.81
	47°F	8.3°C	43.48	33.19	2.68	46.16	35.03	2.68	48.85	36.84	2.71	51.80	38.85	2.73
	55°F	12.8°C	44.75	33.58	2.86	47.01	35.05	2.86	48.97	36.33	2.85	51.66	38.12	2.85
	65°F	18.3°C	43.60	33.58	2.99	45.56	34.90	2.95	48.42	36.89	2.96	51.51	38.99	2.98
	75°F	24°C	43.72	34.11	3.08	46.41	35.99	3.14	48.86	37.65	3.15	51.37	39.40	3.13
	80°F	26.7°C	43.27	33.18	3.21	45.83	34.96	3.24	48.25	36.63	3.24	51.22	38.67	3.27
	85°F	29.4°C	41.80	32.94	3.94	44.24	34.64	3.97	46.66	36.37	4.00	49.48	38.35	5.19
	95°F	35°C	40.50	32.99	5.56	43.04	34.90	5.59	45.02	36.34	5.61	47.49	38.09	5.56
	105°F	40.5°C	38.78	32.91	5.46	40.61	34.26	5.46	42.70	35.79	5.48	45.33	37.81	5.56
	110°F	43.3°C	36.03	32.19	5.51	38.13	33.85	5.48	40.18	35.45	5.44	42.74	37.49	5.45
	115°F	46°C	33.24	30.90	5.62	34.88	32.22	5.61	36.99	33.99	5.64	39.02	35.62	5.60
122°F	50°C	29.84	29.73	5.80	31.54	31.30	5.78	33.31	32.92	5.75	34.84	34.28	5.69	

TC: Total capacity (MBH)

SC: Sensible capacity (MBH)

DB: Dry bulb

WB: Wet bulb



COOLING-5TON

Cooling	Indoor Conditions		DB	65°F (18.3°C)			70°F (21.1°C)			75°F (23.9°C)			80°F (26.7°C)		
			WB	54°F (12.2°C)			59°F (15°C)			63°F (17.2°C)			67°F (19.4°C)		
	Capacity		TC	SC	Input	TC	SC	Input	TC	SC	Input	TC	SC	Input	
Outdoor conditions (DB)	5°F	-15°C	48.92	33.71	2.70	52.04	35.68	2.72	55.01	37.53	2.73	57.67	39.16	2.72	
	17°F	-8.3°C	54.46	38.37	3.31	56.73	39.75	3.24	59.65	41.54	3.24	62.79	43.45	3.22	
	25°F	-3.9°C	54.73	39.46	3.44	57.01	40.92	3.43	59.51	42.49	3.38	63.24	44.90	3.40	
	35°F	1.7°C	55.00	40.74	3.71	58.44	43.02	3.70	61.07	44.68	3.69	63.68	46.36	3.64	
	47°F	8.3°C	53.23	39.24	3.79	56.56	41.47	3.82	59.42	43.35	3.81	62.41	45.31	3.80	
	55°F	12.8°C	53.37	40.20	4.01	56.07	41.97	4.00	59.39	44.24	4.05	62.32	46.18	4.04	
	65°F	18.3°C	54.08	41.46	4.29	56.39	42.97	4.28	59.11	44.79	4.30	62.22	46.85	4.31	
	75°F	24°C	53.65	42.98	4.62	56.36	44.88	4.64	58.77	46.57	4.62	62.12	48.95	4.62	
	80°F	26.7°C	53.29	42.20	5.05	55.98	44.11	5.03	58.93	46.19	5.05	62.03	48.38	5.03	
	85°F	29.4°C	49.35	38.65	5.45	52.22	40.70	5.50	55.56	43.06	5.51	59.10	45.57	6.09	
	95°F	35°C	48.35	38.46	6.45	50.42	39.91	6.37	53.58	42.22	6.50	56.40	44.16	6.45	
	105°F	40.5°C	45.89	38.09	6.41	48.56	40.07	6.39	50.69	41.57	6.37	53.41	43.59	6.36	
	110°F	43.3°C	42.52	37.80	6.34	45.19	39.97	6.37	47.92	42.16	6.34	50.76	44.42	6.32	
	115°F	46°C	41.09	38.36	6.57	43.03	39.95	6.61	45.06	41.56	6.51	47.23	43.36	6.47	
122°F	50°C	36.47	36.41	6.45	38.11	37.88	6.44	39.78	39.37	6.44	42.05	41.46	6.49		

TC: Total capacity (MBH)

SC: Sensible capacity (MBH)

DB: Dry bulb

WB: Wet bulb

## HEATING-3TON

Heating	Indoor Conditions (DB)		60°F (15.6°C)		65°F (18.3°C)		70°F (21.1°C)		75°F (23.9°C)	
			TC	Input	TC	Input	TC	Input	TC	Input
Outdoor conditions (DB)	-22°F	-30°C	22.99	4.73	22.25	4.87	21.50	5.00	20.60	5.14
	-13°F	-25°C	26.97	4.59	26.32	4.70	25.50	4.82	24.35	4.95
	-4°F	-20°C	31.48	5.06	30.41	5.19	29.50	5.34	28.47	5.50
	0°F	-17.8°C	34.14	4.98	33.11	5.10	32.02	5.25	30.77	5.39
	5°F	-15°C	36.32	4.87	35.33	4.99	34.40	5.12	33.02	5.29
	10°F	-12.2°C	41.29	5.48	40.01	5.64	38.66	5.78	36.96	5.94
	17°F	-8.3°C	45.58	6.09	44.08	6.27	42.84	6.44	41.00	6.60
	20°F	-6.7°C	46.09	5.74	44.61	5.88	43.19	6.03	41.29	6.22
	25°F	-3.9°C	46.22	5.43	44.66	5.54	43.52	5.69	41.78	5.83
	32°F	0°C	46.67	5.16	45.40	5.30	43.86	5.41	42.15	5.60
	35°F	1.7°C	46.87	4.88	45.37	4.99	44.18	5.14	42.23	5.28
	40°F	4.4°C	54.10	5.20	52.73	5.35	51.09	5.48	48.80	5.62
	47°F	8.3°C	60.54	5.40	58.66	5.53	57.23	5.69	54.88	5.83
	50°F	10°C	61.77	5.21	60.20	5.37	58.67	5.52	56.33	5.66
57°F	13.9°C	64.06	5.16	62.19	5.28	60.09	5.41	57.69	5.58	

## HEATING-5TON

Heating	Indoor Conditions (DB)		60°F (15.6°C)		65°F (18.3°C)		70°F (21.1°C)		75°F (23.9°C)	
			TC	Input	TC	Input	TC	Input	TC	Input
Outdoor conditions (DB)	-22°F	-30°C	31.60	6.21	30.80	6.35	29.96	6.51	28.82	6.71
	-13°F	-25°C	45.80	6.48	44.68	6.68	43.51	6.88	41.64	7.11
	-4°F	-20°C	50.53	6.78	48.92	6.94	47.59	7.14	45.83	7.35
	0°F	-17.8°C	52.96	7.08	51.41	7.23	49.67	7.40	47.44	7.59
	5°F	-15°C	55.31	7.31	53.80	7.51	51.98	7.69	49.90	7.94
	10°F	-12.2°C	58.97	7.37	57.20	7.56	55.69	7.79	53.69	8.00
	17°F	-8.3°C	63.23	7.38	61.33	7.57	59.48	7.80	57.40	8.04
	20°F	-6.7°C	62.47	6.96	60.77	7.11	59.17	7.31	56.63	7.53
	25°F	-3.9°C	62.63	6.59	60.74	6.73	58.86	6.88	56.68	7.08
	32°F	0°C	62.28	6.23	60.23	6.37	58.53	6.50	56.13	6.70
	35°F	1.7°C	62.27	5.81	60.22	5.96	58.19	6.14	55.98	6.33
	40°F	4.4°C	68.07	5.76	66.41	5.92	64.47	6.05	61.83	6.21
	47°F	8.3°C	74.29	5.63	71.78	5.76	69.83	5.89	67.24	6.07
	50°F	10°C	75.95	5.42	73.52	5.55	71.45	5.70	68.88	5.86
57°F	13.9°C	77.71	5.28	75.22	5.43	73.32	5.59	70.17	5.76	

## Capacity Corrections

The system can extend the line sets flexibly within its limitation to fit the actual situation. However, it will cause cooling/heating capacity decrease because of the pressure loss by longer line length. Using the following correction factor to calculate the approximate capacity accordingly.

SUCTION LINE LENGTH/SIZE VS CAPACITY MULTIPLIER (R-410A)

Capacity (Btu/h)	36k		Pipe Length (m/ft)					
Cooling			7.5/24.6	15/49.2	25/82	35/114.8	50/164	65/213.3
Height difference H(m/ft)	Indoor Upper than Outdoor	30/98.4	/	/	/	0.889	0.850	0.812
		20/65.6	/	/	0.924	0.898	0.859	0.820
		10/32.8	/	0.959	0.933	0.907	0.868	0.828
		5/16.4	0.995	0.969	0.942	0.916	0.876	0.837
	0		1.000	0.974	0.947	0.921	0.881	0.841
	Outdoor Upper than Indoor	-5/-16.4	1.000	0.974	0.947	0.921	0.881	0.841
		-10/-32.8	/	0.974	0.947	0.921	0.881	0.841
		-20/-65.6	/	/	0.947	0.921	0.881	0.841
-30/-98.4		/	/	/	0.921	0.881	0.841	
Heating			7.5/24.6	15/49.2	25/82	35/114.8	50/164	65/213.3
Height difference H(m/ft)	Indoor Upper than Outdoor	30/98.4	/	/	/	0.964	0.945	0.927
		20/65.6	/	/	0.976	0.964	0.945	0.927
		10/32.8	/	0.988	0.976	0.964	0.945	0.927
		5/16.4	1.000	0.988	0.976	0.964	0.945	0.927
	0		1.000	0.988	0.976	0.964	0.945	0.927
	Outdoor Upper than Indoor	-5/-16.4	0.992	0.980	0.968	0.956	0.938	0.920
		-10/-32.8	/	0.972	0.960	0.948	0.930	0.912
		-20/-65.6	/	/	0.952	0.941	0.923	0.905
-30/-98.4		/	/	/	0.933	0.915	0.898	
Capacity (Btu/h)	60k		Pipe Length (m/ft)					
Cooling			7.5/24.6	15/49.2	25/82	35/114.8	50/164	65/213.3
Height difference H(m/ft)	Indoor Upper than Outdoor	30/98.4	/	/	/	0.870	0.823	0.775
		20/65.6	/	/	0.911	0.879	0.831	0.783
		10/32.8	/	0.953	0.920	0.888	0.840	0.791
		5/16.4	0.995	0.962	0.930	0.897	0.848	0.799
	0		1.000	0.967	0.934	0.902	0.852	0.803
	Outdoor Upper than Indoor	-5/-16.4	1.000	0.967	0.934	0.902	0.852	0.803
		-10/-32.8	/	0.967	0.934	0.902	0.852	0.803
		-20/-65.6	/	/	0.934	0.902	0.852	0.803
-30/-98.4		/	/	/	0.902	0.852	0.803	
Heating			7.5/24.6	15/49.2	25/82	35/114.8	50/164	65/213.3
Height difference H(m/ft)	Indoor Upper than Outdoor	30/98.4	/	/	/	0.955	0.932	0.909
		20/65.6	/	/	0.970	0.955	0.932	0.909
		10/32.8	/	0.985	0.970	0.955	0.932	0.909
		5/16.4	1.000	0.985	0.970	0.955	0.932	0.909
	0		1.000	0.985	0.970	0.955	0.932	0.909
	Outdoor Upper than Indoor	-5/-16.4	0.992	0.977	0.962	0.947	0.924	0.902
		-10/-32.8	/	0.969	0.954	0.939	0.917	0.895
		-20/-65.6	/	/	0.947	0.932	0.910	0.887
-30/-98.4		/	/	/	0.924	0.902	0.880	

Fig 4. Line length and elevation difference limits

©2023 ECOER INC.

43671 Trade Center Place, Suite 100  
Dulles, VA 20166

Tel: 703-348-2538

[www.ecoer.com](http://www.ecoer.com)