



Tennessee Valley Authority, Post Office Box 2000, Decatur, Alabama 35609-2000

September 26, 2005

10 CFR 50.55a

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Mail Stop: OWFN P1-35
Washington, D.C. 20555-0001

Gentlemen:

In the Matter of) Docket No. 50-296
Tennessee Valley Authority)

BROWNS FERRY NUCLEAR PLANT (BFN) - UNIT 3 - AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME) SECTION XI, INSERVICE INSPECTION (ISI) PROGRAM, SECOND TEN-YEAR INSPECTION INTERVAL - REQUESTS FOR RELIEF 3-ISI-7, REVISION 1, 3-ISI-12, AND 3-ISI-19 - RESPONSE TO NRC REQUEST FOR ADDITIONAL INFORMATION (TAC NOS. MC6314, MC6386, AND MC6387)

This letter provides the TVA response to an NRC request for additional information regarding BFN Unit 3, ASME Section XI Inservice Inspection (ISI) Program, requests for relief 3-ISI-7, Revision 1, 3-ISI-12, and 3-ISI-19. These requests for relief were submitted by TVA letter dated March 4, 2005 for NRC review and approval.

Request for relief 3-ISI-7, Revision 1, addressed ten (10) Reactor Pressure Vessel (RPV) nozzle-to-vessel full penetration welds and one (1) nozzle inner radius. The design configuration of the RPV nozzle-to-vessel and inner-radius welds precluded a 100 percent ultrasonic (UT) examination of the required volume for the full penetration welds of the nozzles.

Request for relief 3-ISI-12 addressed three Residual Heat Removal System, and one Reactor Water Cleanup System full penetration austenitic stainless steel piping welds. An ultrasonic examination was performed for these piping welds of the accessible areas, to the maximum extent practical, due to the configuration. Credit for the one-sided only ultrasonic examination provided 50 percent coverage because of a recently added requirement in 10 CFR 50.55a(b)(2)(xv)(A)(2), which

A047

U.S. Nuclear Regulatory Commission
Page 2
September 26, 2005


states in part, "Where examination from both sides is not possible on austenitic welds, full coverage credit from a single side may be claimed only after completing a successful single sided Appendix VIII demonstration using flaws on the opposite side of the weld...." At this time, there is no Appendix VIII Program for single sided austenitic welds nor is one planned in the future; therefore, only 50 percent coverage can be claimed. Under the original ASME Section XI Code requirements [prior to 10 CFR 50.55a(b)(2)(xv)(A)(2)], UT coverage attained was essentially 100 percent.

Request for relief 3-ISI-19 addresses three reactor pressure vessel (RPV) longitudinal shell welds. These RPV shell welds did not receive essentially (i.e., greater than 90 percent) 100 percent coverage due to obstructions from other components.

The enclosure to this letter contains the specific NRC questions and the corresponding TVA response.

There are no new regulatory commitments in this letter. If you have any questions, please contact me at (256) 729-2636.

Sincerely,



William D. Crouch
Manager of Licensing
and Industry Affairs

cc: See Page 3

U.S. Nuclear Regulatory Commission
Page 3
September 26, 2005

Enclosure

cc (Enclosure):

(Via NRC Electronic Distribution)

Mr. Stephen J. Cahill, Branch Chief
U.S. Nuclear Regulatory Commission
Region II
Sam Nunn Atlanta Federal Center
61 Forsyth Street, SW, Suite 23T85
Atlanta, Georgia 30303-8931

NRC Resident Inspector
Browns Ferry Nuclear Plant
10833 Shaw Road
Athens, Alabama 35611-6970

Ms. Eva A. Brown, Project Manager
U.S. Nuclear Regulatory Commission
One White Flint, North
(MS 08G9)
11555 Rockville Pike
Rockville, Maryland 20852-2739

Ms. Margaret Chernoff, Project Manager
U.S. Nuclear Regulatory Commission
One White Flint, North
(MS 08G9)
11555 Rockville Pike
Rockville, Maryland 20852-2739

ENCLOSURE

TENNESSEE VALLEY AUTHORITY
BROWNS FERRY NUCLEAR PLANT (BFN)
UNIT 3
AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME) SECTION XI,
INSERVICE INSPECTION (ISI) PROGRAM
(SECOND TEN-YEAR INSPECTION INTERVAL)

REQUEST FOR RELIEF 3-ISI-7, REVISION 1, 3-ISI-12, AND 3-ISI-19
RESPONSE TO NRC REQUEST FOR ADDITIONAL INFORMATION

This enclosure provides TVA's response to an NRC request for additional information regarding BFN Unit 3, ASME Section XI Inservice Inspection (ISI) Program, requests for relief 3-ISI-7, Revision 1, 3-ISI-12, and 3-ISI-19. These requests for relief were submitted by TVA letter dated March 4, 2005 for NRC review and approval.

Request for relief 3-ISI-7, Revision 1, addressed ten (10) Reactor Pressure Vessel (RPV) nozzle-to-vessel full penetration welds and one (1) nozzle inner radius.

Request for relief 3-ISI-12 addressed three Residual Heat Removal System, and one Reactor Water Cleanup System full penetration austenitic stainless steel piping welds.

Request for relief 3-ISI-19 addressed three reactor pressure vessel (RPV) longitudinal shell welds.

Listed below are the NRC specific questions and the corresponding TVA response.

1.0, Request for Relief 3-ISI-7, Revision 1

NRC Request 1.1

Typically, there can be significant changes between the design drawings and the as-built conditions of plant components. Clarify whether the design drawings represent as-built configurations. State whether the actual as-built dimensions and curvatures that exist on the surfaces, such as the inner radius and outside weld crowns, are accurately depicted on the submitted drawings. Include whether the outside surface weld crowns are ground flush in the blend radius regions, and if possible, provide a surface roughness finish value (in root mean square units), for the reactor pressure vessel (RPV) base metal and nozzle-to-vessel welds. How do the Browns Ferry Nuclear Plant (BFN), Unit 3, nozzle-to-vessel weld as-built configurations compare to conditions on the representative specimens used during the Electric Power Research Institution (EPRI) Performance Demonstration Initiative (PDI) qualification?

TVA Response to NRC Request 1.1

The design drawings represent the basic as-built configurations of the Unit 3 Reactor Pressure Vessel in the plant. The manufacturer design drawings depict specified dimensions (linear, angular, and radii dimensions), with tolerances specified. These dimensions were verified and documented during the manufacturing process of the vessel by the vendor. The design drawings also contained specific surface finish requirements for machined and welded surfaces. Machined surfaces require a 250 finish or better unless otherwise noted. All welds to be suitable for Non-Destructive Testing with all offsets blended to a 3:1 taper (minimum). The drawings specified minimum radius dimensions for the nozzle to shell weld. To obtain this, the welds were machined and ground flush with the vessel and into the radius blend of the nozzle on the outside of the vessel.

Note: The examinations performed during BFN Unit 3 Cycle 10 refueling outage (Spring 2002) were performed prior to the implementation of the "Final Rule" and did not use ASME Section XI, Appendix VIII qualification criteria (see Attachment A). Examination of Weld N10-IR was conducted using PDI qualified examination criteria. A comparison of the EPRI specimens versus the BFN Unit 3 N10-IR revealed the following:

- The smallest EPRI nozzle specimen has an inner radius dimension of 2.9" and an I.D. Bore dimension of 3.94".
- The BFN Unit 3 N10-IR has an inner radius dimension of 0.75 inches and an I.D. Bore dimension of 1.95 inches.

The qualified procedure utilized the alternative method described in Code Case N-552, with the conditions specified in Regulatory Guide 1.147, Revision 13, January 2004.

NRC Request 1.2

Describe the ultrasonic methods that were used, including wave propagation modes and angles of interrogation.

TVA Response to NRC Request 1.2

RPV NOZZLE TO SHELL WELD	NDE REPORT No.	CYCLE NUMBER	COVERAGE
N1B-NV	R-156	10	77%
N2A-NV	R-158	10	77%
N2C-NV	R-160	10	77%
N2E-NV	R-162	10	77%
N3A-NV	R-164	10	77%
N4A-NV	R-166	10	77%
N4F-NV	R-168	10	77%
N5B-NV	R-170	10	71%
N7-NV	R-125	10	70%
N9-NV	R-172	10	74%
N10-Inner Radius	R-188	11	90%

See Attachment A for the above listed Inspection Reports.

NRC Request 1.3

Submit cross-sectional sketches showing the completed ultrasonic examination volumes for each wave mode and angle used on the subject nozzles. Include in these sketches the required ASME Code examination volumes and state whether the sketches represent the entire circumferential length of the welds, or show limitations to these coverages for specific regions of the welds. Are there any as-built conditions that may impact the examination coverages? Using the sketches and coverages illustrated, describe how the coverage values shown in 3-ISI-7, Revision 1, Table 1 were generated.

TVA Response to NRC Request 1.3

See attached nondestructive examination reports (see table above for report number)

2.0, Request for Relief 3-ISI-12

NRC Request 2.1

Clearly state the base material type(s) and fabrication forms for each of the subject piping welds. For example, for Weld TRHR-3-191, clarify whether this is a statically cast or austenitic valve welded to a statically cast austenitic elbow, or a statically cast valve welded to a wrought elbow.

TVA Response to NRC Request 2.1

Listed below are the base material type(s) and fabrication forms for each of the subject piping welds listed in 3-ISI-12.

DRHR-3-19 - 20" Tee 1.272" Nominal Wall to 20" Schedule 80 Pipe: Tee, SA-403, WP316NG, Wrought Austenitic S.S. Pipe, A358, GR304 CL I, Austenitic S.S. Electric Fusion Welded Austenitic, Chromium Nickel Alloy Steel (A240, TP304 S.S. Plate).

DRHR-3-21 - 20" Schedule 80 Elbow to 20" Valve 3-FCV-74-49: Valve, A351, CF8M, Austenitic S.S. Casting. Elbow, A403, WP304, Wrought Austenitic S.S. (Note: In TVA's March 2005 submittal this component was erroneously identified as an elbow to pipe weld rather than valve to elbow weld as stated above.)

TRHR-3-191 - 20" Valve 3-FCV-74-48 to 20" Schedule 80 Elbow: Valve, A351, CF8M, Austenitic S.S. Casting. Elbow, A234 WPB, Wrought C.S. Forging.

RWCU-3-007-G004 - 4" Schedule 80 Pipe to 4" Valve 3-CKV-69-629: Pipe, A333, Gr1, C.S. Seamless Pipe. Valve, A351, CF8M, Austenitic S.S. Casting.

NRC Request 2.2

Describe the ultrasonic methods that were used, including wave propagation modes and angles of interrogation.

TVA Response to NRC Request 2.2

An ultrasonic examination was performed on the piping welds to accessible areas to the maximum extent practical due to the configuration. Credit for the one-sided only ultrasonic examination provided 50 percent coverage because of a the requirement mandated in 10 CFR 50.55a(b)(2)(xv)(A)(2), which states:

"Where examination from both sides is not possible on austenitic welds, full coverage credit from a single side may be claimed only after completing a successful single sided Appendix VIII demonstration using flaw on the opposite side of the weld." Therefore only 50percent coverage can be claimed. Additionally, there is no Appendix VIII Program for cast austenitic piping welds. Therefore, only 50 percent coverage can be claimed. Under the original ASME Section XI Code requirements UT coverage attained would have been essentially 100 percent.

DRHR-3-19: This weld was examined using a 45 degree shear wave, 0.5", 1.5 MHz and a 60 degree refracted longitudinal wave, 2(10 x 18 mm), 2 MHz transducers. Examination was

performed from the pipe side of the weld across the weld crown. A 5% to 20% ID noise was maintained. There were no obstructions.

DRHR-3-21: This weld was examined using a 45 degree shear wave, 0.5", 1.5 MHz and a 60 degree refracted longitudinal wave, 2(10 x 18 mm), 2 MHz transducers. Examination was performed from the pipe side of the weld across the weld crown. A 5% to 20% ID noise was maintained. There were no obstructions.

TRHR-3-191: This weld was examined using a 45 degree shear wave, 0.5", 1.5 MHz, a 60 degree shear wave, 0.5", 1.5 MHz, a 45 degree refracted longitudinal wave, 2(10 x 18 mm) 2 MHz, a 45 degree refracted longitudinal wave, 2(15 x 25 mm) 2MHz, and a 60 degree refracted longitudinal wave, 2(10 x 18 mm), 2 MHz, transducer. Examination was performed from the pipe side of the weld across the weld crown. A 5% to 20% ID noise was maintained. There were no obstructions.

RWCU-3-007-G004: This weld was examined using a 45 and 60 degree shear wave, 0.375", 2.25 MHz transducers. Examination was performed from the pipe side of the weld across the weld crown. A 5% to 20% ID noise was maintained. There were no obstructions.

NRC Request 2.3

Submit cross-sectional sketches showing the completed ultrasonic examination volumes for each wave mode and angle used on the subject piping welds. Include in these sketches the required ASME Code examination volume zones and state whether the sketches represent the entire circumferential length of the welds, or show limitations to these coverages for specific regions of the welds. Are there any as-built conditions that may impact the examination coverages, including outside surface weld crowns and surface finishes? If possible, provide a surface roughness finish value (in root mean square units) of the subject piping welds. How do the subject BFN Unit 3 piping weld as-built configurations compare to conditions on the representative specimens used during the EPRI PDI qualification?

TVA Response to NRC Request 2.3

COMPONENT WELD	REPORT NUMBER	CYCLE NUMBER	EXAMINATION COVERAGE
DRHR-3-19	R-086	11	50%
DRHR-3-21	R-140	10	50%
TRHR-3-191	R-189	11	50%
RWCU-3-007-G004	R-081	11	50%

See Attachment B for the above listed Inspection Reports.

The EPRI PDI specimens used for PDI qualifications have similar configurations (i.e., flush welds, single side access, and weld joint design) as the welds listed in request for relief 3-ISI-12.

NRC Request 2.4

The licensee has implemented a Risk-Informed Inservice Inspection (RI-ISI) program at BFN Unit 3. As such, only a limited number of Class 1 piping welds are being inspected, as opposed to the ASME Code requirement of 25 percent of all Class 1 piping welds. Discuss why the partial examinations performed on the subject welds provide an adequate basis to conclude that the targeted degradation mechanisms (intergranular stress corrosion cracking and thermal fatigue) would have been detected, if present, in these welds. Discuss other piping weld examinations in these systems that are also subject to the same degradation mechanisms, and why the limited examinations on the subject welds do not impair or undermine the intent of the RI-ISI program. State whether BFN Unit 3 will inspect additional piping welds (not presently being examined) to account for the limited examination volumes of the subject welds and ensure that an adequate level of susceptible material, as required by the RI-ISI program, is being examined.

TVA Response to NRC Request 2.4

TVA received a Safety Evaluation Report (SER) from the NRC dated February 11, 2000, "Browns Ferry Nuclear Plant Unit 3, ASME Code Relief for Risk-Informed Inservice Inspection of Piping Welds." This allowed TVA to utilize an alternate Risk-Informed Inservice Inspection (RI-ISI) Program for BFN Unit 3. This program was developed in general accordance with the Westinghouse Owners Group (WOG) Topical Report WCAP-14572, Revision 1-NPA, which was approved by the NRC staff.

Reference Westinghouse Electric Company, LLC, letter WOG-RIISI-01-014, dated December 19, 2001, Westinghouse Owner's Group Implementation Subgroup Interpretation WOG RI-ISI IN 01.

Reference the Westinghouse Owners Group (WOG) Topical Report WCAP-14572, Revision 1-NPA, "Westinghouse Owners Group Application Of Risk - Informed Methods To Piping Inservice Inspection Topical Report," Section 4.0, Inspection Program Requirements.

The referenced Westinghouse Interpretations state that when inservice or preservice ultrasonic examinations of a location required by ASME Section XI were previously performed in accordance with ASME Section XI and achieved greater than 90 percent coverage and are now performed in accordance with ASME Section XI and the additional requirements of the PDI and 10 CFR 50.55a for the RI-ISI program and achieve \leq 90 percent

coverage, solely because 10 CFR 50.55a does not permit crediting far side examination coverage for single sided examinations of stainless steel material, that the amount of risk addressed by the examination remains the same for that location. As discussed in Westinghouse Owners Group (WOG) Topical Report WCAP-14572, Revision 1-NP-A, "Westinghouse Owners Group Application Of Risk-Informed Methods To Piping Inservice Inspection Topical Report," it should be noted that if a current examination is a partial examination and it continues to be a partial examination in the RI-ISI process, the amount of risk addressed by the examination remains the same.

In summary, since three of the subject welds previously received an ASME Section XI or augmented (NUREG 03013) inservice ultrasonic examination that received >90% coverage and one weld which only had a preservice examination that received >90% coverage and had a low failure importance, it is TVA's position that no change in risk resulted from these examination limitations. Therefore, additional examinations are not required. Request for relief 3-ISI-12 was submitted as recommended by item 4 on page 192 of WCAP-14572, Revision 1-NP-A which states "The coverage obtained, limitations encountered, alternative provisions, and an assessment of how the risk is being addressed should be documented. The information should be formally submitted as a relief request."

3.0, Request for Relief 3-ISI-19

NRC Request 3.1

It has been proposed by industry (the Boiling-Water Reactor (BWR) Vessel and Internals project), and approved by the U.S. Nuclear Regulatory Commission, that only the longitudinal welds are required to be volumetrically examined to maintain structural integrity of the RPV in a BWR. Relief was requested for 3 of the 15 longitudinal shell welds at BFN Unit 3. Request for Relief 3-ISI-19 states, "twelve of the fifteen welds received essentially (i.e., greater than 90 percent) 100 percent coverage." In addition, the actual examination coverage for the three welds included in 3-ISI-19 were listed as 90, 86, and 89 percent, respectively. For comparison purposes, please summarize the actual coverage(s) obtained on the remaining 12 longitudinal shell welds.

TVA Response to NRC Request 3.1

The examination coverage for all 15 of the longitudinal RPV welds is provided in the table below.

RPV VERTICAL WELD	REPORT No.	CYCLE No.	EXAMINATION COVERAGE
VIA	R-212A	11	90%
V1B	R-212B	11	86%
V1C	R-212C	11	89%
V2A	R-212D	11	100%
V2B	R-212E	11	100%
V2C	R-212F	11	100%
V3A	R-212G	11	100%
V3B	R-212H	11	100%
V3C	R-212I	11	100%
V4A	R-212L	11	100%
V4B	R-212J	11	100%
V4C	R-212K	11	100%
V5A	R-212O	11	97%
V5B	R-212P	11	100%
V5C	R-212Q	11	97%

NRC Request 3.2

Clearly state what the exact limitations encountered due to the obstructions on the vessel inner surface were. For instance, does insufficient clearance exist to accommodate the inspection tool. Describe the constraints that must be considered to perform an effective examination, and show (through sketches and descriptions) how the interferences preclude a full ASME Code Examination. Also, describe if it is possible to deal with these limitations by altering the inspection device.

TVA Response to NRC Request 3.2

The requested information was provided in TVA's letter dated March 5, 2005, page E2-5 and restated below.

The configuration of BFN Unit 3 RPV and vessel internals prevents essentially 100 percent examination coverage of the three RPV longitudinal shell welds (V-1-A, V-1-B, and V-1-C). The examinations were performed with automated ultrasonic equipment from the vessel inside surface utilizing the Advanced Inservice Reactor Inspection System 21 (AIRIS 21) device, and Enhanced Data Acquisition System-II (EDAS™-II) equipment. The V-1-A, V-1-B, and V-1-C longitudinal shell weld scans were obstructed by the jet pump restrainer bracket and jet pump diffuser and received 90, 86, and 89, percent coverage respectively. The outside surfaces of these three welds were inaccessible due to the concrete bio-shield wall. The UT examinations of the longitudinal shell welds were performed to the maximum extent practical for maximum coverage utilizing the state of the art equipment available at the time the examinations were performed. The UT examinations of the longitudinal shell welds

were performed with equipment, personnel, and procedures qualified to the Performance Demonstration Initiative (PDI) Program in accordance with the requirements of the 1995 Edition, 1996, Addenda of ASME Section XI, Division 1, Appendix VIII as mandated by 10 CFR 50.55a.

Attachment A

Inspection Reports
For RPV Nozzle-To-Shell Welds Listed In
The Table Below

RPV NOZZLE TO SHELL WELD	NDE REPORT No.	CYCLE NUMBER	COVERAGE
N1B-NV	R-156	10	77%
N2A-NV	R-158	10	77%
N2C-NV	R-160	10	77%
N2E-NV	R-162	10	77%
N3A-NV	R-164	10	77%
N4A-NV	R-166	10	77%
N4F-NV	R-168	10	77%
N5B-NV	R-170	10	71%
N7-NV	R-125	10	70%
N9-NV	R-172	10	74%
N10-Inner Radius	R-188	11	90%

Inspection Report R-156
Weld N1B-NV

00001

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R156</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: NIB	
EXAMINATION METHOD				SYSTEM RPV	
ISI DWG. NO. 3-ISI-0328-C					
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: B-D
PROCEDURE: N_UT_9		REV:9	TC:02-06	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld..

Examination. Nozzle to Vessel weld NIB

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination.

(NIB-IR) *see R157*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

77% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>	REVIEWED BY: <i>David Kleinjan</i>	ANII: <i>What</i>
LEVEL: II DATE: <i>4-4-02</i>	LEVEL: <i>II</i> DATE: <i>4/4/02</i>	DATE: <i>4/18/02</i>
PG. 1 OF 16		<i>5/11/02</i>

Calculation of ASME code coverage
For section XI NDE Examination

N1B

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	100%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *


The sum of all the percentage of scans	700%
Divided by the total # of scans	9
Percentage of examination Volume coverage	77%

* Transverse coverage includes coverage obtained during the inner radius examination.

HSBCT
7/18/00

00003

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R156</i>							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 3-29-02									
PROC.: N-UT- 9		REV: 9		TC: 02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F					
INSTR. MFG: STAVELEY			DUE DATE: 8-05-02			SIMULATOR BLOCK NO: DB55079							
MODEL/TYPER: SONIC-136			M & TE NO.: VH751			THERMOMETER S/N: 522352			DUE DATE: 5-17-02				
TRANSDUCER MFG: Harisonic						COUPLANT SONOTRACE			BATCH: 01141				
S/N DB34198		SIZE: .75		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>			LONG <input checked="" type="checkbox"/>	RL <input type="checkbox"/>			
CABLE TYPE: RG174		LENGTH: 120 inches		ANGLE VERIFICATION <i>1st 2nd 3rd</i>									
DAC						BLOCK TYPE: <i>Roypus</i>		S/N: DB35055079					
<div style="display: flex; align-items: center;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg); font-weight: bold; margin-right: 10px;">AMPLITUDE</div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: 10 inches</p>						NOMINAL ANGLE: 0		ACTUAL ANGLE: N/A					
						INSTRUMENT SETTINGS							
						REFLECTOR			REFERENCE		MEMORY		
						SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER	
						AXIAL		<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.8 dB		1	
						CIRC		<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a	
						FREQ: 2.25		MHz		REJECT: off		%	
						ANGLE: n/a		deg		DAMPING: 500		ohms	
						DELAY: .499		msec		PULSER: 222			
						ZERO: n/a		msec		FILTER: Filt 3			
VELOCITY: .238		msec		REP RATE: 2KHZ									
RANGE: 10		inches		TOF: <input checked="" type="checkbox"/> PEAK		<input type="checkbox"/> FLANK							
DISPLAY MODE: PE			POWER: AC										
DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF							
REF. REFLECTOR: 1" GAIN: 8 dB						CALIBRATION TIMES							
AMPLITUDE: 80 %			METAL PATH: 1"			INITIAL TIME: 9:00		FINAL TIME: 14:50					
VERIFICATION TIMES		1) <i>n/a</i>	2) <i>n/a</i>	3) <i>n/a</i>	4) <i>n/a</i>	5) <i>n/a</i>	6) <i>n/a</i>	7) <i>n/a</i>	8) <i>n/a</i>	9) <i>n/a</i>			
LINEARITY CHECK													
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
				40		20				80			80
COMMENTS:						WELDS/ITEMS EXAMINED:							
						NIB Nozzle To Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II		EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II			REVIEWER: <i>David Kleinjan</i> LEVEL: <i>II</i>		DATE: <i>4/1/02</i>		ANII: <i>Robert Todd</i>		DATE: <i>4/18/02</i>	PG.: 4-5 OF 15 <i>4/18/02</i>	3 OF 15

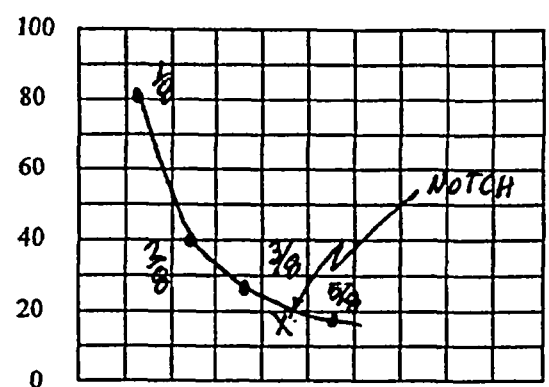TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R156											
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 3-29-02				CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F											
PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18				TEMP: 72.6°F											
INSTR. MFG: STAVELEY DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079															
MODEL/TYPE: SONIC-136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02															
TRANSDUCER MFG: Krautkramer		COUPLANT SONOTRACE BATCH: 01141															
S/N DB34843 SIZE: .5x1 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>															
CABLE TYPE: RG1743 LENGTH: 120 inches		ANGLE VERIFICATION															
DAC		BLOCK TYPE: IIW				S/N: DB55074											
		NOMINAL ANGLE: 45°				ACTUAL ANGLE: 46°											
 <p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS															
		REFLECTOR				REFERENCE		MEMORY									
		SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER							
		AXIAL		<input type="checkbox"/>		<input checked="" type="checkbox"/>		42.6 dB		2							
		CIRC		<input type="checkbox"/>		<input type="checkbox"/>		n/a dB		n/a							
		FREQ: 2.25		MHz		REJECT: off		%									
		ANGLE: N/A		deg		DAMPING: 500		ohms									
		DELAY: .830		msec		PULSER: 222											
		ZERO: N/A		msec		FILTER: FITL 3											
		VELOCITY: .126		msec		REP RATE: 2KHZ											
RANGE: 20		inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK													
DISPLAY MODE: PE				POWER: AC													
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF				TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF													
REF. REFLECTOR: 1"		GAIN: 33.6 dB		CALIBRATION TIMES													
AMPLITUDE: 80 %		METAL PATH: 1"		INITIAL TIME: 9:00				FINAL TIME: 14:50									
VERIFICATION TIMES		1) n/a		2) n/a		3) n/a		4) n/a									
		5) n/a		6) n/a		7) n/a		8) n/a									
		9) n/a															
LINEARITY CHECK																	
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20					
		SIGNAL 2		50	45	40	35	30	25	20	15	10					
ATTENUATOR		GAIN		SET		-6 dB		-12 dB		SET		+12		SET		+6	
		AMP		80%		32 TO 48		16 TO 24		20 %		64 TO 96		40%		64 TO 96	
				40		20				80				80			
COMMENTS:					WELDS/ITEMS EXAMINED:												
Delta difference between 3/8 to 5/8 on the clad side is 3 dB ✓					NIB Nozzle to Shell												
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i>			EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>			REVIEWER: <i>[Signature]</i>			ANII: <i>Robert Field</i>			DATE: 4/18/02					
LEVEL: II			LEVEL: II			LEVEL: <i>II</i>			DATE: 4/1/02			PG.: 4 OF 15 <i>4/1/02</i>					

00005

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R 156													
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 3-29-02																	
PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F																	
INSTR. MFG: STAVELEY DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079																	
MODEL/TYPE: SONIC-136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02																	
TRANSDUCER MFG: Krautkramer		COUPLANT SONOTRACE BATCH: 01141																	
S/N DB34154 SIZE: .5x1 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>																	
CABLE TYPE: RG174 LENGTH: 120 inches		ANGLE VERIFICATION																	
DAC		BLOCK TYPE: IIW				S/N: DB55074													
		NOMINAL ANGLE: 60				ACTUAL ANGLE: 59													
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS																	
		REFLECTOR				REFERENCE		MEMORY											
		SCAN DIRECT.	NTCH	SDH		SENSITIVITY		NUMBER											
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>		49 dB		3											
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>		n/a dB		n/a											
		FREQ:	2.25 MHz		REJECT:		off %												
		ANGLE:	N/A deg		DAMPING:		500 ohms												
		DELAY:	1.20 msec		PULSER:		222												
		ZERO:	N/A msec		FILTER:		FITL 3												
		VELOCITY:	.123 msec		REP RATE:		2KHZ												
RANGE:	20 inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK																
DISPLAY MODE: PE				POWER: AC															
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF				TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF															
REF. REFLECTOR: 1"		GAIN: 36 dB		CALIBRATION TIMES															
AMPLITUDE: 80 %		METAL PATH: 1"		INITIAL TIME: 9:00				FINAL TIME: 14:50											
VERIFICATION TIMES		1) n/a		2) n/a		3) n/a		4) n/a		5) n/a		6) n/a		7) n/a		8) n/a		9) n/a	
LINEARITY CHECK																			
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20							
		SIGNAL 2		50	45	40	35	30	25	20	15	10							
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET		+6					
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%		64 TO 96					
				40		20				80				80					
COMMENTS:										WELDS/ITEMS EXAMINED:									
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE CLAD SIDE										NIB Nozzle to Shell									
EXAMINER: MIKE W. KLEINJAN <i>Mike as of 4/1/02</i> LEVEL: II					EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II					REVIEWER: <i>David Whittaker</i> LEVEL: III DATE: 4/1/02					ANII: DATE: PG.: 1-7 OF 1-10 5 of 15 <i>5/4/02</i>				

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R156						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-29-02								
PROC.: N-UT- 55 REV:9		DUE DATE: 08-11-02		CALIBRATION BLOCK NO.: BF-84-IR		TEMP: 70.5°F						
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A								
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02						
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141										
S/N DB 35163		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>		
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074						
<p style="text-align: center;">DISPLAY WIDTH: 20 inches</p>				NOMINAL ANGLE: 28		ACTUAL ANGLE: N/A						
				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE			MEMORY		
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY			MEMORY NUMBER		
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	63.6 dB			20		
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB			N/A		
				FREQ:	2.25 MHz		REJECT: OFF			%		
				ANGLE:	N/A deg		DAMPING: 200			ohms		
				DELAY:	1.66 msec		PULSER: 222					
				ZERO:	N/A msec		FILTER: FILT 1					
VELOCITY:	0.233 msec		REP RATE: 4 KHZ									
RANGE:	20.0 inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES								
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 0830			FINAL TIME: 1400					
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40		20				80		80	
COMMENTS:					WELDS/ITEMS EXAMINED:							
					REACTOR PRESSURE VESSEL							
					N1B-IR							
					wedge ID 0-14795-214 ✓							
EXAMINER: DAVID KLEINJAN <i>D.K. Kleijan</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>Mike Kleijan</i> LEVEL: II			REVIEWER: <i>Shel...</i> LEVEL: II DATE: 4/1/02			ANII: <i>Albert...</i> DATE: 4/18/02 PG.: 44 OF 115 4/11/02 6 OF 15			

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R156</i>							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-29-02									
PROC.: N-UT- 55 REV:9		TC: <i>N/A</i>		CALIBRATION BLOCK NO.: BF-84-IR		TEMP: 70.5°F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER				COUPLANT SONOTRACE BATCH: 01141									
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>							
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074							
				NOMINAL ANGLE: 32°		ACTUAL ANGLE: N/A							
<p>AMPLITUDE</p> <p>DISPLAY WIDTH: 20 inches</p>				INSTRUMENT SETTINGS									
				REFLECTOR			REFERENCE		MEMORY				
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER				
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	63.8 dB		21				
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A				
				FREQ: 2.25 MHz		REJECT: OFF %							
				ANGLE: N/A deg		DAMPING: 200 ohms							
				DELAY: 1.35 msec		PULSER: 222							
				ZERO: N/A msec		FILTER: FILT 1							
				VELOCITY: 0.235 msec		REP RATE: 4 KHZ							
RANGE: 20.0 inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK											
DISPLAY MODE: PE			POWER: AC										
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF											
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 0940		FINAL TIME: 1410							
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A				
LINEARITY CHECK													
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20			
	SIGNAL 2	50	45	40	35	30	25	20	15	10			
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6	
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%		64 TO 96
			40		20				80				80
COMMENTS:					WELDS/ITEMS EXAMINED:								
					REACTOR PRESSURE VESSEL								
					NIB-IR								
					<i>wedge IO D-14795-250</i>								
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>[Signature]</i> LEVEL: III		DATE: <i>4/18/02</i>		ANII: <i>Albert Field</i>		DATE: <i>4/18/02</i>			
PG.: <i>43</i> OF <i>4</i> 15 <i>1/11/02</i>													
7 OF 15													

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R156

PROJECT: BFN UNIT: 3 WELD ID: N13 CONFIG.: NOZZLE COMPONENT: VESSEL

CAL. SHT. NO.: NA PROCEDURE: N-UT-9 REV.: 9 PCR: 02-06 #/A TEMP.: 89 PYRO.: 522352

SCAN SENS.: ⊕ dB EXAM START: 3/29/02 11:15 EXAM END: 1310 EXAM ANGLE: 0°, 45°, 60°

Lo LOCATION: TDC Wo LOCATION: E OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
28°	SCAN	dB		69.8	⊕					SCANNING #	10/11		BLEND RADIUS								
32°	SCAN	dB		69.6						SCANNING #	10/11		BLEND RADIUS								
0°	SCAN	dB		34.8						SCANNING #	9		ON WELD AND BASE MATERIAL								
45°	SCAN	dB		56.0						SCANNING #	9		VESSEL SIDE ONLY								
45 T	SCAN	dB		56.6						SCANNING #	10/11		CONV								
45 TAN	SCAN	dB		56.6						SCANNING #	10/11		CONV								
60	SCAN	dB		63						SCANNING #	9		VESSEL SIDE ONLY								
60 T	SCAN	dB		63						SCANNING #	10/11		CONV								
60 TAN	SCAN	dB		63						SCANNING #	10/11		CONV								
NO RECORDABLE INDICATIONS																					

COMMENTS: * 28° AND 32° FOR THE BLEND RADIUS. TRANSVERSE COVERAGE INCLUDES COVERAGE OBTAINED DURING THE INNER RADIUS EXAMINATIONS.

5 TO 10% NOISE LEVEL WAS OBSERVED

EXAMINER: Mike W. #142 LEVEL: II DATE: 3-29-02

REVIEWED BY: [Signature] LEVEL: II DATE: 4/1/02

EXAMINER: [Signature] LEVEL: II DATE: 3-29-02


ANII: [Signature] DATE: 4/18/02 PAGE 8 OF 15

00000


00009

REPORT NUMBER
R156

Nozzle Examination 45° Waveforms

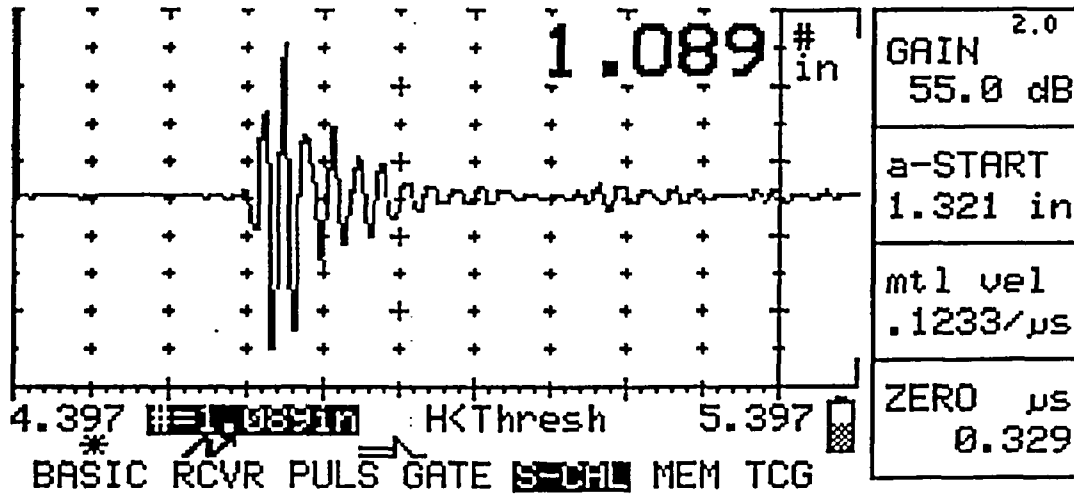

45° Pre Waveform

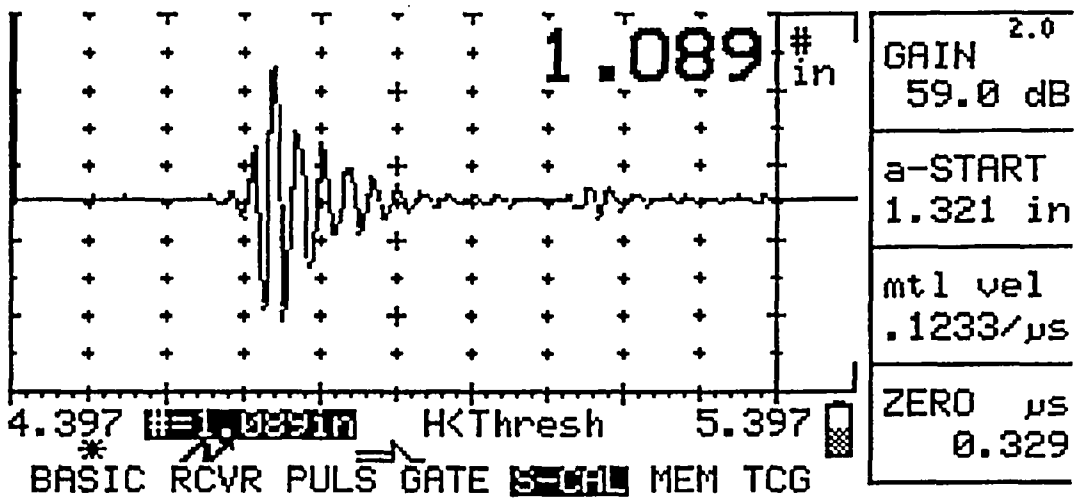


45° Post Waveform


Hsbct
d11
4/10/02

00010
Report Number
R156

Nozzle Examination 60° Waveforms

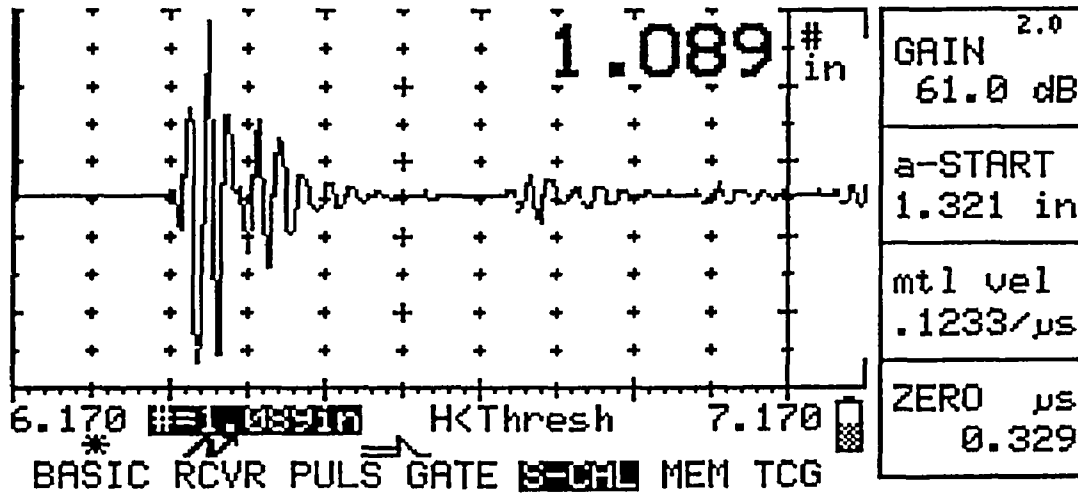

60° Pre Waveform

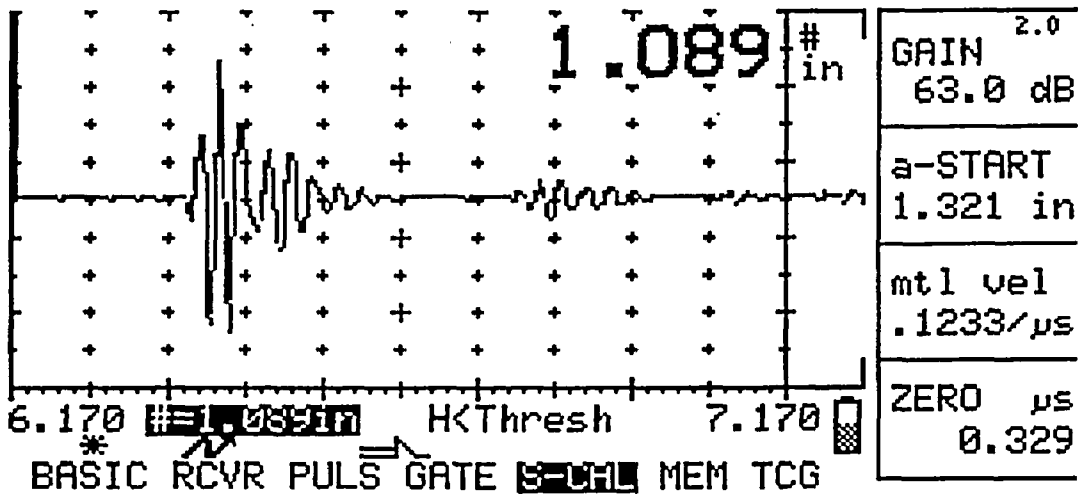

60° Post Waveform


H 5 BCT
4/18/00

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R156
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-OT-9 REV.: 9 PCR: 0200 N/A - 1/11/02
 SEARCH UNIT-MAKE: Krautkramer SIZE: 15K1 FREQ.: 2.25
 SN: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Senec 13E SN: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
1/2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

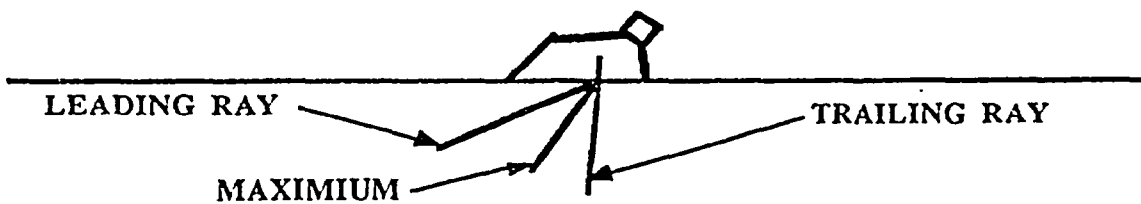

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>M. W. Logan</u>	REVIEWED BY: <u>John Whiteley</u>	ANII: <u>Albert Todd</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/18/02</u> PAGE: <u>12</u> OF <u>15</u>


TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. <u>R156</u>
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0206 ~~7/10~~ 4/11/02
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5X1 FREQ.: 2.25
 S/N: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Seac 13C S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				100% DAC		LEADING RAY			
	20% DAC		50% DAC		MP	W	20% DAC		50% DAC	
	W	MP	W	MP			MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	8 3/8	7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

from 4/11/02

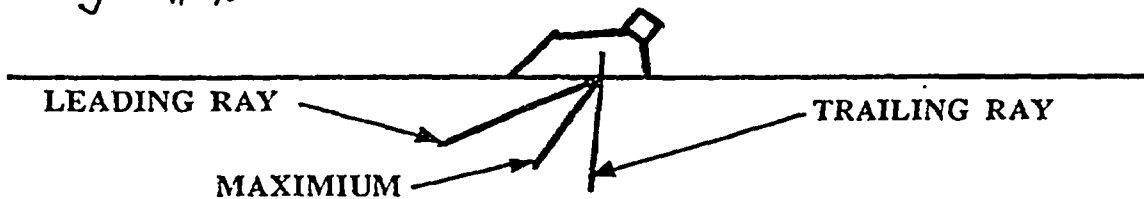


RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mike W. Henry</u>	REVIEWED BY: <u>[Signature]</u>	ANI: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/18/02</u> PAGE: <u>12 OF 15</u>

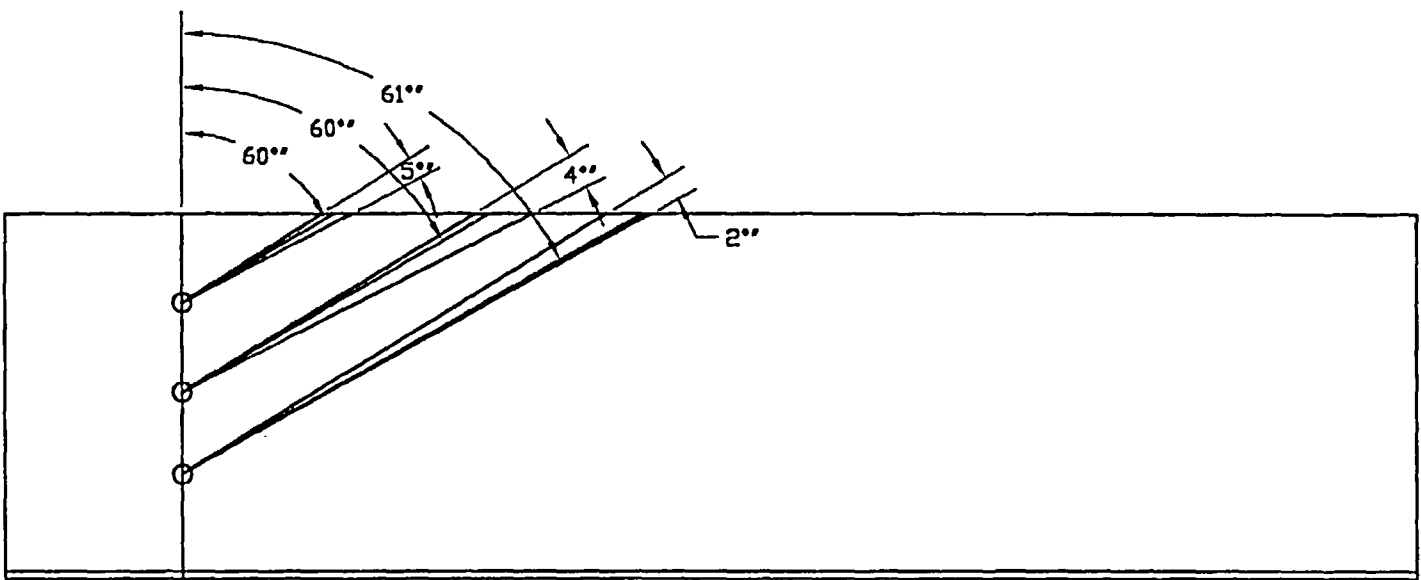


REPORT NUMBER
R156

00013

Browns Ferry Unit 3
Beamsread
MARCH 2002
45 BC BF-18

4/16

13 of 15

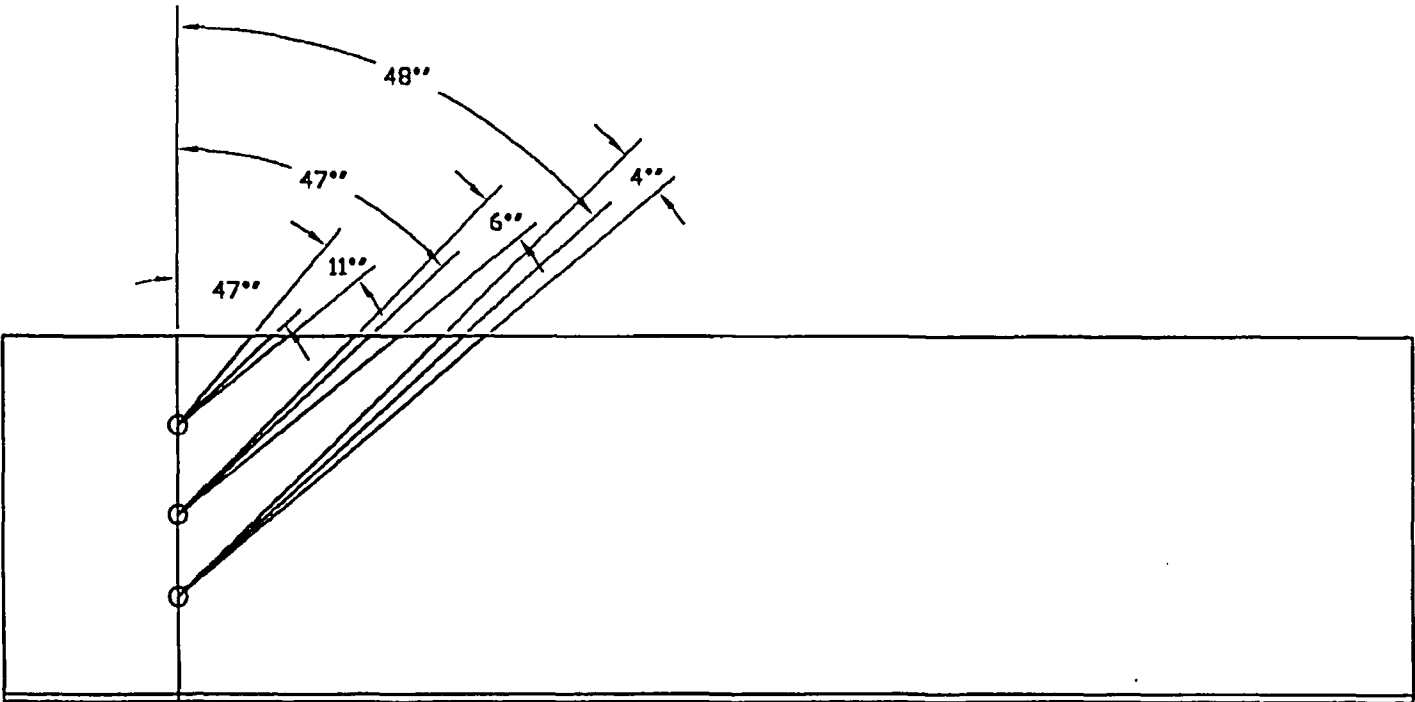


Report Number
R156

HSB
4/18/02
A/H

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

00014

14-8-15

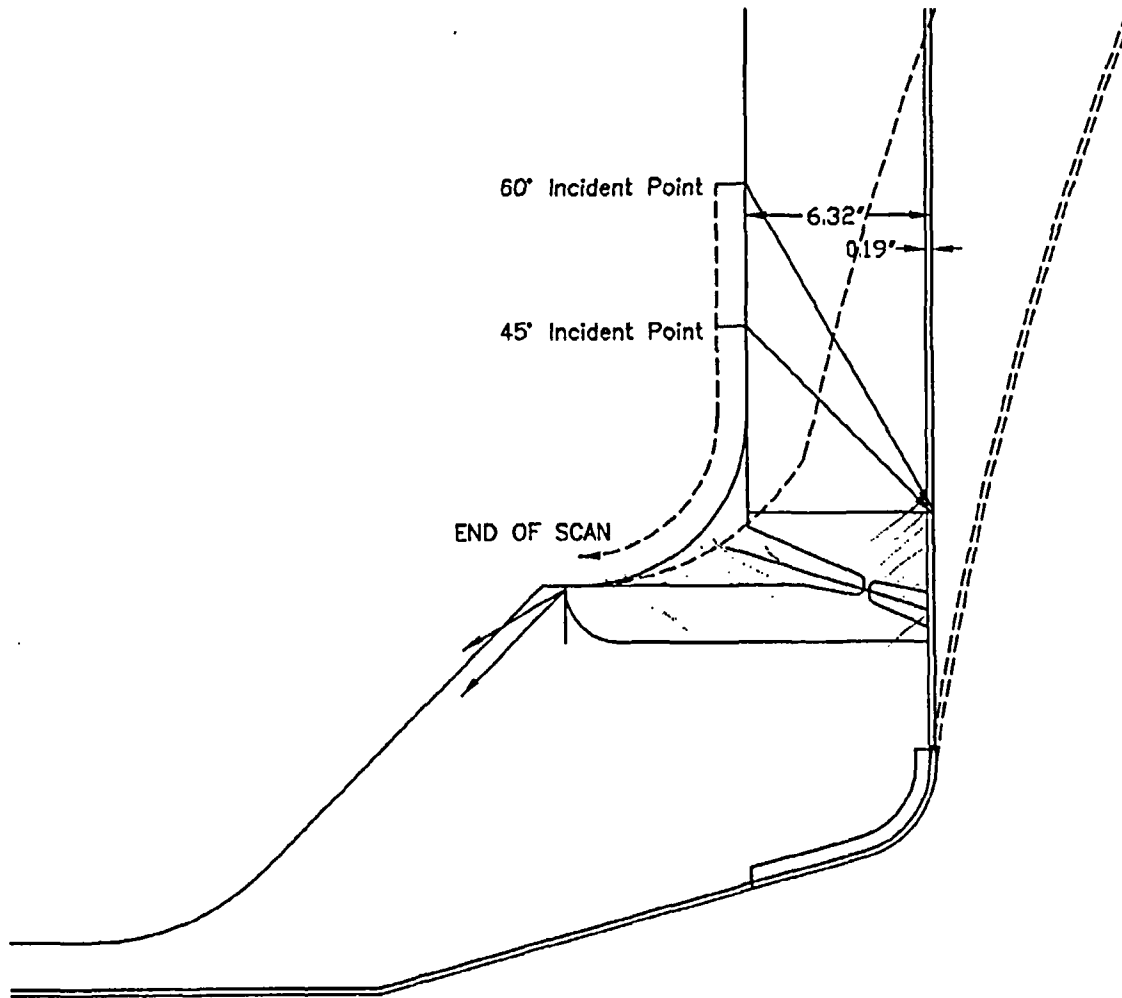

Transverse coverage includes coverage obtained during the inner radius examination

15
05
15

HSBC
9/1/02
4/18/02

Report Number
R156

Browns Ferry Unit 3
NIB Nozzle-to-Shell
MARCH 2002
SP-NIB-NS

00015

00016

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R157	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: NIB-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0328-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
CATEGORY: B-D					
PROCEDURE: N-UT-55		REV: 9	TC: N/A 02-03	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: 024-000 DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: ^{5/4/02} II		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.

NIB-IR: This examination was performed using a 28° and 32° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indication

RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>	REVIEWED BY: <i>David Kleinjan</i>	ANIL <i>What?</i>
LEVEL: II DATE: 4-4-02	LEVEL: II DATE: 4/4/02	DATE: 4/18/02
		PG. 1 OF 4

Jan 4/11/02

00017

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R157							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-29-02									
PROC.: N-UT- 55 REV:9		TC: N/A		CALIBRATION BLOCK NO.: BF-84-IR		TEMP: 70.5°F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141											
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>			
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074							
				NOMINAL ANGLE: 32°		ACTUAL ANGLE: N/A							
<p>AMPLITUDE</p> <p>DISTANCE</p> <p>DISPLAY WIDTH: 20 inches</p>				INSTRUMENT SETTINGS									
				REFLECTOR			REFERENCE		MEMORY				
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER				
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	63.8 dB		21				
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A				
				FREQ: 2.25	MHz		REJECT: OFF		%				
				ANGLE: N/A	deg		DAMPING: 200		ohms				
				DELAY: 1.35	msec		PULSER: 222						
				ZERO: N/A	msec		FILTER: FILT 1						
				VELOCITY: 0.235	msec		REP RATE: 4 KHZ						
				RANGE: 20.0	inches		TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK				
				DISPLAY MODE: PE			POWER: AC						
DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF							
REF. REFLECTOR: N/A				GAIN: N/A dB		CALIBRATION TIMES							
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 0940			FINAL TIME: 1410						
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			
LINEARITY CHECK													
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
				40		20				80		80	
COMMENTS:						WELDS/ITEMS EXAMINED:							
Wedge ID D-14795-250						REACTOR PRESSURE VESSEL							
						NIB-IR							
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>Paul Whiteley</i> LEVEL: III DATE: 4/18/02		ANI: <i>What Fall</i> DATE: 4/18/02		PG.: 1 OF 4 2 OF 4					

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R157					
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-29-02							
PROC.: N-UT- 55		REV: 9		CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A							
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352 DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER				COUPLANT SONOTRACE BATCH: 01141							
S/N DB 35163		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>					
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION							
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074					
				NOMINAL ANGLE: 28		ACTUAL ANGLE: N/A					
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">100 80 60 40 20 0</div> <div style="border: 1px solid black; width: 150px; height: 150px; position: relative;"> </div> <div style="margin-left: 10px; writing-mode: vertical-rl; transform: rotate(180deg);">A M P L I T U D E</div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: 20 inches</p>				INSTRUMENT SETTINGS							
				REFLECTOR			REFERENCE		MEMORY		
				SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER	
				AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	63.6 dB		20	
				CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A	
				FREQ: 2.25		MHz		REJECT: OFF		%	
				ANGLE: N/A		deg		DAMPING: 200		ohms	
				DELAY: 1.66		msec		PULSER: 222			
				ZERO: N/A		msec		FILTER: FILT 1			
				VELOCITY: 0.233		msec		REP RATE: 4 KHZ			
RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK							
DISPLAY MODE: PE			POWER: AC								
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: N/A				GAIN: N/A dB							
AMPLITUDE: N/A %				METAL PATH: N/A"							
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	
LINEARITY CHECK											
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20
	SIGNAL 2		50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %	64 TO 96		40%	64 TO 96
			40		20			80			80
COMMENTS:					WELDS/ITEMS EXAMINED:						
Wedge ID D-14795-214					REACTOR PRESSURE VESSEL						
					NIB-IR						
EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i>			EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i>			REVIEWER: <i>[Signature]</i>			ANI <i>[Signature]</i>		
LEVEL: II			LEVEL: II			DATE: 4/18/02			DATE: 4/18/02		
						PG.: 14 OF 14			3 of 4		

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R157

PROJECT: BFN UNIT: 3 WELD ID: N1B CONFIG: INNER RADIOS COMPONENT: N/A

CAL. SHT. NO.: N/A PROCEDURE: N-UT 55 REV.: 9 PCR.: 03-08 TEMP.: 85 PYRO.: 52352
074-10-02

SCAN SENS.: 4 dB EXAM START: 11:15³⁰ EXAM END: 13:10 EXAM ANGLE: 28° : 32°

Lo LOCATION: T D C Wo LOCATION: φ of WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
				*																	
28°	SCAN		dB	69.8			SCANNING		#	10/11		Blend			Radius						
32°	SCAN		dB	69.8			SCANNING		#	10/11		Blend			Radius						
No Recordable Indication																					

COMMENTS: A MATERIAL NOISE LEVEL OF 5-10% WAS OBSERVED

EXAMINER: [Signature] LEVEL: II DATE: 03-29-02 REVIEWED BY: [Signature] LEVEL: 4L DATE: 4/4/02
EXAMINER: Wick DATE: 4-4-02 ANII: Ally DATE: 4/18/02 PAGE: 2 OF: 4

00019

Inspection Report R-158
Weld N2A-NV

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R158	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N2A	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0328-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
CATEGORY: B-D					
PROCEDURE: N-UT-9		REV:9	TC:02-06	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
EXAMINER: N/A		EXAMINER: N/A		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	
LEVEL: <i>II</i>		LEVEL: N/A		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld..

Examination. Nozzle to Vessel weld N2A
 Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination.
 (N2A-IR) *See R159*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown
 45° Tangent to the weld was used on vessel side CW/CCW
 45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown
 60° Tangent to the weld was used on vessel side CW/CCW
 60° Parallel to the weld was used on vessel side CW/CCW

77% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No RECORDABLE INDICATIONS

RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>		REVIEWED BY: <i>David Kleinjan</i>		ANII: <i>Albert Todd</i>	
LEVEL: II DATE: <i>4-7-02</i>		LEVEL: <i>II</i> DATE: <i>4/4/02</i>		DATE: <i>4/18/02</i>	
				PG. 1 OF 15	

Calculation of ASME code coverage
For section XI NDE Examination

N2A

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	100%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *

The sum of all the percentage of scans	700%
Divided by the total # of scans	9
Percentage of examination Volume coverage	77%

* Transverse coverage includes coverage obtained during the inner radius examination.

F/S BCT
4/10/02

00022

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R158</i>							
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 4-1-02										
PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F										
INSTR. MFG: Staveley DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079										
MODEL/TYPE: Sonic 136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02										
TRANSDUCER MFG: Harisonic		COUPLANT SONOTRACE BATCH: 01141										
S/N DB34198 SIZE: .75 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL <input type="checkbox"/>										
CABLE TYPE: RG174 LENGTH: 120 inches		ANGLE VERIFICATION										
DAC		BLOCK TYPE: <i>Roncus Roncus</i> S/N: DB55079										
		NOMINAL ANGLE: 0			ACTUAL ANGLE: N/A							
<p>AMPLITUDE</p> <p>DISTANCE</p> <p>DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS										
		REFLECTOR			REFERENCE		MEMORY					
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER					
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.8 dB		1					
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a					
		FREQ:	2.25	MHz	REJECT: off		%					
		ANGLE:	n/a	deg	DAMPING: 500		ohms					
		DELAY:	.499	msec	PULSER: 222							
		ZERO:	n/a	msec	FILTER: Filt 3							
		VELOCITY:	.238	msec	REP RATE: 2KHZ							
RANGE:	10	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: 1" GAIN: 8 dB			CALIBRATION TIMES									
AMPLITUDE: 80% METAL PATH: 1"			INITIAL TIME: 13:30		FINAL TIME: 18:00							
VERIFICATION TIMES			1) 11:45	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a	9) n/a	
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20%		64 TO 96		40% 64 TO 96	
			40		20				80		80	
COMMENTS:						WELDS/ITEMS EXAMINED:						
						N2A, N2C, N2E Nozzle to Shell						
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II			EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II			REVIEWER: <i>For [Signature]</i> LEVEL: III DATE: 4/4/02			ANII: <i>What [Signature]</i> DATE: 4/10/02 PG.: 13 OF 15 <i>Jan 4/10/02</i>			

00023

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R158</i>							
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 4-1-02										
PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F										
INSTR. MFG: Staveley DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079										
MODEL/TYPE: Sonic 136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02										
TRANSDUCER MFG: Krautkramer		COUPLANT SONOTRACE BATCH: 01141										
S/N DB34843 SIZE: .5x1 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>										
CABLE TYPE: RG1743 LENGTH: 120 inches		ANGLE VERIFICATION										
DAC		BLOCK TYPE: IIW		S/N: DB55074								
		NOMINAL ANGLE: 45°		ACTUAL ANGLE: 46°								
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS										
		REFLECTOR			REFERENCE		MEMORY					
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER					
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	45.6 dB		2					
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a					
		FREQ:	2.25 MHz		REJECT: off		%					
		ANGLE:	N/A deg		DAMPING: 500		ohms					
		DELAY:	.830 msec		PULSER: 222							
		ZERO:	N/A msec		FILTER: FITL 3							
		VELOCITY:	.126 msec		REP RATE: 2KHZ							
RANGE:	20 inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: 1"		GAIN: 33.6 dB		CALIBRATION TIMES								
AMPLITUDE: 80 %		METAL PATH: 1"		INITIAL TIME: 13:30		FINAL TIME: 18:00						
VERIFICATION TIMES		1) 4:45	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a	9) n/a		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40		20				80		80	
COMMENTS:					WELDS/ITEMS EXAMINED:							
Delta difference between 3/8 to 5/8 on the clad side is 3 dB					N2A, N2C, N2E Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II			EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i> LEVEL: II			REVIEWER: <i>David Whitaker</i> LEVEL: III DATE: 4/4/02			ANIL <i>Anil</i> DATE: 4/18/02 PG.: 24 OF 15 <i>Jan 4/18/02</i>			

00024

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R158					
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 4-1-02								
PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F								
INSTR. MFG: Staveley DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: Sonic 136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02								
TRANSDUCER MFG: Krautkramer		COUPLANT SONOTRACE BATCH: 01141								
S/N DB34154 SIZE: .5x1 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>								
CABLE TYPE: RG174 LENGTH: 120 inches		ANGLE VERIFICATION								
DAC		BLOCK TYPE: IIW		S/N: DB55074						
		NOMINAL ANGLE: 60		ACTUAL ANGLE: 59						
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS								
		REFLECTOR		REFERENCE		MEMORY				
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	52 dB		3			
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a			
		FREQ:	2.25	MHz	REJECT: off		%			
		ANGLE:	N/A	deg	DAMPING: 500		ohms			
		DELAY:	1.20	msec	PULSER: 222					
		ZERO:	N/A	msec	FILTER: FITL 3					
		VELOCITY:	.123	msec	REP RATE: 2KHZ					
RANGE:	20	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK							
DISPLAY MODE: PE		POWER: AC								
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF								
REF. REFLECTOR: 1" GAIN: 36 dB		CALIBRATION TIMES								
AMPLITUDE: 80 % METAL PATH: 1"		INITIAL TIME: 13:30		FINAL TIME: 18:00						
VERIFICATION TIMES		1) n/a	2) n/a	3) n/a	4) n/a	5) n/a				
		6) n/a	7) n/a	8) n/a	9) n/a					
LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		
COMMENTS:				WELDS/ITEMS EXAMINED:						
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE CLAD SIDE				N2A, N2C, N2E Nozzle to Shell						
EXAMINER: MIKE W. KLEINJAN <i>with as Kleinjan</i> LEVEL: II		EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i> LEVEL: II		REVIEWER: <i>David Kleinjan</i> LEVEL: II DATE: 4/4/02		ANI: <i>[Signature]</i> DATE: 4/10/02		PG.: 25 OF 15 <i>Jan 4/10/02</i>		

00025

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R158							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02									
PROC.: N-UT- 55 REV:9		OK TC: N/A		CALIBRATION BLOCK NO.: BF-85-IR		TEMP: 68.1° F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141											
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>			
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC		BLOCK TYPE: CS IIW				S/N: DB 55074							
		NOMINAL ANGLE: 25°				ACTUAL ANGLE: N/A							
<p>DISPLAY WIDTH: 20 inches</p>		INSTRUMENT SETTINGS											
		REFLECTOR			REFERENCE			MEMORY					
		SCAN DIRECT.		NTCH	SDH		SENSITIVITY		NUMBER				
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>		60.0 dB		25				
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>		N/A dB		N/A				
		FREQ: 2.25		MHz		REJECT: OFF		%					
		ANGLE: N/A		deg		DAMPING: 200		ohms					
		DELAY: 1.12		msec		PULSER: 222							
		ZERO: N/A		msec		FILTER: FILT 1							
		VELOCITY: 0.234		msec		REP RATE: 4 KHZ							
		RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK					
		DISPLAY MODE: PE			POWER: AC								
DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF							
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1355		FINAL TIME: 1805							
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			
LINEARITY CHECK													
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
				40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:								
					REACTOR PRESSURE VESSEL								
					N2A-IR, N2C-IR, N2E-IR								
					Wedge ID D-14795-147								
EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II			REVIEWER: <i>Sal Whiteley</i> LEVEL: III DATE: 4/4/02			ANI: <i>Michael Tull</i> DATE: 4/18/02 PG.: 16 OF 15 <i>Jan 4/10/02</i>				

00026

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R158							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02									
PROC.: N-UT- 55		REV: 9		CALIBRATION BLOCK NO.: BF-85-IR		TEMP: 68.1° F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141											
S/N DB 35163		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>			
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074							
<p style="text-align: center;">DISPLAY WIDTH: 20 inches</p>				NOMINAL ANGLE: 19°		ACTUAL ANGLE: N/A							
				INSTRUMENT SETTINGS									
				REFLECTOR			REFERENCE			MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY			NUMBER			
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.2 dB			19			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB			N/A			
				FREQ: 2.25		MHz		REJECT: OFF			%		
				ANGLE: N/A		deg		DAMPING: 200			ohms		
				DELAY: 0.996		msec		PULSER: 222					
				ZERO: N/A		msec		FILTER: FILT 1					
VELOCITY: 0.234		msec		REP RATE: 4 KHZ									
RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK	<input checked="" type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC										
DUAL: <input type="checkbox"/> ON	<input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON			<input checked="" type="checkbox"/> OFF								
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1245		FINAL TIME: 1807							
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A				
LINEARITY CHECK													
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20			
	SIGNAL 2	50	45	40	35	30	25	20	15	10			
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6	
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96	
			40		20				80			80	
COMMENTS:					WELDS/ITEMS EXAMINED:								
					REACTOR PRESSURE VESSEL								
					N2A-IR, N2C-IR, N2E-IR								
					Wedge ID D-14795-144								
EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i>		REVIEWER: <i>[Signature]</i>		ANII:		DATE:					
LEVEL: I		LEVEL: II		LEVEL: III		DATE: 4/4/02		PG.: 7 OF 15 <i>for 4/18/02</i>					

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R158

PROJECT: BFN UNIT: 3 WELD ID: N2A CONFIG.: Nozzle COMPONENT: VESSEL

CAL. SHT. NO.: NA PROCEDURE: NT-UT-9 REV.: 9 PCR.: 02-06 TEMP.: 85 PYRO.: 522352

SCAN SENS.: * dB EXAM START: 4/01/02 14:30 EXAM END: 1520 EXAM ANGLE: 0°, 45°, 60°

Lo LOCATION: TDC Wo LOCATION: E OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
				*																	
19°	SCAN	dB	63.2				SCANNING	#	10/11				BLEND RADIUS								
25°	SCAN	dB	66.				SCANNING	#	10/11				BLEND RADIUS								
0°	SCAN	dB	34.8				SCANNING	#	9				ON WELD AND BASE MATERIAL								
45°	SCAN	dB	56.6				SCANNING	#	9				ON WELD AND VESSEL SIDE								
45T	SCAN	dB	56.6				SCANNING	#	10/11				CW/CCW VESSEL SIDE								
45TAN	SCAN	dB	56.6				SCANNING	#	10/11				CW/CCW VESSEL SIDE								
60°	SCAN	dB	63.				SCANNING	#	9				ON WELD AND VESSEL SIDE								
60T	SCAN	dB	63.				SCANNING	#	10/11				CW/CCW VESSEL SIDE								
60TAN	SCAN	dB	63.				SCANNING	#	10/11				CW/CCW VESSEL SIDE								
NO RECORDABLE INDICATION																					

COMMENTS: 19° AND 25° EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE INNER RADIUS EXAMINATIONS. 5 TO 10% Noise level was observed


EXAMINER: [Signature] LEVEL: II DATE: 4-4-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/4/02
 EXAMINER: [Signature] LEVEL: II DATE: 04-01-02 ANI: [Signature] DATE: 4/18/02 PAGE 8 OF 15

8 of 15


000017

00028 Report Number
R158

Nozzle Examination 45 °Waveforms

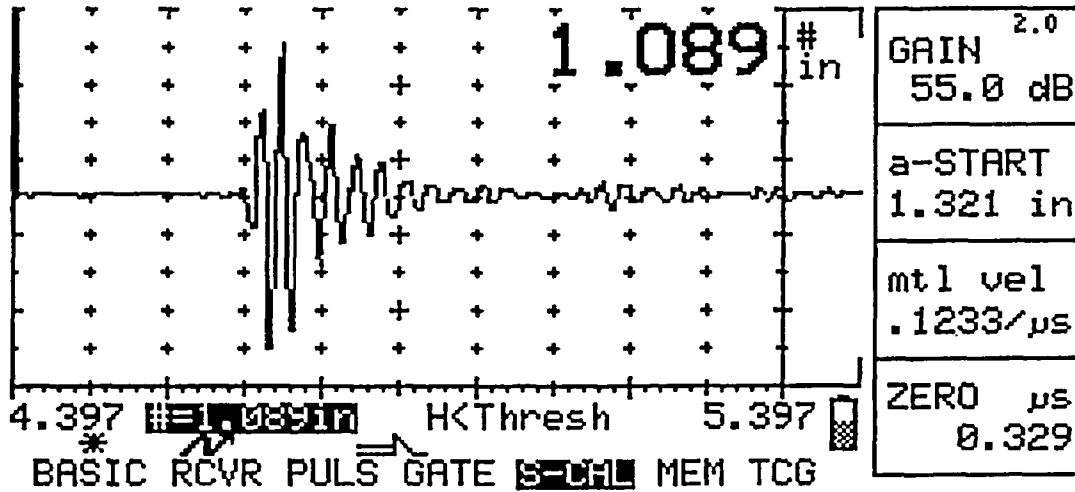

45° Pre Waveform

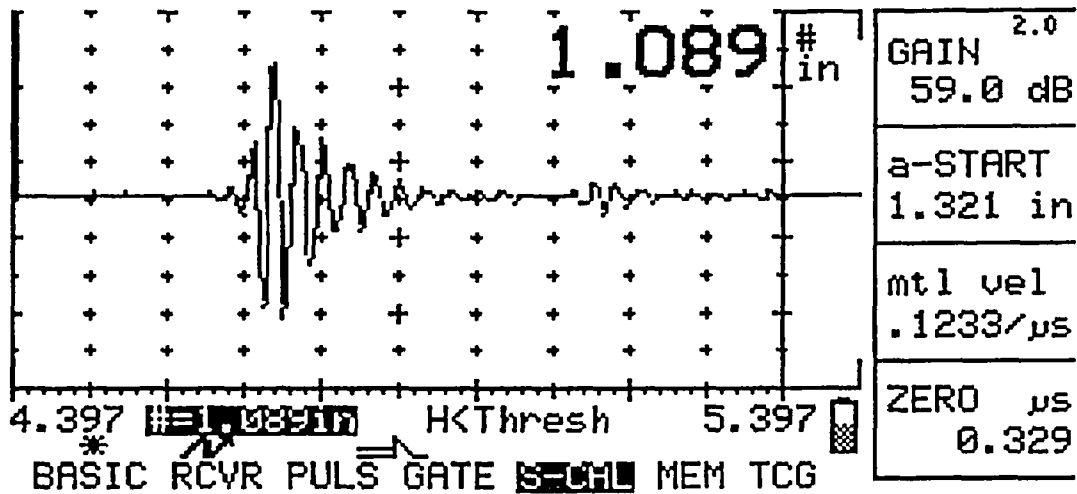


45° Post Waveform


HSB ct
4/18/02
DHH

00029
 Report Number
 R158

Nozzle Examination 60° Waveforms

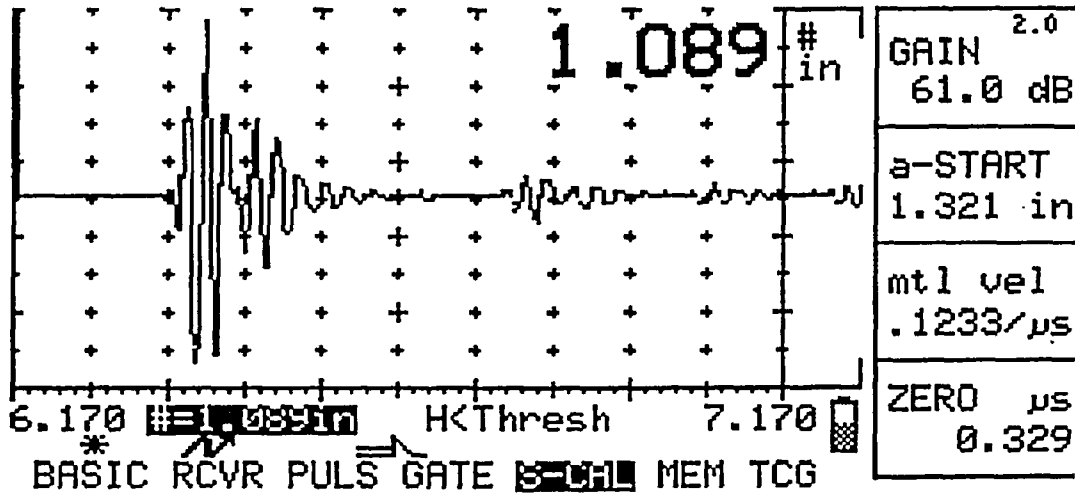

60° Pre Waveform

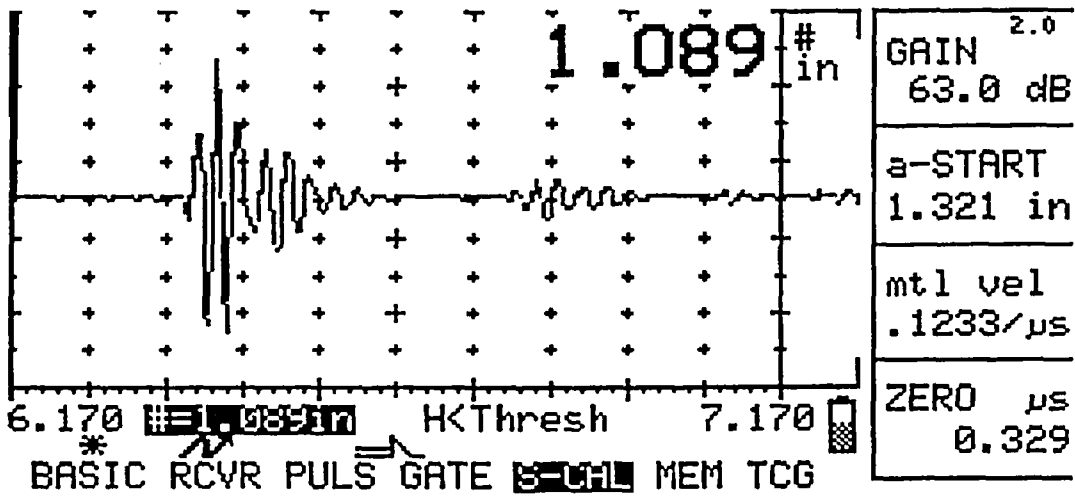

60° Post Waveform


HSBCT
 ATY
 4/18/02

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R158
------------	--	---------------------------

PROJECT: BF 11 UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 5206 7/12 and 3-30-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: 15X1 FREQ.: 2.25
 SN: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Sumec 13C SN: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY					LEADING RAY				
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	MP	
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
1/2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

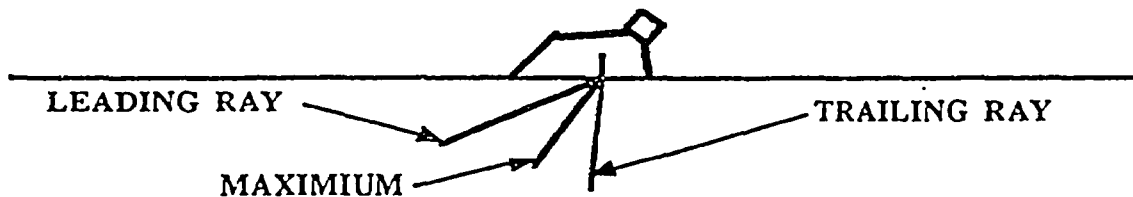

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18

FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANIL: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/18/02</u>
		PAGE: <u>11</u> OF <u>15</u>


TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R158
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0006 N/A 3-30-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5x1 FREQ.: 2.25
 S/N: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Some 13C S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	8 3/8	7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

6 J 4/11/02

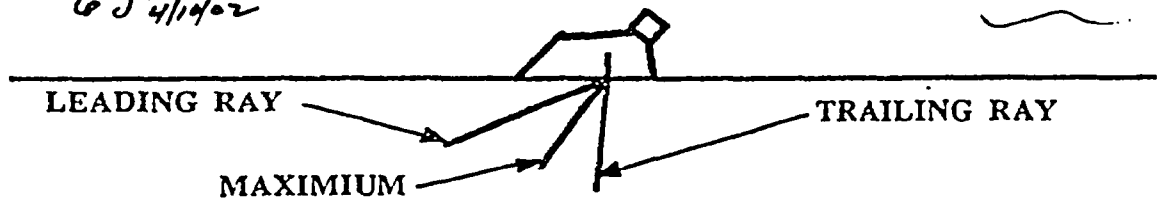

RESOLUTION


NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18

FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mike W Henry</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>Albert Hill</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>II</u> DATE: <u>4/4/02</u>	DATE: <u>4/10/02</u>
		PAGE: <u>10</u> OF <u>15</u>

00032 REPORT NUMBER
R158

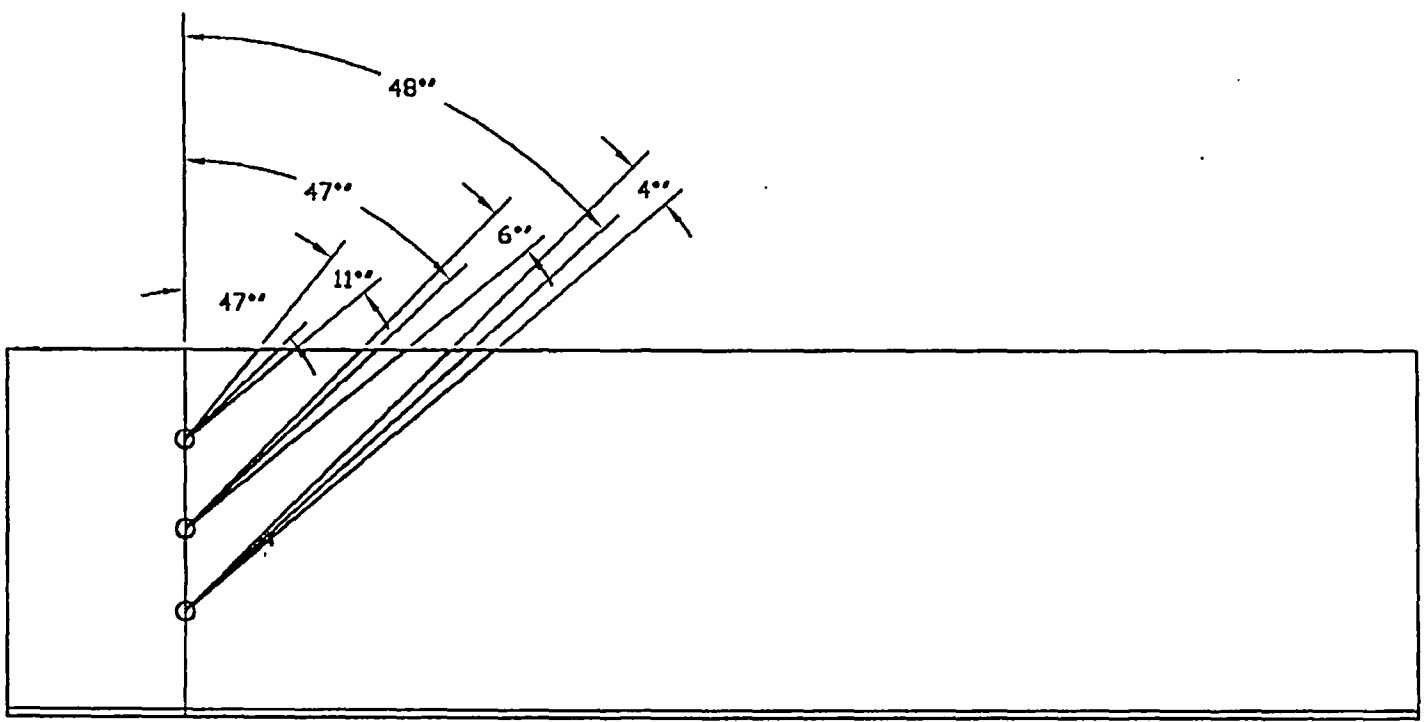

HSDCT
150514
4/1/02
4/1/02


13 08 15

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

00033 REPORT NUMBER
R 158


H56CT
1395H
60/14
18/08

SI 50 HI

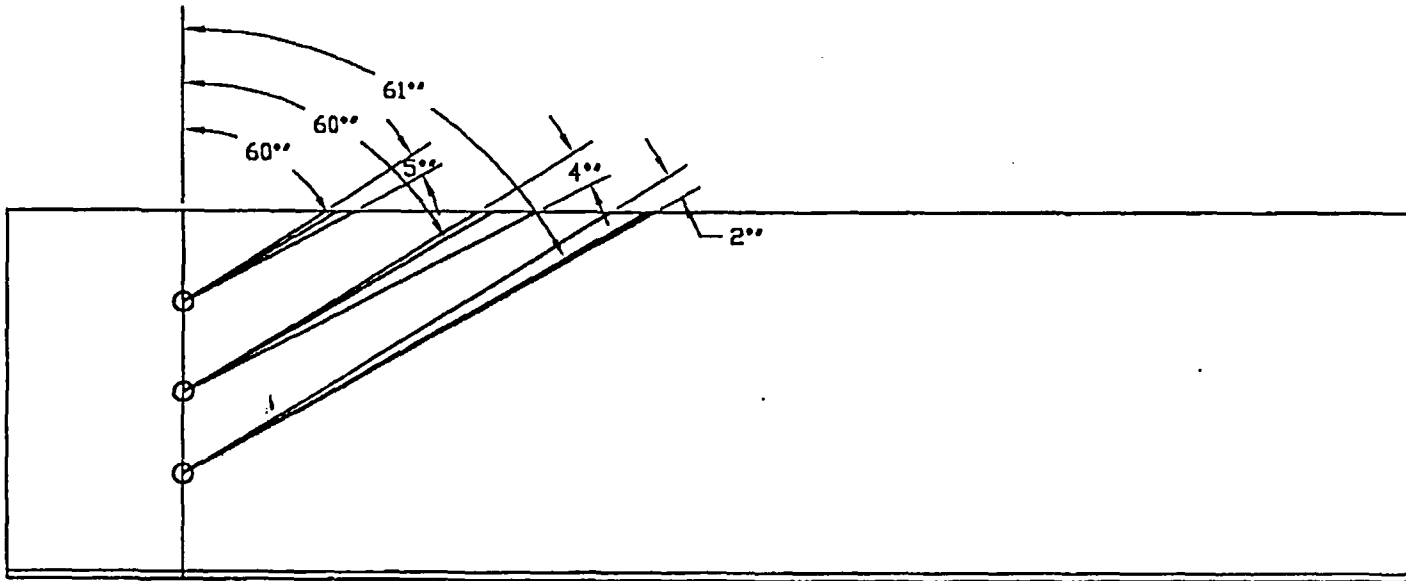

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

00034 REPORT NUMBER
R158

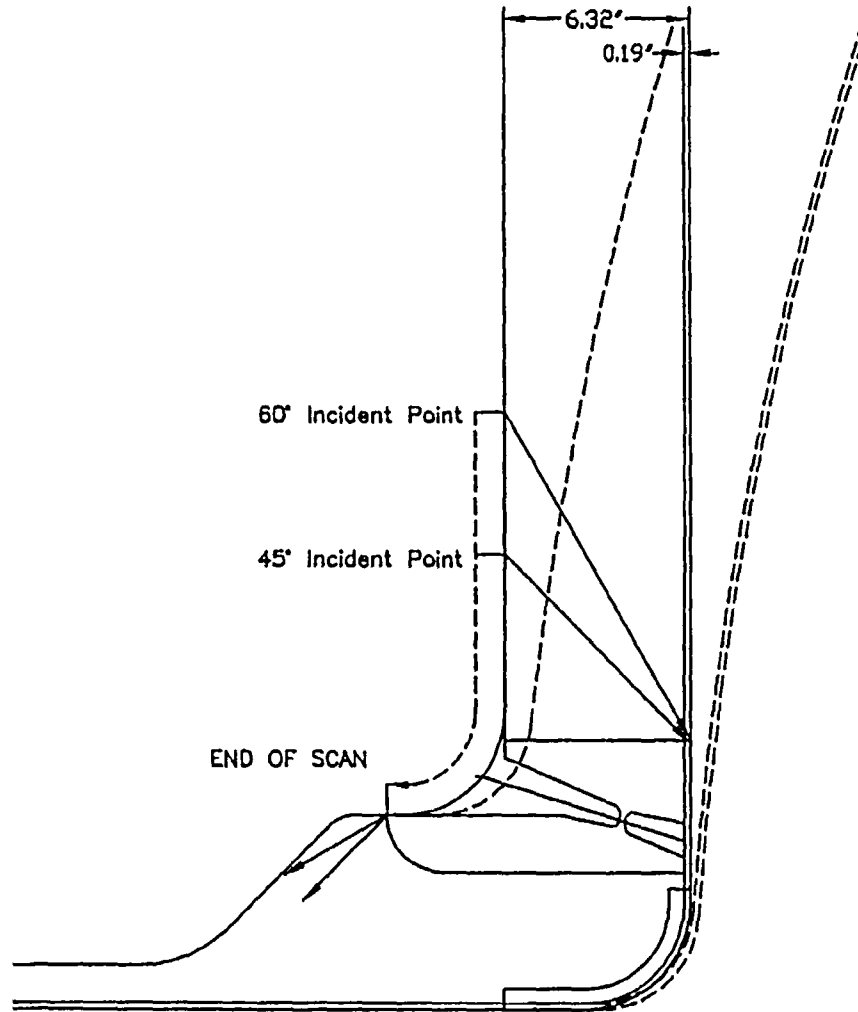

Transverse coverage includes coverage obtained during the inner radius examination

T15BCT
ATT
4/18/02

Browns Ferry Unit 3
N2 Nozzle-to-Shell
MARCH 2002
SP-N2-NS

15 08 15

00035

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R 159	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N2A-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0328-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
PROCEDURE: N-UT-55		REV: 9	TC: N/A	COFIG.:	NOZZLE TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: II		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.

N2A-IR: This examination was performed using a 19° and 25° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI.

No Recordable Indication


RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>	REVIEWED BY: <i>[Signature]</i>	ANII: <i>What Todd</i>
LEVEL: II DATE: 4-4-02	LEVEL: II DATE: 4/4/02	DATE: 4/18/02
		PG. 1 OF 24

4/18/02

00036

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R159</i>						
PROJECT: BFN UNIT: 3 CYCLE: 10			CALIBRATION DATE: 04-01-02									
PROC.: N-UT- 55 REV:9 <i>05 TC 1/10/02</i>			CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1° F									
INSTR. MFG: STAVELEY DUE DATE: 08-11-02			SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473			THERMOMETER S/N: 522352 DUE DATE: 05-17-02									
TRANSDUCER MFG: KRAUTKRAMER			COUPLANT SONOTRACE BATCH: 01141									
S/N DB 35163 SIZE: 1.0" FREQ: 2.25 MHz			EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>									
CABLE TYPE: RG 174 LENGTH: 120 inches			ANGLE VERIFICATION									
DAC			BLOCK TYPE: CS IIW			S/N: DB 55074						
			NOMINAL ANGLE: 19°			ACTUAL ANGLE: N/A						
<p style="text-align: center;">DISPLAY WIDTH: 20 inches</p>			INSTRUMENT SETTINGS									
			REFLECTOR			REFERENCE		MEMORY				
			SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER			
			AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.2 dB		19			
			CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A			
			FREQ: 2.25 MHz			REJECT: OFF %						
			ANGLE: N/A deg			DAMPING: 200 ohms						
			DELAY: 0.996 msec			PULSER: 222						
			ZERO: N/A msec			FILTER: FILT 1						
			VELOCITY: 0.234 msec			REP RATE: 4 KHZ						
RANGE: 20.0 inches			TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: N/A GAIN: N/A dB			CALIBRATION TIMES									
AMPLITUDE: N/A % METAL PATH: N/A"			INITIAL TIME: 1245			FINAL TIME: 1807						
VERIFICATION TIMES			1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	
LINEARITY CHECK												
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20
		SIGNAL 2		50	45	40	35	30	25	20	15	10
ATTENUATOR		GAIN		SET	-6 dB	-12 dB		SET	+12	SET	+6	
		AMP		80%	32 TO 48	16 TO 24		20%	64 TO 96	40%	64 TO 96	
					40	20			80		80	
COMMENTS:						WELDS/ITEMS EXAMINED:						
Wedge ID D-14795-144						REACTOR PRESSURE VESSEL						
						N2A-IR, N2C-IR, N2E-IR						
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: H			EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: H			REVIEWER: <i>[Signature]</i> LEVEL: H DATE: 4/11/02			ANI: <i>[Signature]</i> DATE: 4/18/02 PG.: 12 OF 14 2 OF 4 <i>Jan 4/19/02</i>			

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R159								
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02										
PROC.: N-UT- 55		REV: 9		TC: N/A 08		CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1° F								
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A										
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02								
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141												
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>				
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION										
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074								
				NOMINAL ANGLE: 25°		ACTUAL ANGLE: N/A								
				INSTRUMENT SETTINGS										
				REFLECTOR			REFERENCE		MEMORY					
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER					
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	60.0 dB		25					
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A					
				FREQ: 2.25 MHz		REJECT: OFF %								
				ANGLE: N/A deg		DAMPING: 200 ohms								
				DELAY: 1.12 msec		PULSER: 222								
				ZERO: N/A msec		FILTER: FILT 1								
				VELOCITY: 0.234 msec		REP RATE: 4 KHZ								
				RANGE: 20.0 inches		TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK						
				DISPLAY MODE: PE			POWER: AC							
				DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF				
				CALIBRATION TIMES										
REF. REFLECTOR: N/A				GAIN: N/A dB		INITIAL TIME: 1355		FINAL TIME: 1805						
AMPLITUDE: N/A %				METAL PATH: N/A"		1) N/A	2) N/A	3) N/A	4) N/A	5) N/A	6) N/A	7) N/A	8) N/A	9) N/A
				LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20				
	SIGNAL 2	50	45	40	35	30	25	20	15	10				
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET		+6	
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%		64 TO 96	
			40		20				80				80	
COMMENTS:						WELDS/ITEMS EXAMINED:								
Wedge ID D-14795-147						REACTOR PRESSURE VESSEL								
						N2A-IR, N2C-IR, N2E-IR								
EXAMINER: DAVID KLEINJAN <i>D.L. Kleinjan</i>		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i>		REVIEWER: <i>[Signature]</i>		ANIL: <i>[Signature]</i>		DATE: 4/10/02		PG.: 13 OF 14 3 of 4 <i>Jan 4/10/02</i>				
LEVEL: II		LEVEL: II		LEVEL: III		DATE: 4/1/02								

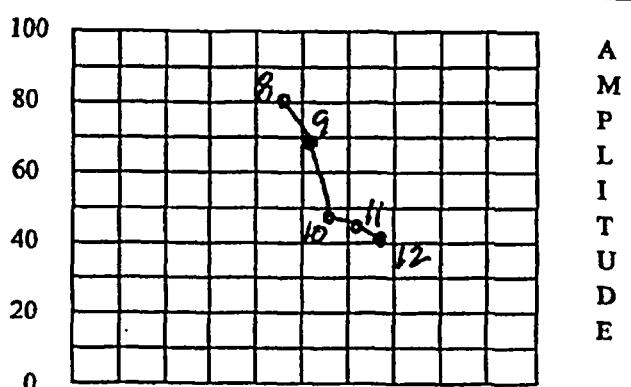

DISPLAY WIDTH: 20 inches

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R159

PROJECT: BFN UNIT: 3 WELD ID: N2A CONFIG.: INNER RADIUS COMPONENT: 1/4

CAL. SHT. NO.: NA PROCEDURE: N-UT-55 REV.: 9 PCR: 02-08 TEMP.: 85 PYRO.: 520352
08470-02

SCAN SENS.: X dB EXAM START: 1430 EXAM END: 1520 EXAM ANGLE: 19, 25°

L₀ LOCATION: TDC W₀ LOCATION: E OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
19	SCAN	dB	63.2	X			SCANNING	#		10/11			BLEND RADIUS								
25	SCAN	dB	66				SCANNING	#		19/11			BLEND RADIUS								
No Recordable Indications																					
4/11/02																					

COMMENTS: A MATERIAL NOISE LEVEL OF 8-10% WAS OBSERVED
5

EXAMINER: J.R. Klyne LEVEL: II DATE: 4-01-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/4/02
 EXAMINER: Michelle Klyne LEVEL: II DATE: 4-4-02 ANI: [Signature] DATE: 4/18/02 PAGE 4 OF 4

00033

Inspection Report R-160
Weld N2C-NV

00039

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R160</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N2C	
EXAMINATION METHOD				SYSTEM RPV	ISI DWG. NO. 3-ISI-0328-C
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: B-D
PROCEDURE: N_UT_9		REV:9	TC:02-06	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN <i>4/18/02</i>		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	EXAMINER: N/A
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	LEVEL: N/A

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld..

Examination. Nozzle to Vessel weld N2C

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination. (N2C-IR) *see R161*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

77% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indication

RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>	REVIEWED BY: <i>Spencer Whiteley</i>	ANII: <i>Albert Todd</i>
LEVEL: II DATE: <i>4-4-02</i>	LEVEL: <i>II</i> DATE: <i>4/4/02</i>	DATE: <i>4/18/02</i>
		PG. 1 OF 15

00040
REPORT Number
R160

Calculation of ASME code coverage
For section XI NDE Examination

N2C

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	100%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *

The sum of all the percentage of scans	700%
Divided by the total # of scans	9
Percentage of examination Volume coverage	77%

* Transverse coverage includes coverage obtained during the inner radius examination.

HSBCJ
4/18/02
2 of 15
5/4/02

00041


TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R160					
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 4-1-02							
PROC.: N-UT- 9		REV: 9		TC: 02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F			
INSTR. MFG: Staveley		DUE DATE: 8-05-02				SIMULATOR BLOCK NO: DB55079					
MODEL/TYPE: Sonic 136		M & TE NO.: VH751		THERMOMETER S/N: 522352		DUE DATE: 5-17-02					
TRANSDUCER MFG: Harisonic		COUPLANT SONOTRACE BATCH: 01141									
S/N DB34198		SIZE: .75		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input checked="" type="checkbox"/>			
CABLE TYPE: RG174		LENGTH: 120 inches		ANGLE VERIFICATION							
DAC		BLOCK TYPE: <i>Recipus Ramp</i>		S/N: DB55079		NOMINAL ANGLE: 0					
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>		A M P L I T U D E		INSTRUMENT SETTINGS							
				REFLECTOR			REFERENCE		MEMORY		
				SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER	
				AXIAL		<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.8 dB		1	
				CIRC		<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a	
				FREQ: 2.25		MHz		REJECT: off		%	
				ANGLE: n/a		deg		DAMPING: 500		ohms	
				DELAY: .499		msec		PULSER: 222			
				ZERO: n/a		msec		FILTER: Filt 3			
				VELOCITY: .238		msec		REPRATE: 2KHZ			
RANGE: 10		inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK							
DISPLAY MODE: PE		POWER: AC		DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF					
REF. REFLECTOR: 1"		GAIN: 8 dB		CALIBRATION TIMES							
AMPLITUDE: 80 %		METAL PATH: 1"		INITIAL TIME: 13:30		FINAL TIME: 18:00					
VERIFICATION TIMES		1) 11:45	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a		
LINEARITY CHECK											
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20
		SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12	
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96	
				40		20		80		80	
COMMENTS:					WELDS/ITEMS EXAMINED:						
					N2A, N2C, N2E Nozzle to Shell						
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II		EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i> LEVEL: II		REVIEWER: <i>Paul W. [Signature]</i> LEVEL: III		DATE: 4/1/02		ANII: <i>[Signature]</i>		DATE: 4/18/02	
					PG: 1 OF 15 3 OF 15 <i>JV1162</i>						

00042


TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R160						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 4-1-02								
PROC.: N-UT- 9		REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F						
INSTR. MFG: Staveley		DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: Sonic 136		M & TE NO.: VH751		THERMOMETER S/N: 522352		DUE DATE: 5-17-02						
TRANSDUCER MFG: Krautkramer				COUPLANT SONOTRACE BATCH: 01141								
S/N DB34843		SIZE: .5x1		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>						
CABLE TYPE: RG1743		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: DB55074						
				NOMINAL ANGLE: 45°		ACTUAL ANGLE: 46°						
				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	45.6 dB		2			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a			
				FREQ: 2.25		MHz		REJECT: off		%		
				ANGLE: N/A		deg		DAMPING: 500		ohms		
				DELAY: .830		msec		PULSER: 222				
				ZERO: N/A		msec		FILTER: FITL 3				
				VELOCITY: .126		msec		REP RATE: 2KHZ				
				RANGE: 20		inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK				
				DISPLAY MODE: PE			POWER: AC					
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: 1"			GAIN: 33.6 dB			CALIBRATION TIMES						
AMPLITUDE: 80%			METAL PATH: 1"			INITIAL TIME: 13:30		FINAL TIME: 18:00				
VERIFICATION TIMES	1) 11:45	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a	9) n/a			
LINEARITY CHECK												
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20		
	SIGNAL 2	50	45	40	35	30	25	20	15	10		
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20%		64 TO 96		40%	64 TO 96
			40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:							
Delta difference between 3/8 to 5/8 on the clad side is 3 dB					N2A, N2C, N2E Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II					EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II							
REVIEWER: <i>[Signature]</i> LEVEL: III					DATE: 4/1/02							
ANII: <i>[Signature]</i>					DATE: 4/18/02							
					PG.: 1 of 15							

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R160						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 4-1-02								
PROC.: N-UT- 9 REV:9		TC:02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F						
INSTR. MFG: Staveley		DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: Sonic 136		M & TE NO.: VH751		THERMOMETER S/N: 522352		DUE DATE: 5-17-02						
TRANSDUCER MFG: Krautkramer				COUPLANT SONOTRACE BATCH: 01141								
S/N DB34154		SIZE: .5x1		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>						
CABLE TYPE: RG174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: DB55074						
				NOMINAL ANGLE: 60		ACTUAL ANGLE: 59						
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	52 dB		3			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a			
				FREQ: 2.25 MHz		REJECT: off		%				
				ANGLE: N/A deg		DAMPING: 500		ohms				
				DELAY: 1.20 msec		PULSER: 222						
				ZERO: N/A msec		FILTER: FITL 3						
				VELOCITY: .123 msec		REP RATE: 2KHZ						
RANGE: 20 inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK										
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
CALIBRATION TIMES												
INITIAL TIME: 13:30			FINAL TIME: 18:00									
VERIFICATION TIMES		1) n/a	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a	9) n/a		
LINEARITY CHECK												
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20	
		SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %	64 TO 96		40%	64 TO 96
				40		20			80			80
COMMENTS:						WELDS/ITEMS EXAMINED:						
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE CLAD SIDE						N2A, N2C, N2E Nozzle to Shell						
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i>						EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i>			REVIEWER: <i>Paul Whitaker</i>		ANII: <i>What?</i>	
LEVEL: II		LEVEL: H		LEVEL: <i>II</i>		DATE: 4/4/02		DATE: 4/18/02		PG.: 18 TOP 15 5 of 15 <i>4/19/02</i>		

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R160</i>									
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02											
PROC.: N-UT- 55		REV: 9		TC N/A		CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1° F									
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO.: N/A											
MODEL/TYPER: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02									
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141													
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>					
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION											
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074									
				NOMINAL ANGLE: 25°		ACTUAL ANGLE: N/A									
INSTRUMENT SETTINGS															
REFLECTOR					REFERENCE		MEMORY								
SCAN DIRECT.		NTCH	SDH		SENSITIVITY		NUMBER								
AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>		60.0 dB		25								
CIRC		<input type="checkbox"/>	<input type="checkbox"/>		N/A dB		N/A								
FREQ: 2.25		MHz		REJECT: OFF		%									
ANGLE: N/A		deg		DAMPING: 200		ohms									
DELAY: 1.12		msec		PULSER: 222											
ZERO: N/A		msec		FILTER: FILT 1											
VELOCITY: 0.234		msec		REP RATE: 4 KHZ											
RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK											
DISPLAY MODE: PE				POWER: AC											
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF													
CALIBRATION TIMES															
REF. REFLECTOR: N/A		GAIN: N/A dB		INITIAL TIME: 1355		FINAL TIME: 1805									
AMPLITUDE: N/A %		METAL PATH: N/A"		VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	
LINEARITY CHECK															
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20					
	SIGNAL 2	50	45	40	35	30	25	20	15	10					
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET		+6		
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%		64 TO 96		
			40		20				80				80		
COMMENTS:					WELDS/ITEMS EXAMINED:										
					REACTOR PRESSURE VESSEL										
					N2A-IR, N2C-IR, N2E-IR										
					<i>wedge ID D-14795-147</i>										
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>[Signature]</i> LEVEL: III		DATE: 4/14/02		ANII: <i>[Signature]</i>		DATE: 5-4/18/02		PG: 15 OF 15 5 6 OF 15			

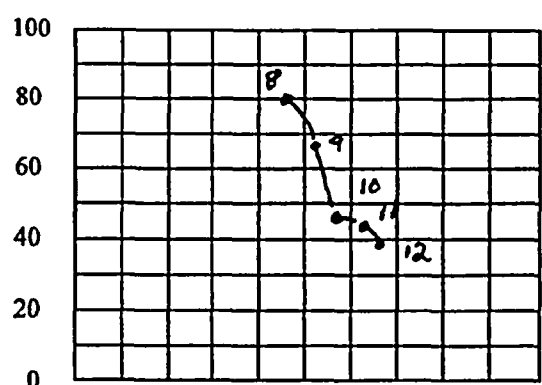

DISPLAY WIDTH: 20 inches

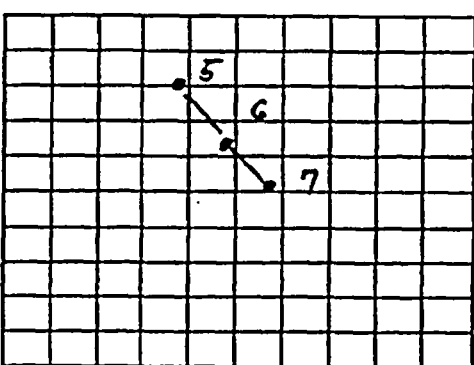TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R160							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02									
PROC.: N-UT- 55		REV: 9		TC: N/A		CALIBRATION BLOCK NO.: BF-85-IR		TEMP: 68.1°F					
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02				SIMULATOR BLOCK NO.: N/A							
MODEL/TYPER: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE				BATCH: 01141							
S/N DB 35163		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>			
CABLE TYPE: RG 174		LENGTH: 120 inches				ANGLE VERIFICATION							
DAC					BLOCK TYPE: CS IIW		S/N: DB 55074						
 <p style="text-align: center;">DISPLAY WIDTH: 20 inches</p>					NOMINAL ANGLE: 19°		ACTUAL ANGLE: N/A						
					INSTRUMENT SETTINGS								
A M P L I T U D E		REFLECTOR			REFERENCE		MEMORY						
		SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER					
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.2 dB		19					
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A					
		FREQ: 2.25		MHz		REJECT: OFF		%					
		ANGLE: N/A		deg		DAMPING: 200		ohms					
		DELAY: 0.996		msec		PULSER: 222							
		ZERO: N/A		msec		FILTER: FILT 1							
		VELOCITY: 0.234		msec		REP RATE: 4 KHZ							
		RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK							
		DISPLAY MODE: PE			POWER: AC								
		DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF								
REF. REFLECTOR: N/A		GAIN: N/A dB				CALIBRATION TIMES							
AMPLITUDE: N/A %		METAL PATH: N/A"				INITIAL TIME: 1245		FINAL TIME: 1807					
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			
LINEARITY CHECK													
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
				40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:								
					REACTOR PRESSURE VESSEL								
					N2A-IR, N2C-IR, N2E-IR								
					Wedge ID D-14795-144								
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II			REVIEWER: <i>[Signature]</i> LEVEL: III			DATE: 4/18/02		ANI: <i>[Signature]</i> DATE: 4/18/02		PG: 5 OF 15 7 OF 15 <i>4/18/02</i>	

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R160

PROJECT: BFN UNIT: 3 WELD ID: N2C CONFIG.: Nozzle COMPONENT: VESSEL

CAL. SHT. NO.: NA PROCEDURE: NT-UT-9 REV.: 9 PCR.: 02-06/157100 ~~HT~~ TEMP.: 85 PYRO.: 52232

SCAN SENS.: * dB EXAM START: 4/11/02 1520 EXAM END: 1620 EXAM ANGLE: 0°, 45°, 60°

Lo LOCATION: TDC Wo LOCATION: E OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%			
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2	
19°	SCAN	dB	63.2	*					10/11													
25°	SCAN	dB	66.						10/11													
0°	SCAN	dB	34.8						9													
45°	SCAN	dB	56.6						9													
45T	SCAN	dB	56.6						10/11													
45TAN	SCAN	dB	56.6						10/11													
60°	SCAN	dB	63.						9													
60T	SCAN	dB	63.						10/11													
60TAN	SCAN	dB	63.						10/11													
NO RECORDABLE INDICATION																						


COMMENTS: 19° AND 25 EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE INNER RADIUS EXAMINATIONS. 50% TO 10% NOISE LEVEL WAS OBSERVED

EXAMINER: [Signature] LEVEL: III DATE: 4-9-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/11/02
 EXAMINER: [Signature] LEVEL: II DATE: 04-01-02 ANII: [Signature] DATE: 4/13/02 PAGE 88 OF 15


00048

00047 REPORT NUMBER
R160

Nozzle Examination 45° Waveforms

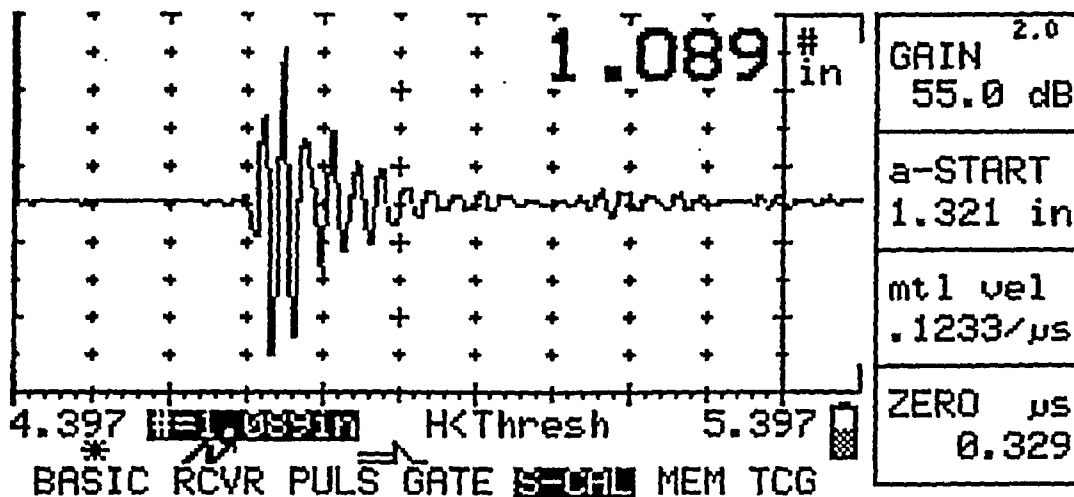

45° Pre Waveform

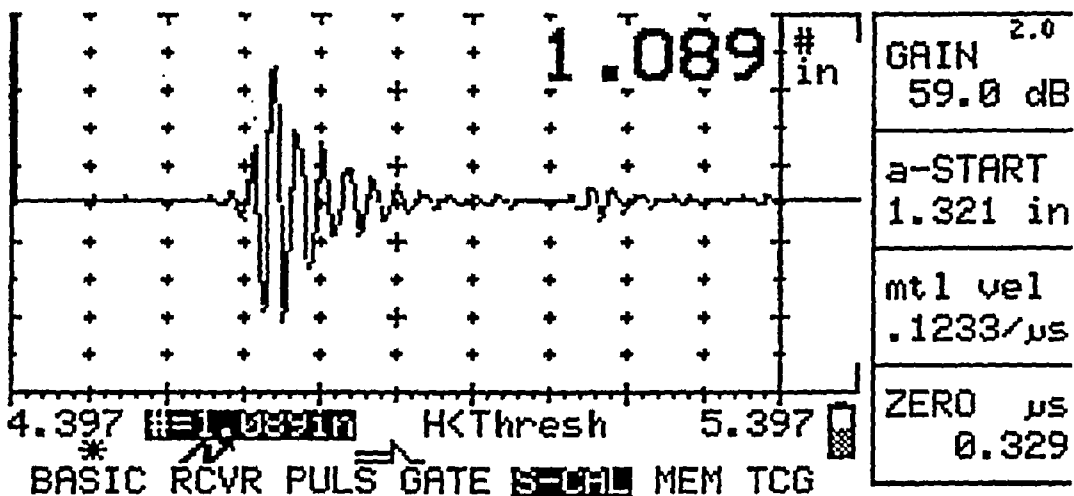


45° Post Waveform


HSBCT
4/18/02
ATI
9
10 of 15
2/21/02

00048.
REPORT NUMBER
R160

Nozzle Examination 60° Waveforms

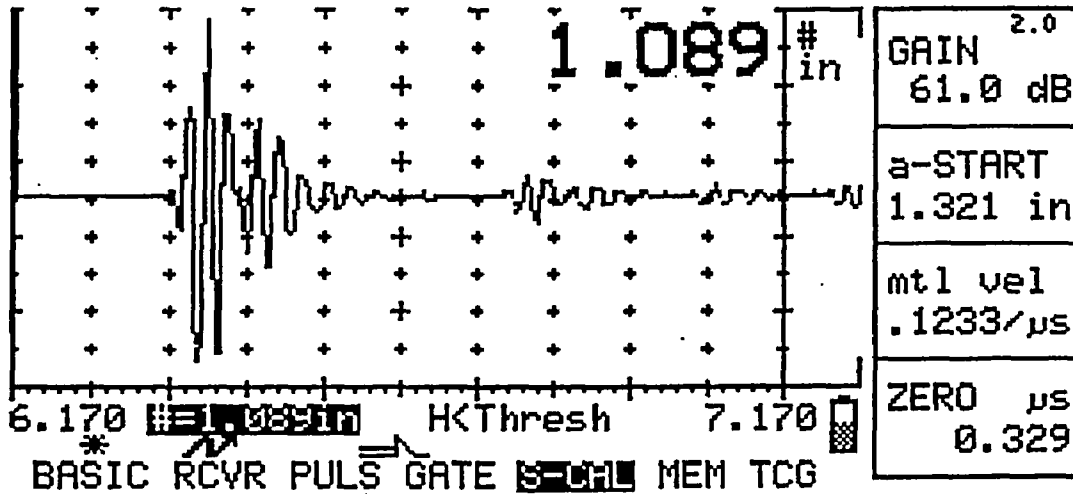

60° Pre Waveform

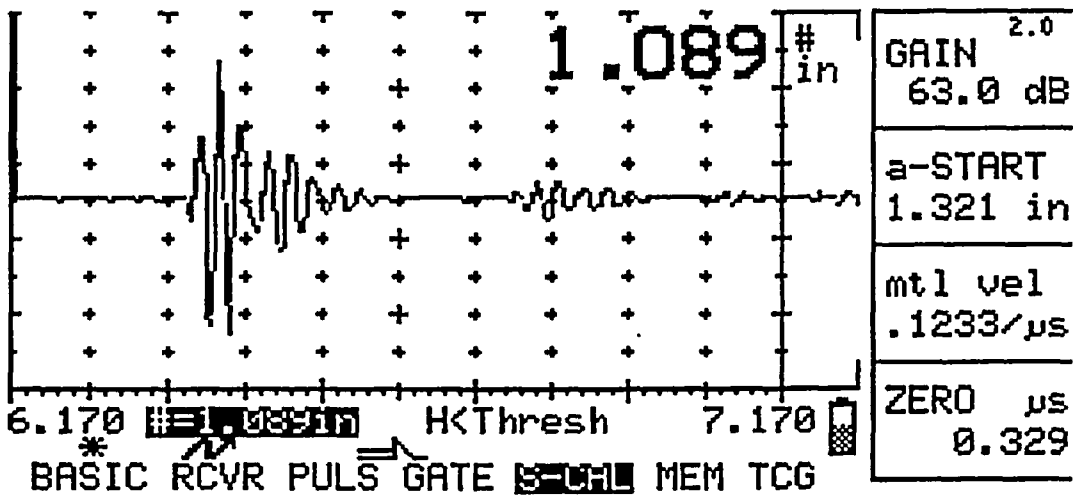

60° Post Waveform

HSBGT
4/10/02

100815


00049

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. <u>R160</u>
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-OT-9 REV.: 9 PCR: Q205 N/A 2/3/02
 SEARCH UNIT-MAKE: Krautkramer SIZE: 15X1 FREQ.: 2.25
 S/N: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Some 13C S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY					LEADING RAY				
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

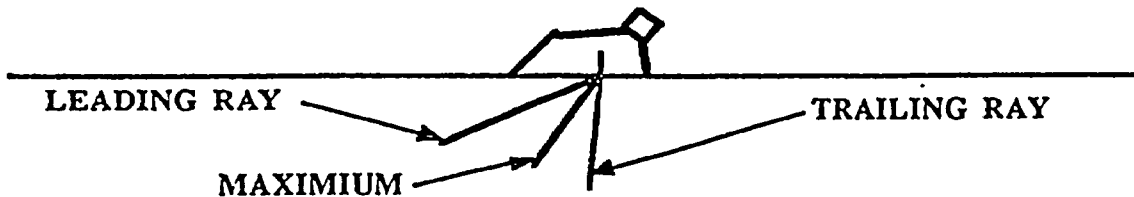

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18

FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N


EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>Albert Lull</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/18/02</u>
		PAGE: <u>11</u> OF <u>15</u>

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. <u>R160</u>
------------	--	---------------------------

PROJECT: BFA UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0206 N/A 3/24/02
 SEARCH UNIT-MAKE: Krautk SIZE: .5X1 FREQ.: 2.25
 S/N: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Sonn 13C S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY						LEADING RAY			
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	8 3/4	7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

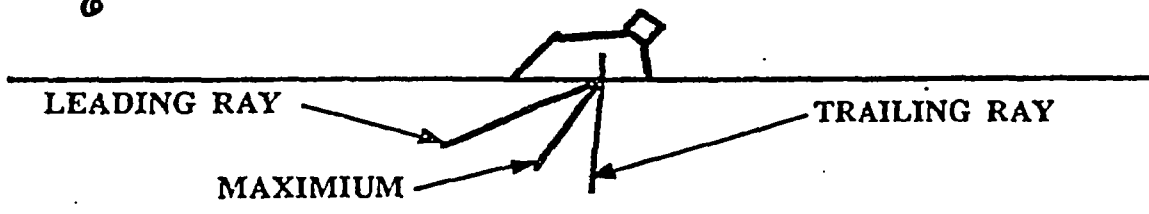


RESOLUTION

NEAR SURFACE REFLECTOR: Nitch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Nitch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mike W. Henry</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/18/02</u> PAGE: <u>3</u> OF <u>15</u>

4180-44491102

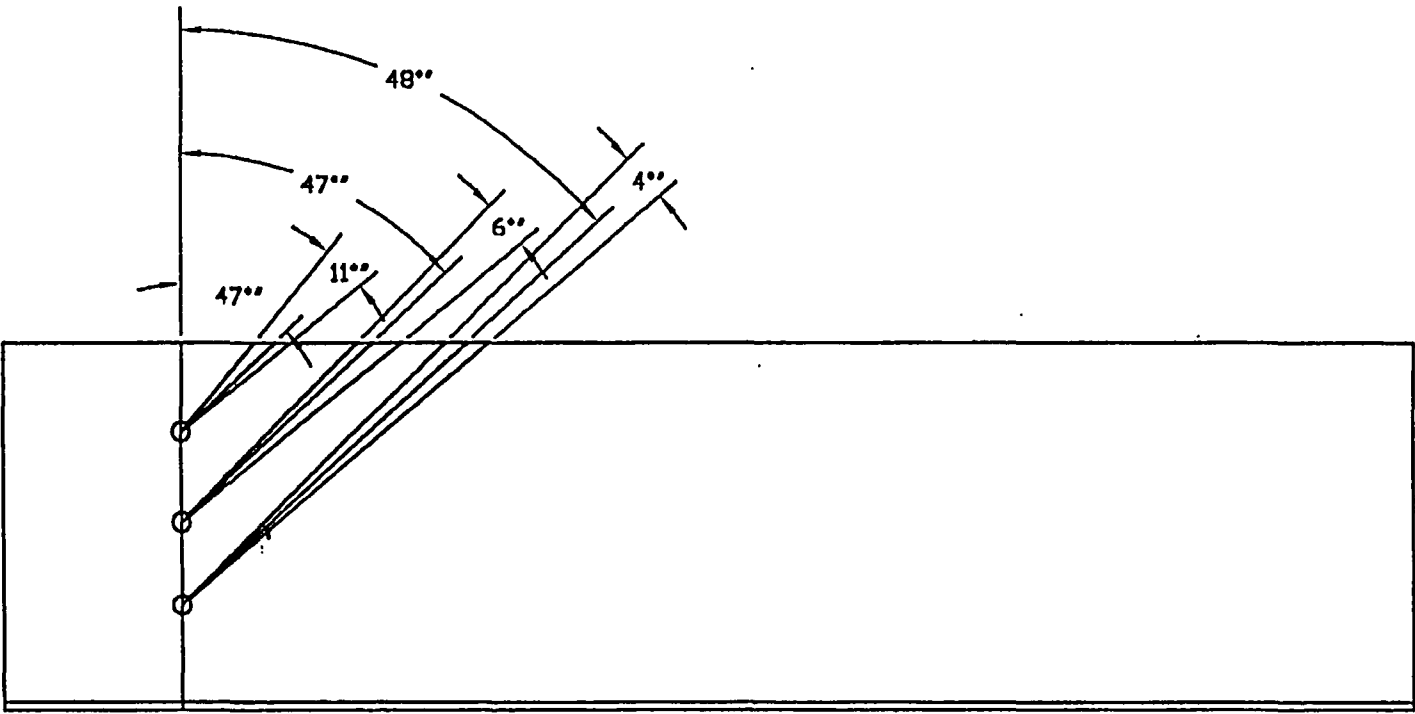


Repeat Number
R16b

00051

HSBCJ
4/18/02

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

5480-9747/100

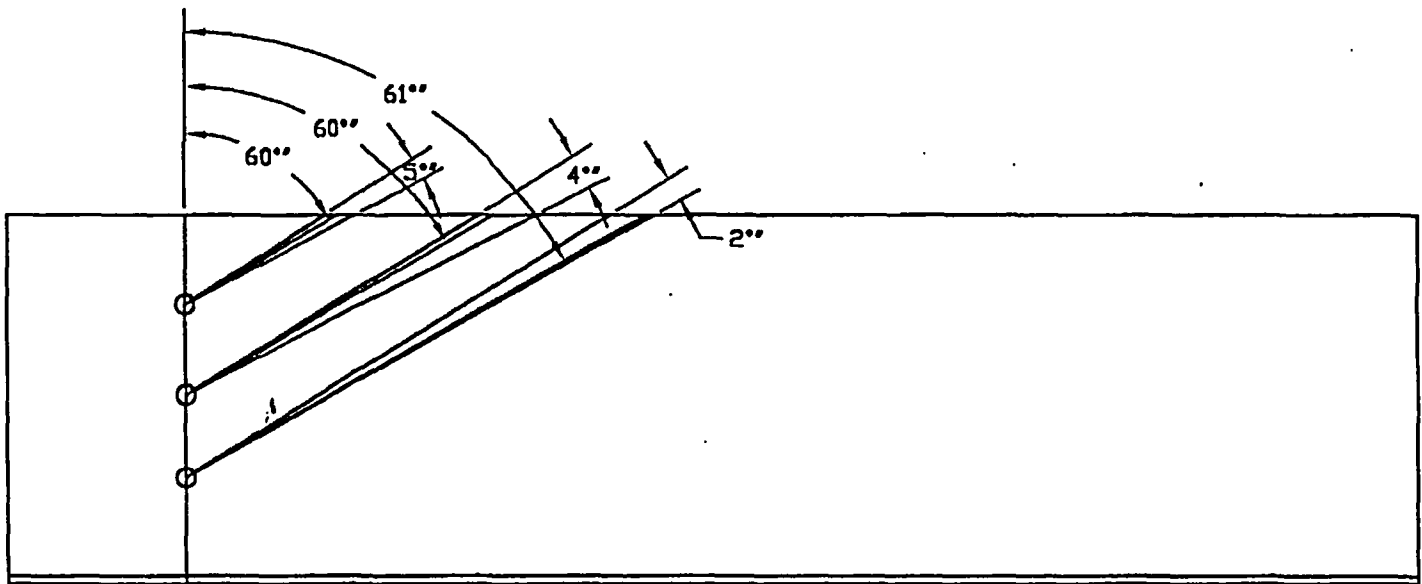

Rubber Number
R160


14 05 15

HSBCT
9/1
4/18/02

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

00052

REPORT NUMBER
00053 R160

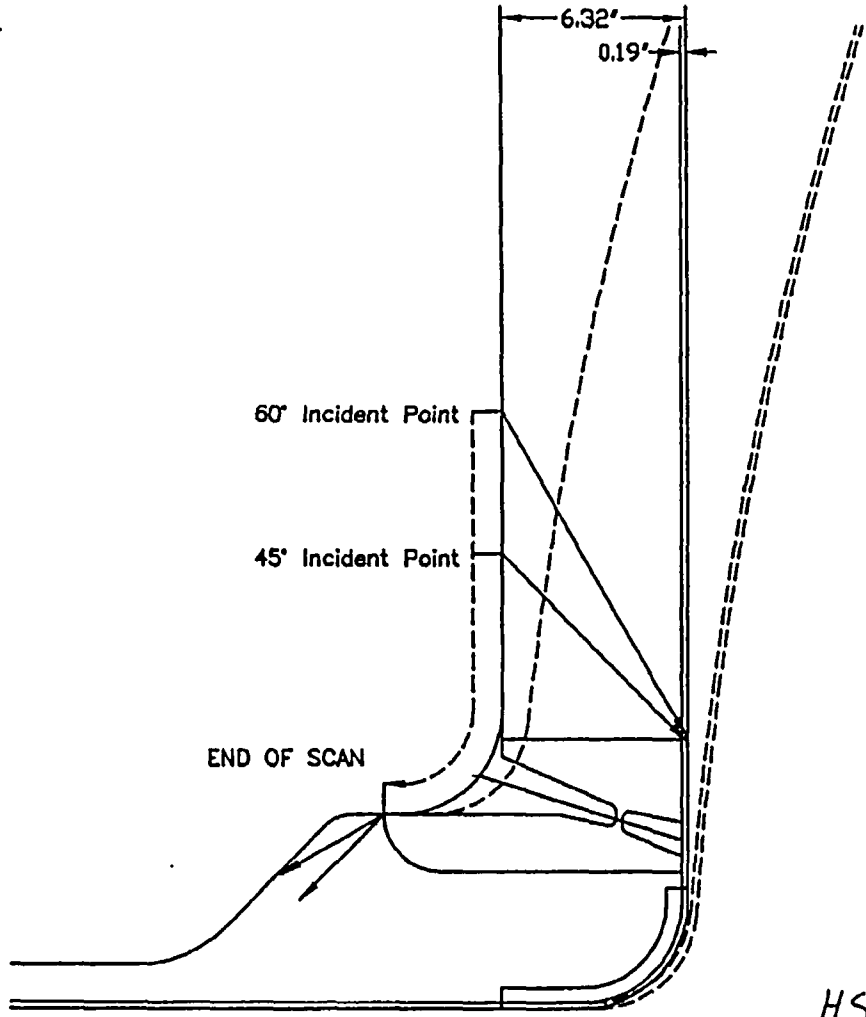

Transverse coverage includes coverage obtained during the inner radius examination

HSBCJ
djh
4/18/02

Browns Ferry Unit 3
N2 Nozzle-to-Shell
MARCH 2002
SP-N2-NS

21 5. 2 51
15 2. 5 15

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R161</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N2C-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0328-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
CATEGORY: B-D					
PROCEDURE: N-UT-55		REV: 9	TC: N/A	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN <i>4/18/02</i>		EXAMINER: DAVID KLEINJAN <i>03-08</i>		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.

N2C-IR: This examination was performed using a 19° and 25° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>		REVIEWED BY: <i>Paul Whitaker</i>		ANIL <i>Robert Hall</i>	
LEVEL: II DATE: <i>4-4-02</i>		LEVEL: <i>II</i> DATE: <i>4/18/02</i>		DATE: <i>4/18/02</i>	
				PG. 1 OF <i>14</i>	


4/18/02

00055

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R161
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 04-01-02
PROC.: N-UT- 55 REV:9 DATE: N/A	CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1° F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35163 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: CS IIW	S/N: DB 55074
	NOMINAL ANGLE: 19°	ACTUAL ANGLE: N/A

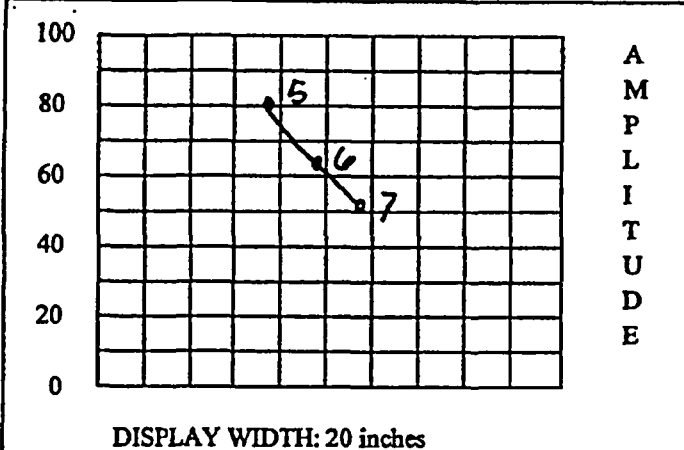

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.2 dB	19
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ: 2.25 MHz	REJECT: OFF %			
ANGLE: N/A deg	DAMPING: 200 ohms			
DELAY: 0.996 msec	PULSER: 222			
ZERO: N/A msec	FILTER: FILT 1			
VELOCITY: 0.234 msec	REP RATE: 4 KHZ			
RANGE: 20.0 inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK			
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: N/A	GAIN: N/A dB	CALIBRATION TIMES							
AMPLITUDE: N/A %	METAL PATH: N/A"	INITIAL TIME: 1245				FINAL TIME: 1807			
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	
	SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6			
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96			
			40	20		80		80			

COMMENTS:	WELDS/ITEMS EXAMINED:
Wedge ID D-14795-144 ✓	REACTOR PRESSURE VESSEL
	N2A-IR, N2C-IR, N2E-IR ✓

EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: I	EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: II DATE: 4/10/02	ANIL: <i>[Signature]</i> DATE: 4/10/02 PG.: 2 of 4 <i>25-4/10/02</i>
---	---	---	---

00056

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R161</i>						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02								
PROC.: N-UT- 55		REV: 9		OF TC: N/A		CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1° F						
INSTR. MFG: STAVELEY			DUE DATE: 08-11-02			SIMULATOR BLOCK NO: N/A						
MODEL/TYPE: SONIC-137			M & TE NO.: VH-5473			THERMOMETER S/N: 522352 DUE DATE: 05-17-02						
TRANSDUCER MFG: KRAUTKRAMER						COUPLANT SONOTRACE BATCH: 01141						
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>						
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC			BLOCK TYPE: CS IIW		S/N: DB 55074							
			NOMINAL ANGLE: 25°		ACTUAL ANGLE: N/A							
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">100 80 60 40 20 0</div> <div style="flex-grow: 1;"> </div> <div style="margin-left: 10px; writing-mode: vertical-rl; transform: rotate(180deg);">A M P L I T U D E</div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: 20 inches</p>						INSTRUMENT SETTINGS						
						REFLECTOR			REFERENCE		MEMORY	
						SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER
						AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	60.0 dB		25
						CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A
						FREQ: 2.25		MHz		REJECT: OFF %		
						ANGLE: N/A		deg		DAMPING: 200 ohms		
						DELAY: 1.12		msec		PULSER: 222		
						ZERO: N/A		msec		FILTER: FILT 1		
						VELOCITY: 0.234		msec		REP RATE: 4 KHZ		
RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: N/A			GAIN: N/A dB			CALIBRATION TIMES						
AMPLITUDE: N/A %			METAL PATH: N/A"			INITIAL TIME: 1355		FINAL TIME: 1805				
VERIFICATION TIMES			1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A				
						7)N/A	8)N/A	9)N/A				
LINEARITY CHECK												
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20	
		SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %	64 TO 96		40%	64 TO 96
				40		20			80			80
COMMENTS:						WELDS/ITEMS EXAMINED:						
Wedge ID D-14795-147						REACTOR PRESSURE VESSEL						
						N2A-IR, N2C-IR, N2E-IR						
EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: H		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>Paul [Signature]</i> LEVEL: II DATE: 4/10/02		ANI: <i>What [Signature]</i> DATE: 4/10/02 PG.: 1 of 1 of 3 of 4 <i>3/5/10/02</i>						

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R161

PROJECT: BFAI UNIT: 3 WELD ID: N2C CONFIG.: INNER. RADIOS COMPONENT: N/A

CAL. SHT. NO.: NA PROCEDURE: N-UT-55 REV.: 9 PCR.: 02-08 TEMP.: 85 PYRO.: 522352
~~N/A~~ 084-10-00

SCAN SENS.: * dB EXAM START: 1520 EXAM END: 1620 EXAM ANGLE: 19°, 25°

Lo LOCATION: TDC Wo LOCATION: φ OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
				*																	
19°	SCAN		dB	632			SCANNING	#	10/11				BLEND RADIUS								
25°	SCAN		dB	660			SCANNING	#	10/11				BLEND RADIUS								
				No Recordable			Indication														

COMMENTS: A MATERIAL NOISE LEVEL OF 5.10 76 WAS OBSERVED

EXAMINER: [Signature] LEVEL: II DATE: 04-01-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/4/02
 EXAMINER: [Signature] LEVEL: II DATE: 04-04-02 ANI: [Signature] DATE: 4/18/02 PAGE 24 OF 4

00157

Inspection Report R-162
Weld N2E-NV

00058

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R162</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N2E	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0328-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
				CATEGORY: B-D	
PROCEDURE: N-UT-9		REV:9	TC:02-06	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN <i>4/4/02</i>		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld..

Examination. Nozzle to Vessel weld N2E

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination. (N2E-IR) *see R163*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

77% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY:

Mike Kleinjan
mkw

LEVEL: II DATE: *4-4-02*

REVIEWED BY:

For [Signature]

LEVEL: *II* DATE: *4/4/02*

ANI:

What Todd
DATE: *4/10*

PG. 1 OF *15* *5/10/02*
15

Calculation of ASME code coverage
For section XI NDE Examination

N2E

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	100%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *

The sum of all the percentage of scans	700%
Divided by the total # of scans	9
Percentage of examination Volume coverage	77%

* Transverse coverage includes coverage obtained during the inner radius examination.


MSBCT
4/19/00
20815

00060

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R162
---------------------------------------	--	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 4-1-02
PROC.: N-UT- 9 REV:9 TC:02-06	CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F
INSTR. MFG: Staveley DUE DATE: 8-05-02	SIMULATOR BLOCK NO: DB55079
MODEL/TYPE: Sonic 136 M & TE NO.: VH751	THERMOMETER S/N: 522352 DUE DATE: 5-17-02
TRANSDUCER MFG: Harisonic	COUPLANT SONOTRACE BATCH: 01141
S/N DB34198 SIZE: .75 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG174 LENGTH: 120 inches	

DAC	ANGLE VERIFICATION
	BLOCK TYPE: Replus Replus S/N: DB55079
	NOMINAL ANGLE: 0 ACTUAL ANGLE: N/A

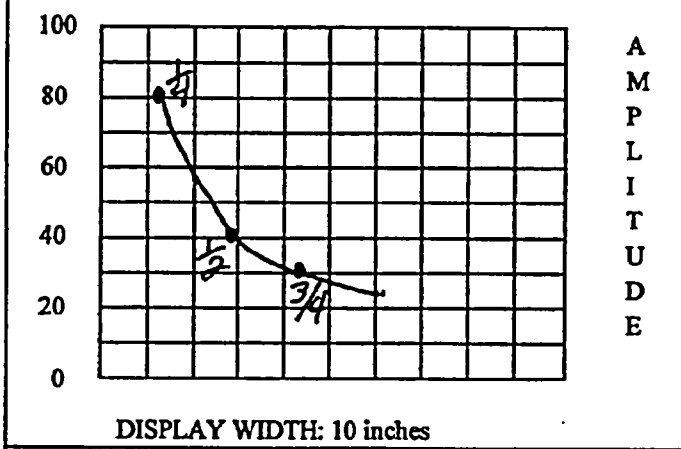

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.8 dB	1
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB	n/a
FREQ: 2.25 MHz	REJECT: off %			
ANGLE: n/a deg	DAMPING: 500 ohms			
DELAY: .499 msec	PULSER: 222			
ZERO: n/a msec	FILTER: Filt 3			
VELOCITY: .238 msec	REP RATE: 2KHZ			
RANGE: 10 inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK			
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: 1" GAIN: 8 dB	CALIBRATION TIMES								
AMPLITUDE: 80 % METAL PATH: 1"	INITIAL TIME: 13:30	FINAL TIME: 18:00							
VERIFICATION TIMES	1) 11:45	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a	9) n/a

J-4/19/02

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
	ATTEN		40	20	80	80				


COMMENTS:	WELDS/ITEMS EXAMINED:
	N2A, N2C, N2E Nozzle to Shell

EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i>	EXAMINER: DAVID KLEINIAN <i>D. Kleinian</i>	REVIEWER: <i>Paul Whiteley</i>	ANII: <i>Albat</i>
LEVEL: II	LEVEL: II	DATE: 4/19/02	DATE: 4/19/02
		PG: 24 OF 15	PG: 24 OF 15

3 J-4/19/02

00061

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R162							
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 4-1-02				PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F					
INSTR. MFG: Staveley DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079				MODEL/TYPE: Sonic 136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02					
TRANSUCER MFG: Krautkramer		COUPLANT SONOTRACE BATCH: 01141				S/N DB34843 SIZE: .5x1 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>					
CABLE TYPE: RG1743 LENGTH: 120 inches		ANGLE VERIFICATION											
DAC		BLOCK TYPE: IIW				S/N: DB55074							
		NOMINAL ANGLE: 45°				ACTUAL ANGLE: 46°							
DAC		INSTRUMENT SETTINGS											
		REFLECTOR				REFERENCE		MEMORY					
		SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER			
		AXIAL		<input type="checkbox"/>		<input checked="" type="checkbox"/>		45.6 dB		2			
		CIRC		<input type="checkbox"/>		<input type="checkbox"/>		n/a dB		n/a			
		FREQ: 2.25 MHz		REJECT: off		%		DAMPING: 500		ohms			
		ANGLE: N/A deg		PULSER: 222		FILTER: FITL 3		VELOCITY: .126 msec		REP RATE: 2KHZ			
		DELAY: .830 msec		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK		DISPLAY MODE: PE		POWER: AC		DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			
		ZERO: N/A msec		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		CALIBRATION TIMES		INITIAL TIME: 13:30		FINAL TIME: 18:00			
		VELOCITY: .126 msec		VERIFICATION TIMES		1) 11:45		2) n/a		3) n/a			
RANGE: 20 inches		4) n/a		5) n/a		6) n/a		7) n/a					
DISPLAY MODE: PE		8) n/a		9) n/a		3-4/10/02							
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		LINEARITY CHECK											
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN SET		-6 dB		-12 dB		SET		+12		SET +6	
		AMP 80%		32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
				40		20				80		80	
COMMENTS:						WELDS/ITEMS EXAMINED:							
Delta difference between 3/8 to 5/8 on the clad side is 3 dB						N2A, N2C, N2E Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i>						EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>							
LEVEL: II						REVIEWER: <i>Paul Whitely</i>							
						DATE: 4/19/02							
						PG.: 15 OF 16							
						<i>4/19/02</i>							

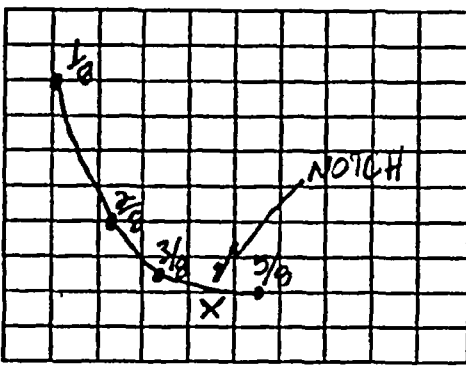

AMPLITUDE
DISTANCE


DISPLAY WIDTH: 10 inches

00062

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R162
---------------------------------------	--	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 4-1-02
PROC.: N-UT- 9 REV:9 TC:02-06	CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F
INSTR. MFG: Staveley DUE DATE: 8-05-02	SIMULATOR BLOCK NO.: DB55079
MODEL/TYPE: Sonic 136 M & TE NO.: VH751	THERMOMETER S/N: 522352 DUE DATE: 5-17-02
TRANSDUCER MFG: Krautkramer	COUPLANT SONOTRACE BATCH: 01141
S/N DB34154 SIZE: .5x1 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: IIW S/N: DB55074
	NOMINAL ANGLE: 60 ACTUAL ANGLE: 59

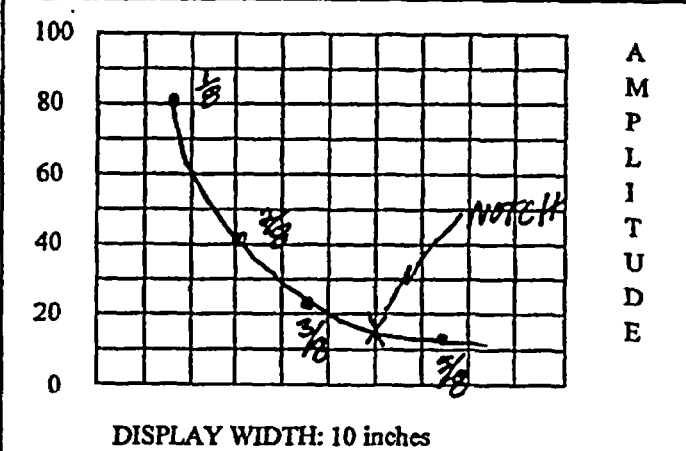

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	52 dB	3
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB	n/a
FREQ: 2.25	MHz	REJECT: off	%	
ANGLE: N/A	deg	DAMPING: 500	ohms	
DELAY: 1.20	msec	PULSER: 222		
ZERO: N/A	msec	FILTER: FITL 3		
VELOCITY: .123	msec	REP RATE: 2KHZ		
RANGE: 20	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK		
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: 1" GAIN: 36 dB	CALIBRATION TIMES
AMPLITUDE: 80% METAL PATH: 1"	INITIAL TIME: 13:30 FINAL TIME: 18:00

VERIFICATION TIMES	1) n/a	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a	9) n/a
--------------------	--------	--------	--------	--------	--------	--------	--------	--------	--------

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96		
			40	20		80		80		


COMMENTS: DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE CLAD SIDE	WELDS/ITEMS EXAMINED: N2A, N2C, N2E Nozzle to Shell

EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i> LEVEL: II	EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i> LEVEL: II	REVIEWER: <i>David Kleinjan</i> LEVEL: II DATE: 4/1/02	ANI: <i>David Kleinjan</i> DATE: 4/19/02 PG.: 18 OF 15 <i>4/19/02</i>
--	--	---	--

00063

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: <i>R162</i>
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 04-01-02
PROC.: N-UT- 55 REV:9 <i>AS TC: N/A 08</i>	CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1° F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35163 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION
DAC	BLOCK TYPE: CS IIW S/N: DB 55074
	NOMINAL ANGLE: 19° ACTUAL ANGLE: N/A

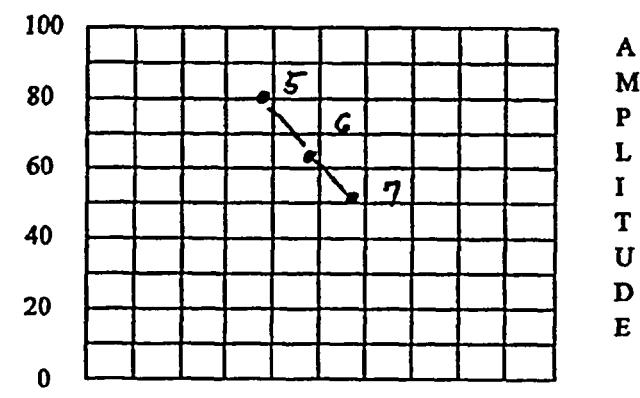

DISPLAY WIDTH: 20 inches

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.2 dB	19
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ: 2.25 MHz	REJECT: OFF %			
ANGLE: N/A deg	DAMPING: 200 ohms			
DELAY: 0.996 msec	PULSER: 222			
ZERO: N/A msec	FILTER: FILT 1			
VELOCITY: 0.234 msec	REP RATE: 4 KHZ			
RANGE: 20.0 inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK			
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: N/A	GAIN: N/A dB	CALIBRATION TIMES							
AMPLITUDE: N/A %	METAL PATH: N/A"	INITIAL TIME: 1245	FINAL TIME: 1807						
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
	REACTOR PRESSURE VESSEL
	N2A-IR, N2C-IR, N2E-IR
	<i>wedge IO D-14795-144</i>

EXAMINER: DAVID KLEINJAN <i>[Signature]</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>[Signature]</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: <i>II</i> DATE: <i>4/19/02</i>	ANI: <i>[Signature]</i> DATE: <i>4/19/02</i> PG.: <i>17</i> OF 15 <i>6 Jan 4/19/02</i>
--	---	--	---

00064

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R162						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02								
PROC.: N-UT- 55		REV: 9		TC: N/A		CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1° F						
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A								
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02						
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141										
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>		
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC		BLOCK TYPE: CS HW				S/N: DB 55074						
		NOMINAL ANGLE: 25°				ACTUAL ANGLE: N/A						
		INSTRUMENT SETTINGS										
		REFLECTOR			REFERENCE			MEMORY				
		SCAN DIRECT.		NTCH	SDH	SENSITIVITY			NUMBER			
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	60.0 dB			25			
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB			N/A			
		FREQ: 2.25		MHz	REJECT: OFF			%				
		ANGLE: N/A		deg	DAMPING: 200			ohms				
		DELAY: 1.12		msec	PULSER: 222							
		ZERO: N/A		msec	FILTER: FILT 1							
		VELOCITY: 0.234		msec	REP RATE: 4 KHZ							
		RANGE: 20.0		inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK							
		DISPLAY MODE: PE			POWER: AC							
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES								
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1355		FINAL TIME: 1805						
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
			40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:							
					REACTOR PRESSURE VESSEL							
					N2A-IR, N2C-IR, N2E-IR							
					Wedge IO D-4795-147							
EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>Paul Whitaker</i> LEVEL: III		DATE: 4/19/02		ANTI: <i>What?</i>		DATE: 4/19/02		PG.: 18 OF 15

5/7/02

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R162

PROJECT: BFN UNIT: 3 WELD ID: N2E CONFIG.: NOzzle COMPONENT: VESSEL

CAL. SHT. NO.: NA PROCEDURE: NI-UT-9 REV.: 9 PCR.: 07-06 TEMP.: 85 PYRO.: 522352
4/11/02 5-7/11/02

SCAN SENS.: X dB EXAM START: 1630 EXAM END: 1745 EXAM ANGLE: 0°, 45°, 60°

Lo LOCATION: TDC Wo LOCATION: ☒ OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
19°	SCAN	dB	63.2				SCANNING	#	10/11	BLEND RADIUS											
25°	SCAN	dB	66.				SCANNING	#	10/11	BLEND RADIUS											
0°	SCAN	dB	34.8				SCANNING	#	9	ON WELD AND BASE MATERIAL											
45°	SCAN	dB	56.6				SCANNING	#	9	ON WELD AND VESSEL SIDE											
45°T	SCAN	dB	56.6				SCANNING	#	10/11	CW/CCW VESSEL SIDE											
45°TAN	SCAN	dB	56.6				SCANNING	#	10/11	CW/CCW VESSEL SIDE											
60°	SCAN	dB	63.				SCANNING	#	9	ON WELD AND VESSEL SIDE											
60°T	SCAN	dB	63.				SCANNING	#	10/11	CW/CCW VESSEL SIDE											
60°TAN	SCAN	dB	63.				SCANNING	#	10/11	CW/CCW VESSEL SIDE											
NO RECORDABLE INDICATION																					

00055


COMMENTS: 19° AND 25° EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS
 TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE
 INNER RADIUS EXAMINATIONS. 5 TO 10% NOISE LEVEL WAS OBSERVED

EXAMINER: [Signature] LEVEL: II DATE: 4-4-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/4/02
 EXAMINER: [Signature] LEVEL: II DATE: 04-01-02 ANI: [Signature] DATE: 4/9/02 PAGE 28 OF 15


REPORT NUMBER
R162

00066

Nozzle Examination 45° Waveforms

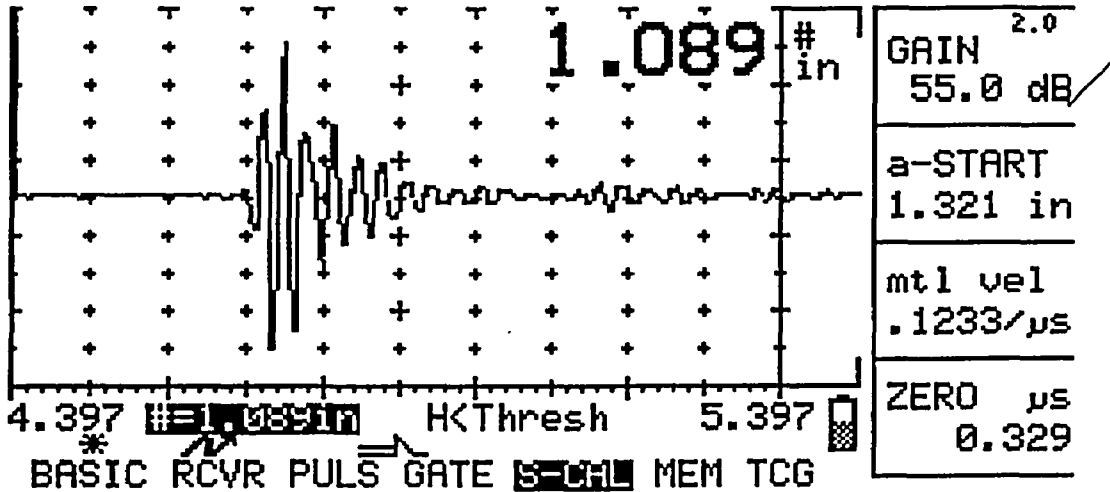

45° Pre Waveform

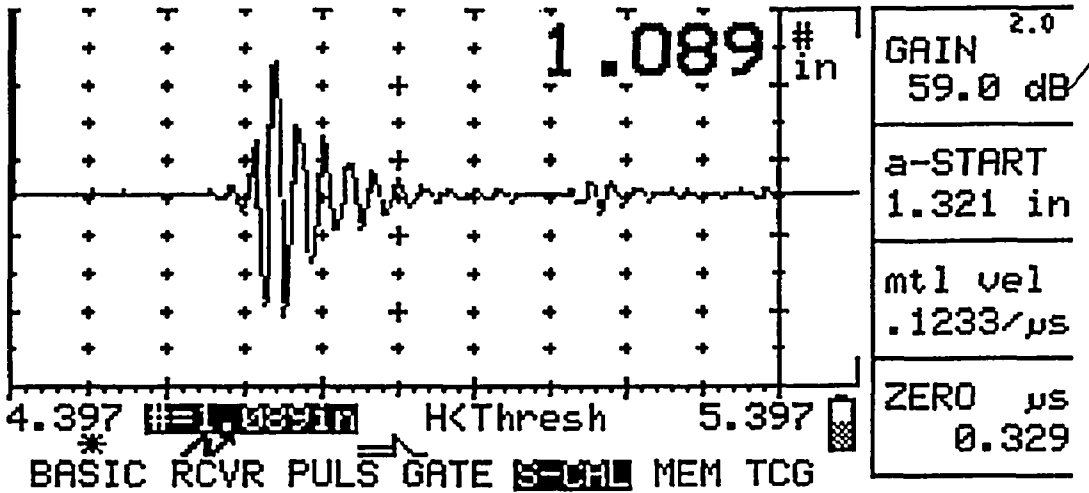

45° Post Waveform


HSACT
A4
4/19/02

954110102
16 of 15


REPORT NUMBER
R162

00067

Nozzle Examination 60° Waveforms

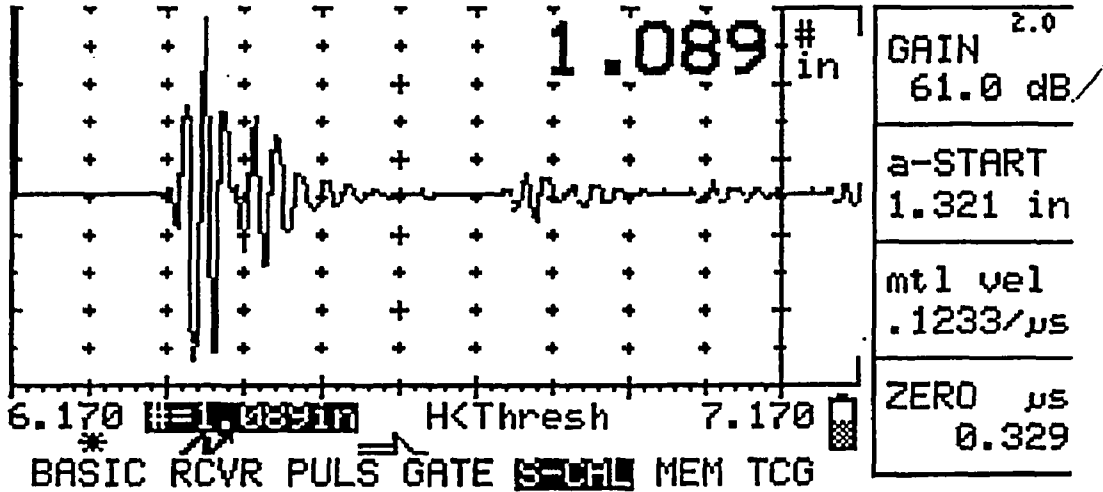

60° Pre Waveform

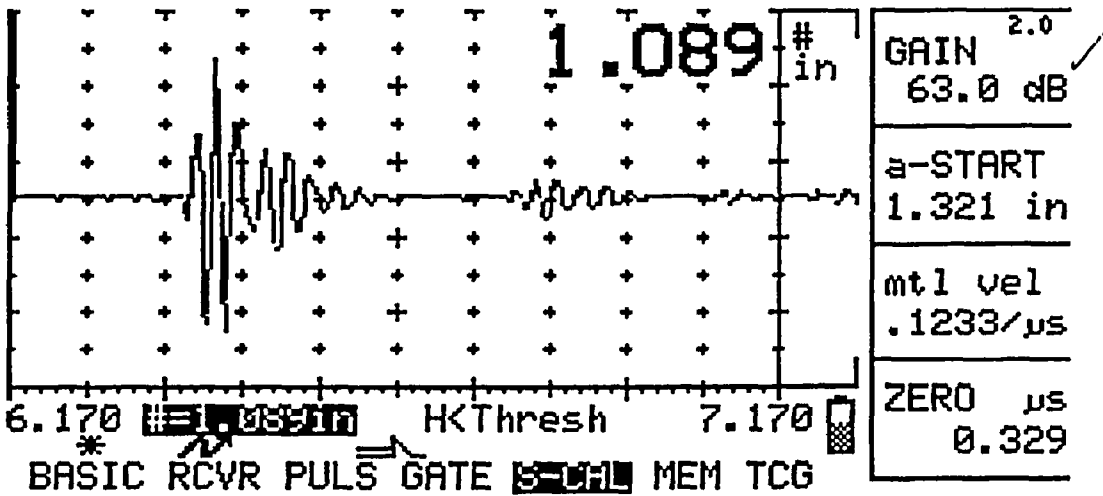

60° Post Waveform

ASBCT
4/19/02


10
11 of 15
J41102

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R162
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-OT-9 REV.: 9 PCR: 0006 ⁰²⁻⁰⁹ 13702
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5X1 FREQ.: 2.25
 S/N: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Smac 13E S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

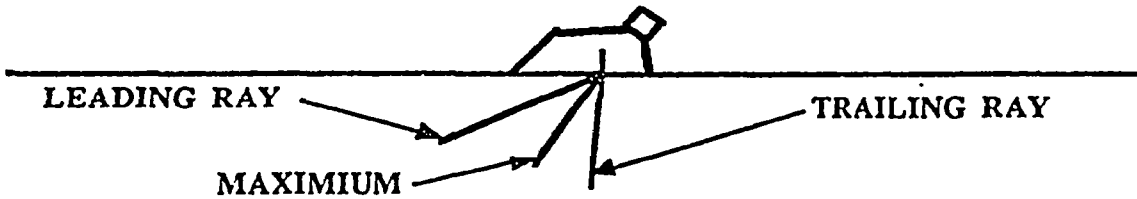

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>M. W. Flynn</u>	REVIEWED BY: <u>Sal...</u>	ANII: <u>Albert...</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>II</u> DATE: <u>4/4/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>12</u> OF <u>15</u>


TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R162
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: ODG H/and 3-3-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5x1 FREQ.: 2.25
 SIN: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Seam 13C SIN: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	6 3/8	7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

6 3/4 1/4 02

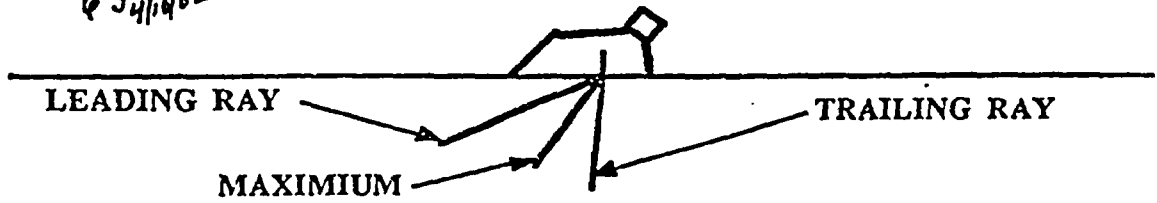

RESOLUTION


NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mark W. Henry</u>	REVIEWED BY: <u>John A. ...</u>	ANII: <u>Albat ...</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>13</u> OF <u>15</u>

REPORT NUMBER
R162 00070

91 3 2 13
143

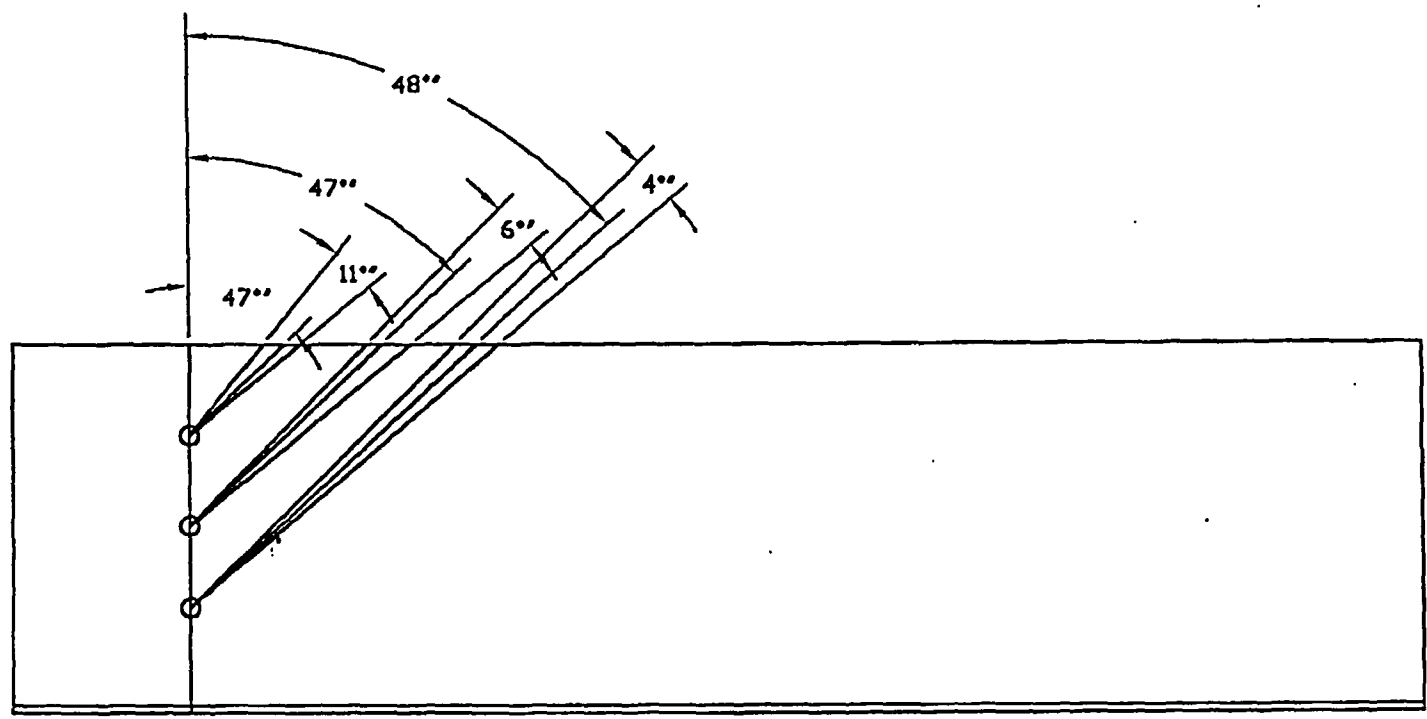


HSBCF
A-11
4/11/02

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

REPORT NUMBER
R162


00071

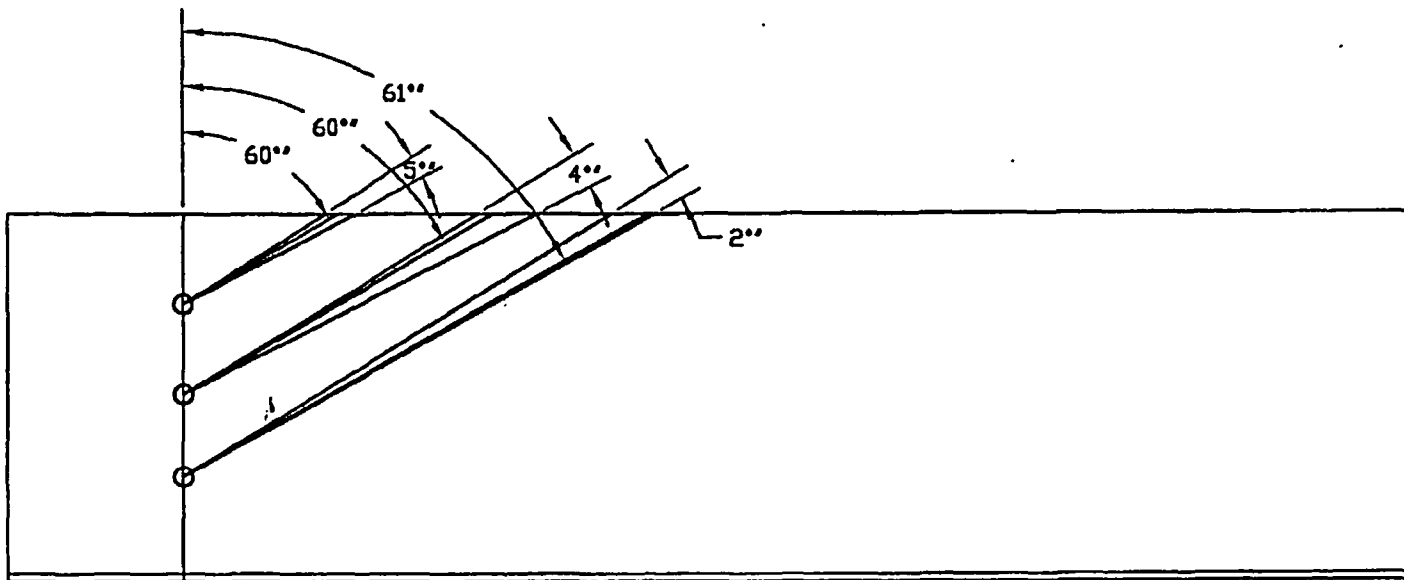

1434100
18 08 15

MSBCF
C/M
4/14/02

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

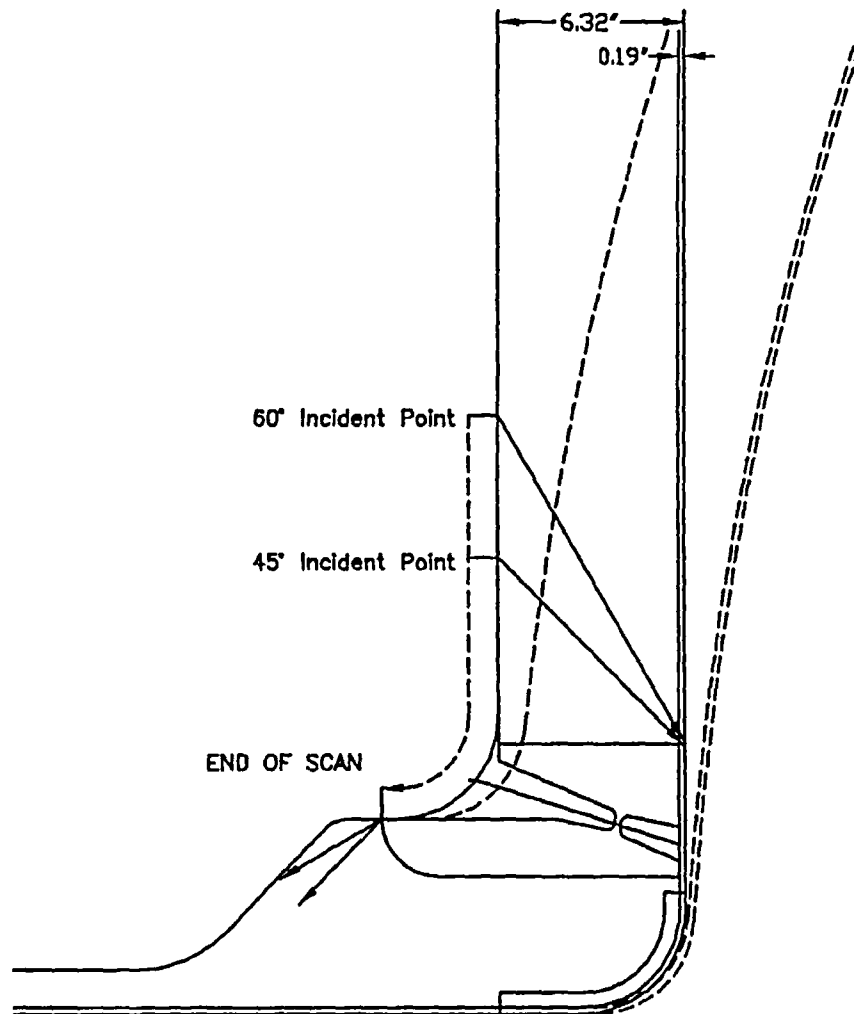

15
7
0515
4/14/02

Transverse coverage includes coverage obtained during the inner radius examination

REPORT NUMBER
R162

HSBCT
4/14/02

Browns Ferry Unit 3
N2 Nozzle-to-Shell
MARCH 2002
SP-N2-NS

00072

00073

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R163	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N2E-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0328-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
PROCEDURE: N-UT-55		REV: 9	TC: N/A 0208	COFIG.:	NOZZLE TO Vessel
EXAMINER: MIKE KLEINJAN <i>3/21/02</i>		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: II		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.

N2E-IR: This examination was performed using a 19° and 25° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indication


RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>		REVIEWED BY: <i>Paul Whitaker</i>		ANII: <i>Robert Todd</i>	
LEVEL: II DATE: <i>4-4-02</i>		LEVEL: <i>II</i> DATE: <i>4/4/02</i>		DATE: <i>4/19/02</i>	
				PG. 1 OF <i>24</i>	

Jan 4/19/02

00074

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R163						
PROJECT: BFN UNIT: 3 CYCLE: 10			CALIBRATION DATE: 04-01-02									
PROC.: N-UT- 55 REV:9 <i>TC: NAC08</i>			CALIBRATION BLOCK NO.: BF-85-IR TEMP: 68.1°F									
INSTR. MFG: STAVELEY DUE DATE: 08-11-02			SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473			THERMOMETER S/N: 522352 DUE DATE: 05-17-02									
TRANSDUCER MFG: KRAUTKRAMER			COUPLANT SONOTRACE BATCH: 01141									
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz			EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>									
CABLE TYPE: RG 174 LENGTH: 120 inches			ANGLE VERIFICATION									
DAC			BLOCK TYPE: CS IIW			S/N: DB 55074						
			NOMINAL ANGLE: 25°			ACTUAL ANGLE: N/A						
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">100 80 60 40 20 0</div> <div style="border: 1px solid black; width: 200px; height: 150px; position: relative;"> </div> <div style="margin-left: 10px; font-size: 20px; line-height: 1;">A M P L I T U D E</div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: 20 inches</p>			INSTRUMENT SETTINGS									
			REFLECTOR			REFERENCE		MEMORY				
			SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER			
			AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	60.0 dB		25			
			CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A			
			FREQ: 2.25 MHz			REJECT: OFF %						
			ANGLE: N/A deg			DAMPING: 200 ohms						
			DELAY: 1.12 msec			PULSER: 222						
			ZERO: N/A msec			FILTER: FILT 1						
			VELOCITY: 0.234 msec			REP RATE: 4 KHZ						
RANGE: 20.0 inches			TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: N/A GAIN: N/A dB			CALIBRATION TIMES									
AMPLITUDE: N/A % METAL PATH: N/A"			INITIAL TIME: 1355			FINAL TIME: 1805						
VERIFICATION TIMES			1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	
LINEARITY CHECK												
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20
		SIGNAL 2		50	45	40	35	30	25	20	15	10
ATTENUATOR		GAIN		SET		-6 dB		-12 dB		SET		+6
		AMP		80%		32 TO 48		16 TO 24		20 %		64 TO 96
				40		20		80		80		
COMMENTS:						WELDS/ITEMS EXAMINED:						
Wedge ID D-14795-147						REACTOR PRESSURE VESSEL						
						N2A-IR, N2C-IR, N2E-IR						
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: H			EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II			REVIEWER: <i>[Signature]</i> LEVEL: <i>III</i> DATE: 4/1/02			ANII: DATE: PG.: 2 OF 2 OF 4 <i>Jan 4/1/02</i>			

00075

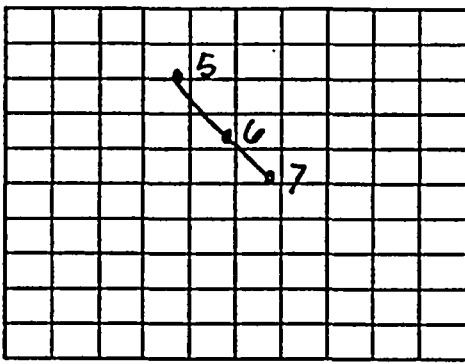TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R163							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02									
PROV: N-UT- 55		REV: 9 TC-11-02-08		CALIBRATION BLOCK NO.: BF-85-IR		TEMP: 68.1° F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A									
MODEL TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141											
S/N DB 35163		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>			
CABLE TYPE: RA 174 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC		BLOCK TYPE: CS IIW				S/N: DB 55074							
		NOMINAL ANGLE: 19°				ACTUAL ANGLE: N/A							
		INSTRUMENT SETTINGS											
		REFLECTOR			REFERENCE			MEMORY					
		SCAN DIRECT.		NTCH	SDH	SENSITIVITY			NUMBER				
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.2 dB			19				
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB			N/A				
		FREQ: 2.25		MHz		REJECT: OFF			%				
		ANGLE: N/A		deg		DAMPING: 200			ohms				
		DELAY: 0.996		msec		PULSER: 222							
		ZERO: N/A		msec		FILTER: FILT 1							
		VELOCITY: 0.234		msec		REP RATE: 4 KHZ							
		RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK					
		DISPLAY MODE: PE			POWER: AC								
DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF							
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1245		FINAL TIME: 1807							
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			
LINEARITY CHECK													
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
				40		20				80		80	
COMMENTS:					WELDS/ITEMS EXAMINED:								
Wedge ID D-14795-144					REACTOR PRESSURE VESSEL								
					N2A-IR, N2C-IR, N2E-IR								
EXAMINER: DAVID KLEINJAN <i>[Signature]</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>[Signature]</i> LEVEL: II			REVIEWER: <i>[Signature]</i> LEVEL: III			DATE: 4/14/02				
						DATE: 4/1/02			PG: 1-3 OF 4 3024 <i>Jan 4/1/02</i>				

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO. R163

PROJECT: BFN UNIT: 3 WELD ID: N2E CONFIG.: INNER RADIUS COMPONENT: — N/A

CAL. SHT. NO.: NA PROCEDURE: N-UT-55 REV.: 9 PCR: 62-06 ^{for 41102} ^{N/A} ₈₂₋₀₈ TEMP.: 85 PYRO.: 522352

SCAN SENS.: * dB EXAM START: 1630 EXAM END: 1745 EXAM ANGLE: 19.25°

Lo LOCATION: TDC Wo LOCATION: E OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
19	SCAN	dB	63.2	*			SCANNING	#	10/11				BLEND RADIUS								
25	SCAN	dB	66				SCANNING	#	10/11				BLEND RADIUS								
	No Recordable Indication																				

COMMENTS: A MATERIAL NOISE LEVEL OF 5-10% WAS OBSERVED

00076

EXAMINER: [Signature] LEVEL: II DATE: 04-01-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/14/02
 EXAMINER: [Signature] LEVEL: II DATE: 4-4-02 ANII: [Signature] DATE: 4/19/02 PAGE 4 OF 4

Inspection Report R-164
Weld N3A-NV

00077

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R164</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N3A	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0329-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
PROCEDURE: N_UT_9		REV:9	TC:02-06	COFIG.:	NOZZLE TO VESSEL
EXAMINER: MIKE KLEINJAN <i>for 4/19/02</i>		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld.

Examination. Nozzle to Vessel weld N3A

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination.

(N3A-IR) *see R 165*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

77% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>Mike W Kleinjan</i>		REVIEWED BY: <i>David Kleinjan</i>		ANII: <i>Albert Judd</i>	
LEVEL: II DATE: <i>4-4-02</i>		LEVEL: <i>II</i> DATE: <i>4/4/02</i>		DATE: <i>4/19/02</i>	
				PG. 1 OF 15 <i>for 4/19/02</i>	

Calculation of ASME code coverage
For section XI NDE Examination

N3A

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	100%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *

The sum of all the percentage of scans	700%
Divided by the total # of scans	9
Percentage of examination Volume coverage	77%

* Transverse coverage includes coverage obtained during the inner radius examination.


HSBCT
4/17/00
2.6.15

00079

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R164
---------------------------------------	--	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 3-31-02
PROC.: N-UT- 9 REV:9 TC:02-06	CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F
INSTR. MFG: STAVELEY DUE DATE: 8-05-02	SIMULATOR BLOCK NO: DB55079
MODEL/TYPE: SONIC-136 M & TE NO.: VH751	THERMOMETER S/N: 522352 DUE DATE: 5-17-02
TRANSDUCER MFG: Harisonic	COUPLANT SONOTRACE BATCH: 01141
S/N DB34198 SIZE: .75 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG174 LENGTH: 120 inches	

DAC	ANGLE VERIFICATION
	BLOCK TYPE: Compus Comp S/N: DB55079
	NOMINAL ANGLE: 0 ACTUAL ANGLE: N/A

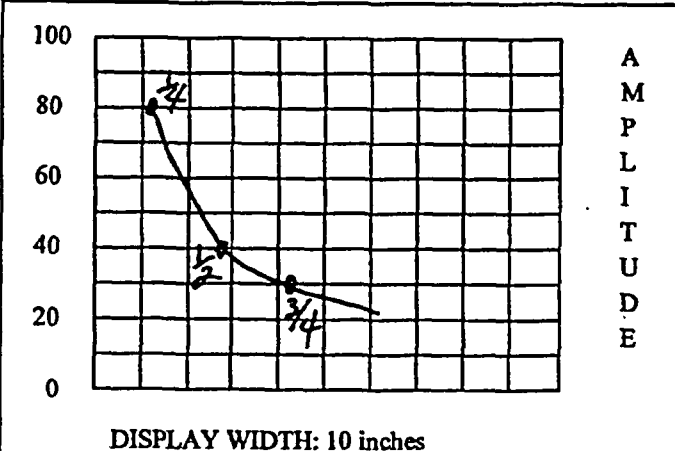

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	
AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.8 dB	
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB	
FREQ:	2.25	MHz	REJECT:	off %
ANGLE:	n/a	deg	DAMPING:	500 ohms
DELAY:	.499	msec	PULSER:	222
ZERO:	n/a	msec	FILTER:	Filt 3
VELOCITY:	.238	msec	REP RATE:	2KHZ
RANGE:	10	inches	TOF:	<input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK
DISPLAY MODE:	PE		POWER:	AC
DUAL:	<input type="checkbox"/> ON	<input checked="" type="checkbox"/> OFF	TCG:	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF

REF. REFLECTOR: 1" GAIN: 8 dB	CALIBRATION TIMES	
AMPLITUDE: 80 % METAL PATH: 1"	INITIAL TIME: 9:00	FINAL TIME: 11:45
VERIFICATION TIMES	1) 2) N/A 3) N/A	4) N/A 5) N/A 6) N/A 7) N/A 8) N/A 9) N/A

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
	N3A Nozzle to Shell

EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II	EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: III DATE: 4/1/02	ANIL: <i>[Signature]</i> DATE: 4/1/02 PG.: 44 OF 15 3 of 15
---	--	---	--

00080

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R164						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 3-29-02 3-31-02 ^{5/19/02}								
PROC.: N-UT- 9		REV:9		TC:02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F				
INSTR. MFG: STAVELEY		DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: SONIC-136		M & TE NO.: VH751		THERMOMETER S/N: 522352		DUE DATE: 5-17-02						
TRANSDUCER MFG: Krautkramer				COUPLANT SONOTRACE BATCH: 01141								
S/N DB34843		SIZE: .5x1		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/>		LONG <input type="checkbox"/> RL <input type="checkbox"/>				
CABLE TYPE: RG1743		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: DB55074						
				NOMINAL ANGLE: 45°		ACTUAL ANGLE: 46°						
<p>DISPLAY WIDTH: 10 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	42.6 dB		2			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a			
				FREQ:	2.25	MHz	REJECT: off		%			
				ANGLE:	N/A	deg	DAMPING: 500		ohms			
				DELAY:	.830	msec	PULSER: 222					
				ZERO:	N/A	msec	FILTER: FITL 3					
				VELOCITY:	.126	msec	REP RATE: 2KHZ					
RANGE:	20	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: 1" GAIN: 33.6 dB				CALIBRATION TIMES								
AMPLITUDE: 80%		METAL PATH: 1"		INITIAL TIME: 9:00		FINAL TIME: 11:45						
VERIFICATION TIMES		1) N/A	2) N/A	3) N/A	4) N/A	5) N/A	6) N/A	7) N/A	8) N/A	9) N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40	20			80			80		
COMMENTS:					WELDS/ITEMS EXAMINED:							
Delta difference between 3/8 to 5/8 on the clad side is 3 dB					N3A Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i> LEVEL: II					EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i> LEVEL: I			REVIEWER: <i>David Kleinjan</i> LEVEL: II		DATE: 4/19/02		PG: 1-5 OF 1-15 4 of 15 4/19/02

00081


TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R164</i>							
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 3-29-02 <i>3-31-02</i>										
PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F										
INSTR. MFG: STAVELEY DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079										
MODEL/TYPE: SONIC-136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02										
TRANSDUCER MFG: Krautkramer		COUPLANT SONOTRACE BATCH: 01141										
S/N DB34154 SIZE: .5x1 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>										
CABLE TYPE: RG174 LENGTH: 120 inches		ANGLE VERIFICATION										
DAC		BLOCK TYPE: IIW		S/N: DB55074								
		NOMINAL ANGLE: 60		ACTUAL ANGLE: 59								
<p>AMPLITUDE</p> <p>DISTANCE</p> <p>DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS										
		REFLECTOR			REFERENCE	MEMORY						
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER						
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	49 dB	3						
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB	n/a						
		FREQ: 2.25 MHz		REJECT: off %								
		ANGLE: N/A deg		DAMPING: 500 ohms								
		DELAY: 1.20 msec		PULSER: 222								
		ZERO: N/A msec		FILTER: FITL 3								
		VELOCITY: .123 msec		REP RATE: 2KHZ								
RANGE: 20 inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK										
DISPLAY MODE: PE		POWER: AC										
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
CALIBRATION TIMES												
REF. REFLECTOR: 1" GAIN: 36 dB		INITIAL TIME: 9:00 FINAL TIME: 11:45										
AMPLITUDE: 80 % METAL PATH: 1"		VERIFICATION TIMES										
		1) N/A	2) N/A	3) N/A	4) N/A							
		5) N/A	6) N/A	7) N/A	8) N/A							
		9) N/A										
LINEARITY CHECK												
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20		
	SIGNAL 2	50	45	40	35	30	25	20	15	10		
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
			40		20		80			80		
COMMENTS:					WELDS/ITEMS EXAMINED:							
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE CLAD SIDE					N3A Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i>		EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>		REVIEWER: <i>David Kleinjan</i>		ANII: <i>Robert Kelly</i>						
LEVEL: II		LEVEL: II		DATE: <i>4/19/02</i>		DATE: <i>4/19/02</i>						
				PG.: 4-6 <i>10</i>		<i>5 of 15 5/11/02</i>						

00082

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: <i>R164</i>
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 03-31-02
PROC.: N-UT- 55 REV:9 <i>TC: N/A 08</i>	CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5° F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35163 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: CS IIW	S/N: DB 55074
	NOMINAL ANGLE: 24	ACTUAL ANGLE: N/A

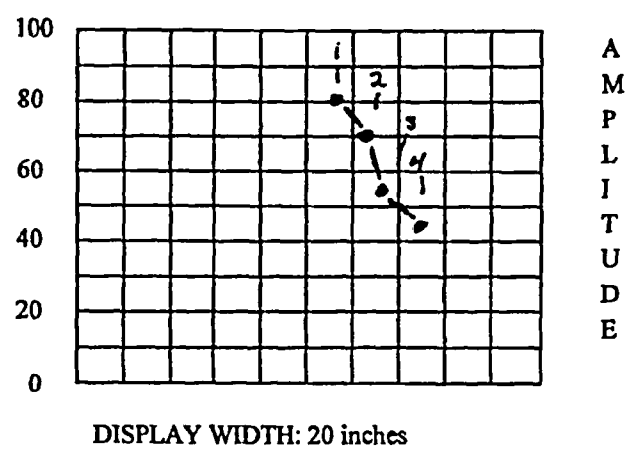

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.0 dB	24
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ:	2.25	MHz	REJECT:	OFF %
ANGLE:	N/A	deg	DAMPING:	200 ohms
DELAY:	0.999	msec	PULSER:	222
ZERO:	N/A	msec	FILTER:	FILT
VELOCITY:	0.233	msec	REP RATE:	4 KHZ
RANGE:	20.0	inches	TOF:	<input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK
DISPLAY MODE:	PE		POWER:	AC
DUAL:	<input type="checkbox"/> ON	<input checked="" type="checkbox"/> OFF	TCG:	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF

REF. REFLECTOR: N/A	GAIN: N/A dB	CALIBRATION TIMES								
AMPLITUDE: N/A %	METAL PATH: N/A"	INITIAL TIME: 0815	FINAL TIME: 1135							
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
	REACTOR PRESSURE VESSEL
	N3A-IR
	<i>wedge ID 0-14795-248</i>

EXAMINER: DAVID KLEINJAN <i>[Signature]</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>[Signature]</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: <i>[Signature]</i> DATE: <i>4/4/02</i>	ANI: <i>[Signature]</i> DATE: <i>4/19/02</i> PG.: <i>7</i> OF <i>15</i> <i>6 Jan 4/10/02</i>
--	---	--	---

00083

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R164						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-31-02							
PROC.: N-UT- 55 REV:9		V.L.T.C. N/A		CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5° F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A							
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352 DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141									
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>									
CABLE TYPE: RG 174 LENGTH: 120 inches		ANGLE VERIFICATION									
DAC		BLOCK TYPE: CS IIW		S/N: DB 55074							
		NOMINAL ANGLE: 28		ACTUAL ANGLE: N/A							
<p>AMPLITUDE</p> <p>DISPLAY WIDTH: 20 inches</p>		INSTRUMENT SETTINGS									
		REFLECTOR			REFERENCE		MEMORY				
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER				
		AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	59.6 dB		28				
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A				
		FREQ: 2.25 MHz		REJECT: OFF %							
		ANGLE: N/A deg		DAMPING: 200 ohms							
		DELAY: 1.39 msec		PULSER: 222							
		ZERO: N/A msec		FILTER: FILT 1							
		VELOCITY: 0.236 msec		REP RATE: 4 KHZ							
RANGE: 20.0 inches		TOF: <input type="checkbox"/> PEAK	<input checked="" type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC								
DUAL: <input type="checkbox"/> ON	<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON	<input checked="" type="checkbox"/> OFF							
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES							
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 0900		FINAL TIME: 1136					
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A					
7)N/A	8)N/A	9)N/A									
LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	
	SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %	64 TO 96		40%	64 TO 96
			40		20			80			80
COMMENTS:				WELDS/ITEMS EXAMINED:							
				REACTOR PRESSURE VESSEL							
				N3A-IR							
				Wedge IO D-14795-249							
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i>		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i>		REVIEWER: <i>Paul Whiteley</i>		ANIL <i>ANIL</i>		DATE: 4/19/02		PG.: 8 OF 15	
LEVEL: H		LEVEL: H		LEVEL: H		DATE: 4/19/02		7 OF 15 5/9/02			

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R164

PROJECT: BFN UNIT: 3 WELD ID: N3A CONFIG.: Nozzle COMPONENT: VESSEL

CAL. SHT. NO.: N/A PROCEDURE: ~~N-UT-9~~ ^{N-UT-9} REV.: 9 PCR.: 02-06, 1-4/10/02 TEMP.: 85 PYRO.: 522352

SCAN SENS.: * dB EXAM START: 9:30 EXAM END: 11:00 EXAM ANGLE: 0°, 45°, 60°

Lo LOCATION: TDC Wo LOCATION: Ø OF WELD


IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%			
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2	
28°	SCAN		dB	65.6			SCANNING	#	10/11				BLEND RADIUS									
24°	SCAN		dB	63			SCANNING	#	10/11				BLEND RADIUS									
0°	SCAN		dB	34.8			SCANNING	#	9				ON WELD AND BASE MATERIAL									
45°	SCAN		dB	56.6			SCANNING	#	9				ON WELD AND VESSEL SIDE									
45T	SCAN		dB	56.6			SCANNING	#	10/11				CW/CCW VESSEL SIDE								00084	
45TAN	SCAN		dB	56.6			SCANNING	#	10/11				CW/CCW VESSEL SIDE									
60	SCAN		dB	63			SCANNING	#	9				ON WELD AND VESSEL SIDE									
60T	SCAN		dB	63			SCANNING	#	10/11				CW/CCW VESSEL SIDE									
60TAN	SCAN		dB	63			SCANNING	#	10/11				CW/CCW VESSEL SIDE									
NO RECORDABLE INDICATION																						

COMMENTS: 28° AND 24° EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS
 TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE
 INNER RADIUS EXAMINATIONS. 5 TO 10% Noise Level was observed


EXAMINER: [Signature] LEVEL: II DATE: 4-4-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/4/02
 EXAMINER: [Signature] LEVEL: II DATE: 03-31-02 ANII: [Signature] DATE: 4/19/02 PAGE 9 OF 15

REPORT Number ⁰⁰⁰⁸⁵
R164

Nozzle Examination 45° Waveforms

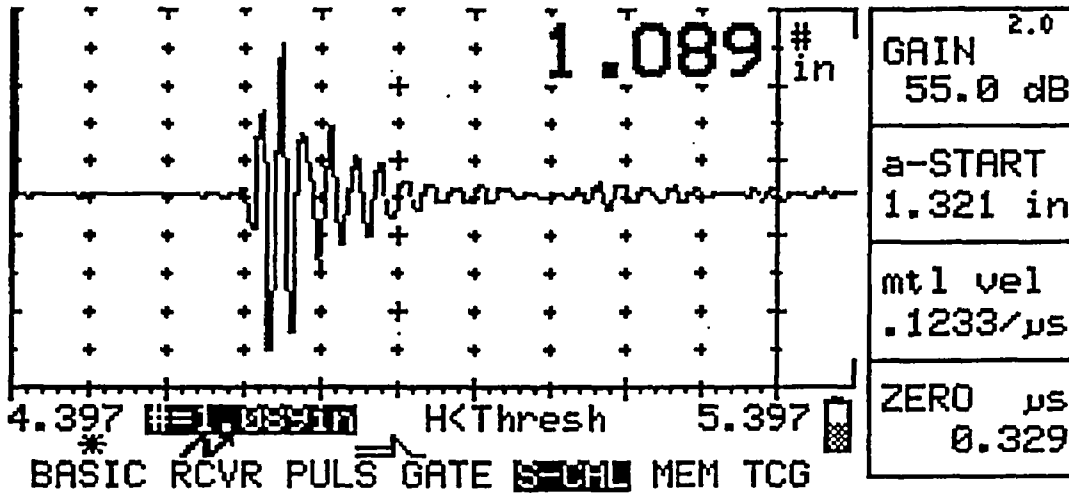

45° Pre Waveform

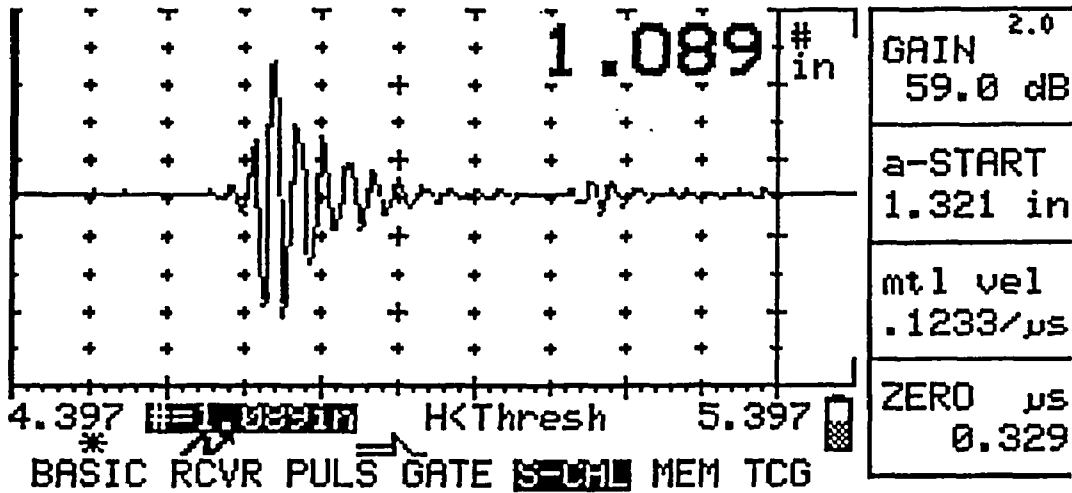


45° Post Waveform


Handwritten:
K58CT
4/19/02
9 5 4/10/02
10.08 46

00086
 REPORT Number
 R164

Nozzle Examination 60° Waveforms

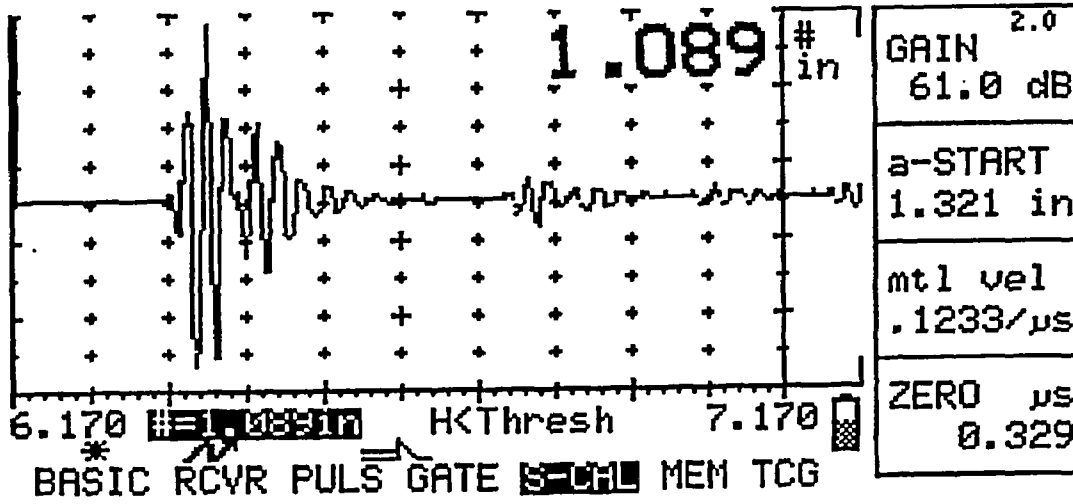

60° Pre Waveform

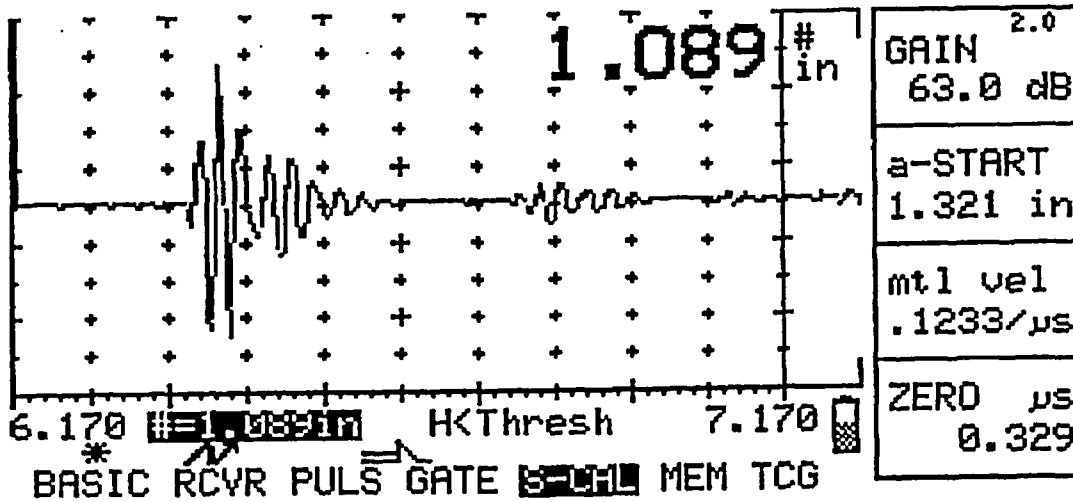

60° Post Waveform


H5BCT
 10/19/00
 10/19/02
 10-25-15

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R164
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0206 N/A w/ 3-30-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: 5X1 FREQ.: 2.25
 S/N: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Sevic 13E S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

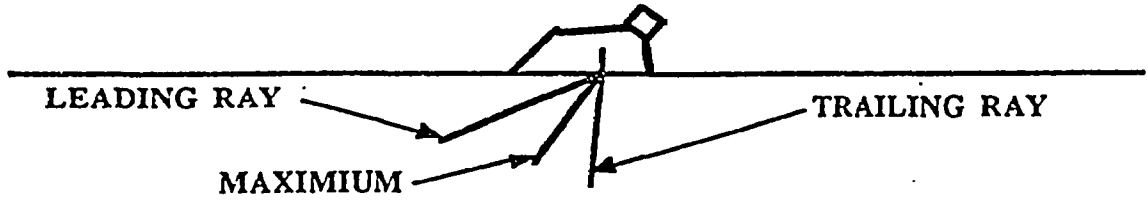

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N


EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>Albert Tall</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>II</u> DATE: <u>4/13/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>4</u> OF <u>15</u>

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R164
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0206 H/A A 3-30-0
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5X1 FREQ.: 2.25
 S/N: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Sonic 13C S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	6 3/8 6 3/8	7.6 7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

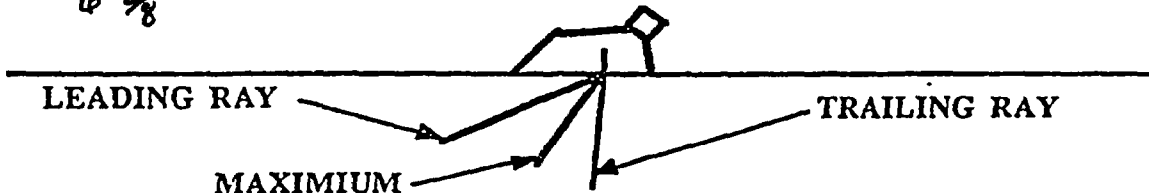


RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF-18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mike W. Henry</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>II</u> DATE: <u>4/3/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>13</u> OF <u>15</u>

REPORT NUMBER
R164 00089

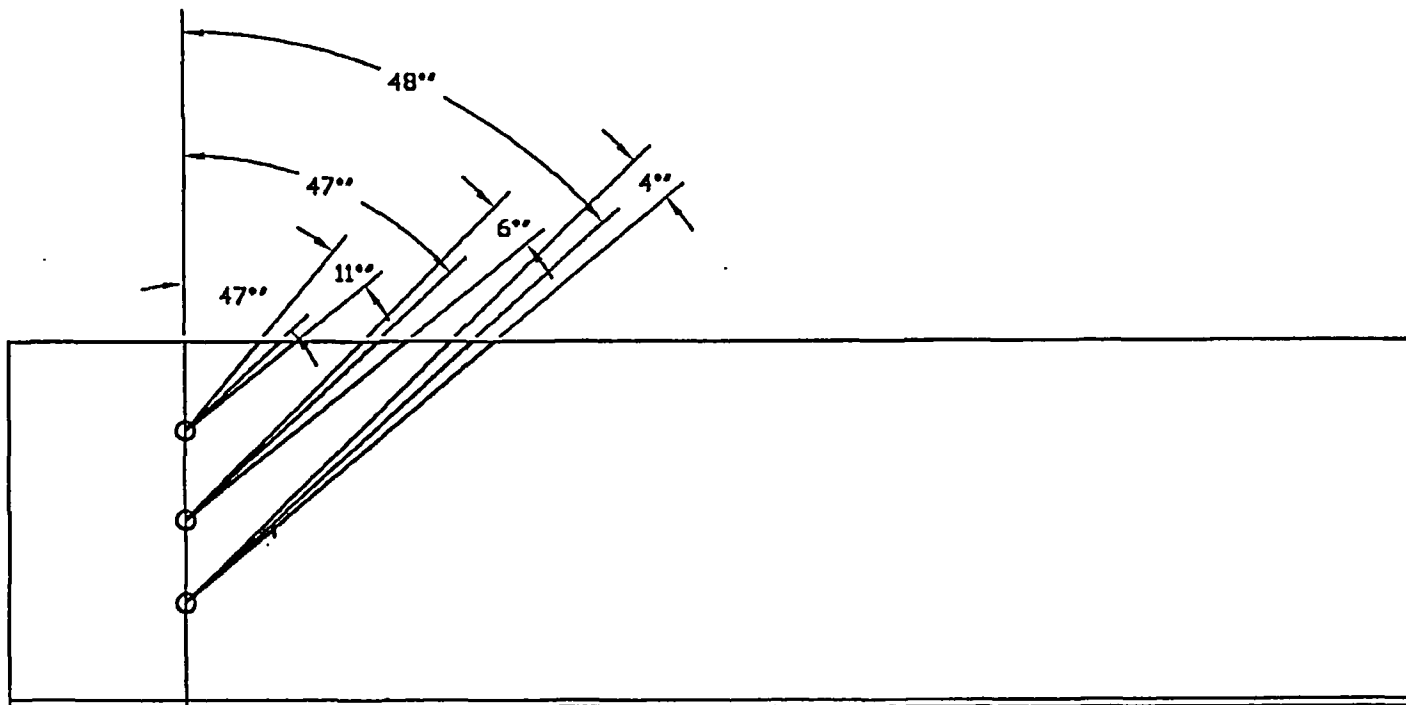


HSBCT
4/19/02
G/H

13-4102
13-4408 15

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18


REPORT NUMBER
R164 00090

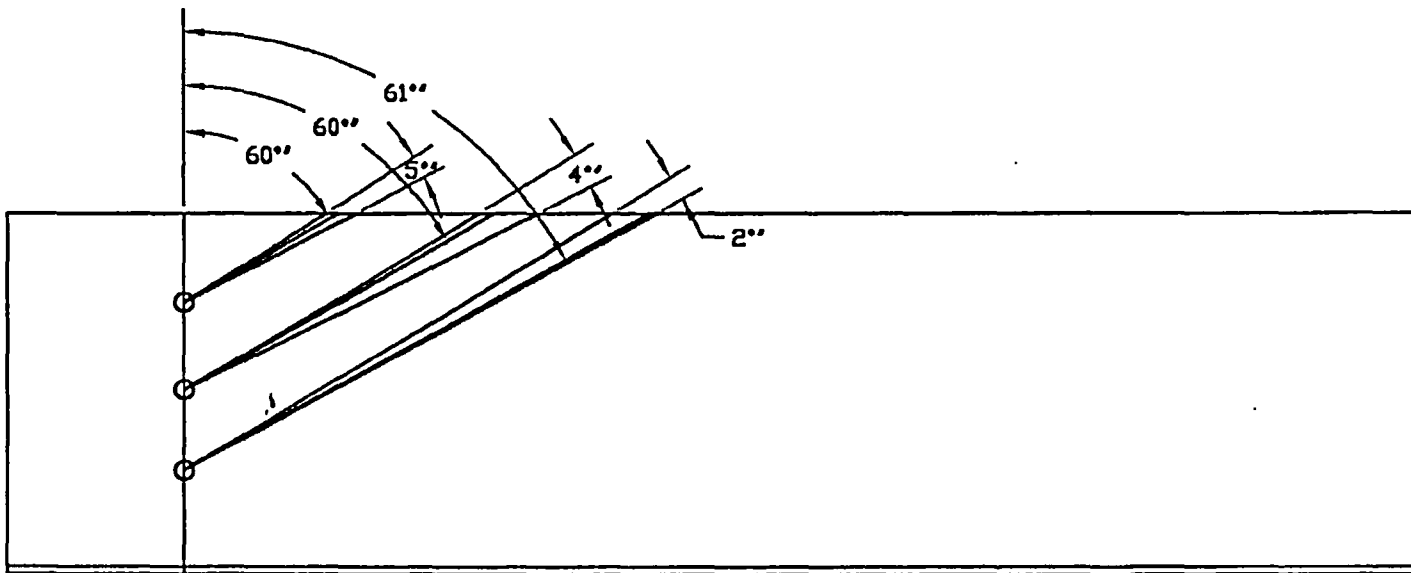

HSBCT
AT 4/19/02

14 15 08 15

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

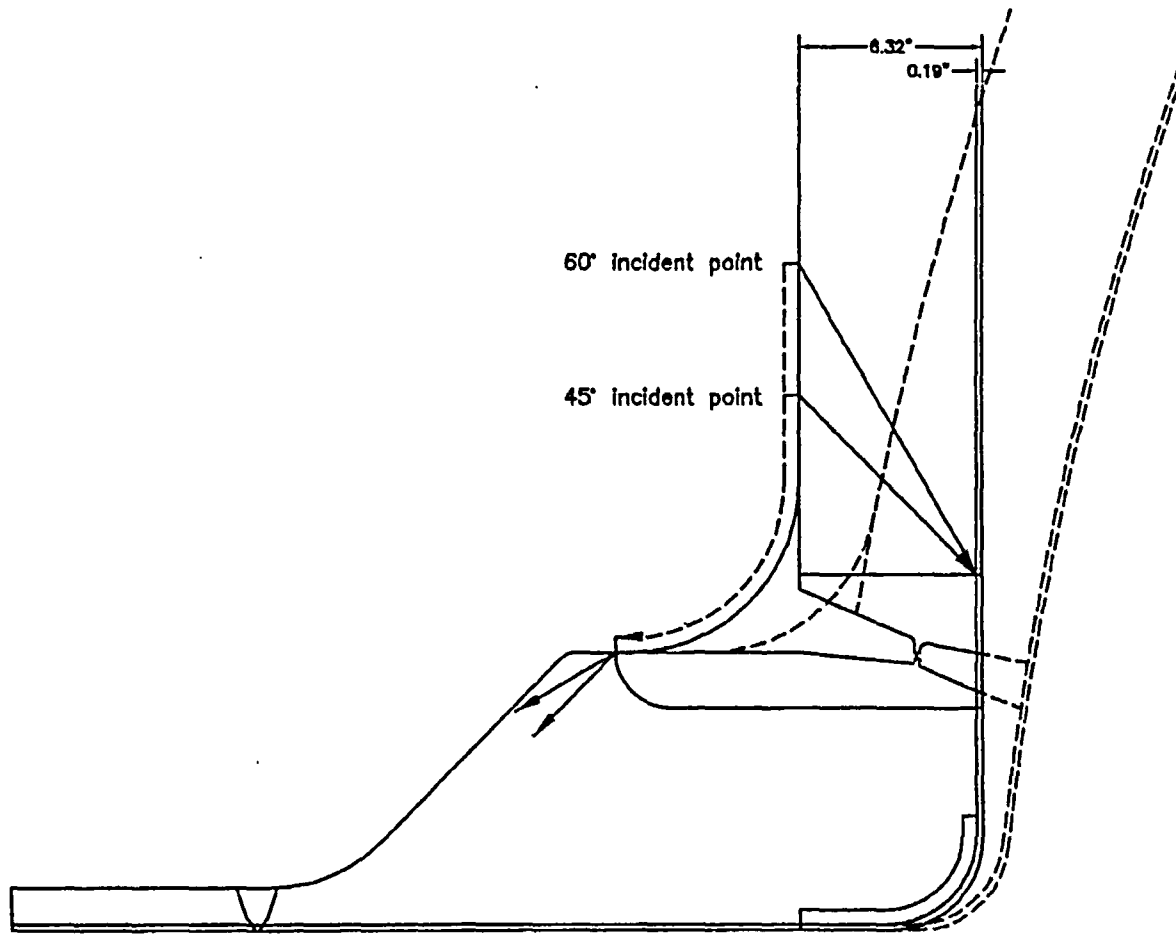

NOTE: transverse coverage includes coverage obtained during the inner radius examinations

Report Number
R164

15 of 15
4/19/02

H5BCT
4/19/02

Browns Ferry Unit 3
N-3 Nozzle-to-Shell
Mrach 2002
SP-N3-NZ

00091

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R165	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N3A-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0329-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: B-D
PROCEDURE: N-UT-55		REV: 9	TC: N/A 03	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN <i>Jan 4/10/02</i>		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: II		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.

N3A-IR: This examination was performed using a 24° and 28° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indication

RESOLUTION BY: Mike Kleinjan <i>Mike W. Kleinjan</i>	REVIEWED BY: <i>Paul Whitaker</i>	ANI: <i>Robert Paul</i>
LEVEL: II DATE: <i>4-4-02</i>	LEVEL: <i>II</i> DATE: <i>4/4/02</i>	DATE: <i>4/19/02</i>
		PG. 1 OF 24

Jan 4/10/02

00093

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R165							
PROJECT: BFN		UNIT: 3	CYCLE: 10		CALIBRATION DATE: 03-31-02								
PROC.: N-UT-		55	REV: 9	TC: N/A	CALIBRATION BLOCK NO.: BF-84-IR		TEMP: 70.5° F						
INSTR. MFG: STAVELEY			DUE DATE: 08-11-02			SIMULATOR BLOCK NO: N/A							
MODEL/TYPE: SONIC-137			M & TE NO.: VH-5473			THERMOMETER S/N: 522352							
DUE DATE: 05-17-02			TRANSducer MFG: KRAUTKRAMER			COUPLANT SONOTRACE BATCH: 01141							
S/N DB 35163		SIZE: 1.0"	FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>	RL <input checked="" type="checkbox"/>					
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074							
				NOMINAL ANGLE: 24		ACTUAL ANGLE: N/A							
<p style="text-align: center;">DISPLAY WIDTH: 20 inches</p>				INSTRUMENT SETTINGS									
				REFLECTOR			REFERENCE		MEMORY				
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER				
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	57.0 dB		24				
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A				
				FREQ:	2.25	MHz	REJECT:		OFF %				
				ANGLE:	N/A	deg	DAMPING:		200 ohms				
				DELAY:	0.999	msec	PULSER:		222				
				ZERO:	N/A	msec	FILTER:		FILT				
				VELOCITY:	0.233	msec	REP RATE:		4 KHZ				
				RANGE:	20.0	inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK						
				DISPLAY MODE: PE			POWER: AC						
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF											
REF. REFLECTOR: N/A				GAIN: N/A dB									
AMPLITUDE: N/A %				METAL PATH: N/A"									
VERIFICATION TIMES				1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	
LINEARITY CHECK													
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20		
	SIGNAL 2		50	45	40	35	30	25	20	15	10		
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET		+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%		64 TO 96
			40		20				80				80
COMMENTS:						WELDS/ITEMS EXAMINED:							
Wedge ID D-14795-248						REACTOR PRESSURE VESSEL							
						N3A-IR							
EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i>				EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i>				REVIEWER: <i>Paul Whiteley</i>		ANII: <i>Albert Hold</i>			
LEVEL: II				LEVEL: II				DATE: 4/19/02		PG: 2 OF 4			
						DATE: 4/14/02							
						2 JUN 4/19/02							

00094

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R165						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-31-02								
PROC.: N-UT- 55		REV: 9		TC: N/A		CALIBRATION BLOCK NO.: BF-84-IR						
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		TEMP: 70.5° F								
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		SIMULATOR BLOCK NO: N/A								
TRANSducer MFG: KRAUTKRAMER				THERMOMETER S/N: 522352								
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		DUE DATE: 05-17-02						
CABLE TYPE: RG 174		LENGTH: 120 inches		COUPLANT SONOTRACE BATCH: 01141								
				EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>								
				ANGLE VERIFICATION								
				BLOCK TYPE: CS IIW		S/N: DB 55074						
				NOMINAL ANGLE: 28		ACTUAL ANGLE: N/A						
DAC				INSTRUMENT SETTINGS								
<p style="text-align: right;">AMPLITUDE</p>		REFLECTOR			REFERENCE		MEMORY					
		SCAN DIRECT.			NTCH		SDH		SENSITIVITY			
		AXIAL			<input checked="" type="checkbox"/>		<input type="checkbox"/>		59.6 dB			
		CIRC			<input type="checkbox"/>		<input type="checkbox"/>		N/A dB			
				FREQ: 2.25 MHz		REJECT: OFF		%				
				ANGLE: N/A deg		DAMPING: 200		ohms				
				DELAY: 1.39 msec		PULSER: 222						
				ZERO: N/A msec		FILTER: FILT 1						
				VELOCITY: 0.236 msec		REP RATE: 4 KHZ						
				RANGE: 20.0 inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK						
				DISPLAY MODE: PE		POWER: AC						
				DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF						
				CALIBRATION TIMES								
REF. REFLECTOR: N/A		GAIN: N/A dB		INITIAL TIME: 0900		FINAL TIME: 1136						
AMPLITUDE: N/A %		METAL PATH: N/A"		VERIFICATION TIMES		1)N/A		2)N/A				
				3)N/A		4)N/A		5)N/A				
				6)N/A		7)N/A		8)N/A				
				9)N/A								
LINEARITY CHECK												
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20
		SIGNAL 2		50	45	40	35	30	25	20	15	10
ATTENUATOR		GAIN		SET	-6 dB	-12 dB	SET	+12	SET	+6		
		AMP		80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96		
				40	20		80		80			
COMMENTS:					WELDS/ITEMS EXAMINED:							
Wedge ID D-14795-249					REACTOR PRESSURE VESSEL							
					N3A-IR							
EXAMINER:		EXAMINER:		REVIEWER:		ANII:						
DAVID KLEINJAN		MIKE KLEINJAN		<i>David Kleinjan</i>								
<i>David Kleinjan</i>		<i>Mike Kleinjan</i>				DATE:						
LEVEL: H		LEVEL: H		LEVEL: H		DATE: 1/10/02		PG.: 1 OF 1				
						3 Jan 4/10/02						

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO. R165

PROJECT: BFN UNIT: 3 WELD ID: N3A CONFIG.: INNER RADII COMPONENT: N/A

CAL. SHT. NO.: N/A PROCEDURE: N-UT-55 REV.: 9 PCR.: 02-08 TEMP.: 85 PYRO.: 522352
02-4-10-02

SCAN SENS.: * dB EXAM START: 9:30 EXAM END: 11:00 EXAM ANGLE: 28, 24

Lo LOCATION: TDC Wo LOCATION: 6 OS WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
				*																	
28°	SCAN	dB	656				SCANNING	#	19/1				BLEND RADIUS								
24°	SCAN	dB	63				SCANNING	#	19/1				BLEND RADIUS								
				No			Recordable			Indication											

00001

COMMENTS: A MATERIAL NOISE LEVEL OF 5-10% WAS OBSERVED

EXAMINER: S.R. Klyne LEVEL: II DATE: 03-31-02

REVIEWED BY: Al Whitkey LEVEL: II DATE: 4/16/02

EXAMINER: Mike W. Lyman LEVEL: II DATE: 4-4-02

ANII: Albert Hall DATE: 4/19/02 PAGE 2 OF 4

Inspection Report R-166
Weld N4A-NV

00096

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R166</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N4A	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0327-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
PROCEDURE: N-UT-9		REV:9	TC:02-06	COFIG.:	NOZZLE TO VESSEL
EXAMINER: MIKE KLEINJAN <i>for 4/10/02</i>		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld..

Examination. Nozzle to Vessel weld N4A

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination.

(N4A-IR) *see R. 147*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

77% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>	REVIEWED BY: <i>David Kleinjan</i>	ANIL: <i>Robert Todd</i>
LEVEL: II DATE: <i>4-4-02</i>	LEVEL: <i>III</i> DATE: <i>4/4/02</i>	DATE: <i>4/19/02</i>
		PG. 1 OF 15 <i>Smiles</i>

REPORT NUMBER
R166 00097

Calculation of ASME code coverage
For section XI NDE Examination

N4A

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	100%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *

The sum of all the percentage of scans	700%
Divided by the total # of scans	9
Percentage of examination Volume coverage	77%

* Transverse coverage includes coverage obtained during the inner radius examination.

H5BCT
4/19/02
2 of 15
~~6-08-15~~ 4/14/02

00098

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R166					
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 3-30-02								
PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18			TEMP: 72.6°F					
INSTR. MFG: Staveley DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: Sonic 136 M & TE NO.: VH751		THERMOMETER S/N: 522352			DUE DATE: 5-17-02					
TRANSDUCER MFG: Krautkramer		COUPLANT SONOTRACE			BATCH: 01141					
S/N DB34154 SIZE: .5x1 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/>			LONG <input type="checkbox"/>		RL <input type="checkbox"/>			
CABLE TYPE: RG174 LENGTH: 120 inches		ANGLE VERIFICATION								
DAC		BLOCK TYPE: IIW		S/N: DB55074						
		NOMINAL ANGLE: 60		ACTUAL ANGLE: 59						
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS								
		REFLECTOR			REFERENCE		MEMORY			
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	49 dB		3			
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a			
		FREQ: 2.25 MHz		REJECT: off		%				
		ANGLE: N/A deg		DAMPING: 500		ohms				
		DELAY: 1.20 msec		PULSER: 222						
		ZERO: N/A msec		FILTER: FITL 3						
		VELOCITY: .123 msec		REP RATE: 2KHZ						
		RANGE: 20 inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK						
		DISPLAY MODE:			POWER: AC					
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF								
REF. REFLECTOR: 1"		GAIN: 36 dB		CALIBRATION TIMES						
AMPLITUDE: 80 %		METAL PATH: 1"		INITIAL TIME: 9:00		FINAL TIME: 18:30				
VERIFICATION TIMES		1)14:00	2)n/a	3)n/a	4)n/a	5)n/a	6)n/a	7)n/a	8)n/a	9)n/a
LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		
COMMENTS:					WELDS/ITEMS EXAMINED:					
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE					N4A,N4F Nozzle to Shell					
CLAD SIDE										
EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i> LEVEL: II		EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II			REVIEWER: <i>David Kleinjan</i> LEVEL: II		ANI: <i>Robert Hill</i> DATE: 4/19/08 PG: 10 OF 15 5/4/02 3 OF 15			

00099


TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R166							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 3-30-02									
PROC.: N-UT- 9		REV:9		TC:02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F					
INSTR. MFG: Staveley			DUE DATE: 8-05-02			SIMULATOR BLOCK NO: DB55079							
MODEL/TYPE: sonic 136			M & TE NO.: VH751			THERMOMETER S/N: 522352			DUE DATE: 5-17-02				
TRANSDUCER MFG: Krautkramer				COUPLANT SONOTRACE					BATCH: 01141				
S/N DB34843		SIZE: .5x1		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/>		LONG <input type="checkbox"/>	RL <input type="checkbox"/>				
CABLE TYPE: RG1743			LENGTH: 120 inches			ANGLE VERIFICATION							
DAC				BLOCK TYPE: IIW		S/N: DB55074							
				NOMINAL ANGLE: 45°		ACTUAL ANGLE: 46°							
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>				REFLECTOR		REFERENCE		MEMORY					
				SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER	
				AXIAL		<input type="checkbox"/>		<input checked="" type="checkbox"/>		42.6 dB		2	
				CIRC		<input type="checkbox"/>		<input type="checkbox"/>		n/a dB		n/a	
				FREQ: 2.25		MHz		REJECT: off		%			
				ANGLE: N/A		deg		DAMPING: 500		ohms			
				DELAY: .830		msec		PULSER: 222					
				ZERO: N/A		msec		FILTER: FITL 3					
				VELOCITY: .126		msec		REP RATE: 2KHZ					
				RANGE: 20		inches		TOF: <input checked="" type="checkbox"/> PEAK		<input type="checkbox"/> FLANK			
DISPLAY MODE: PE				POWER: AC									
DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF							
REF. REFLECTOR: 1"			GAIN: 33.6 dB			CALIBRATION TIMES							
AMPLITUDE: 80 %			METAL PATH: 1"			INITIAL TIME: 9:00		FINAL TIME: 18:30					
VERIFICATION TIMES		1) 14:00	2) n/a	3) n/a	4) n/a	5) n/a	6) n/a	7) n/a	8) n/a	9) n/a			
LINEARITY CHECK													
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20		
		SIGNAL 2	50	45	40	35	30	25	20	15	10		
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6	
		AMP	80%	32 TO 48		16 TO 24		20 %	64 TO 96		40%	64 TO 96	
				40	20				80			80	
COMMENTS:						WELDS/ITEMS EXAMINED:							
Delta difference between 3/8 to 5/8 on the clad side is 3 dB						N4A, N4F Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i>			EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>			REVIEWER: <i>[Signature]</i>			ANII: <i>Albert Hall</i>				
LEVEL: II			LEVEL: II			DATE: 4/19/02			DATE: 4/19/02				
						LEVEL: <i>III</i>			DATE: 4/1/02				
									PG.: 13 OF 15 3/19/02				
									4 OF 15				

00100

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: <i>R166</i>
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 3-30-02
PROC.: N-UT- 9 REV:9 TC:02-06	CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F
INSTR. MFG: Staveley DUE DATE: 8-05-02	SIMULATOR BLOCK NO: DB55079
MODEL/TYPE: sonic 136 M & TE NO.: VH751	THERMOMETER S/N: 522352 DUE DATE: 5-17-02
TRANSDUCER MFG: Harisonic	COUPLANT SONOTRACE BATCH: 01141
S/N DB34198 SIZE: .75 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG174 LENGTH: 120 inches	

DAC	BLOCK TYPE: <i>Ronpus 2</i> S/N: DB55079 NOMINAL ANGLE: 0 ACTUAL ANGLE: N/A
-----	--

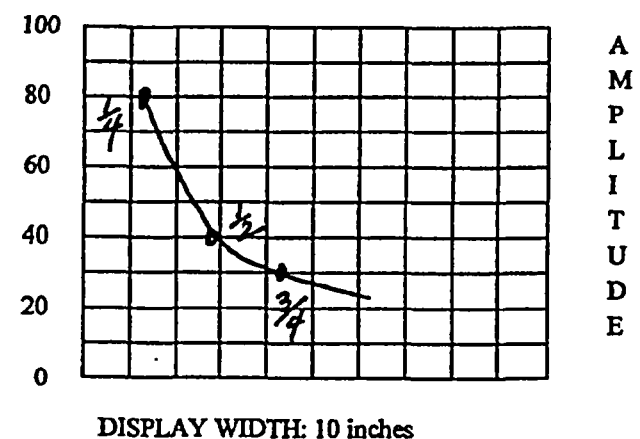

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.8 dB	1
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB	n/a
FREQ: 2.25 MHz	REJECT: off %			
ANGLE: n/a deg	DAMPING: 500 ohms			
DELAY: .499 msec	PULSER: 222			
ZERO: n/a msec	FILTER: Filt 3			
VELOCITY: .238 msec	REP RATE: 2KHZ			
RANGE: 10 inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK			
DISPLAY MODE:	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: 1" GAIN: 8 dB	CALIBRATION TIMES
AMPLITUDE: 80% METAL PATH: 1"	INITIAL TIME: 9:00 FINAL TIME: 1830
VERIFICATION TIMES	1) 14:00 2) <i>n/a</i> 3) <i>n/a</i> 4) <i>n/a</i> 5) <i>n/a</i> 6) <i>n/a</i> 7) <i>n/a</i> 8) <i>n/a</i> 9) <i>n/a</i>

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
	N4A, N4F Nozzle to Shell

EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II	EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: <i>II</i> DATE: <i>4/6/02</i>	ANII: <i>[Signature]</i> DATE: <i>4/19/02</i> PG.: <i>44 OF 15</i> <i>5 OF 15</i>
---	---	---	--

00101

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R166							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-30-02									
PROC.: N-UT- 55		REV: 9		TC: N/A-08		CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02				SIMULATOR BLOCK NO: N/A							
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141											
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>			
CABLE TYPE: RG 174		LENGTH: 120 inches				ANGLE VERIFICATION							
DAC		BLOCK TYPE: CS IIW				S/N: DB 55074							
		NOMINAL ANGLE: 27				ACTUAL ANGLE: N/A							
<p style="text-align: center;">AMPLITUDE</p> <p style="text-align: center;">DEPTH</p>		INSTRUMENT SETTINGS											
		REFLECTOR			REFERENCE			MEMORY					
		SCAN DIRECT.		NTCH	SDH		SENSITIVITY			NUMBER			
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>		56.2 dB			23			
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>		N/A dB			N/A			
		FREQ: 2.25 MHz			REJECT: OFF %								
		ANGLE: N/A deg			DAMPING: 200 ohms								
		DELAY: 0.950 msec			PULSER: 222								
		ZERO: N/A msec			FILTER: FILT 1								
		VELOCITY: 0.233 msec			REP RATE: 4 KHZ								
RANGE: 20.0 inches			TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK										
DISPLAY MODE: PE			POWER: AC										
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1505			FINAL TIME: 1810						
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			
LINEARITY CHECK													
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20		
		SIGNAL 2	50	45	40	35	30	25	20	15	10		
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
				40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:								
					REACTOR PRESSURE VESSEL								
					N4A-IR, N4F-IR								
					<i>wedge ID D-14795-247 ✓</i>								
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II			REVIEWER: <i>[Signature]</i> LEVEL: III			ANII: <i>Robert Tall</i> DATE: 4/19/02 PG: 4-7 OF 7-15 <i>4/19/02</i> 6 OF 15				

00102

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R166</i>								
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-30-02									
PROC.: N-UT- 55		REV: 9		TC: <i>N/A</i>		CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352 DUE DATE: 05-17-02									
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141											
S/N DB 35164 SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>									
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC		BLOCK TYPE: CS IIW		S/N: DB 55074									
		NOMINAL ANGLE: 21		ACTUAL ANGLE: N/A									
<p>AMPLITUDE</p> <p>DEPTH</p> <p>DISPLAY WIDTH: 20 inches</p>		INSTRUMENT SETTINGS											
		REFLECTOR			REFERENCE		MEMORY						
		SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER					
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	55.0 dB		22					
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A					
		FREQ: 2.25		MHz		REJECT: OFF %							
		ANGLE: N/A		deg		DAMPING: 200 ohms							
		DELAY: 1.61		msec		PULSER: 222							
		ZERO: N/A		msec		FILTER: FILT 1							
		VELOCITY: 0.233		msec		REP RATE: 4 KHZ							
RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC										
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF											
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1505		FINAL TIME: 1810							
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A							
		6)N/A	7)N/A	8)N/A	9)N/A								
LINEARITY CHECK													
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
				40		20				80			80
COMMENTS:				WELDS/ITEMS EXAMINED:									
				REACTOR PRESSURE VESSEL									
				N4A-IR, N4F-IR									
				<i>Wedge I.D. D 14795-2461</i>									
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>[Signature]</i> LEVEL: II		DATE: <i>4/19/02</i>		ANII: <i>[Signature]</i>		DATE: <i>4/19/02</i>		PG.: <i>18</i> OF <i>15</i>	

7 OF 15 Jan

TVA

MANUAL ULTRASONIC VESSEL
EXAMINATION DATA SHEET

REPORT NO.

R166

PROJECT: BFN UNIT: 3 WELD ID: N4A CONFIG.: None COMPONENT: VESSELCAL. SHT. NO.: N/A PROCEDURE: N-UT-9 ^{5/11/02} ~~N-UT-7~~ REV.: 9 PCR.: 02-06 TEMP.: 85 PYRO.: 522352SCAN SENS.: * dB EXAM START: 1650 ^{3/30/02} EXAM END: 1750 EXAM ANGLE: 0°, 45°, 60°Lo LOCATION: TDC Wo LOCATION: Ø OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
				*																	
21°	SCAN	dB	61				SCANNING	#	10/11				BLEND RADIUS								
27°	SCAN	dB	62.2				SCANNING	#	10/11				BLEND RADIUS								
0°	SCAN	dB	71.8				SCANNING	#	9				ON WELD AND BASE MATERIAL								
45°	SCAN	dB	56.6				SCANNING	#	9				ON WELD AND VESSEL SIDE								
45T	SCAN	dB	56.6				SCANNING	#	10/11				CW/CCW VESSEL SIDE								
45TAN	SCAN	dB	56.6				SCANNING	#	10/11				CCW/CCW VESSEL SIDE								
60°	SCAN	dB	63				SCANNING	#	9				ON WELD AND VESSEL SIDE								
60T	SCAN	dB	63				SCANNING	#	10/11				CW/CCW VESSEL SIDE								
60TAN	SCAN	dB	63				SCANNING	#	10/11				CW/CCW VESSEL SIDE								
NO RECORDABLE INDICATION																					


COMMENTS: 21° AND 27° EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS
TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE
INNER RADIUS EXAMINATIONS. 5 TO 10% NOISE LEVEL WAS OBSERVED

EXAMINER: Mike W. [Signature] LEVEL: III DATE: 4-4-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/16/02
EXAMINER: [Signature] LEVEL: II DATE: 3-30-02 ANI: [Signature] DATE: 9/19/02 PAGE 28 OF 15


REPORT NUMBER
R166

00104

Nozzle Examination 45° Waveforms

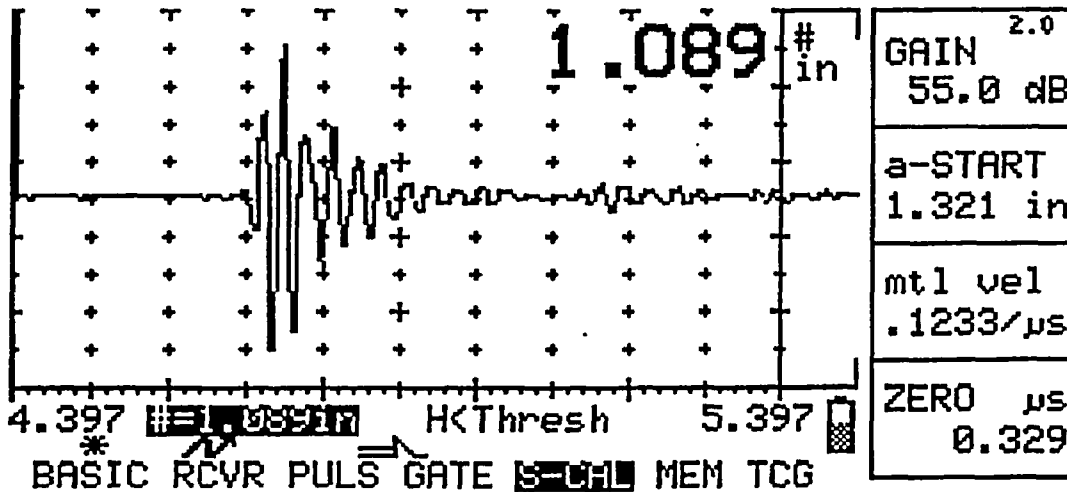

45° Pre Waveform

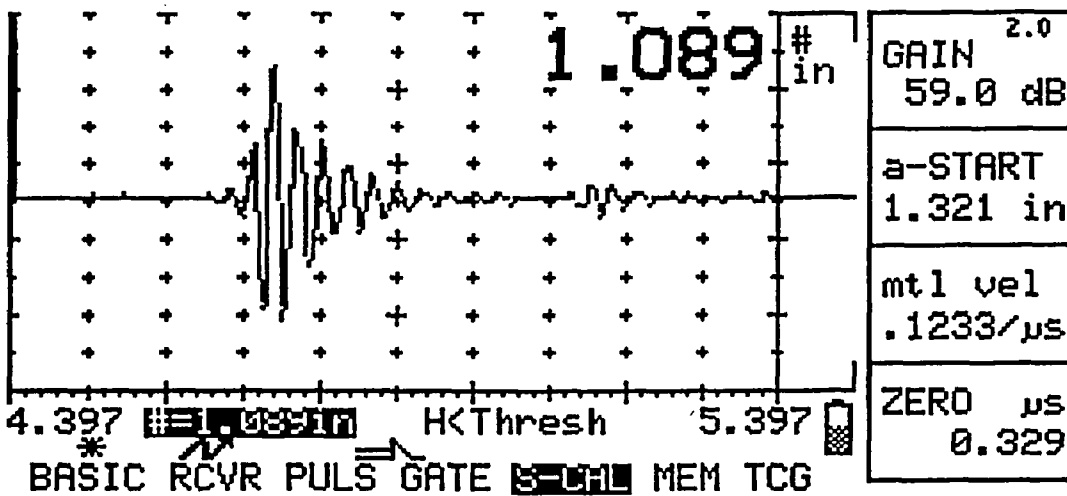


45° Post Waveform

HSBCT
4/11/02


4/11/02 9 of 15

00105
 REPORT NUMBER
 R166

Nozzle Examination 60° Waveforms

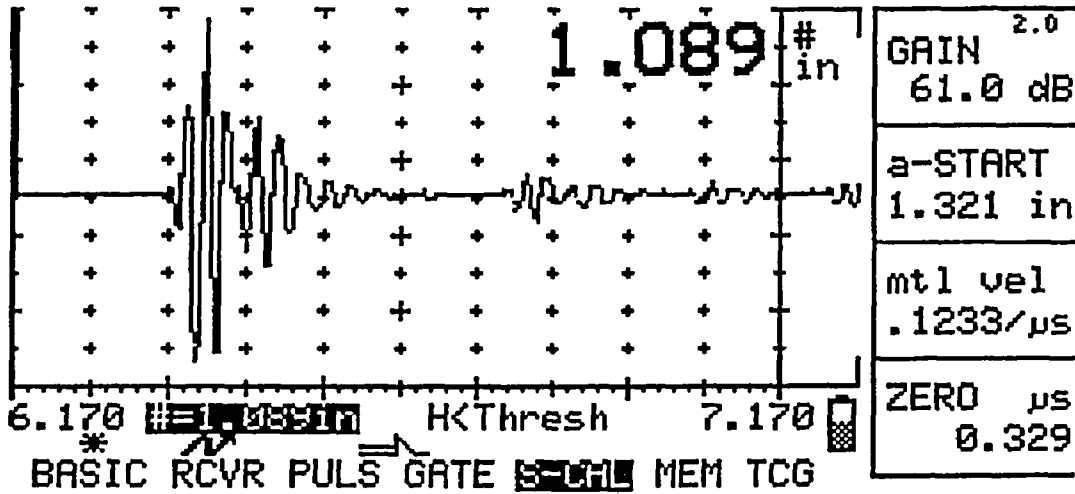

60° Pre Waveform

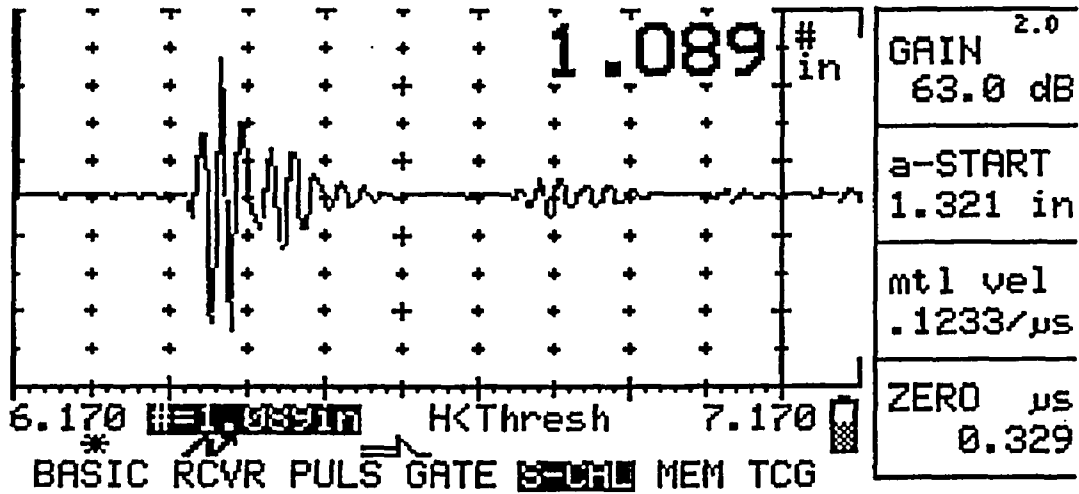

60° Post Waveform


H5 BGT
 4/19/09

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R166
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-OT-9 REV.: 9 PCR: 0206 N/A mt 4-4-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: 15X1 FREQ.: 2.25
 S/N: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Some 135 S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY						LEADING RAY			
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
1/2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

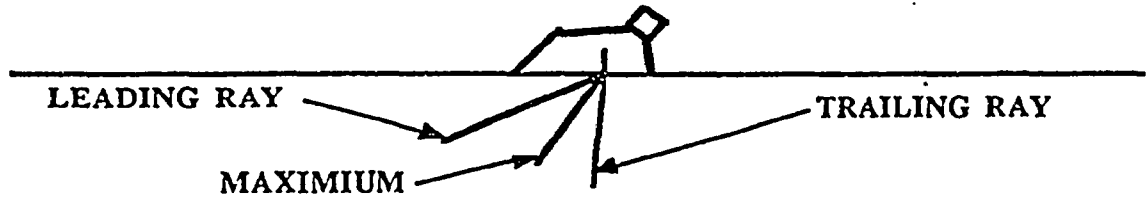

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N


EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>12</u> OF <u>15</u>

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R166
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0206 H/A 04-04-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5x1 FREQ.: 2.25
 SN: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Sonic 136 SN: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY						LEADING RAY			
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	6 3/4	7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

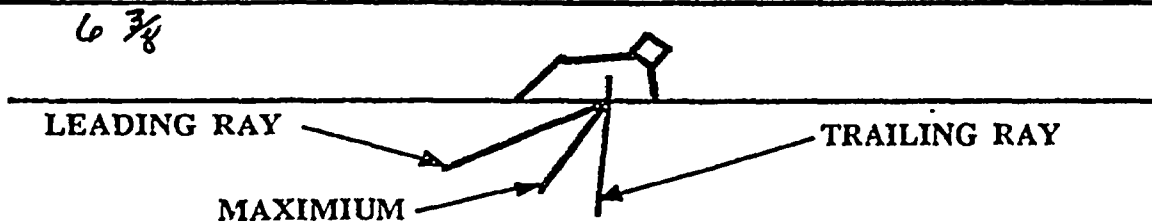


RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mike W. Kleyer</u>	REVIEWED BY: <u>Paul [Signature]</u>	ANII: <u>Albert [Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/14/02</u>
		PAGE: <u>15</u> OF <u>15</u>

REPORT NUMBER 00108
R166

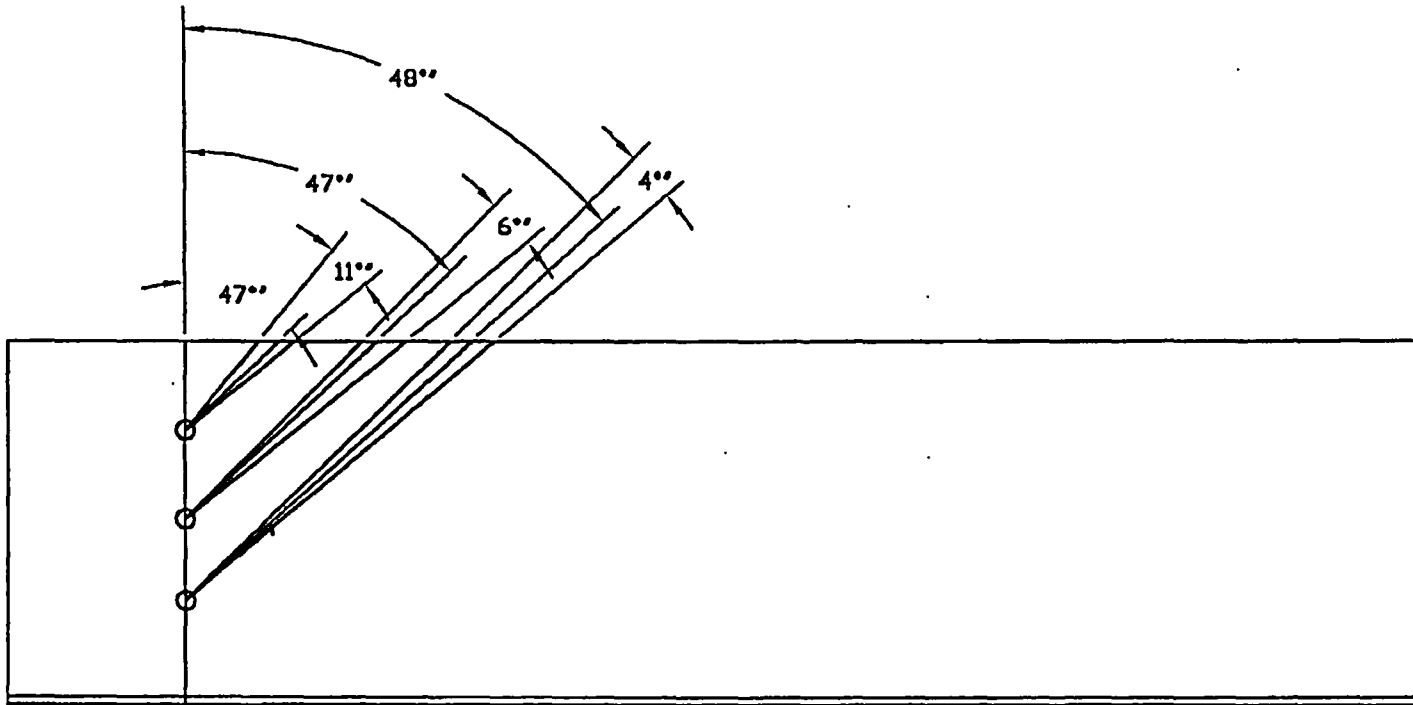


13 Apr 05 15
See #119/02

#15BCT 4/19/02	Browns Ferry Unit 3
	Beamspread
	MARCH 2002
	BF-18


Report Number
R166
00109

5150
14 April 01

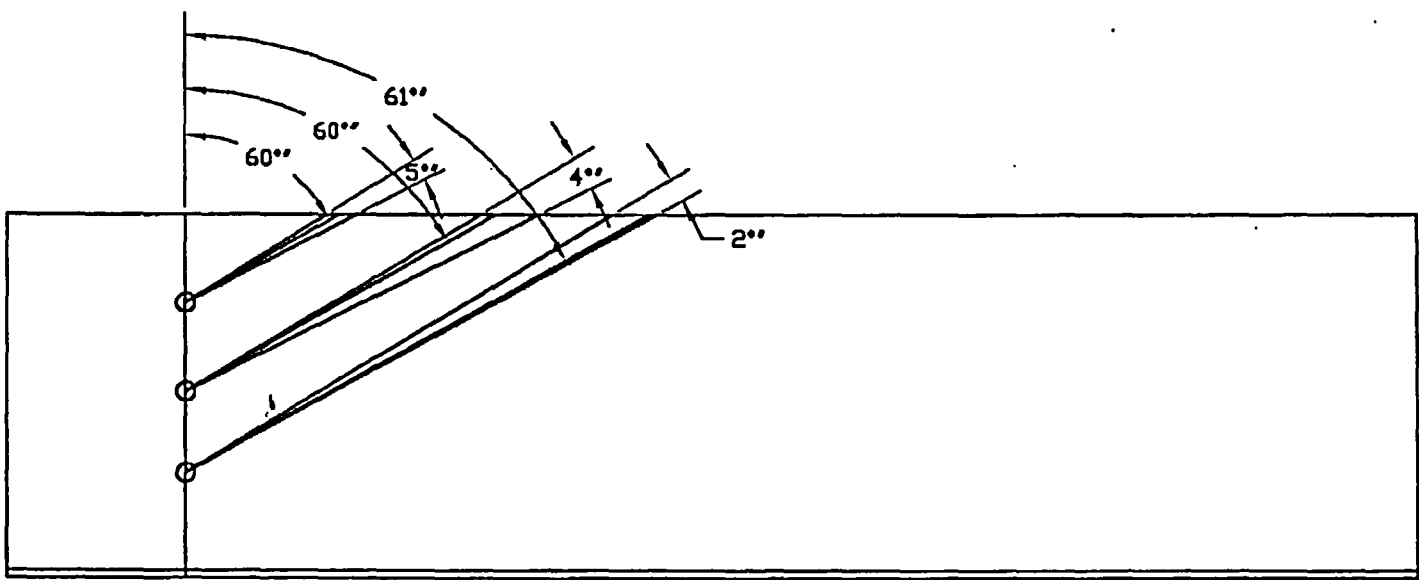

H5BET
ATY
4/19/02

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

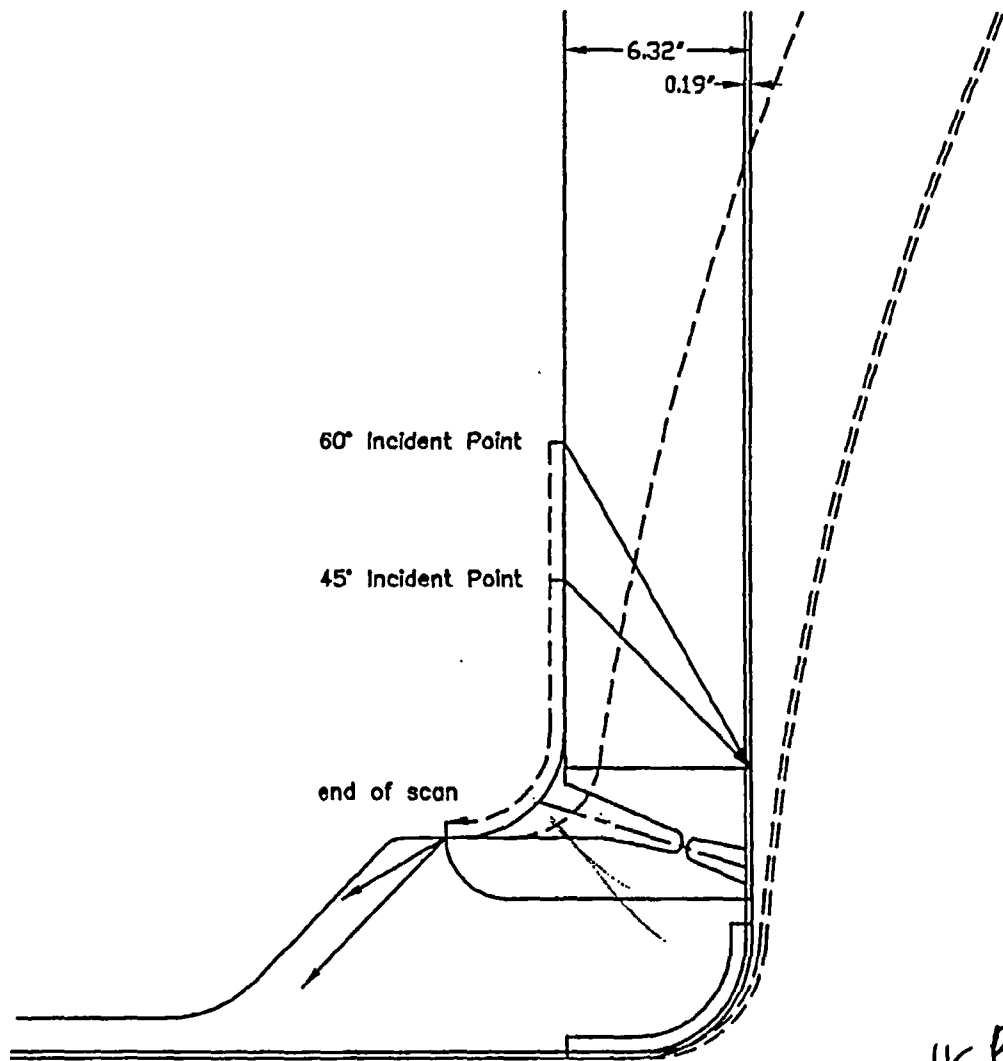

NOTE: Transverse coverage includes coverage obtained during the inner radius examinations.

Report Number
R166

HSBCJ
4/19/02

Browns Ferry Unit 3

N4 Nozzle-to-Shell

March 2002

SP-N4-NS

00110

15 08 15

00111

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R167</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N4A-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0327-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
CATEGORY: B-D					
PROCEDURE: N-UT-55		REV: 9	TC: N/A	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: <i>US 4-10-02</i> DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.

N4A-IR: This examination was performed using a 21° and 27° in the blend radius in two directions CW/CCW

100% code coverage was obtained


This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>		REVIEWED BY: <i>[Signature]</i>		ANII: <i>What Tech</i>	
LEVEL: II DATE: <i>01-01-02</i>		LEVEL: <i>III</i> DATE: <i>4/4/02</i>		DATE: <i>4/19/02</i>	
				PG. 1 OF 24 <i>Jan 4/10/02</i>	

00112

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R167																																																																		
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-30-02																																																																				
PROC.: N-UT- 55		REV: 9		DB TC: N/A 02-02		CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F																																																																		
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A																																																																				
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02																																																																		
TRANSDUCER MFG: KRAUTKRAMER				COUPLANT SONOTRACE		BATCH: 01141																																																																		
S/N DB 351613		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>																																																														
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION																																																																				
				BLOCK TYPE: CS IIW		S/N: DB 55074																																																																		
				NOMINAL ANGLE: 21		ACTUAL ANGLE: N/A																																																																		
				INSTRUMENT SETTINGS																																																																				
				REFLECTOR			REFERENCE		MEMORY																																																															
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER																																																															
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	55.0 dB		22																																																															
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A																																																															
				FREQ: 2.25	MHz		REJECT: OFF		%																																																															
				ANGLE: N/A	deg		DAMPING: 200		ohms																																																															
				DELAY: 1.61	msec		PULSER: 222																																																																	
				ZERO: N/A	msec		FILTER: FILT 1																																																																	
				VELOCITY: 0.233	msec		REP RATE: 4 KHZ																																																																	
				RANGE: 20.0	inches		TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK																																																															
				DISPLAY MODE: PE			POWER: AC																																																																	
				DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF																																																														
				CALIBRATION TIMES																																																																				
				INITIAL TIME: 1505				FINAL TIME: 1810																																																																
				1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A																																																												
<p style="text-align: center;">LINEARITY CHECK</p> <table border="1"> <thead> <tr> <th rowspan="2">VERTICAL</th> <th colspan="2">SIGNAL 1</th> <th>100</th> <th>90</th> <th>80</th> <th>70</th> <th>60</th> <th>50</th> <th>40</th> <th>30</th> <th>20</th> </tr> </thead> <tbody> <tr> <td></td> <td colspan="2">SIGNAL 2</td> <td>50</td> <td>45</td> <td>40</td> <td>35</td> <td>30</td> <td>25</td> <td>20</td> <td>15</td> <td>10</td> </tr> <tr> <th rowspan="2">ATTENUATOR</th> <th>GAIN</th> <th>SET</th> <td colspan="2">-6 dB</td> <td colspan="2">-12 dB</td> <td colspan="2">SET</td> <td colspan="2">+12</td> <td>SET</td> <td>+6</td> </tr> <tr> <th>AMP.</th> <td>80%</td> <td colspan="2">32 TO 48</td> <td colspan="2">16 TO 24</td> <td colspan="2">20 %</td> <td colspan="2">64 TO 96</td> <td>40%</td> <td>64 TO 96</td> </tr> <tr> <td></td> <td></td> <td></td> <td>40</td> <td>20</td> <td></td> <td></td> <td>80</td> <td></td> <td></td> <td>80</td> <td></td> </tr> </tbody> </table>												VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20		SIGNAL 2		50	45	40	35	30	25	20	15	10	ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6	AMP.	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96				40	20			80			80	
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20																																																													
		SIGNAL 2		50	45	40	35	30	25	20	15	10																																																												
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6																																																												
	AMP.	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96																																																												
			40	20			80			80																																																														
COMMENTS:						WELDS/ITEMS EXAMINED:																																																																		
Wedge ID D-14795-246						REACTOR PRESSURE VESSEL																																																																		
						N4A-IR, N4F-IR																																																																		
EXAMINER: DAVID KLEINJAN		EXAMINER: MIKE KLEINJAN		REVIEWER:		ANII: <i>What</i>		DATE: 4/19/02		PG: 3 OF 4																																																														
<i>D.L. Klay</i>		<i>Mike W. Kleinjan</i>		<i>Paul White</i>						4/10/02																																																														
LEVEL: II		LEVEL: II		LEVEL: III		DATE: 4/10/02		PG: 3 OF 4		2 OF 4																																																														

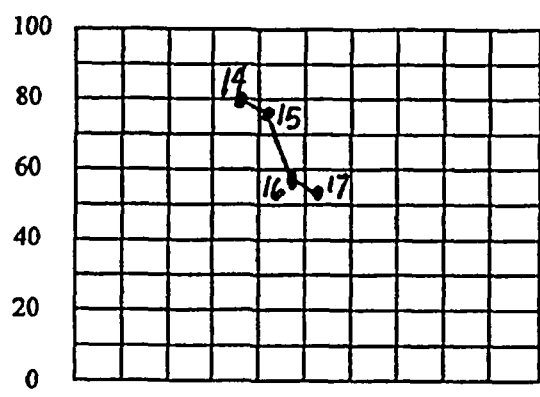


DISPLAY WIDTH: 20 inches

00113

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R167
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 03-30-02
PROC.: N-UT- 55 REV:9 TC: N/A 0308	CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPER: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	

DAC	BLOCK TYPE: CS IIW	S/N: DB 55074
	NOMINAL ANGLE: 27	ACTUAL ANGLE: N/A

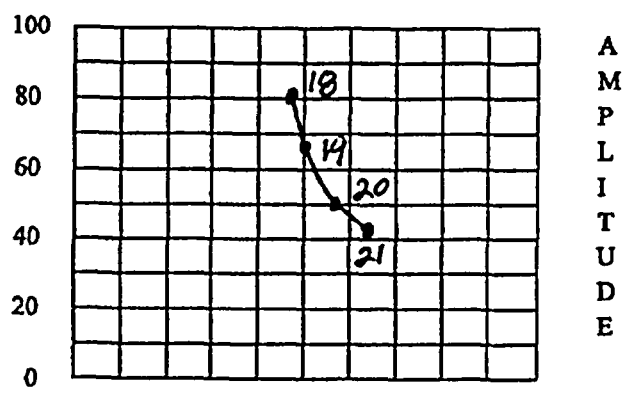

DISPLAY WIDTH: 20 inches

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	56.2 dB	23
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ: 2.25 MHz	REJECT: OFF %			
ANGLE: N/A deg	DAMPING: 200 ohms			
DELAY: 0.950 msec	PULSER: 222			
ZERO: N/A msec	FILTER: FILT 1			
VELOCITY: 0.233 msec	REP RATE: 4 KHZ			
RANGE: 20.0 inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK			
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: N/A	GAIN: N/A dB	CALIBRATION TIMES								
AMPLITUDE: N/A %	METAL PATH: N/A"	INITIAL TIME: 1505			FINAL TIME: 1810					
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	

LINEARITY CHECK

VERTICAL	SIGNAL 1									
	100	90	80	70	60	50	40	30	20	
ATTENUATOR	SIGNAL 2									
	50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
Wedge ID D-14795-247	REACTOR PRESSURE VESSEL
	N4A-IR, N4F-IR

EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II	REVIEWER: <i>John Whitaker</i> LEVEL: <i>II</i> DATE: <i>4/1/02</i>	ANI: <i>What hold</i> DATE: <i>4/19/02</i> PG.: <i>1 of 4</i> <i>3 of 4</i> <i>4/19/02</i>
--	---	---	---

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R167

PROJECT: BEN UNIT: 3 WELD ID: N4A CONFIG.: INNER RADIUS COMPONENT: - N/A

CAL. SHT. NO.: NA PROCEDURE: N-UT-55 REV.: 7 PCR: 0208/NA TEMP.: 85 PYRO.: 52235
05476-02

SCAN SENS.: * dB EXAM START: 1650 EXAM END: 1750 EXAM ANGLE: 21, 27

Lo LOCATION: TDC Wo LOCATION: 6 OS WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%			
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2	
21°	SCAN		dB	61			SCANNING * 10%			BLEND RADIUS												
27°	SCAN		dB	62.2			SCANNING * 10%			BLEND RADIUS												
No Recordable Indications																						

00114

COMMENTS: A MATERIAL NOISE LEVEL OF 510% WAS OBSERVED

EXAMINER: D.R. [Signature] LEVEL: II DATE: 03-30-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/16/02
 EXAMINER: [Signature] LEVEL: II DATE: 4-4-02 ANII: [Signature] DATE: 9/19/02 PAGE 42 OF 4

Inspection Report R-168
Weld N4F-NV

00115

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R168</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N4F	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0327-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
PROCEDURE: N-UT-9		REV:9	TC:02-06	COFIG.:	NOZZLE TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL:II		LEVEL:II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld..

Examination. Nozzle to Vessel weld N4F

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination.

(N4F-IR) *see R169*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

77% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>with w Kleinjan</i>	REVIEWED BY: <i>Paul Whitaker</i>	ANII: <i>Robert Smith</i>
LEVEL: II DATE: 4-4-02	LEVEL: <i>III</i> DATE: 4/4/02	DATE: 4/19/02
		PG. 2 OF 2 15 <i>see 4/19/02</i> 1 OF 15

REPORT NUMBER
R168

00116

Calculation of ASME code coverage
For section XI NDE Examination

N4F

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	100%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *

The sum of all the percentage of scans	700%
Divided by the total # of scans	9
Percentage of examination Volume coverage	77%

* Transverse coverage includes coverage obtained during the inner radius examination.

H5BCT
4/19/02

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R168
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 3-30-02
PROC.: N-UT- 9 REV:9 TC:02-06	CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F
INSTR. MFG: Staveley DUE DATE: 8-05-02	SIMULATOR BLOCK NO: DB55079
MODEL/TYPE: sonic 136 M & TE NO.: VH751	THERMOMETER S/N: 522352 DUE DATE: 5-17-02
TRANSDUCER MFG: Harisonic	COUPLANT SONOTRACE BATCH: 01141
S/N DB34198 SIZE: .75 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG174 LENGTH: 120 inches	

4-403 ANGLE VERIFICATION	
BLOCK TYPE: Rompas <i>Rompas</i> S/N: DB55079	
NOMINAL ANGLE: 0	ACTUAL ANGLE: N/A

DAC		INSTRUMENT SETTINGS		
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>	A	REFLECTOR		
	M	SCAN DIRECT.	NTCH	SDH
	P	AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>
	L	CIRC	<input type="checkbox"/>	<input type="checkbox"/>
	I	FREQ:	2.25	MHz
	T	ANGLE:	n/a	deg
	U	DELAY:	.499	msec
	D	ZERO:	n/a	msec
	E	VELOCITY:	.238	msec
	E	RANGE:	10	inches

REF. REFLECTOR: 1" GAIN: 8 dB	CALIBRATION TIMES	
AMPLITUDE: 80% METAL PATH: 1"	INITIAL TIME: 9:00	FINAL TIME: 1830
VERIFICATION TIMES	1) 14:00	2) n/a
	3) n/a	4) n/a
	5) n/a	6) n/a
	7) n/a	8) n/a
	9) n/a	

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
	N4A, N4F Nozzle to Shell

EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i>	EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i>	REVIEWER: <i>David Kleinjan</i>	ANII: <i>What?</i>
LEVEL: II	LEVEL: II	DATE: 4/19/02	DATE: 4/19/02
		PG.: 16 OF 15 <i>54/1002</i>	


00118

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R168						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 3-30-02								
PROC.: N-UT- 9 REV:9		TC:02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F						
INSTR. MFG: Staveley		DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: sonic 136		M & TE NO.: VH751		THERMOMETER S/N: 522352		DUE DATE: 5-17-02						
TRANSDUCER MFG: Krautkramer				COUPLANT SONOTRACE BATCH: 01141								
S/N DB34843		SIZE: .5x1		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>						
CABLE TYPE: RG1743		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: DB55074						
				NOMINAL ANGLE: 45°		ACTUAL ANGLE: 46°						
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	42.6 dB		2			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a			
				FREQ: 2.25		MHz		REJECT: off		%		
				ANGLE: N/A		deg		DAMPING: 500		ohms		
				DELAY: .830		msec		PULSER: 222				
				ZERO: N/A		msec		FILTER: FITL 3				
				VELOCITY: .126		msec		REP RATE: 2KHZ				
RANGE: 20		inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: 1" GAIN: 33.6 dB				CALIBRATION TIMES								
AMPLITUDE: 80 %		METAL PATH: 1"		INITIAL TIME: 9:00		FINAL TIME: 18:30						
VERIFICATION TIMES	1) 14:00	2) N/A	3) N/A	4) N/A	5) N/A	6) N/A	7) N/A	8) N/A	9) N/A			
LINEARITY CHECK												
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20		
	SIGNAL 2	50	45	40	35	30	25	20	15	10		
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40		20				80			
COMMENTS:					WELDS/ITEMS EXAMINED:							
Delta difference between 3/8 to 5/8 on the clad side is 3 dB					N4A,N4F Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II					EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II							
REVIEWER: <i>[Signature]</i> LEVEL: III DATE: 4/10/02					AII: <i>[Signature]</i> DATE: 4/19/02 PG: 18 OF 15 4/10/02 4 OF 15							

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R168
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 3-30-02
PROC.: N-UT- 9 REV:9 TC:02-06	CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F
INSTR. MFG: Staveley DUE DATE: 8-05-02	SIMULATOR BLOCK NO: DB55079
MODEL/TYPE: Sonic 136 M & TE NO.: VH751	THERMOMETER S/N: 522352 DUE DATE: 5-17-02
TRANSDUCER MFG: Kraunkramer	COUPLANT SONOTRACE BATCH: 01141
S/N DB34154 SIZE: .5x1 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG174 LENGTH: 120 inches	

DAC		ANGLE VERIFICATION	
		BLOCK TYPE: IIW	S/N: DB55074
		NOMINAL ANGLE: 60	ACTUAL ANGLE: 59

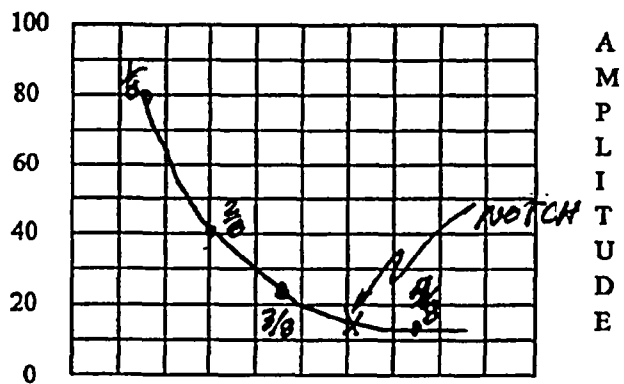

DISPLAY WIDTH: 10 inches

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	49 dB	3
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB	n/a
FREQ: 2.25 MHz	REJECT: off %			
ANGLE: N/A deg	DAMPING: 500 ohms			
DELAY: 1.20 msec	PULSER: 222			
ZERO: N/A msec	FILTER: FITL 3			
VELOCITY: .123 msec	REP RATE: 2KHZ			
RANGE: 20 inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK			
DISPLAY MODE:	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: 1" GAIN: 36 dB	CALIBRATION TIMES								
AMPLITUDE: 80% METAL PATH: 1"	INITIAL TIME: 9:00				FINAL TIME: 18:30				
VERIFICATION TIMES	1)14:00	2)n/a	3)n/a	4)n/a	5)n/a	6)n/a	7)n/a	8)n/a	9)n/a

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96	80	
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE CLAD SIDE	N4A,N4F Nozzle to Shell


EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II	EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: III DATE: 4/14/02	ANH: <i>Albert Hall</i> DATE: 4/19/02 PG.: 17 OF 15 5 OF 15
---	--	---	--

00120

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R168
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 03-30-02
PROC.: N-UT- 55 REV:9 AP, TC: N/A 0000	CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: CS IIW	S/N: DB 55074
	NOMINAL ANGLE: 21	ACTUAL ANGLE: N/A

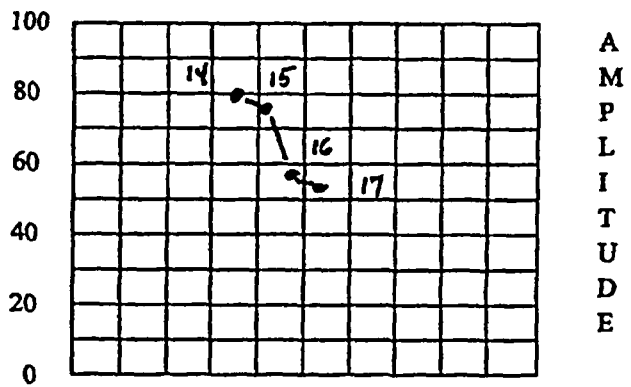

DISPLAY WIDTH: 20 inches

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	55.0 dB	22
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ: 2.25	MHz	REJECT: OFF	%	
ANGLE: N/A	deg	DAMPING: 200	ohms	
DELAY: 1.61	msec	PULSER: 222		
ZERO: N/A	msec	FILTER: FILT 1		
VELOCITY: 0.233	msec	REP RATE: 4 KHZ		
RANGE: 20.0	inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK		
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: N/A	GAIN: N/A dB	CALIBRATION TIMES							
AMPLITUDE: N/A %	METAL PATH: N/A"	INITIAL TIME: 1505			FINAL TIME: 1810				
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	
	SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6			
	AMP	80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96			
			40	20		80		80			

COMMENTS:	WELDS/ITEMS EXAMINED:
	REACTOR PRESSURE VESSEL
	N4A-IR, N4F-IR
	wedge IO D-14795-246


EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II	REVIEWER: <i>Robert Allen</i> LEVEL: III DATE: 4/1/02	ANII: <i>Robert Allen</i> DATE: 4/19/02 PG. 14 OF 15 5/10/02 6 OF 15
---	---	---	---

00121

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R168
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 03-30-02
PROC.: N-UT- 55 REV:9 AP TC: N/A CB	CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: CS IIW	S/N: DB 55074
	NOMINAL ANGLE: 27	ACTUAL ANGLE: N/A

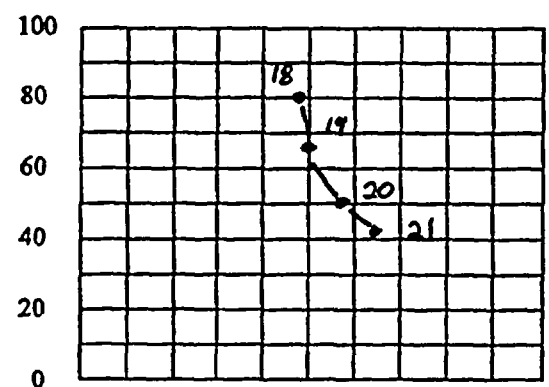

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	56.2 dB	23
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ: 2.25	MHz	REJECT: OFF	%	
ANGLE: N/A	deg	DAMPING: 200	ohms	
DELAY: 0.950	msec	PULSER: 222		
ZERO: N/A	msec	FILTER: FILT 1		
VELOCITY: 0.233	msec	REP RATE: 4 KHZ		
RANGE: 20.0	inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK		
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: N/A	GAIN: N/A dB	CALIBRATION TIMES							
AMPLITUDE: N/A %	METAL PATH: N/A"	INITIAL TIME: 1505	FINAL TIME: 1810						
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	
	SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB	-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48	16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40	20				80			

COMMENTS:	WELDS/ITEMS EXAMINED: REACTOR PRESSURE VESSEL N4A-IR, N4F-IR wedge IO 0-14795-247
-----------	---

EXAMINER: DAVID KLEINJAN <i>D.R. Kleyan</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: <i>III</i> DATE: <i>4/16/02</i>	ANII: <i>[Signature]</i> DATE: <i>4/19/02</i> PG.: 4-5 OF 1-15 <i>4/19/02</i> 7 OF 15
--	---	---	---

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R168

PROJECT: BFN UNIT: 3 WELD ID: N4F CONFIG.: Nozzle COMPONENT: VESSEL

CAL. SHT. NO.: N/A PROCEDURE: NU-UT-9 REV.: 9 PCR: N/A ⁰²⁰⁶ ^{2 9-09-02} TEMP.: 85 PYRO.: 522352

SCAN SENS.: X dB ^{3/30/02} EXAM START: 15:50 EXAM END: 1650 EXAM ANGLE: 0°, 45°, 60°

L₀ LOCATION: TDC W₀ LOCATION: 1/2 OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%			
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2	
21°	SCAN	dB	61																			
27°	SCAN	dB	62.2																			
0°	SCAN	dB	74.8																			
45°	SCAN	dB	56.6																			
45°T	SCAN	dB	56.6																			
45°TAN	SCAN	dB	56.6																			
60°	SCAN	dB	63																			
60°T	SCAN	dB	63																			
60°TAN	SCAN	dB	63																			
NO RECORDABLE INDICATION																						


00152

COMMENTS: 21° AND 27° EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS
 TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE
 INNER RADIUS EXAMINATIONS. 5 to 10 % Noise Level was observed and


EXAMINER: [Signature] LEVEL: 11 DATE: 3-30-02 REVIEWED BY: [Signature] LEVEL: 11 DATE: 4/19/02
 EXAMINER: [Signature] LEVEL: 11 DATE: 3-30-02 ANI: [Signature] DATE: 4/19/02 PAGE 78 OF 15

REPORT NUMBER
R168 00123

Nozzle Examination 45° Waveforms

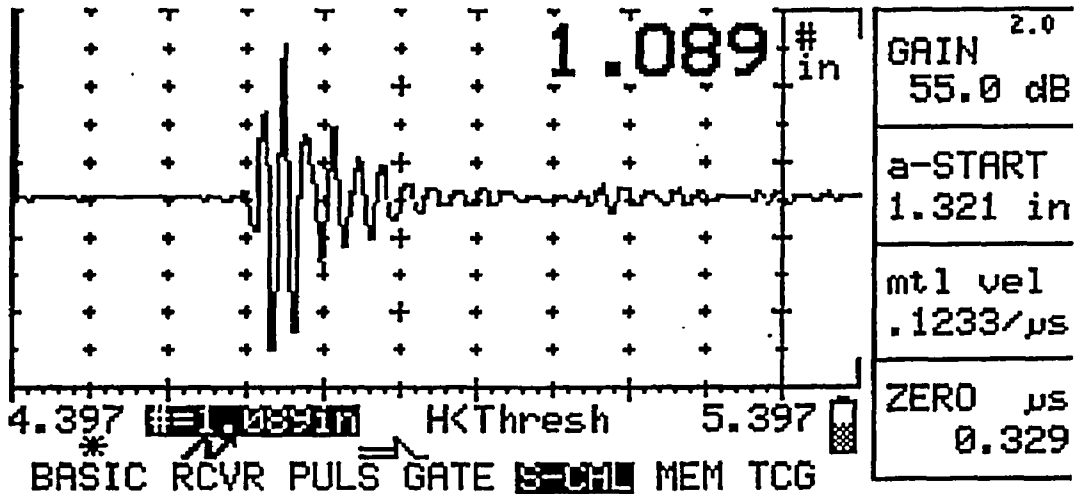

45° Pre Waveform

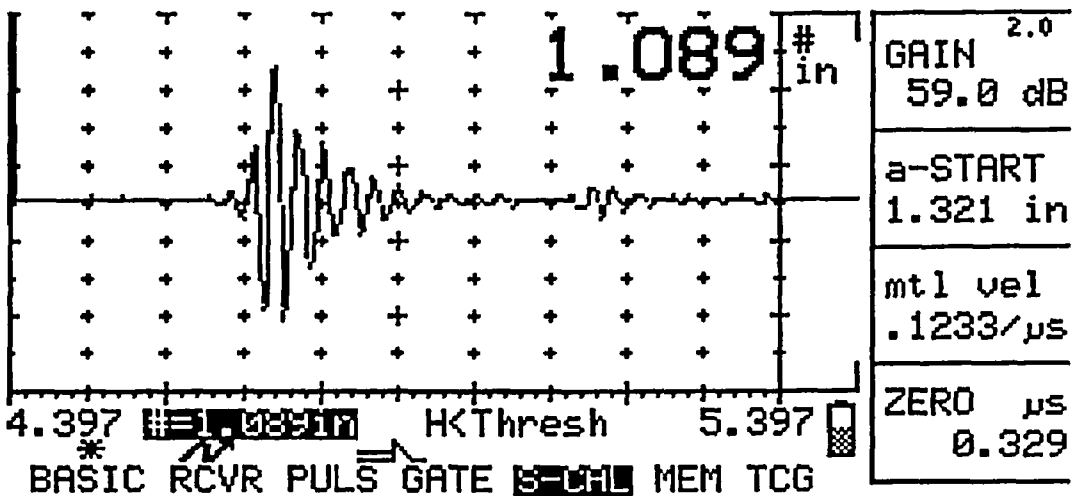


45° Post Waveform


H5BCT
4/19/02
9 of 15
Jul 19 2002 10:28:15

00124
 REPORT NUMBER
 R168

Nozzle Examination 60° Waveforms

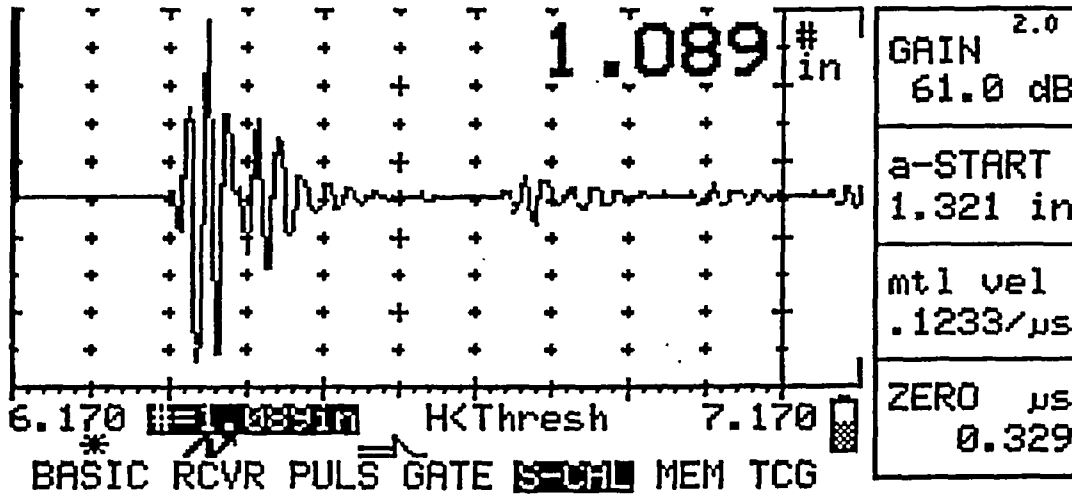

60° Pre Waveform

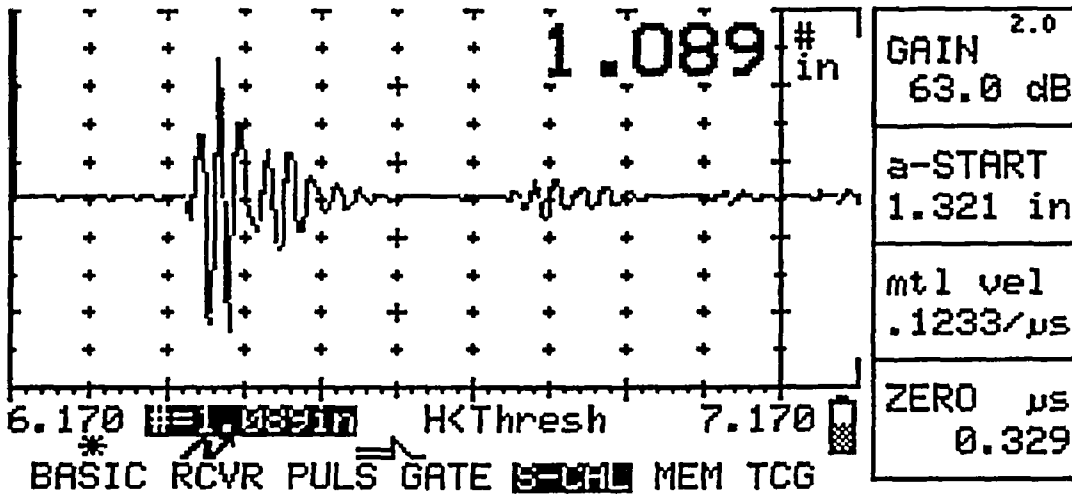

60° Post Waveform

H SBC
 4/14/02


4/11/02 10 OF 15
 4/15/15

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R168
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18⁰²
 PROCEDURE NO.: N-OT-9 REV.: 9 PCR: 0206 RTA ml 9-30-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5X1 FREQ.: 2.25
 SIN: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Some 13C SIN: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY					LEADING RAY				
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

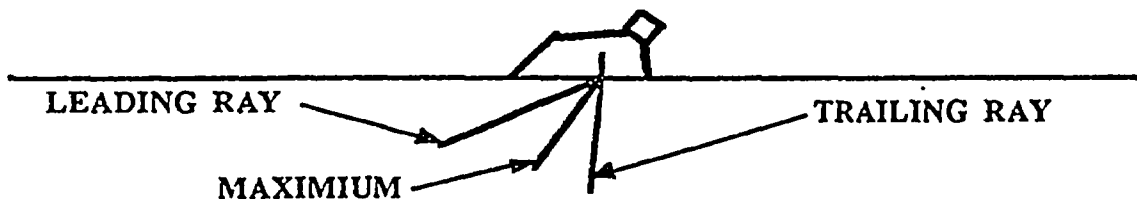

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N


EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>II</u> DATE: <u>4/6/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>12</u> OF <u>15</u>

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R168
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0206 NTA and 3-30-02
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5x1 FREQ.: 2.25
 SIN: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Sonn 13G SN: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY						LEADING RAY			
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	6 3/8	7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

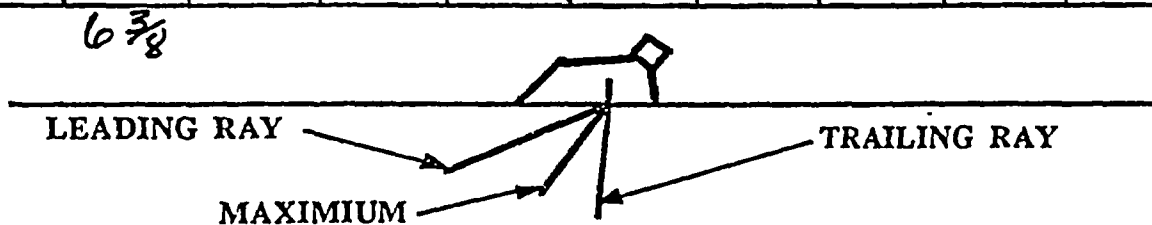


RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18

FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mike W Henry</u>	REVIEWED BY: <u>[Signature]</u>	ANI: <u>Albat full</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>1215</u> OF <u>15</u>

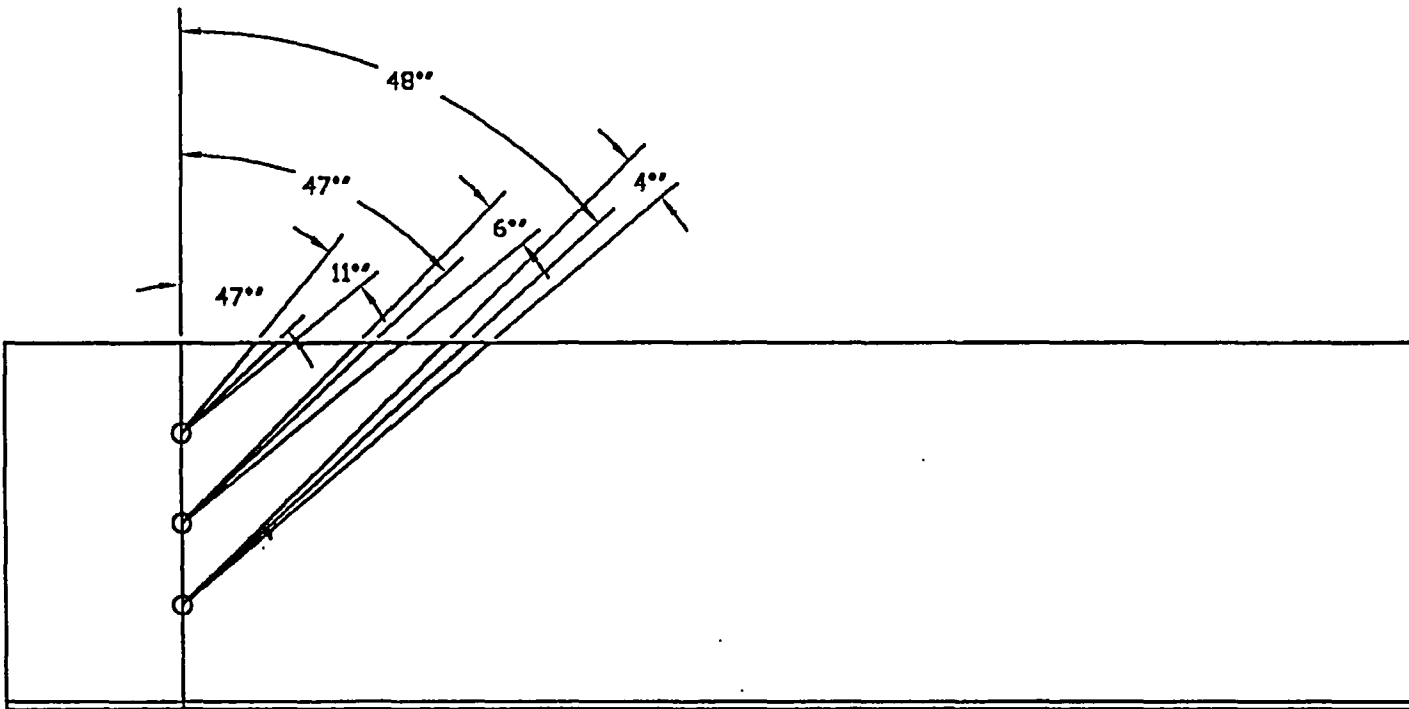


Report Number
R168

H5BGT
1/17
4/17/02

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

00127.

13
4/5/16
10-11/02

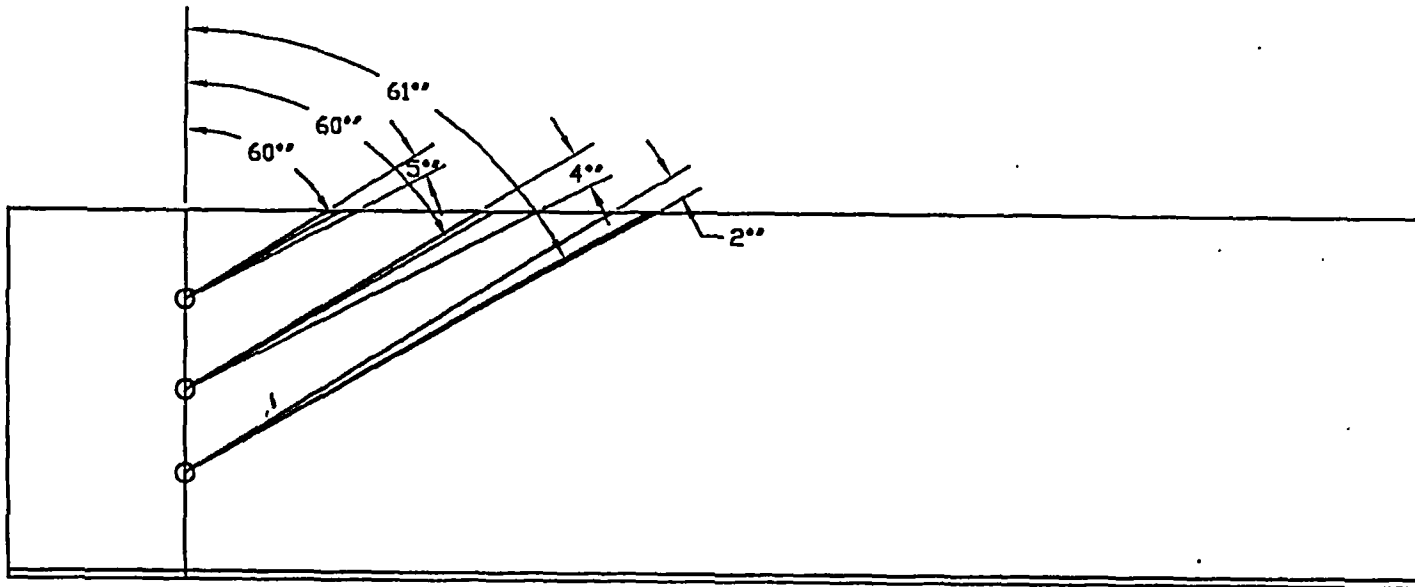


Report Number
R168

HSBCT
4/1/02

Browns Ferry Unit 3
Beamspread
MARCH 2002
BF-18

00128

14
3.15
4/1/02

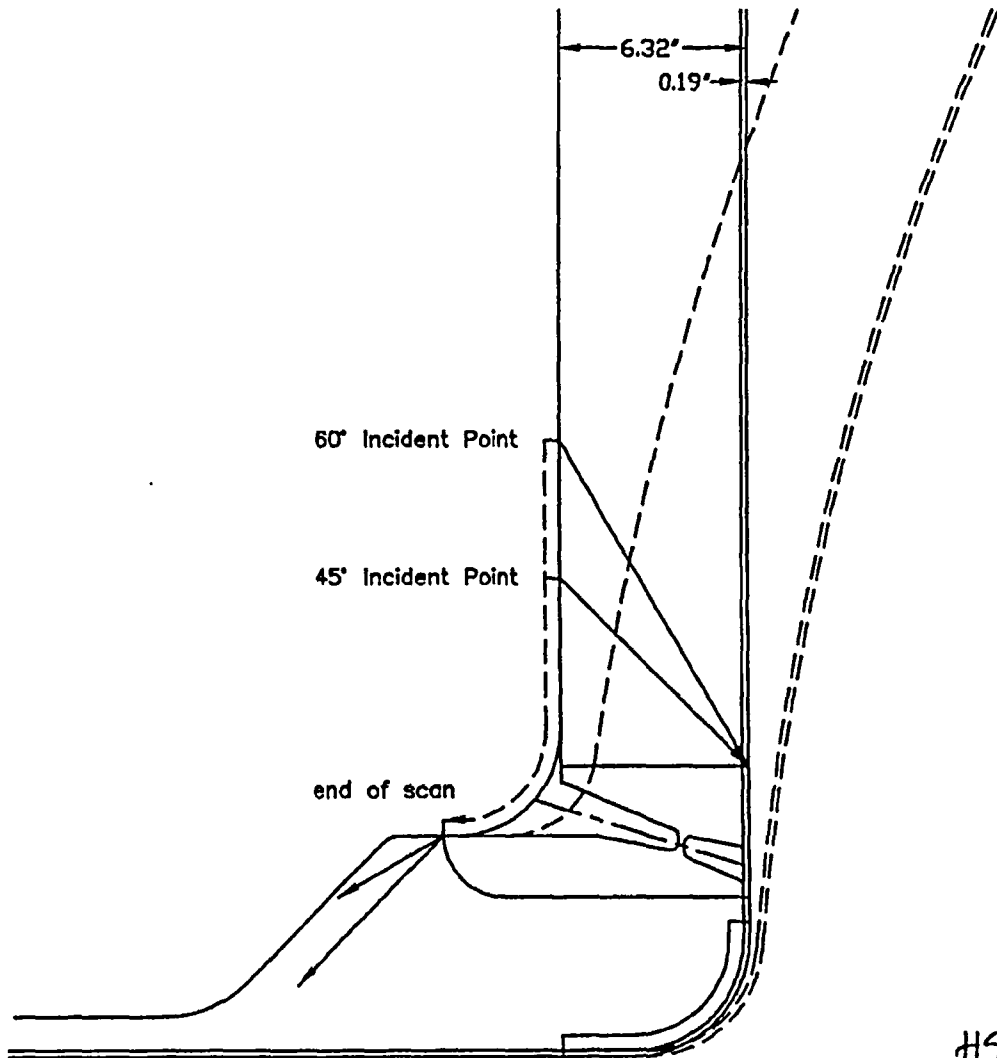

5/1/02
15 of 15

NOTE: Transverse coverage includes coverage obtained during the inner radius examinations.

Report Number
R168

<i>HSBCT</i>	Browns Ferry Unit 3
<i>4/19/02</i>	N4 Nozzle-to-Shell
	March 2002
	SP-N4-NS

00129

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R169</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N4F-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0327-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
PROCEDURE: N-UT-55		REV:9	TC: N/A <i>63-08</i>	COFIG.:	NOZZLE TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: <i>DAVID KLEINJAN</i> DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: I		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.


N4F-IR: This examination was performed using a 21° and 27° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications


RESOLUTION BY: Mike Kleinjan <i>Mike Kleinjan</i>	REVIEWED BY: <i>Albert Todd</i>	ANII: <i>Albert Todd</i>
LEVEL: II DATE: <i>4-4-02</i>	LEVEL: <i>II</i> DATE: <i>4/4/02</i>	DATE: <i>4/19/02</i>
		PG. 1 OF 4 <i>1</i> 4/11/02

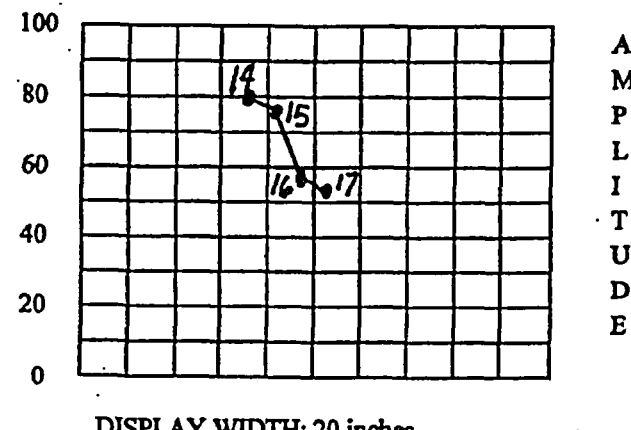TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R169</i>						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-30-02								
PROC.: N-UT- 55		REV: 9		TC: <i>N702-08</i>		CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F						
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A								
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02						
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE		BATCH: 01141								
S/N DB 351643		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>		
CABLE TYPE: <i>4-4-06</i> RG 174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC		BLOCK TYPE: CS IIW		S/N: DB 55074		NOMINAL ANGLE: 21		ACTUAL ANGLE: N/A				
		INSTRUMENT SETTINGS										
		REFLECTOR			REFERENCE		MEMORY					
		SCAN DIRECT.		NTCH	SDH	SENSITIVITY		NUMBER				
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>	55.0 dB		22				
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A				
		FREQ: 2.25		MHz		REJECT: OFF		%				
		ANGLE: N/A		deg		DAMPING: 200		ohms				
		DELAY: 1.61		msec		PULSER: 222						
		ZERO: N/A		msec		FILTER: FILT 1						
		VELOCITY: 0.233		msec		REP RATE: 4 KHZ						
RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES								
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1505		FINAL TIME: 1810						
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40		20				80		80	
COMMENTS:					WELDS/ITEMS EXAMINED:							
Wedge ID D=14795-246					REACTOR PRESSURE VESSEL							
					N4A-IR, N4F-IR							
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II			REVIEWER: <i>Shel White</i> LEVEL: <i>III</i> DATE: <i>4/1/02</i>			ANI: <i>Albert Todd</i> DATE: <i>4/1/02</i> PG.: <i>1-5</i> OF <i>1-4</i> <i>4/1/02</i> <i>2 of 4</i>			

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R169
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 03-30-02
PROC.: N-UT- 55 REV:9 TC: N/A	CALIBRATION BLOCK NO.: BF-84-IR TEMP: 70.5°F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPER: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: CS IIW	S/N: DB 55074
	NOMINAL ANGLE: 27	ACTUAL ANGLE: N/A

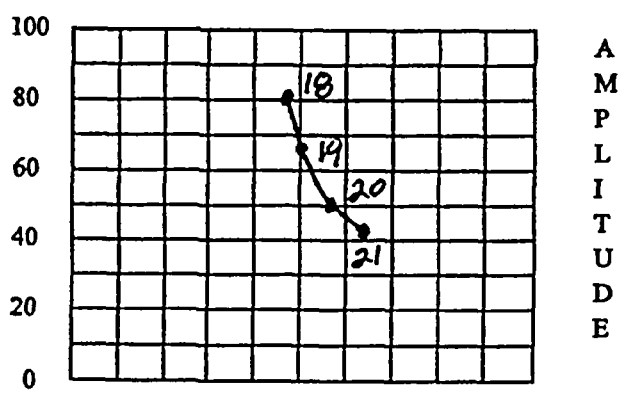

DISPLAY WIDTH: 20 inches

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	56.2 dB	23
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ: 2.25 MHz	REJECT: OFF %			
ANGLE: N/A deg	DAMPING: 200 ohms			
DELAY: 0.950 msec	PULSER: 222			
ZERO: N/A msec	FILTER: FILT 1			
VELOCITY: 0.233 msec	REP RATE: 4 KHZ			
RANGE: 20.0 inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK			
DISPLAY MODE: PE	POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: N/A	GAIN: N/A dB	CALIBRATION TIMES								
AMPLITUDE: N/A %	METAL PATH: N/A"	INITIAL TIME: 1505	FINAL TIME: 1810							
VERIFICATION TIMES	1)N/A 2)N/A 3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
Wedge ID D-14795-247	REACTOR PRESSURE VESSEL
	N4A-IR, N4F-IR

EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: <i>II</i> DATE: <i>4/19/02</i>	ANII: <i>[Signature]</i> DATE: <i>4/19/02</i> PG.: <i>4</i> OF <i>4</i> <i>4/19/02</i> 3 of 4
--	---	--	--

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO. R169

PROJECT: BFN UNIT: 3 WELD ID: N4F CONFIG.: INNER RADIUS COMPONENT: NA

CAL. SHT. NO.: NA PROCEDURE: N-UT-55 REV.: 9 PCR.: 02-08 TEMP.: 85 PYRO.: 5235
08-4-10-02

SCAN SENS.: *dB EXAM START: 1550 EXAM END: 1650 EXAM ANGLE: 21, 27

Lo LOCATION: TDC Wo LOCATION: E OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%			
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2	
21°	SCAN		dB	G1			SCANNING # 10/11			BLEND RADIUS												
27°	SCAN		dB	G2.2			SCANNING # 10/11			BLEND RADIUS												
No Recordable Indication																						

COMMENTS: A MATERIAL NOISE LEVEL OF 5-10% WAS OBSERVED

00139

EXAMINER: [Signature] LEVEL: II DATE: 03-30-02 REVIEWED BY: [Signature] LEVEL: III DATE: 4/1/02
 EXAMINER: [Signature] LEVEL: II DATE: 4-4-02 ANI: Albert Tald DATE: 4/19/02 PAGE 24 OF 4

Inspection Report R-170
Weld N5B-NV

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R170	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N5B	
EXAMINATION METHOD				SYSTEM RPV ISI DWG. NO. 3-ISI-0331-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1 CATEGORY: B-D	
PROCEDURE: N-UT_9		REV:9	TC:02-06	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN <i>4/19/02</i>		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: <i>II</i>		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld..

Examination. Nozzle to Vessel weld N5B

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination.

(NSB-IR) *see R171*

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

71% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

(1)(2) Geometric transverse indications observed (Foodwater Bracket Pads) using the 1/8 and 25 search units. (Transverse SCAN Supplement)

*No Recordable Indications using the 0, 45T, 45P, 60T, 60P Search Units
• (Bracket Pads were verified by underwater cameras) *ML**

RESOLUTION BY: Mike Kleinjan <i>ML</i>	REVIEWED BY: <i>David Kleinjan</i>	ANI: <i>Robert Todd</i>
LEVEL: II DATE: 4-4-02	LEVEL: <i>III</i> DATE: 4/4/02	DATE: 4/19/02
		PG. 1 OF 18

see 4/19/02

Calculation of ASME code coverage
For section XI NDE Examination

N5B



1) 0 Degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	74%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	65%
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100%
7) 45 degree Parallel-scan CCW direction	100%
8) 60 degree Parallel-scan CW direction	100%
9) 60 degree Parallel-scan CCW direction	100%

The sum of all the percentage of scans	639%
Divided by the total # of scans	9
Percentage of examination Volume coverage	71%

*Transverse coverage includes coverage obtained during the inner radius examination.

HSBCT
4/19/02

REPORT NUMBER
R170 00136

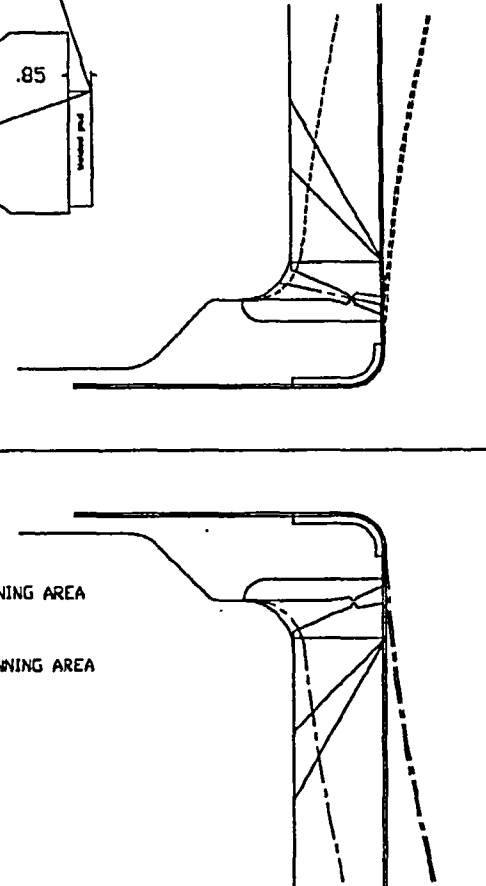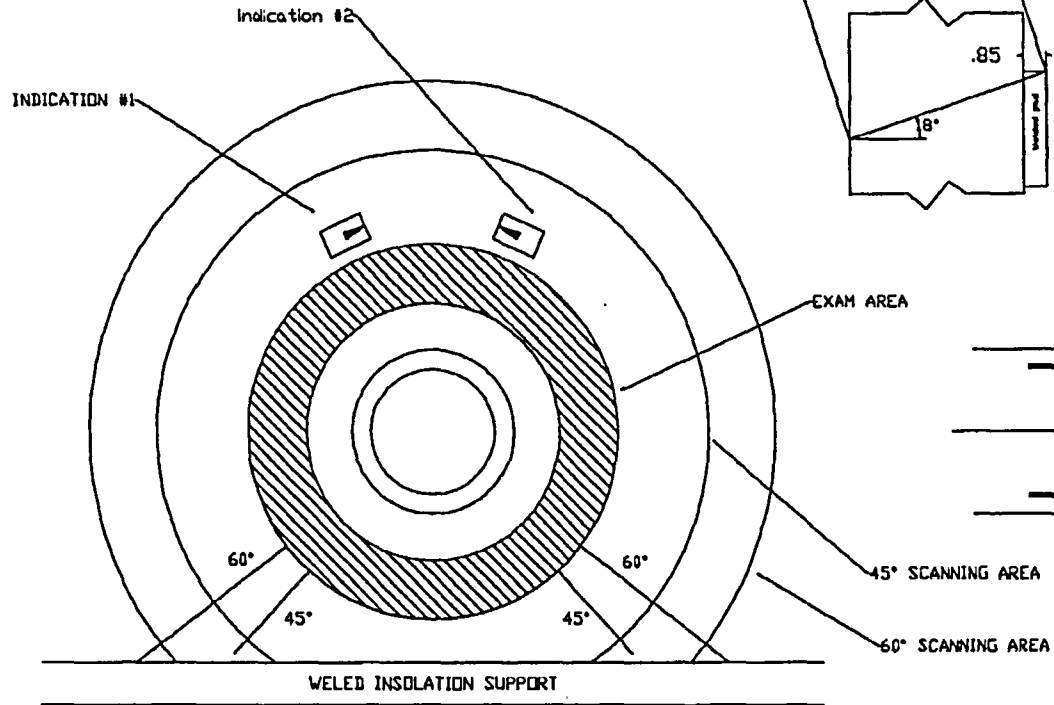

ed/bj/1/2
1/13/02
H 5 BCT

87 50 5

LIMITED SCAN 45° AND 60° DUE TO WELDED INSULATION SUPPORT

TOTAL EXAM AREA	2555	TOTAL EXAM AREA	2555
EXAM LIMITATION 45°	665	EXAM LIMITATION 60°	875
45° COVERAGE	1819 = 74°	60° COVERAGE	1680 = 65°

Browns Ferry Unit 3
N5 Nozzle-to-Shell
MARCH 2002
SP-N5-NS

00137

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R170						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 3-21-02 4-4-02 <i>4/19/02</i>								
PROC.: N-UT- 9		REV:9		TC:02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F				
INSTR. MFG: STAVELEY		DUE DATE: 8-05-02				SIMULATOR BLOCK NO: DB55079						
MODEL/TYPE: SONIC 136		M & TE NO.: VH751				THERMOMETER S/N: 522352		DUE DATE: 5-17-02				
TRANSDUCER MFG: Harisonic		COUPLANT SONOTRACE BATCH: 01141										
S/N DB34198		SIZE: .75		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input checked="" type="checkbox"/>				
CABLE TYPE: RG174		LENGTH: 120 inches				ANGLE VERIFICATION						
DAC		BLOCK TYPE: Rompus <i>Rompus</i>		S/N: DB55079								
		NOMINAL ANGLE: 0		ACTUAL ANGLE: N/A								
INSTRUMENT SETTINGS												
REFLECTOR					REFERENCE		MEMORY					
SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER				
AXIAL		<input type="checkbox"/>		<input checked="" type="checkbox"/>		20.8 dB		1				
CIRC		<input type="checkbox"/>		<input type="checkbox"/>		n/a dB		n/a				
FREQ: 2.25		MHz		REJECT: off		%						
ANGLE: n/a		deg		DAMPING: 500		ohms						
DELAY: .499		msec		PULSER: 222								
ZERO: n/a		msec		FILTER: Filt 3								
VELOCITY: .238		msec		REP RATE: 2KHZ								
RANGE: 10		inches		TOF: <input checked="" type="checkbox"/> PEAK		<input type="checkbox"/> FLANK						
DISPLAY MODE: PE				POWER: AC								
DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF						
CALIBRATION TIMES												
REF. REFLECTOR: 1"		GAIN: 8 dB		INITIAL TIME: 9:00		FINAL TIME: 17:30						
AMPLITUDE: 80 %		METAL PATH: 1"		4)N/A		5)N/A		6)N/A				
VERIFICATION TIMES		1)11:45		2)N/A		3)N/A		7)N/A				
								8)N/A				
								9)N/A				
LINEARITY CHECK												
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20
		SIGNAL 2		50	45	40	35	30	25	20	15	10
ATTENUATOR		GAIN		SET	-6 dB	-12 dB	SET	+12	SET	+6		
		AMP		80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
				40	20		80		80			
COMMENTS:					WELDS/ITEMS EXAMINED:							
					N5B Nozzle to Shell							
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i>		EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>		REVIEWER: <i>David Kleinjan</i>		ANII: <i>What Hill</i>		DATE: 4/19/02				
LEVEL: II		LEVEL: II		LEVEL: <i>II</i>		DATE: 4/4/02		PG. 7 6 OF 18 18 <i>4/19/02</i>				


TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R170						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 2-21-02 4-4-02 <i>5/19/02</i>								
PROC.: N-UT- 9		REV:9		TC:02-06		CALIBRATION BLOCK NO.: BF18						
INSTR. MFG: STAVELEY		DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: SONIC 136		M & TE NO.: VH751		THERMOMETER S/N: 522352		DUE DATE: 5-17-02						
TRANSDUCER MFG: Krautkramer				COUPLANT SONOTRACE BATCH: 01141								
S/N DB34843		SIZE: .5x1		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>						
CABLE TYPE: RG1743		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: DB55074						
				NOMINAL ANGLE: 45°		ACTUAL ANGLE: 46°						
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	45.6	dB	2			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a	dB	n/a			
				FREQ:	2.25	MHz	REJECT: off		%			
				ANGLE:	N/A	deg	DAMPING: 500		ohms			
				DELAY:	.830	msec	PULSER: 222					
				ZERO:	N/A	msec	FILTER: FITL 3					
				VELOCITY:	.126	msec	REP RATE: 2KHZ					
RANGE:	20	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK									
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: 1"				GAIN: 33.6 dB								
AMPLITUDE: 80 %				METAL PATH: 1"								
INITIAL TIME: 9:00				FINAL TIME: 17:30								
VERIFICATION TIMES		1) 11:45	2) N/A	3) N/A	4) N/A	5) N/A	6) N/A	7) N/A	8) N/A	9) N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40		20		80		80			
COMMENTS:						WELDS/ITEMS EXAMINED:						
Delta difference between 3/8 to 5/8 on the clad side is 3 dB						NSB Nozzle to shell						
EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i>						EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>			REVIEWER: <i>Paul W. ...</i>		ANII: <i>Robert Hill</i>	
LEVEL: II						LEVEL: II			DATE: 4/19/02		PG.: 7 OF 18	

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R170							
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 3-31-02 4/4/02 5/11/02			CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F							
PROC.: N-UT- 9 REV:9 TC:02-06		INSTR. MFG: STAVELEY DUE DATE: 8-05-02			SIMULATOR BLOCK NO: DB55079							
MODEL/TYPE: SONIC 136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02			COUPLANT SONOTRACE BATCH: 01141							
TRANSDUCER MFG: Kraunkramer		S/N DB34154 SIZE: .5x1 FREQ: 2.25 MHz			EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>							
CABLE TYPE: RG174 LENGTH: 120 inches		ANGLE VERIFICATION										
DAC		BLOCK TYPE: IIW			S/N: DB55074							
		NOMINAL ANGLE: 60			ACTUAL ANGLE: 59							
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>		INSTRUMENT SETTINGS										
		REFLECTOR			REFERENCE		MEMORY					
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER					
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	52	dB	3					
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a	dB	n/a					
		FREQ:	2.25	MHz	REJECT:	off	%					
		ANGLE:	N/A	deg	DAMPING:	500	ohms					
		DELAY:	1.20	msec	PULSER:	222						
		ZERO:	N/A	msec	FILTER:	FITL 3						
		VELOCITY:	.123	msec	REP RATE:	2KHZ						
RANGE:	20	inches	TOF:	<input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
REF. REFLECTOR: 1"		GAIN: 36 dB		CALIBRATION TIMES								
AMPLITUDE: 80 %		METAL PATH: 1"		INITIAL TIME: 9:00		FINAL TIME: 17:30						
VERIFICATION TIMES		1) 11:45	2) N/A	3) N/A	4) N/A	5) N/A	6) N/A	7) N/A	8) N/A	9) N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40		20				80		80	
COMMENTS:					WELDS/ITEMS EXAMINED:							
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE					NSB Nozzle to Shell							
CLAD SIDE												
EXAMINER: MIKE W. KLEINJAN <i>Mike W. Kleinjan</i>			EXAMINER: DAVID KLEINJAN <i>D. Kleinjan</i>			REVIEWER: <i>Paul Whitaker</i>			ANI: <i>Albert Tall</i>			
LEVEL: II			LEVEL: II			DATE: 4/4/02			DATE: 4/19/02			
						PG: 2 of 18			6 of 18			

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R170
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 03-31-02 4-4-02 <i>J. Taylor</i>
PROC.: N-UT- 55 REV:9 AS AC: N/A	CALIBRATION BLOCK NO.: BF-85-IR TEMP: 70.5° F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 351643 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: CS IIW S/N: DB 55074
	NOMINAL ANGLE: 18 ACTUAL ANGLE: N/A

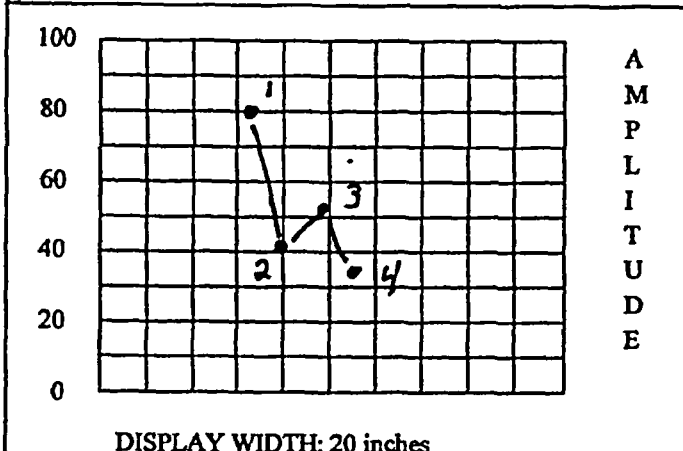

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	52.0 dB	18
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ:	2.25	MHz	REJECT:	OFF %
ANGLE:	N/A	deg	DAMPING:	200 ohms
DELAY:	1.02	msec	PULSER:	222
ZERO:	N/A	msec	FILTER:	FILT 1
VELOCITY:	0.234	msec	REP RATE:	4 KHZ
RANGE:	20.0	inches	TOF:	<input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK
DISPLAY MODE:	PE		POWER:	AC
DUAL:	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG:	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF

REF. REFLECTOR: N/A GAIN: N/A dB	CALIBRATION TIMES
AMPLITUDE: N/A % METAL PATH: N/A"	INITIAL TIME: 1330 FINAL TIME: 1700
VERIFICATION TIMES 1)N/A 2)N/A 3)N/A	4)N/A 5)N/A 6)N/A 7)N/A 8)N/A 9)N/A

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		

COMMENTS:	WELDS/ITEMS EXAMINED:
	REACTOR PRESSURE VESSEL
	N5B-IR
	wedge ID D-14795-253/

EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II	REVIEWER: <i>Robert Taylor</i> LEVEL: III DATE: 4/14/02	ANH: <i>Robert Taylor</i> DATE: 4/19/02 PG.: 19 OF 18 <i>4/19/02</i> 7 of 18
---	---	---	---

00141

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET		REPORT NUMBER: R170							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-31-02 4-4-02 <i>5/11/02</i>							
PROC.: N-UT- 55 REV:9		TC: N/A <i>4/11/02</i>		CALIBRATION BLOCK NO.: BF-85-IR TEMP: 70.5° F							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A							
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352 DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141									
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>									
CABLE TYPE: RG 174 LENGTH: 120 inches		ANGLE VERIFICATION									
		BLOCK TYPE: CS IIW		S/N: DB 55074							
		NOMINAL ANGLE: 25		ACTUAL ANGLE: N/A							
DAC		INSTRUMENT SETTINGS									
<p>AMPLITUDE</p> <p>DEPTH</p> <p>DISPLAY WIDTH: 20 inches</p>		REFLECTOR		REFERENCE	MEMORY						
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER					
		AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	55.4 dB	25					
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A					
		FREQ: 2.25 MHz	REJECT: OFF	%							
		ANGLE: N/A deg	DAMPING: 200	ohms							
		DELAY: 1.22 msec	PULSER: 222								
		ZERO: N/A msec	FILTER: FILT 1								
		VELOCITY: 0.235 msec	REP RATE: 4 KHZ								
		RANGE: 20.0 inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK								
*DISPLAY MODE: PE	POWER: AC										
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: N/A GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A % METAL PATH: N/A"		INITIAL TIME: 1440		FINAL TIME: 1700							
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A 5)N/A 6)N/A 7)N/A 8)N/A 9)N/A						
LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	
	SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6			
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96			
			40	20		80		80			
COMMENTS:			WELDS/ITEMS EXAMINED:								
Wedge ID D-14795-166 ✓			REACTOR PRESSURE VESSEL								
			N5B-IR								
EXAMINER: <i>R. Kleinf...</i> DAVID KLEINJAN <i>D.L. Kleinf...</i> LEVEL: II			EXAMINER: <i>Mike Kleinf...</i> MIKE KLEINJAN <i>4/11/02</i> <i>MJK</i> LEVEL: II			REVIEWER: <i>Paul Whitaker</i> PAUL WHITAKER LEVEL: III DATE: <i>4/11/02</i>			ANII: <i>What Hill</i> DATE: <i>4/19/02</i> PG: <i>115 OF 178</i> <i>5/11/02</i> <i>80K18</i>		

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R170

PROJECT: BFN UNIT: 3 WELD ID: N5 B CONFIG.: INNER RADIUS COMPONENT: N/A

CAL. SHT. NO.: N/A PROCEDURE: N-UT-55 REV.: 9 PCR.: N/A TEMP.: 85 PYRO.: 522352
08-06
08-4-10-02

SCAN SENS.: 58 dB EXAM START: 1445 EXAM END: 1641 EXAM ANGLE: 18°

Lo LOCATION: TDC Wo LOCATION: E of weld

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
1							7.5	5 1/4	1.75	7.5	5	1.75							7.5	4 3/4	1.75
2							7.5	68 1/4	1.75	7.5	68	1.75							7.5	67 1/4	1.75
<p>INDICATION #1 AND #2 are GEOMETRICAL REFLECTORS FROM welded Pads ON THE END of THE VESSEL. ABOVE N5B. SEE PHOTOS</p> <p>THE Location of The welded Pads are at L=5" AND L=68"</p>																					


COMMENTS: COVERAGE of THE TRANSVERSE EXAM WILL INCLUDE COVERAGE OBTAINED DURING THE INNER RADIUS EXAMINATION. 200% DAC @ Reference indications ① and ②.

EXAMINER: Mike W. [Signature] LEVEL: II DATE: 4-4-02 REVIEWED BY: [Signature] LEVEL: PT DATE: 4/10/02
 EXAMINER: N/A LEVEL: N/A DATE: N/A ANII: [Signature] DATE: 4/19/02 PAGE 19 OF 18

NOZZLE N5B
WELDED PADS

REPORT NUMBER
R170

00143

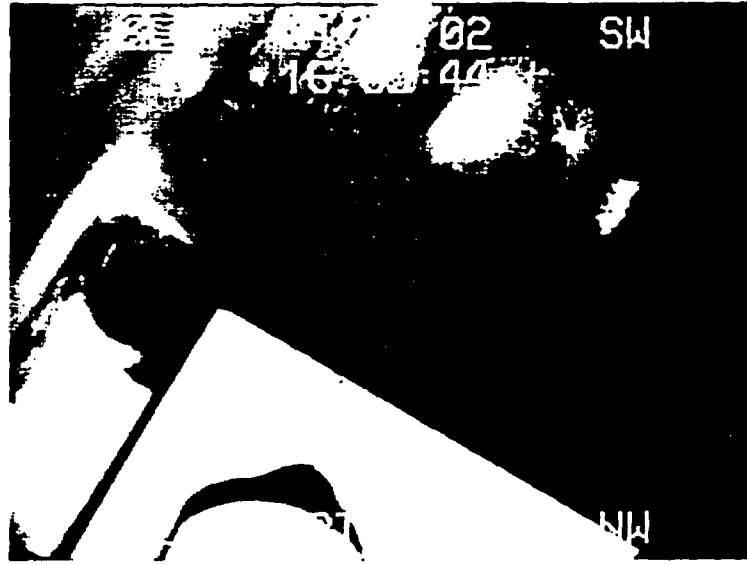

Browns Ferry U3 C10 R. O. V. Tech.



Browns Ferry U3 C10 R. O. V. Tech.

HSBCT
4/11/02

Jan 10
4/11/02 50818

TVA

MANUAL ULTRASONIC VESSEL
EXAMINATION DATA SHEET

REPORT NO.

R170

PROJECT: BFN UNIT: 3 WELD ID: N5B CONFIG.: Nozzle COMPONENT: VESSELCAL. SHT. NO.: N/A PROCEDURE: NT-UT-9 REV.: 9 PCR.: 02-06 TEMP.: 85 PYRO.: 522352SCAN SENS.: * dB EXAM START: 1415 EXAM END: 1641 EXAM ANGLE: 0°, 45°, 60°Lo LOCATION: TDC Wo LOCATION: E OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
18	SCAN	dB	58																		
25	SCAN	dB	61.4																		
0	SCAN	dB	348																		
45	SCAN	dB	56.6																		
45T	SCAN	dB	56.6																		
45TAN	SCAN	dB	56.6																		
60	SCAN	dB	63																		
60T	SCAN	dB	63																		
60TAN	SCAN	dB	63																		
NO RECORDABLE INDICATION																					
SEE SKETCH FOR EXAM LIMITATION																					

COMMENTS: 18" AND 25" EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS
TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE
INNER RADIUS EXAMINATIONS. 5 TO 10% NOISE LEVEL WAS OBSERVED.


EXAMINER: Mike W. Poyner LEVEL: III DATE: 4-4-07
EXAMINER: _____ LEVEL: _____ DATE: _____

REVIEWED BY: John W. Poyner LEVEL: III DATE: 5/19/07
ANI: John W. Poyner DATE: 5/19/07 PAGE 11 OF 18


001144

REPORT NUMBER
R170 00145

Nozzle Examination 45° Waveforms

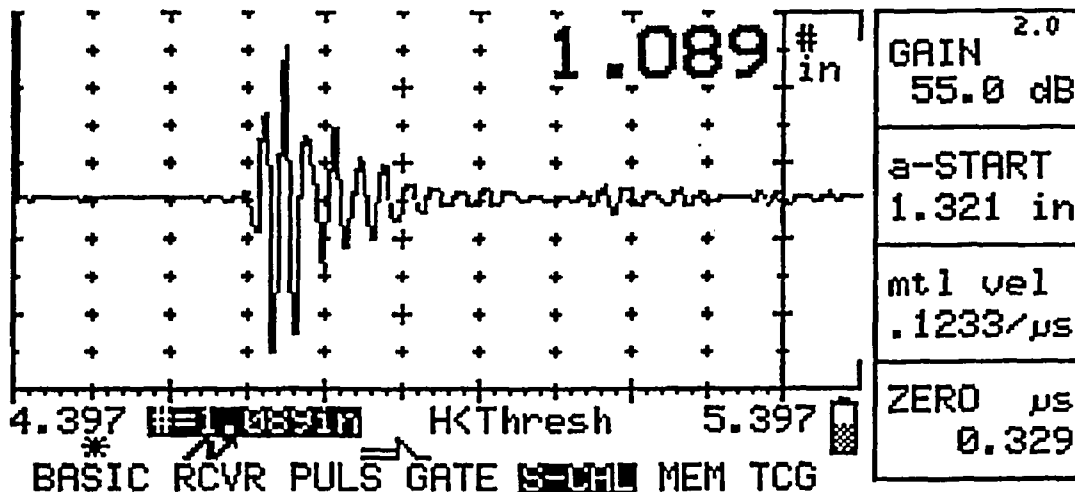

45° Pre Waveform

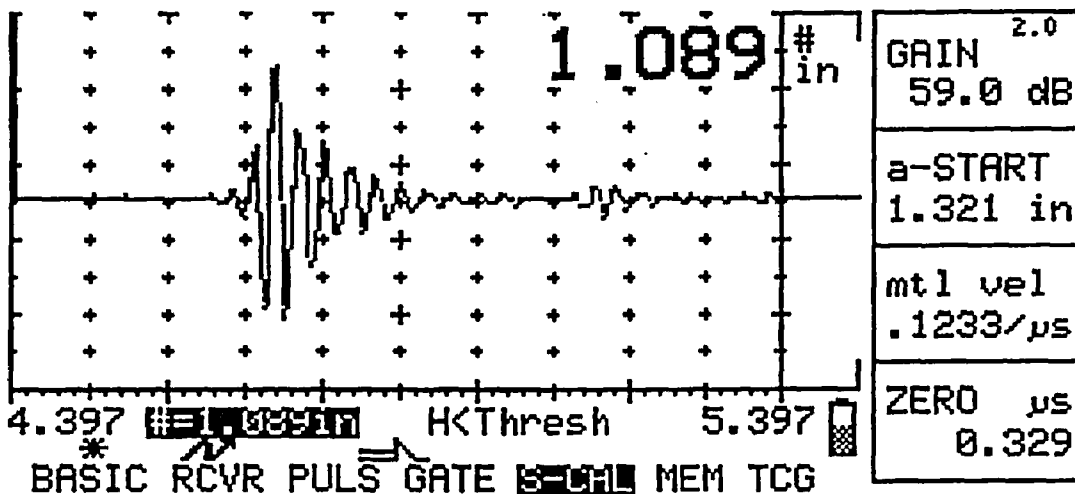

45° Post Waveform

HSBCT
4/19/02


12 1-4/102
V 08 18

REPORT NUMBER


R170

00146

Nozzle Examination 60° Waveforms

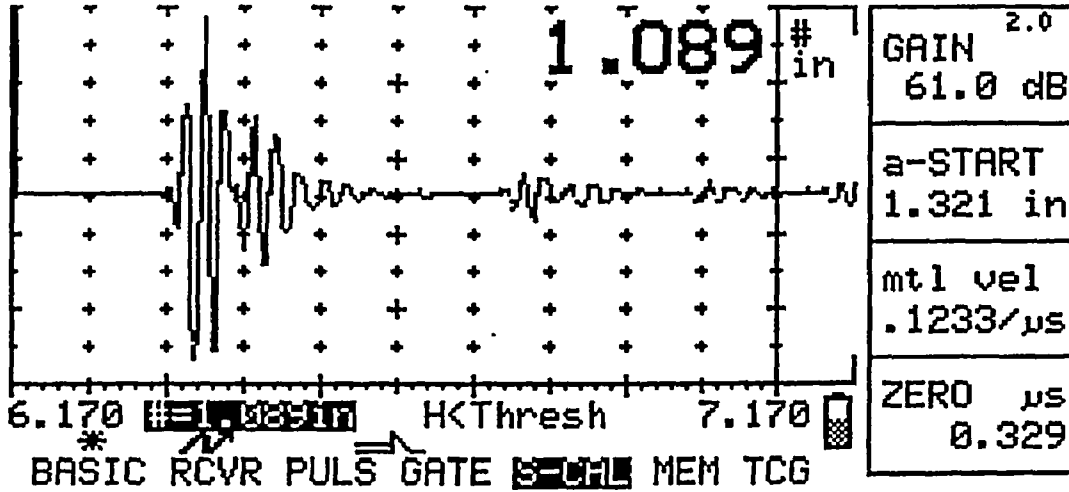

60° Pre Waveform

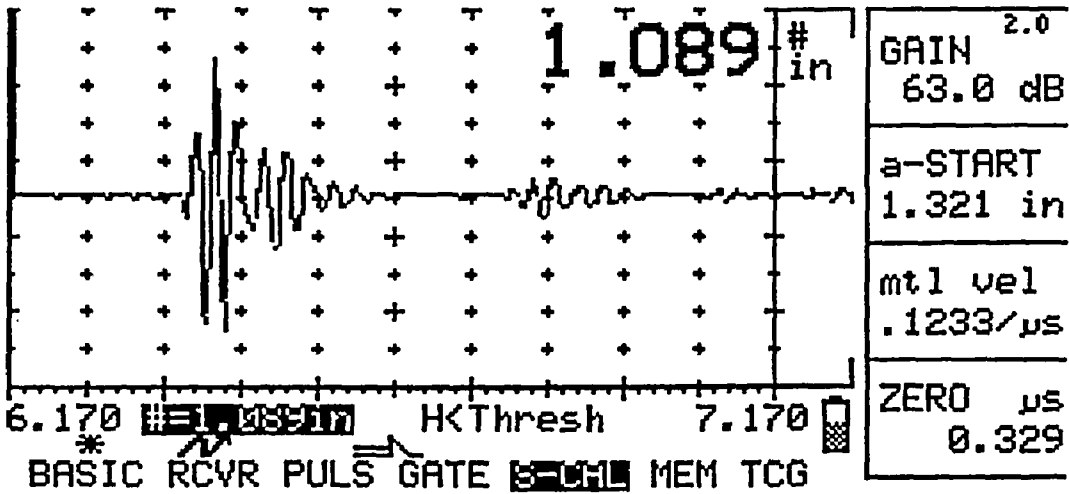

60° Post Waveform

H5BCT
A 4/19/02


13
Date 4/19/02 + 0 0 18

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R170
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-OT-9 REV.: 9 PCR: 02-06 ~~HTA~~ 5/11/02
 SEARCH UNIT-MAKE: Krautkramer SIZE: 15X1 FREQ.: 2.25
 SIN: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Some 13C SIN: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
1/2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

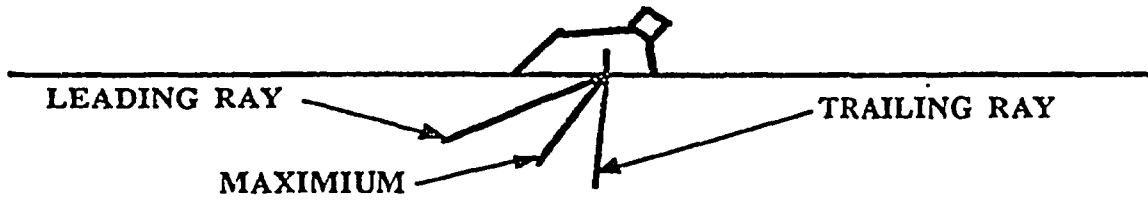

RESOLUTION

NEAR SURFACE REFLECTOR: Note OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Note ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N


EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>II</u> DATE: <u>4/4/02</u>	DATE: <u>4/19/02</u> PAGE: <u>23</u> OF <u>18</u>

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R170
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 02-06 ~~4/18~~ ^{4/14/02}
 SEARCH UNIT-MAKE: Krautkramer SIZE: .5x1 FREQ.: 2.25
 S/N: DB 34154 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: Sony 13C S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	6 1/4 6 7/8	7.6 7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

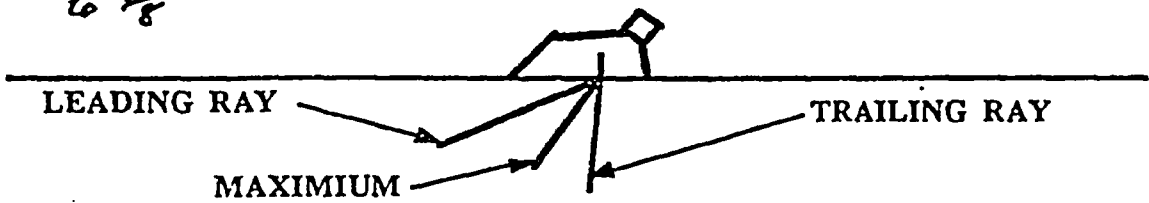

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253


SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Mike W. Henry</u>	REVIEWED BY: <u>Paul Whitney</u>	ANII: <u>Albert Tall</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>III</u> DATE: <u>4/4/02</u>	DATE: <u>4/19/02</u> PAGE: <u>14/150F 18</u>

REPORT NUMBER

R170

00149

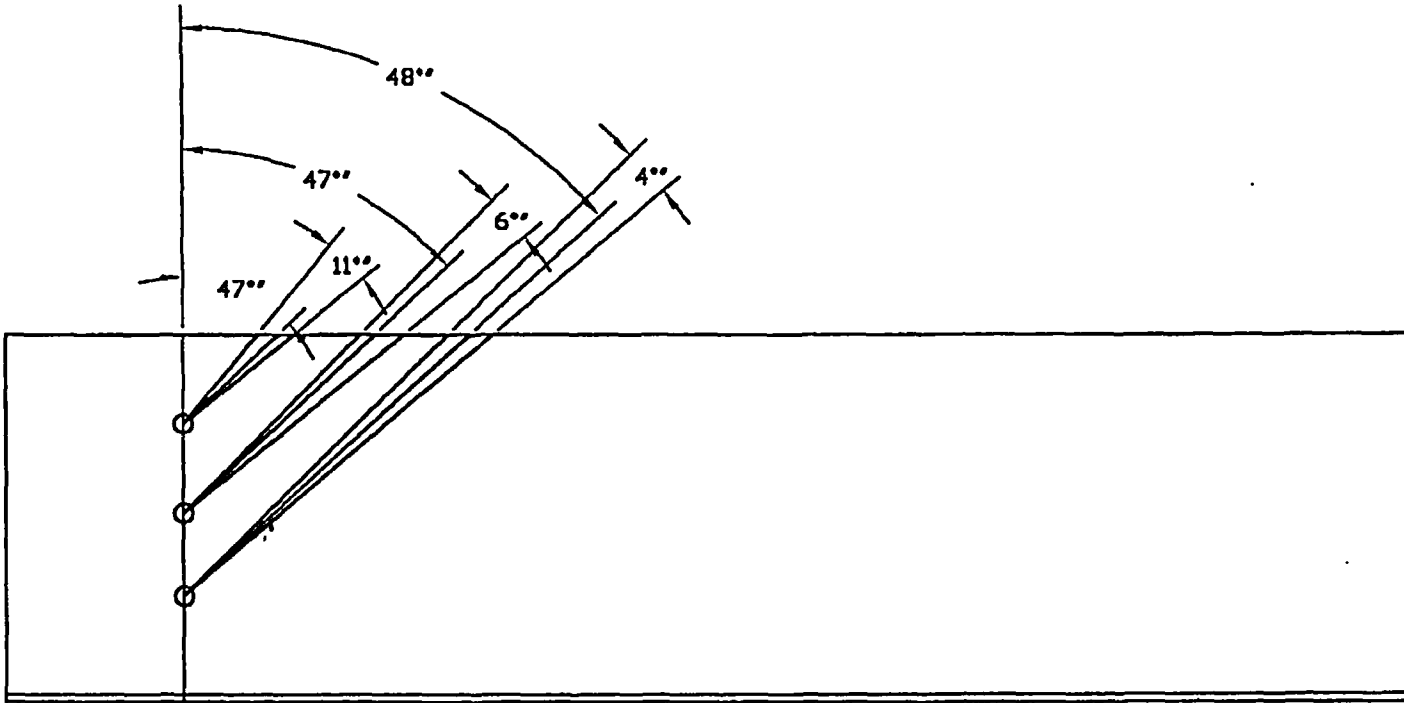

160818

H/S BCT
0/4
4/19/02

Browns Ferry Unit 3

Beamspread


MARCH 2002

BF-18

REPORT NUMBER

R170

00130

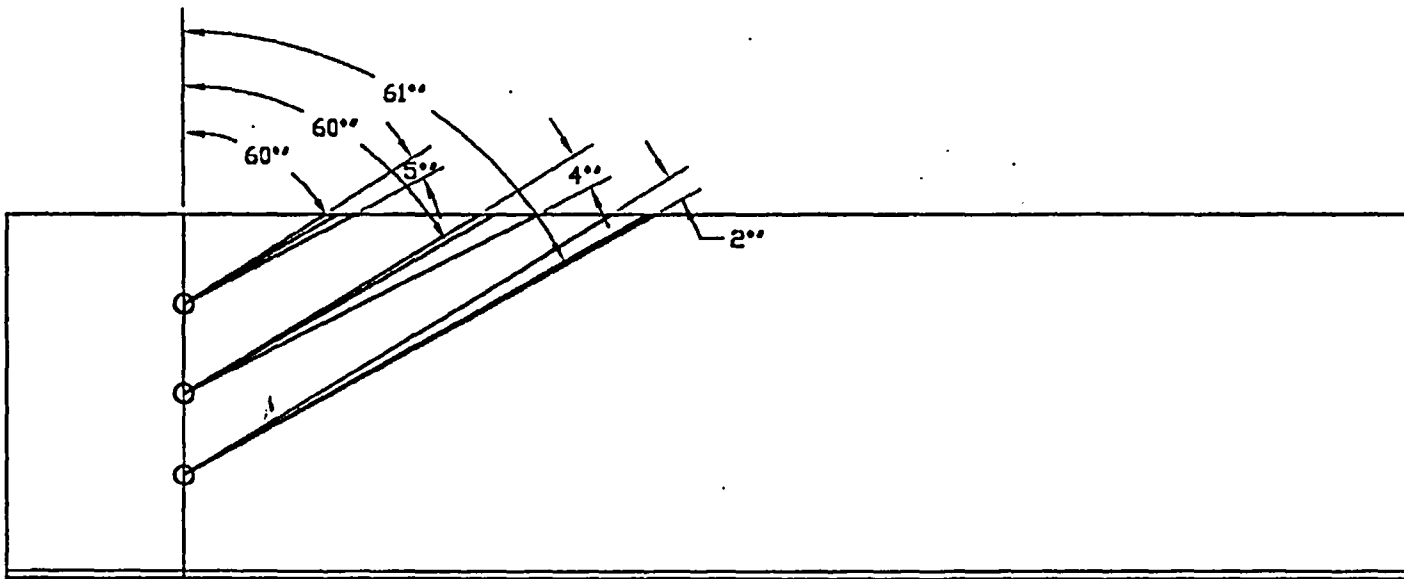

HSBCT
CPA
4/19/02

Browns Ferry Unit 3

Beamspread

MARCH 2002


BF-18

17 APR 08 18

REPORT NUMBER

R170 00151

8150K 2010118

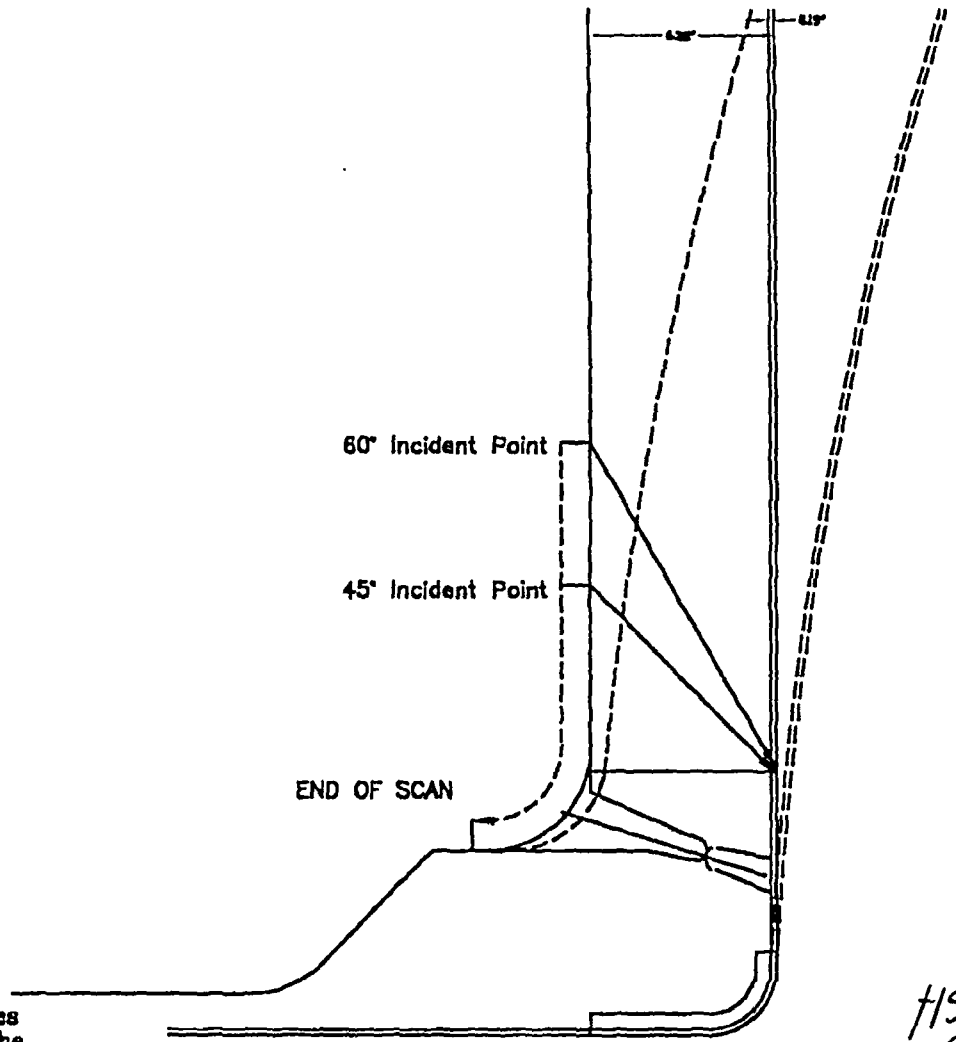

Transverse coverage includes coverage obtained during the inner radius examination

HISBCT
01/11
4/11/02

Browns Ferry Unit 3
N5 Nozzle-to-Shell
MARCH 2002
SP-N5-NS

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R171	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: NSB-IR	
EXAMINATION METHOD				SYSTEM RPV	ISI DWG. NO. 3-ISI-0331-C
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: B-D
PROCEDURE: N-UT-55		REV: 9	TC: N/A 03-08	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN <i>5/4/11/02</i>		EXAMINER: DAVID KLEINJAN DAVID KLEINJAN <i>5/4/11/02</i>		EXAMINER: N/A	EXAMINER: N/A
LEVEL: II		LEVEL: II		LEVEL: N/A	LEVEL: N/A

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld and the inner radius examination.

NSB-IR: This examination was performed using a 25° and 18° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

Geometric indications observed out of the exam Area for the inner radius exam. (Forwarder Bracket Pads) (See NSB for details)

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>4/19/02</i>	REVIEWED BY: <i>[Signature]</i>	ANII: <i>[Signature]</i>
LEVEL: II DATE: <i>4/2/02</i>	LEVEL: II DATE: <i>4/4/02</i>	DATE: <i>4/19/02</i>
		PG. 1 OF <i>24</i>

5/4/11/02

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R171						
PROJECT: BFN UNIT: 3 CYCLE: 10			CALIBRATION DATE: 03-31-02										
PROC.: N-UT- 55 REV:9 TC: N/A			CALIBRATION BLOCK NO.: BF-85-IR TEMP: 70.5° F										
INSTR. MFG: STAVELEY DUE DATE: 08-11-02			SIMULATOR BLOCK NO: N/A										
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473			THERMOMETER S/N: 522352 DUE DATE: 05-17-02										
TRANSDUCER MFG: KRAUTKRAMER			COUPLANT SONOTRACE BATCH: 01141										
S/N DB 351643 SIZE: 1.0" FREQ: 2.25 MHz			EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>										
CABLE TYPE: 1/2" RG 174 LENGTH: 120 inches			ANGLE VERIFICATION										
DAC			BLOCK TYPE: CS IIW		S/N: DB 55074								
			NOMINAL ANGLE: 18		ACTUAL ANGLE: N/A								
<p style="text-align: center;">DISPLAY WIDTH: 20 inches</p>			INSTRUMENT SETTINGS										
			REFLECTOR			REFERENCE		MEMORY					
			SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER					
			AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	52.0 dB		18					
			CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A					
			FREQ:	2.25	MHz	REJECT: OFF		%					
			ANGLE:	N/A	deg	DAMPING: 200		ohms					
			DELAY:	1.02	msec	PULSER: 222							
			ZERO:	N/A	msec	FILTER: FILT 1							
			VELOCITY:	0.234	msec	REP RATE: 4 KHZ							
RANGE:	20.0	inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK										
DISPLAY MODE: PE			POWER: AC										
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: N/A GAIN: N/A dB			CALIBRATION TIMES										
AMPLITUDE: N/A % METAL PATH: N/A"			INITIAL TIME: 1330		FINAL TIME: 1700								
VERIFICATION TIMES			1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A		
LINEARITY CHECK													
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20		
	SIGNAL 2		50	45	40	35	30	25	20	15	10		
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6	
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96	
			40		20				80			80	
COMMENTS:						WELDS/ITEMS EXAMINED:							
Wedge ID d-14795-253						REACTOR PRESSURE VESSEL							
						N5B-IR							
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>M.K. Kleinjan</i> N/A LEVEL: II			REVIEWER: <i>A.D. Whitten</i> LEVEL: III DATE: 4/1/02			ANII: <i>Albert Todd</i> DATE: 4/1/02 PG.: 2 OF 4 2 OF 4				

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R171							
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 03-31-02									
PROC.: N-UT- 55		REV: 9		TC: N/A		CALIBRATION BLOCK NO.: BF-85-IR							
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A									
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02							
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141											
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>			
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION									
DAC		BLOCK TYPE: CS IIW			S/N: DB 55074								
		NOMINAL ANGLE: 25			ACTUAL ANGLE: N/A								
<p>AMPLITUDE</p> <p>DISTANCE</p> <p>DISPLAY WIDTH: 20 inches</p>		INSTRUMENT SETTINGS											
		REFLECTOR			REFERENCE			MEMORY					
		SCAN DIRECT.		NTCH	SDH		SENSITIVITY			NUMBER			
		AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>		55.4 dB			25			
		CIRC		<input type="checkbox"/>	<input type="checkbox"/>		N/A dB			N/A			
		FREQ: 2.25		MHz		REJECT: OFF			%				
		ANGLE: N/A		deg		DAMPING: 200			ohms				
		DELAY: 1.22		msec		PULSER: 222							
		ZERO: N/A		msec		FILTER: FILT 1							
		VELOCITY: 0.235		msec		REP RATE: 4 KHZ							
		RANGE: 20.0		inches		TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK					
		*DISPLAY MODE: PE			POWER: AC								
DUAL: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON		<input checked="" type="checkbox"/> OFF							
REF. REFLECTOR: N/A		GAIN: N/A dB		CALIBRATION TIMES									
AMPLITUDE: N/A %		METAL PATH: N/A"		INITIAL TIME: 1440			FINAL TIME: 1700						
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			
LINEARITY CHECK													
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20	
		SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
		..		40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:								
Wedge ID D-14795-166					REACTOR PRESSURE VESSEL								
					NSB-IR								
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>John P. ...</i> LEVEL: III		DATE: 4/19/02		ANI: <i>Albert ...</i>					
								PG: 3 OF 4 3 of 4					

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R171

PROJECT: BFA UNIT: 3 WELD ID: N5B CONFIG.: INNER RADIUS COMPONENT: N/A

CAL. SHT. NO.: N/A PROCEDURE: N-UT-55 REV.: 9 PCR.: 02.98 TEMP.: 85 PYRO.: 52352
~~00410.02~~

SCAN SENS.: X dB EXAM START: 1445 EXAM END: 1641 EXAM ANGLE: 18°, 25°

Lo LOCATION: TDC Wo LOCATION: Ø 05 WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
18	SCAN	dB	58	*									BLEND	RADIUS							
25	SCAN	dB	61.4										BLEND	RADIUS							
	NO RECORDABLE INDICATION																				

COMMENTS: A MATERIAL NOISE LEVEL OF 5-10% WAS OBSERVED

00155

EXAMINER: D.P. Hoge LEVEL: II DATE: 03-31-02 REVIEWED BY: Joe P. Tuttle LEVEL: III DATE: 4/4/02
 EXAMINER: N/A LEVEL: N/A DATE: N/A ANII: Robert Todd DATE: 4/19/02 PAGE 4 OF 4

Inspection Report R-125
Weld N7-NV

00055

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R125</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N7 NOZZLE	
EXAMINATION METHOD				SYSTEM: RPV ISI DWG. NO. 3-ISI-0295-A	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: B-D
PROCEDURE: N-UT-9		REV: 9	TC: N/A <i>02-01</i>	COFIG.:	.RPV HEAD TO NOZZLE
EXAMINER: D. GRONEWOLD		EXAMINER: N/A	EXAMINER: <i>02-3-01</i>	EXAMINER: N/A	EXAMINER: N/A
LEVEL: II		LEVEL: N/A	LEVEL: N/A	LEVEL: N/A	LEVEL: N/A

A MANUAL ULTRASONIC EXAMINATION WAS PERFORMED ON THE N7 NOZZLE WHICH IS A RPV HEAD TO NOZZLE WELD TO THE REQUIREMENTS OF ASME SECTION ~~N~~ *XI* *4/5/02*

A 0 deg. , 45 deg. and a 60deg INSPECTION ANGLES WERE USED.

THIS WELD WAS LIMITED TO SCANNING ON THE HEAD SIDE DUE TO THE CONFIGURATION.

THE NOZZLE INNER RADIUS WAS SEEN 360 WITH THE 45 AND THE 60

NO OTHER INDICATIONS WERE DETECTED.

70 % COVERAGE WAS ACHEIVED

0 deg. = 50%

45 deg. = 82 %

60 deg. = 90 %

45 & 60 CW & CCW = 60 %

RESOLUTION BY: DOUGLAS GRONEWOLD <i>Douglas Gronewold</i>	REVIEWED BY: <i>Douglas Gronewold</i>	ANII: <i>What Tech</i>
LEVEL: II DATE: 3-29-02	LEVEL: III DATE: 3-31-02	DATE: 4/5/02
		PG. 1 OF 13

00056

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: <i>R125</i>		
PROJECT: BFN UNIT: 3 CYCLE: 10 <i>95.0</i>	CALIBRATION DATE: 3/29/02			
PROC.: N-UT- 9 REV:9 TC: <i>NA 02-06</i>	CALIBRATION BLOCK NO.: BF 19 TEMP: 81°F			
INSTR. MFG: KRAUTKRAMER DUE DATE: 6/15/02	SIMULATOR BLOCK NO: NA			
MODEL/TYPE: USN 52L M & TE NO.: E30219	THERMOMETER S/N: 562775 DUE DATE: 12/8/02			
TRANSDUCER MFG: Aerotech	COUPLANT ULTRAGEL II BATCH: 0325			
S/N C03305 SIZE: 1.0 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL <input type="checkbox"/>			
CABLE TYPE: RG 58 LENGTH: 72" inches	ANGLE VERIFICATION			
	BLOCK TYPE: NA	S/N: NA		
DAC	NOMINAL ANGLE: 0°	ACTUAL ANGLE: NA		
<div style="display: flex; align-items: center;"> <div style="flex: 1;"> </div> <div style="flex: 0.2; text-align: center; font-weight: bold;">A M P L I T U D E</div> </div> <p style="text-align: center;">DISPLAY WIDTH: 5.61 inches</p>	INSTRUMENT SETTINGS			
	REFLECTOR		REFERENCE MEMORY	
	SCAN DIRECT.	NTCH	SDH	SENSITIVITY NUMBER
	AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	22 dB 12
	CIRC	<input type="checkbox"/>	<input type="checkbox"/>	NA dB NA
	FREQ: 2.8 MHz	REJECT: 0 %		
	ANGLE: OFF deg	DAMPING: 1000 ohms		
	DELAY: -0.125 msec	PULSER: SINGLE *		
	ZERO: 1.261 msec	FILTER: FIXED *		
	VELOCITY: .2318 msec	REP RATE: HIGH		
	RANGE: 5.61 inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK		
	RECTIFIER: FULL	POWER: DC		
	DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		
	REF. REFLECTOR: NA GAIN: NA dB	CALIBRATION TIMES		
	AMPLITUDE: NA % METAL PATH: NA*	INITIAL TIME: 0640	FINAL TIME: 1345	
VERIFICATION TIMES	1)N/A 2)N/A 3)N/A	4)N/A 5)N/A 6)N/A 7)N/A 8)N/A 9)N/A		
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !				
LINEARITY CHECK				
VERTICAL	SIGNAL 1	100 90 80 70 60 50 40 30 20		
	SIGNAL 2	50 45 40 35 30 25 20 15 10		
ATTENUATOR	GAIN SET	-6 dB -12 dB SET +12 SET +6		
	AMP 80%	32 TO 48 16 TO 24 20 % 64 TO 96 40% 64 TO 96		
		40 20 80 80		
COMMENTS:	WELDS/ITEMS EXAMINED: N7 SHELL TO NOZZLE WELD <i>head</i>			
EXAMINER: <i>Douglas Aronow</i>	EXAMINER: N/A	REVIEWER: <i>Dariusz Duley</i>		
LEVEL: <i>II</i>	LEVEL:	DATE: <i>3-30-02</i>		
		ANII: <i>What</i>		
		DATE: <i>4/5/02</i>		
		PG.: 2 OF 13		

00057

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R125</i>							
PROJECT: BFN UNIT: 3		CYCLE: 10 <i>8</i>		CALIBRATION DATE: 3/29/02								
PROC.: N-UT- 9 REV:9		TC: <i>N 03-00</i>		CALIBRATION BLOCK NO.: BF 19		TEMP: 81°F						
INSTR. MFG: KRAUTKRAMER		DUE DATE: 6/15/02		SIMULATOR BLOCK NO: 790913								
MODEL/TYPE: USN 52L		M & TE NO.: E30219		THERMOMETER S/N: 562775		DUE DATE: 12/8/02						
TRANSDUCER MFG: HARISONICS				COUPLANT ULTRAGEL II BATCH: 0325								
S/N T7429		SIZE: 1" x .5"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>						
CABLE TYPE: RG 58		LENGTH: 72" inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: 5307						
				NOMINAL ANGLE: 45°		ACTUAL ANGLE: 47						
<p>DISPLAY WIDTH: 8.6 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR		REFERENCE	MEMORY					
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER				
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	30 dB	10				
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	NA dB	NA				
				FREQ:	2.8	MHz	REJECT: 0	%				
				ANGLE:	47	deg	DAMPING: 1000	ohms				
				DELAY:	-0.555	msec	PULSER: SINGLE *					
				ZERO:	12.337	msec	FILTER: FIXED *					
				VELOCITY:	.1272	msec	REP RATE: HIGH					
				RANGE:	8.6	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK					
				RECTIFIER: FULL		POWER: DC						
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
REF. REFLECTOR: ROMPAS <i>SDH</i> GAIN: 30 dB				CALIBRATION TIMES								
AMPLITUDE: 40%		METAL PATH: 1.08"		INITIAL TIME: 0620		FINAL TIME: 1330						
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N	7)N/A	8)N/A	9)N/A			
* PDI QUALIFIED INSTRUMENT SETTINGS:												
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !												
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
			40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:							
NEAR FIELD RESOLUTION WAS CHECKED BY MOVING					N7 NOZZLE <i>to Head</i>							
TRANSDUCER OVER THE OD NOTCH AND WATCHING THE												
SIGNAL RESPONSE WALK INTO THE INITIAL PULSE.												
EXAMINER: <i>Douglas Irons</i>			EXAMINER: <i>N/A</i>			REVIEWER: <i>Darlene Duling</i>			ANII: <i>What Tadd</i>			
LEVEL: <i>II</i>			LEVEL:			LEVEL: <i>III</i>			DATE: <i>4/5/02</i>			
					DATE: <i>3-30-02</i>							
					PG.: 3 OF 13							

00058

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R125</i>						
PROJECT: BFN UNIT: 3		CYCLE: 10 <i>10</i>		CALIBRATION DATE: 3/29/02								
PROC.: N-UT- 9 REV:9		TC: <i>MAC-20</i>		CALIBRATION BLOCK NO.: BF 19		TEMP: 81°F						
INSTR. MFG: KRAUTKRAMER		DUE DATE: 6/15/02		SIMULATOR BLOCK NO: 790913								
MODEL/TYPE: USN 52L		M & TE NO.: E30219		THERMOMETER S/N: 562775		DUE DATE: 12/8/02						
TRANSDUCER MFG: Harisonic				COUPLANT ULTRAGEL II BATCH: 0325								
S/N T7429		SIZE: 1" x 5"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>						
CABLE TYPE: RG 58		LENGTH: 72" inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: 5307						
				NOMINAL ANGLE: 60°		ACTUAL ANGLE: 63						
<p style="text-align: center;">DISPLAY WIDTH: 11.23 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	38 dB		20			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>			dB			
				FREQ: 2.8		MHz		REJECT: 0		%		
				ANGLE: 63		deg		DAMPING: 1000		ohms		
				DELAY: -.859		msec		PULSER: SINGLE *				
				ZERO: 16.478		msec		FILTER: FIXED *				
				VELOCITY: 1.287		msec		REP RATE: HIGH				
RANGE: 11.23		inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK								
RECTIFIER: FULL			POWER: DC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
CALIBRATION TIMES				INITIAL TIME: 0610		FINAL TIME: 1340						
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N	7)N/A	8)N/A	9)N/A		
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !												
LINEARITY CHECK												
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20	
		SIGNAL 2	50	45	40	35	30	25	20	15	10	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6
		AMP	80%	32 TO 48		16 TO 24		20 %	64 TO 96		40%	64 TO 96
				40		20			80			80
COMMENTS:					WELDS/ITEMS EXAMINED:							
NEAR FIELD RESOLUTION WAS CHECKED BY MOVING THE					N7 NOZZLE <i>to head</i>							
TRANSDUCER OVER THE OD NOTCH AND WATCHING THE												
SIGNAL RESPONSE WALK INTO THE INITIAL PULSE.												
EXAMINER: <i>Douglas Monnewell</i>			EXAMINER: <i>W/A</i>			REVIEWER: <i>Deane Dickey</i>			ANI: <i>Robert Hall</i>			
LEVEL: <i>II</i>			LEVEL:			LEVEL: <i>II</i>			DATE: <i>4/5/02</i>			
						DATE: <i>3/30/02</i>			PG.: 4 OF 13			

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R125

PROJECT: BFNP UNIT: 3 WELD ID: N7 CONFIG.: HEAD COMPONENT: NOZZLE

CAL. SHT. NO.: _____ PROCEDURE: N-UT-9 REV.: 9 PCR: 63.06 TEMP: 79°F PYRO... 562775
08-11-3-02

SCAN SENS.: 46 dB EXAM START: 1040 EXAM END: 1110 EXAM ANGLE: 60

Lo LOCATION: VESSEL 0° Wo LOCATION: WELD 4

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
<u>NRI</u>																					
<u>N/A</u>																					

COMMENTS: 5% TO 10% NOISE @ +8dB OVER REFERENCE, SCAN FROM HEAD SIDE ONLY, NOZZEL IR SEEN 360°
NO INDICATIONS DETECTED

00059

EXAMINER: Dylan Anonahel LEVEL: II DATE: 3-29-02
 EXAMINER: _____ LEVEL: _____ DATE: _____

REVIEWED BY: Debra Taylor LEVEL: III DATE: 5-3-02
 ANII: Robert Hall DATE: 4/5/02 PAGE 5 OF 13

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R125

PROJECT: BFNP UNIT: 3 WELD ID: N7 CONFIG.: HEAD COMPONENT: NOZZLE

CAL. SHT. NO.: _____ PROCEDURE: N-UT-9 REV.: 9 PCR.: ⁰³⁻⁰⁶N/A TEMP.: 79°F PYRO.: 562775
054-800

SCAN SENS.: 42 dB EXAM START: 1040 EXAM END: 1110 EXAM ANGLE: 45°

L₀ LOCATION: VESSEL 0° W₀ LOCATION: WELD 6

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%			
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2	
<u>NRI</u>																						
	<u>N/A</u>																					
	<u>N/A</u>																					

COMMENTS: 5% TO 10% NOISE WITH +12db OVER REF, SCAN FROM HEAD SIDE ONLY; NOZZLE IR SEEN 360°
 NO INDICATIONS WERE DETECTED

EXAMINER: Douglas Amundson LEVEL: II DATE: 3-29-02 REVIEWED BY: Douglas Amundson LEVEL: III DATE: 3-29-02
 EXAMINER: _____ LEVEL: _____ DATE: _____ ANII: Albert Fall DATE: 7/5/02 PAGE 6 OF 13

0006

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R125

PROJECT: BFNP UNIT: 3 WELD ID: N7 CONFIG.: HEAD COMPONENT: NOZZLE

CAL. SHT. NO.: _____ PROCEDURE: N-UT-9 REV.: 9 PCR.: N/A TEMP.: 79°F PYRO.: 562775
03-06
12-8-02

SCAN SENS.: 34 dB EXAM START: 1040 EXAM END: 1110 EXAM ANGLE: 0°

Lo LOCATION: VESSEL 0° Wo LOCATION: WELD E

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
<u>NRI</u>	<u>N/A</u>																				
<u>N/A</u>	<u>N/A</u>																				

COMMENTS: 80% FSH TO 100% FSH BACKWALK @ +12dB OVER REF (34dB)
NO INDICATIONS WERE DETECTED

EXAMINER: Dylan Monahan LEVEL: II DATE: 3-29-02 REVIEWED BY: Dave Gaudin LEVEL: III DATE: 3-31-02
 EXAMINER: _____ LEVEL: _____ DATE: _____ ANII: Albert Todd DATE: 4/5/02 PAGE 7 OF 13

00061

00062


TVA **WALL THICKNESS PROFILE SHEET** **REPORT NO: R125**

PROJECT: BFN
UNIT: 3



WELD NO: N7
SYSTEM: RV Head

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	4.2	4.2	4.2	4.2
2	4.15	4.15	4.15	4.15
3	4.15	4.15	4.15	4.15
4	4.15	4.15	4.15	4.15
5	N/A	N/A	N/A	N/A

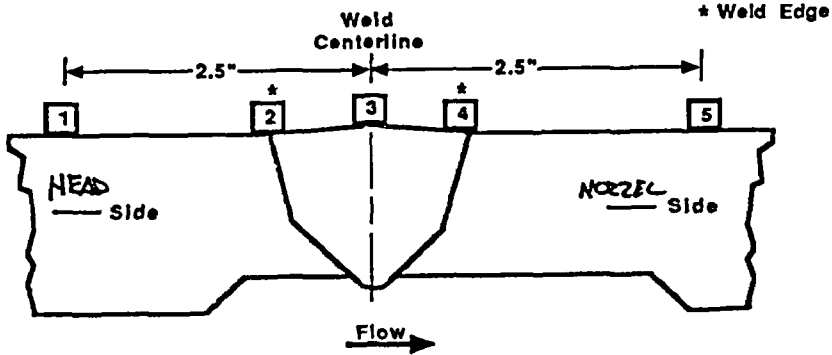

CROWN HEIGHT: _____ DIAMETER: _____
CROWN WIDTH: _____ WELD LENGTH: _____

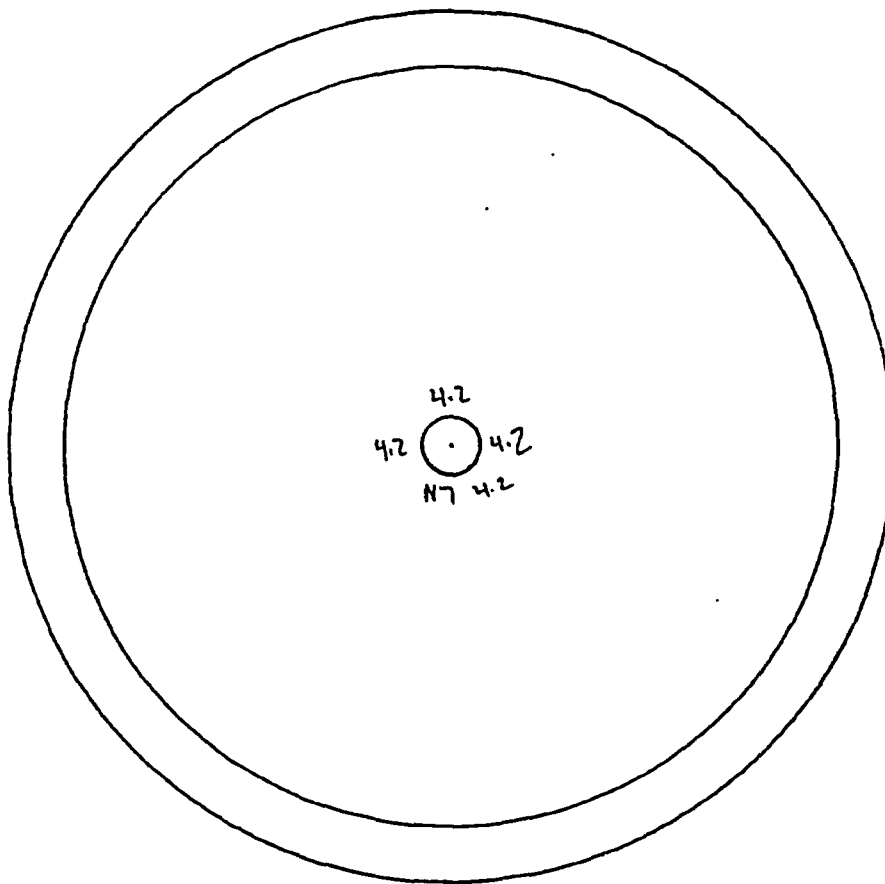


EXAMINER: Dyle Aronson
LEVEL: II
DATE: 3-29-02

REVIEWED BY: Jason Aubrey
LEVEL: III DATE: 3-29-02

ANII: What's Right
DATE: 4/5/02
PAGE: 8 OF 13

00063

R-125

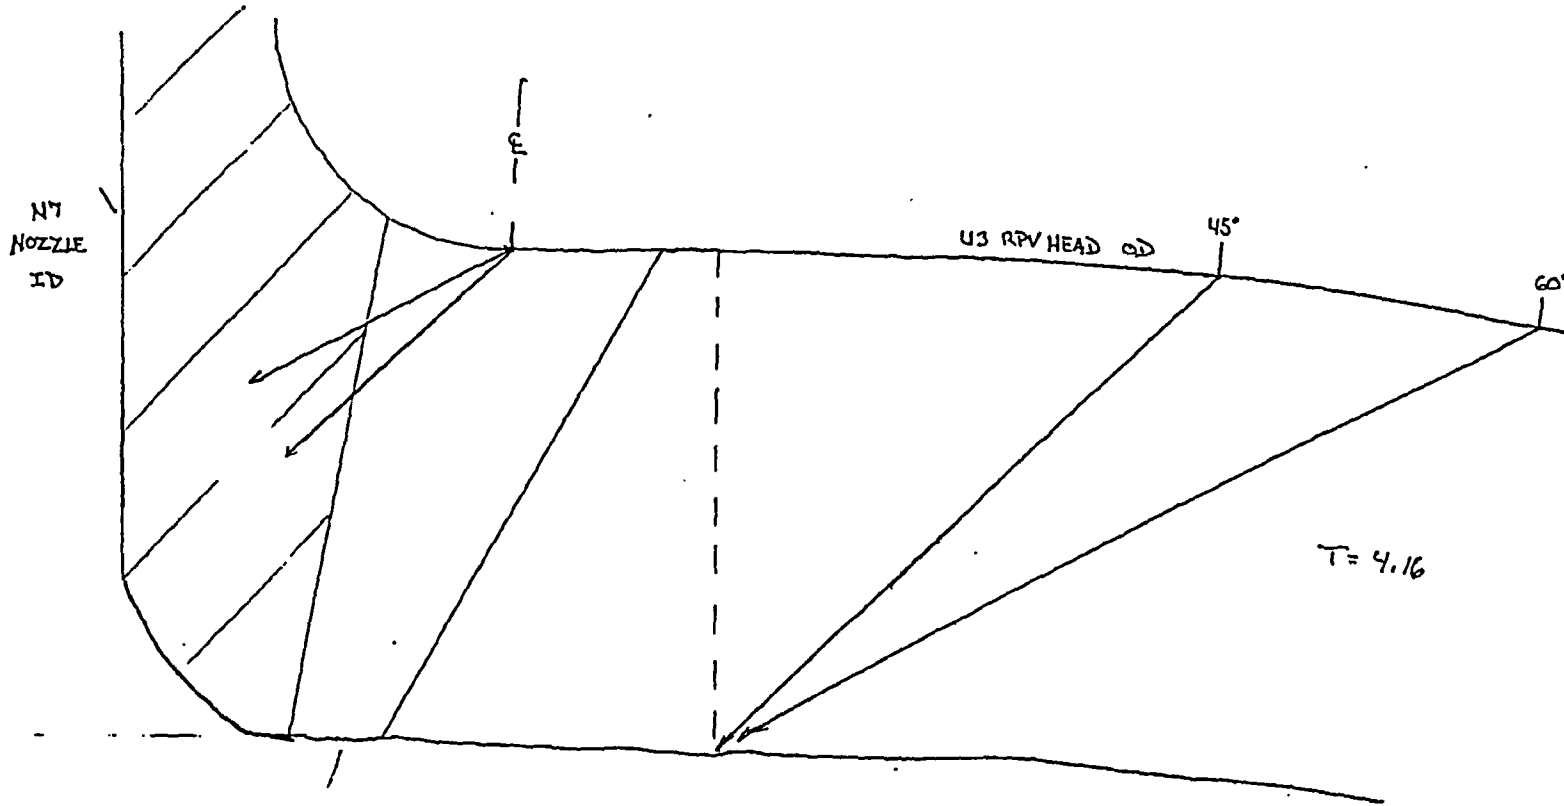

Douglas Greenwood will
3-29-02


HSBCT
01/19/02

Date 2/1/03


45° Waveforms

R125

00064

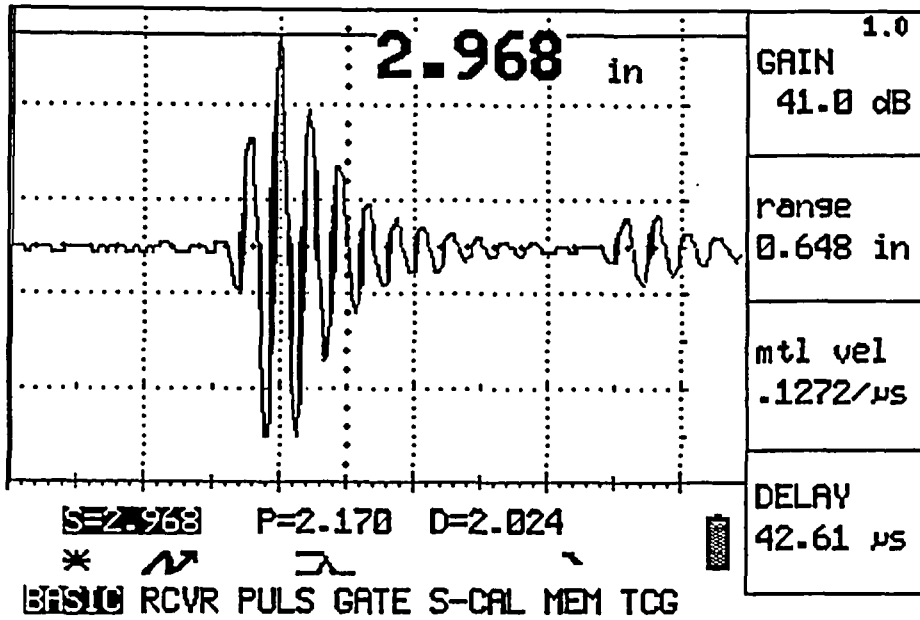

45° Pre Examination Waveform

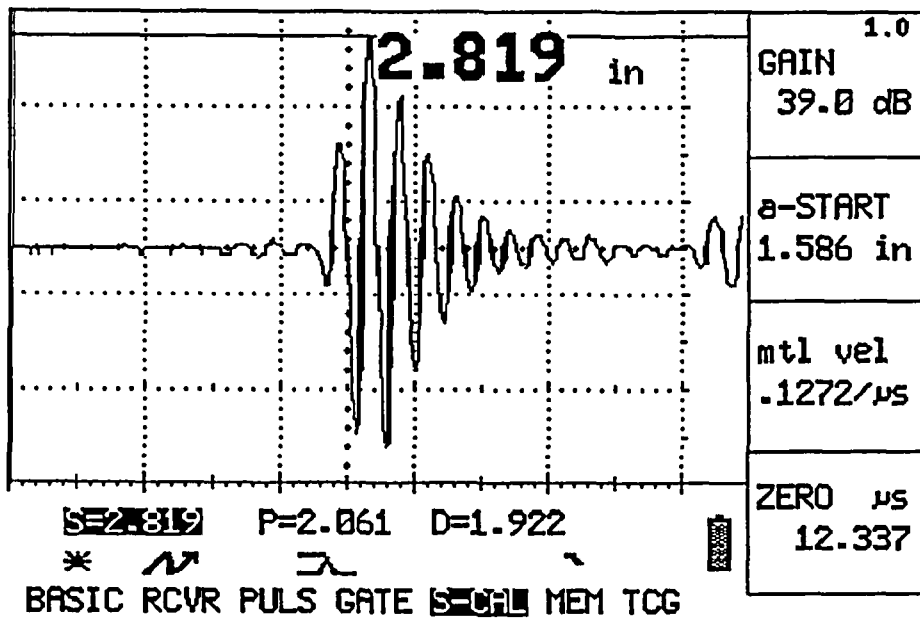


45° Post Examination Waveform

HSBCT
9/11
4/5/00


R125

60° Waveforms

00065

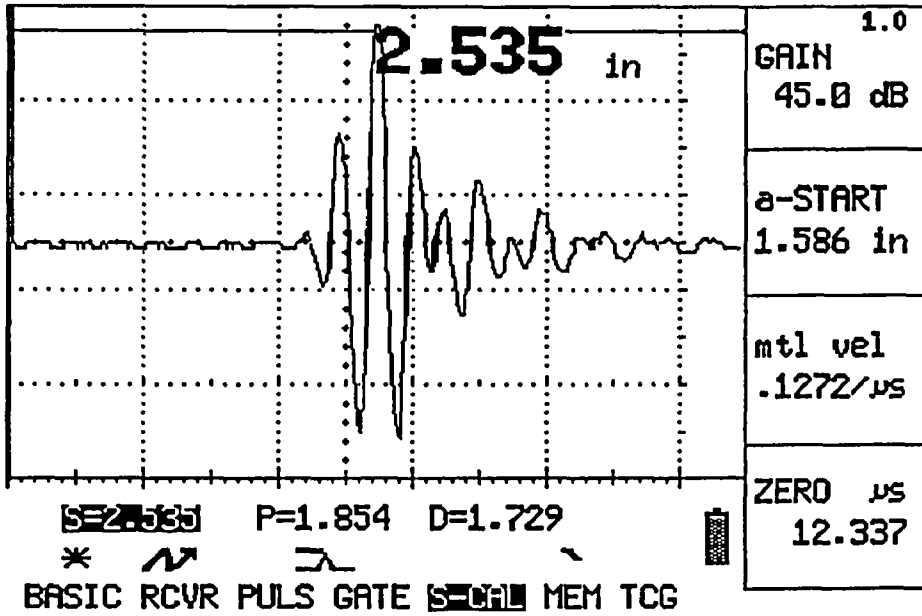

60° Pre Examination Waveform

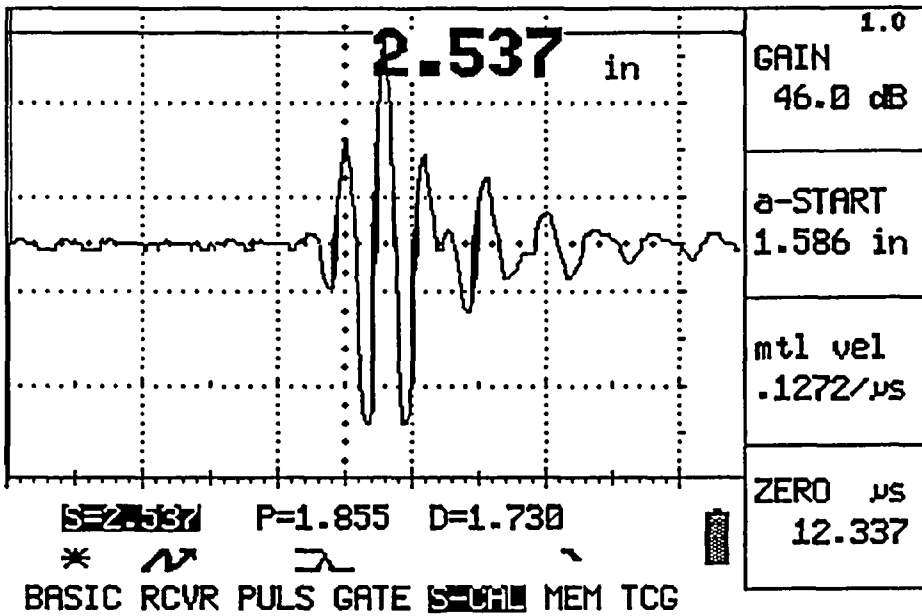

60° Post Examination Waveform


HSBCT
4/15/60

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. <u>R125</u>
------------	--	---------------------------

PROJECT: BFNP UNIT: 3 CALIBRATION BLOCK NO.: BF19
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: N/A
 SEARCH UNIT-MAKE: Horasonic SIZE: 1" x .5" FREQ.: 2.25
 S/N: T7429 ANGLE: 60
 ULTRASONIC INSTRUMENT-MAKE: KB S/N: E30219

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1.3	1.58	1.55	1.70	2.09	1.9	2.74	2.65	2.3	2.46
1/2T	2.85	3.39	3.0	3.55	4.16	3.7	5.32	4.95	4.55	4.98
3/4T	4.4	5.33	4.65	5.56	6.35	5.57	7.25	6.53	6.40	7.08

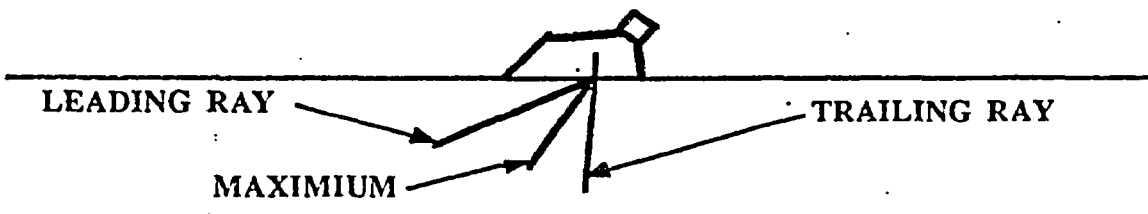

RESOLUTION

NEAR SURFACE REFLECTOR: OD NOTCH DEPTH: .078" SIZE: 2" x 1/4" CAL BLK.: BF19
 FAR SURFACE REFLECTOR: ID NOTCH DEPTH: .075" SIZE: 2" x 1/4"
 SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N


EXAMINER: <u>Douglas Aronowald</u>	REVIEWED BY: <u>David C. Doolin</u>	ANII: <u>Albert Tull</u>
LEVEL: <u>II</u> DATE: <u>3-29-02</u>	LEVEL: <u>III</u> DATE: <u>3-31-02</u>	DATE: <u>4/5/02</u>
		PAGE: <u>12</u> OF <u>13</u>

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. <u>R125</u>
------------	--	---------------------------

PROJECT: BFNP UNIT: 3 CALIBRATION BLOCK NO.: BF19
 PROCEDURE NO.: N-UT-9 REV.: 9 PCR: N/A
 SEARCH UNIT-MAKE: Harsonic SIZE: 1" X .5" FREQ.: 2.25
 S/N: T7429 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: KB S/N: E30219

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	.8	1.19	.93	1.30	1.42	1.13	1.67	1.42	1.135	1.162
1/2T	1.8	2.65	1.95	2.73	2.95	2.35	3.35	2.75	2.65	3.2
3/4T	2.9	4.09	3.05	4.19	4.48	3.4	5.03	4.1	3.85	4.83

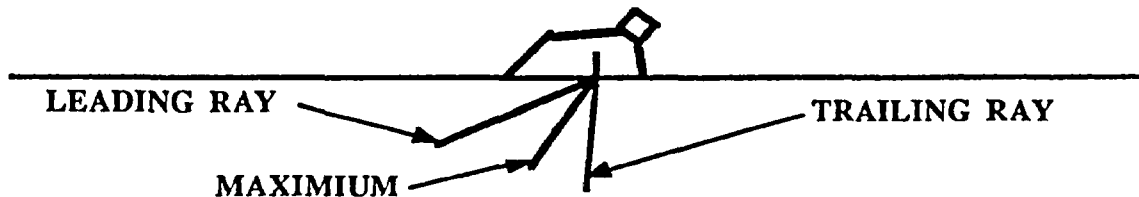

RESOLUTION

NEAR SURFACE REFLECTOR: OD NOTCH DEPTH: .078" SIZE: 2" X 1/4" CAL BLK.: BF19
 FAR SURFACE REFLECTOR: ID NOTCH DEPTH: .075" SIZE: 2" X 1/4"
 SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>Douglas Monro</u>	REVIEWED BY: <u>Douglas Daley</u>	ANII: <u>Albert Hill</u>
LEVEL: <u>II</u> DATE: <u>3-29-02</u>	LEVEL: <u>III</u> DATE: <u>3-31-02</u>	DATE: <u>4/5/02</u>
		PAGE: <u>13</u> OF <u>13</u>

Inspection Report R-172
Weld N9-NV

00156

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R172	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N9	
EXAMINATION METHOD			SYSTEM RPV	ISI DWG. NO. 3-ISI-0332-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: B-D
PROCEDURE: N_UT_9		REV:9	TC:02-06	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN		EXAMINER: DAVID KLEINJAN		EXAMINER: N/A	EXAMINER: N/A
LEVEL: II <i>see 4/19/02</i>		LEVEL: II		LEVEL: N/A	LEVEL: N/A

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle to Vessel welds. This examination report satisfies ASME section XI requirements for the Nozzle to shell weld.

Examination. Nozzle to Vessel weld N9

Transverse coverage for the Nozzle to Vessel weld was supplemented by the inner radius examination.

(N9-IR) **see R 173**

0° was used on the weld crown and base material Vessel side

45° was used on the vessel side only scanning over the weld crown

45° Tangent to the weld was used on vessel side CW/CCW

45° Parallel to the weld was used on vessel side CW/CCW

60° was used on the vessel side only scanning over the weld crown

60° Tangent to the weld was used on vessel side CW/CCW

60° Parallel to the weld was used on vessel side CW/CCW

74% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indications

RESOLUTION BY: Mike Kleinjan <i>Mike w/ 4/19/02</i>	REVIEWED BY: <i>David White</i>	ANI: <i>What Todd</i>
LEVEL: II DATE: 4-4-02	LEVEL: II DATE: 4/4/02	DATE: 4/19/02
		PG. 1 OF 16



Calculation of ASME code coverage
For section XI NDE Examination

N9

1) 0 degree (weld metal scan)	100%
2) 45 degree Transverse-scan from vessel side of weld	100%
3) 45 degree Transverse-scan from nozzle side of weld	0%
4) 60 degree Transverse-scan from vessel side of weld	70 %
5) 60 degree Transverse-scan from nozzle side of weld	0%
6) 45 degree Parallel-scan CW direction	100% *
7) 45 degree Parallel-scan CCW direction	100% *
8) 60 degree Parallel-scan CW direction	100% *
9) 60 degree Parallel-scan CCW direction	100% *
The sum of all the percentage of scans	670%
Divided by the total # of scans	9
Percentage of examination Volume coverage	74%

* Transverse coverage includes coverage obtained during the inner radius examination.

H5BCT
AT
4/19/02

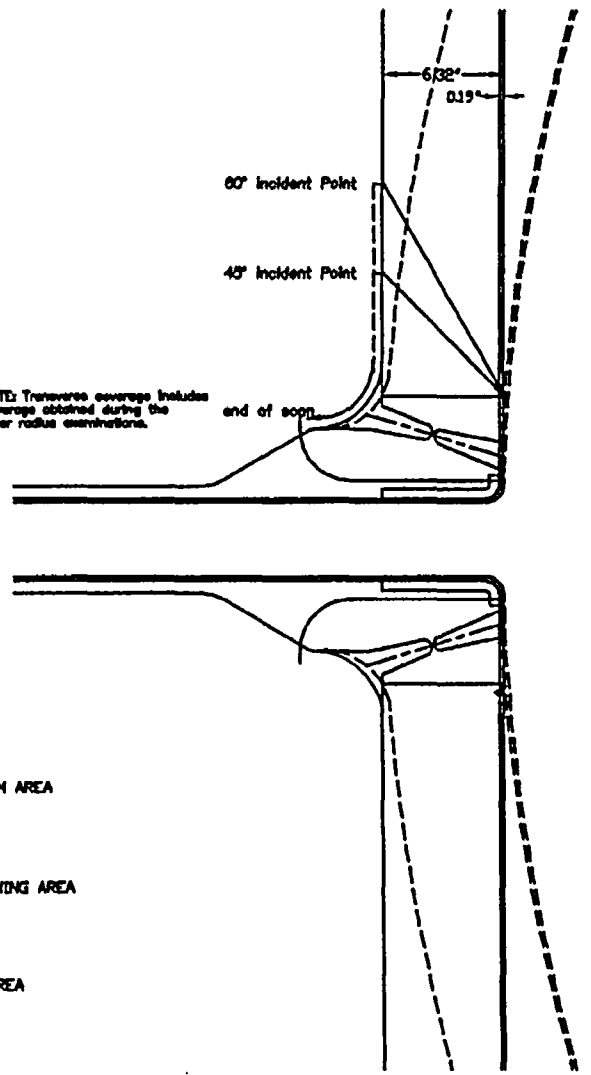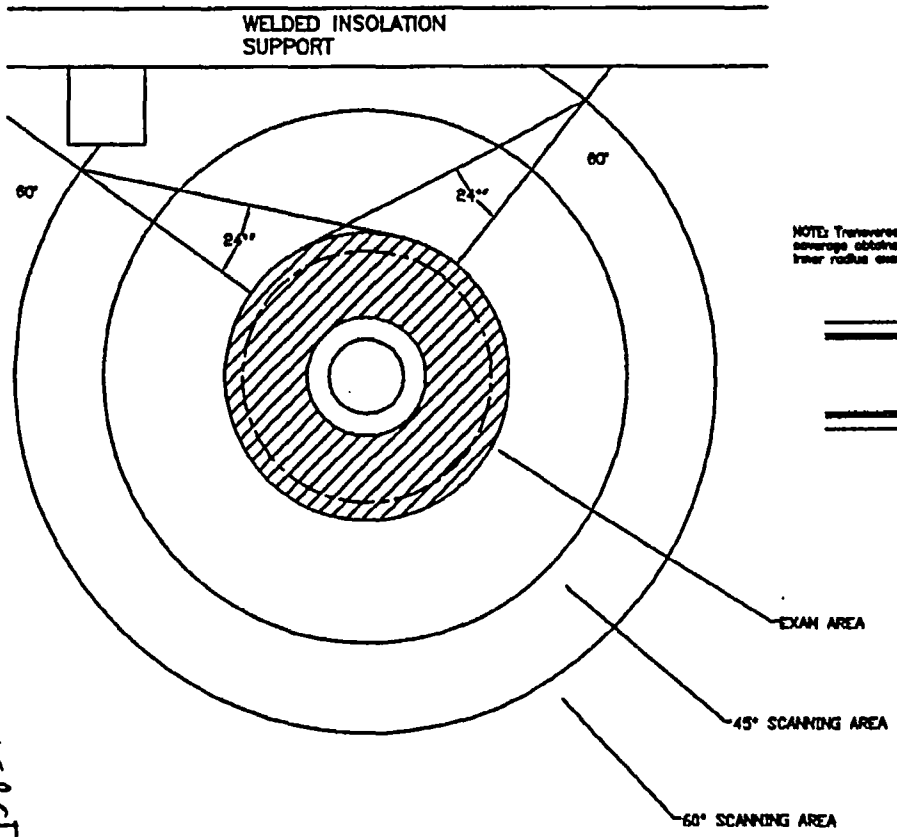

HSBCI
A1/1/02

LIMITED SCAN 60° DUE TO WELDED INSULATION SUPPORT

TOTAL EXAM AREA 179.17
 EXAM LIMITATION 60° 54.62
 60° COVERAGE 124.55 = 70%

Report Number
R172

Browns Ferry Unit 3
N9 Nozzle-to-Shell
March 2002
SP-N9-NS

00158


TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R172</i>					
PROJECT: BFN UNIT: 3 CYCLE: 10		CALIBRATION DATE: 04-01-02				PROC.: N-UT- 9 REV:9 TC:02-06		CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F			
INSTR. MFG: STAVELEY DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079				MODEL/TYPE: SONIC 136 M & TE NO.: VH751		THERMOMETER S/N: 522352 DUE DATE: 5-17-02			
TRANSUCER MFG: Harisonic		COUPLANT SONOTRACE BATCH: 01141				S/N DB34198 SIZE: .75 FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL <input type="checkbox"/>			
CABLE TYPE: RG174 LENGTH: 120 inches		ANGLE VERIFICATION				BLOCK TYPE: <i>Repass Repass</i> S/N: DB55079		NOMINAL ANGLE: 0 ACTUAL ANGLE: N/A			
DAC		INSTRUMENT SETTINGS									
<p>AMPLITUDE (A M P L I T U D E) vs DISTANCE (INCHES)</p> <p>DISPLAY WIDTH: 10 inches</p>		REFLECTOR		REFERENCE		MEMORY					
		SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER				
		AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.8 dB		1				
		CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a				
		FREQ:	2.25	MHz	REJECT: off		%				
		ANGLE:	n/a	deg	DAMPING: 500		ohms				
		DELAY:	.499	msec	PULSER: 222						
		ZERO:	n/a	msec	FILTER: Filt 3						
		VELOCITY:	.238	msec	REP RATE: 2KHZ						
		RANGE:	10	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK						
DISPLAY MODE: PE		POWER: AC		DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF					
REF. REFLECTOR: 1" GAIN: 8 dB		CALIBRATION TIMES									
AMPLITUDE: 80 % METAL PATH: 1"		INITIAL TIME: 9:00		FINAL TIME: 17:30							
VERIFICATION TIMES		1) 11:45	2) N/A	3) N/A	4) N/A	5) N/A	6) N/A	7) N/A	8) N/A	9) N/A	
LINEARITY CHECK											
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20
	SIGNAL 2		50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20%	64 TO 96		40%	64 TO 96
			40		20			80			80
COMMENTS:					WELDS/ITEMS EXAMINED:						
					N9 Nozzle to Shell						
EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i> LEVEL: II			EXAMINER: DAVID KLEINJAN <i>D.R. Kleinjan</i> LEVEL: II			REVIEWER: <i>[Signature]</i> LEVEL: <i>III</i> DATE: <i>4/19/02</i>			ANI: <i>Robert Todd</i> DATE: 4/19/02		
					PG.: 16 OF 16 <i>4 of 16</i>						

00160

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R172
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 04-01-02
PROC.: N-UT- 9 REV:9 TC:02-06	CALIBRATION BLOCK NO.: BF18 TEMP: 72.6°F
INSTR. MFG: STAVELEY DUE DATE: 8-05-02	SIMULATOR BLOCK NO: DB55079
MODEL/TYPE: SONIC 136 M & TE NO.: VH751	THERMOMETER S/N: 522352 DUE DATE: 5-17-02
TRANSDUCER MFG: Krautkramer	COUPLANT SONOTRACE BATCH: 01141
S/N DB34843 SIZE: .5x1 FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG1743 LENGTH: 120 inches	

DAC	BLOCK TYPE: IIW S/N: DB55074
	NOMINAL ANGLE: 45° ACTUAL ANGLE: 46°

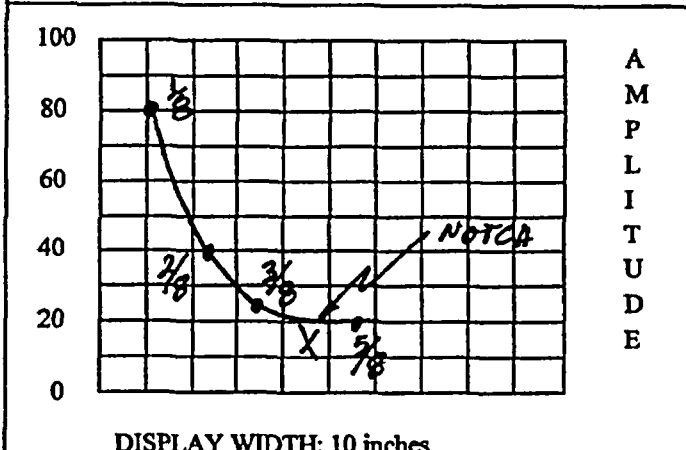

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	45.6 dB	2
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB	n/a
FREQ:	2.25	MHz	REJECT:	off %
ANGLE:	N/A	deg	DAMPING:	500 ohms
DELAY:	.830	msec	PULSER:	222
ZERO:	N/A	msec	FILTER:	FITL 3
VELOCITY:	.126	msec	REP RATE:	2KHZ
RANGE:	20	inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK	
DISPLAY MODE:	PE		POWER:	AC
DUAL:	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	TCG:	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF	

REF. REFLECTOR: 1" GAIN: 33.6 dB	
AMPLITUDE: 80% METAL PATH: 1"	
VERIFICATION TIMES	1) 11:45 2) N/A 3) N/A 4) N/A 5) N/A 6) N/A 7) N/A 8) N/A 9) N/A

CALIBRATION TIMES
INITIAL TIME: 9:00 FINAL TIME: 17:30

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20 %	64 TO 96	40%	64 TO 96		
			40	20		80		80		


COMMENTS: Delta difference between 3/8 to 5/8 on the clad side is 3 dB	WELDS/ITEMS EXAMINED: N9 Nozzle to shell

EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i>	EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i>	REVIEWER: <i>[Signature]</i>	ANII: <i>Robert Todd</i>
LEVEL: II	LEVEL: II	DATE: 4/19/02	DATE: 4/19/02
		PG: 7 OF 16	PG: 7 OF 16

00161

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R172						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02								
PROC.: N-UT- 9		REV:9		TC:02-06		CALIBRATION BLOCK NO.: BF18		TEMP: 72.6°F				
INSTR. MFG: STAVELEY		DUE DATE: 8-05-02		SIMULATOR BLOCK NO: DB55079								
MODEL/TYPE: SONIC 136		M & TE NO.: VH751		THERMOMETER S/N: 522352		DUE DATE: 5-17-02						
TRANSDUCER MFG: Krautkramer		COUPLANT SONOTRACE BATCH: 01141										
S/N DB34154		SIZE: .5x1		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/>		LONG <input type="checkbox"/>				
CABLE TYPE: RG174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: IIW		S/N: DB55074						
				NOMINAL ANGLE: 60		ACTUAL ANGLE: 59						
<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input type="checkbox"/>	<input checked="" type="checkbox"/>	52 dB		3			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	n/a dB		n/a			
				FREQ:	2.25 MHz		REJECT: off		%			
				ANGLE:	N/A deg		DAMPING: 500		ohms			
				DELAY:	1.20 msec		PULSER: 222					
				ZERO:	N/A msec		FILTER: FITL 3					
				VELOCITY:	.123 msec		REP RATE: 2KHZ					
				RANGE:	20 inches		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK					
				DISPLAY MODE: PE			POWER: AC					
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
CALIBRATION TIMES				INITIAL TIME: 9:00		FINAL TIME: 17:30						
REF. REFLECTOR: 1"		GAIN: 36 dB		AMPLITUDE: 80 %		METAL PATH: 1"						
VERIFICATION TIMES		1) 11:45	2) N/A	3) N/A	4) N/A	5) N/A	6) N/A	7) N/A	8) N/A	9) N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40% 64 TO 96	
			40		20		80				80	
COMMENTS:						WELDS/ITEMS EXAMINED:						
DELTA dB DIFFERENCE IS 4.4 FROM THE 3/8 TO 5/8 ON THE CLAD SIDE						N9 Nozzle to Shell						
EXAMINER: MIKE W. KLEINJAN <i>Mike W Kleinjan</i> LEVEL: II						EXAMINER: DAVID KLEINJAN <i>David Kleinjan</i> LEVEL: II			REVIEWER: <i>David Kleinjan</i> LEVEL: II		ANII: <i>What?</i> DATE: 4/19/02	
						DATE: 4/14/02		PG: 4 of 10			6 of 16	

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R172						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02								
PROC.: N-UT- 55		REV: 9		TC: N/A		CALIBRATION BLOCK NO.: BF-85-IR TEMP: 65.4° F						
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A								
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02						
TRANSDUCER MFG: KRAUTKRAMER				COUPLANT SONOTRACE BATCH: 01141								
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>		
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074						
				NOMINAL ANGLE: 13°		ACTUAL ANGLE: N/A						
INSTRUMENT SETTINGS												
REFLECTOR					REFERENCE		MEMORY					
SCAN DIRECT.		NTCH	SDH		SENSITIVITY		NUMBER					
AXIAL		<input checked="" type="checkbox"/>	<input type="checkbox"/>		50.0 dB		13					
CIRC		<input type="checkbox"/>	<input type="checkbox"/>		N/A dB		N/A					
FREQ: 2.25		MHz		REJECT: OFF		%						
ANGLE: N/A		deg		DAMPING: 200		ohms						
DELAY: 0.875		msec		PULSER: 222								
ZERO: N/A		msec		FILTER: FILT 1								
VELOCITY: 0.234		msec		REP RATE: 4 KHZ								
RANGE: 10.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
CALIBRATION TIMES												
INITIAL TIME: 0915				FINAL TIME: 1105								
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A			
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	
	SIGNAL 2		50	45	40	35	30	25	20	15	10	
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
			40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:							
					REACTOR PRESSURE VESSEL							
					N9-IR							
					<i>wedgy ID D 14795-251</i>							
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II			REVIEWER: <i>Paul Whiteley</i> LEVEL: III DATE: 4/19/02		ANII: <i>Albert Todd</i> DATE: 4/19/02				
PG.: 19 OF 16 <i>5/11/02</i> 7 OF 16												

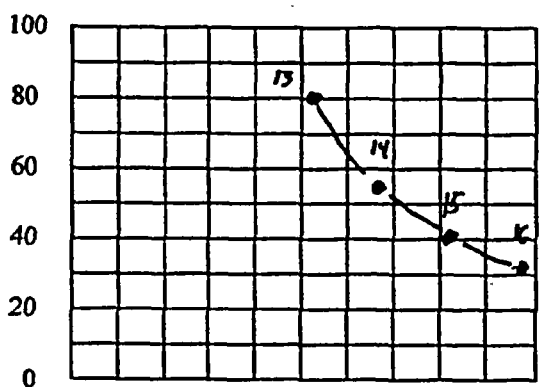

DISPLAY WIDTH: 10 inches

00163

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R172						
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02								
PROC.: N-UT- 55		REV: 9		CALIBRATION BLOCK NO.: BF-85-IR		TEMP: 65.4° F						
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A								
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02						
TRANSDUCER MFG: KRAUTKRAMER		COUPLANT SONOTRACE BATCH: 01141										
S/N DB 35164		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>		RL <input checked="" type="checkbox"/>		
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION								
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074						
				NOMINAL ANGLE: 16°		ACTUAL ANGLE: N/A						
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">AMP L I T U D E</div> </div> <p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>				INSTRUMENT SETTINGS								
				REFLECTOR			REFERENCE		MEMORY			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER			
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	47.0 dB		16			
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A			
				FREQ: 2.25		MHz		REJECT: OFF		%		
				ANGLE: N/A		deg		DAMPING: 200		ohms		
				DELAY: 1.01		msec		PULSER: 222				
				ZERO: N/A		msec		FILTER: FILT 1				
				VELOCITY: 0.234		msec		REP RATE: 4 KHZ				
RANGE: 10.0		inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC									
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF										
CALIBRATION TIMES												
INITIAL TIME: 0820				FINAL TIME: 1107								
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A		
LINEARITY CHECK												
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20		
	SIGNAL 2	50	45	40	35	30	25	20	15	10		
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96
			40		20				80			80
COMMENTS:					WELDS/ITEMS EXAMINED:							
					REACTOR PRESSURE VESSEL							
					N9-IR							
					wedge ID D-14795-252							
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II		EXAMINER: MIKE KLEINJAN <i>Mike Kleinjan</i> LEVEL: II		REVIEWER: <i>David Kleinjan</i> LEVEL: II		DATE: 4/19/02		ANII: <i>Albert Todd</i>		DATE: 4/19/02		
PG. 11 OF 16										8 of 16		

TVA

MANUAL ULTRASONIC VESSEL
EXAMINATION DATA SHEET

REPORT NO.

R172

PROJECT: BFN UNIT: 3 WELD ID: N9 CONFIG.: Nonpipe COMPONENT: VESSELCAL. SHT. NO.: N/A PROCEDURE: NA-UT-9 REV.: 9 PCR: 0206/449 ^{L 4-1-02} TEMP.: 85 PYRO.: 52235SCAN SENS.: * dB EXAM START: ^{4/6/02} 9:45 EXAM END: 10:30 EXAM ANGLE: 0°, 45°, 60°Lo LOCATION: TDC Wo LOCATION: ℄ OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
13°	SCAN		dB	56			SCANNING	#	10/11												
16°	SCAN		dB	53			SCANNING	#	10/11												
0°	SCAN		dB	74.8			SCANNING	#	9												
45°	SCAN		dB	56.6			SCANNING	#	9												
45T	SCAN		dB	56.6			SCANNING	#	10/11												
45 TAN	SCAN		dB	56.6			SCANNING	#	10/11												
60°	SCAN		dB	63			SCANNING	#	9												
60T	SCAN		dB	63			SCANNING	#	10/11												
60 TAN	SCAN		dB	63			SCANNING	#	10/11												
NO RECORDABLE INDICATION																					


COMMENTS: 13° AND 16° EXAMINATIONS ARE THE BLEND RADIUS EXAMINATIONS
TRANSVERSE EXAMINATION COVERAGE WILL INCLUDE COVERAGE OBTAINED DURING THE
INNER RADIUS EXAMINATIONS. 5 TO 10% NOISE LEVEL WAS OBSERVED AT 4-1-02

EXAMINER: Mike W. Kojan LEVEL: II DATE: 4-4-02 REVIEWED BY: A. M. M. M. LEVEL: III DATE: 4/4/02
EXAMINER: A. R. Kojan LEVEL: II DATE: 04-01-02 ANH: Robert Tall DATE: 4/19/02 PAGE 8 OF 16


REPORT NUMBER
R172

00165

Nozzle Examination 45° Waveforms

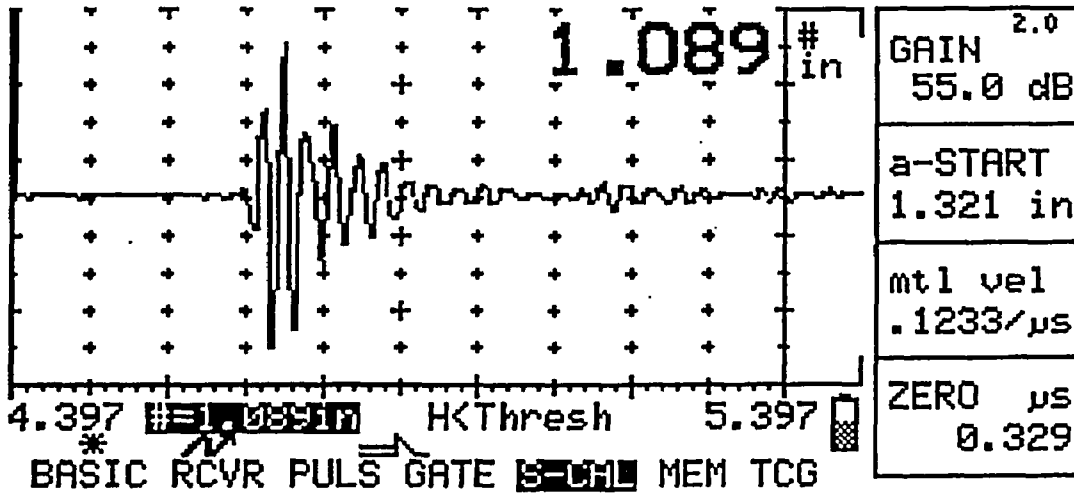

45° Pre Waveform

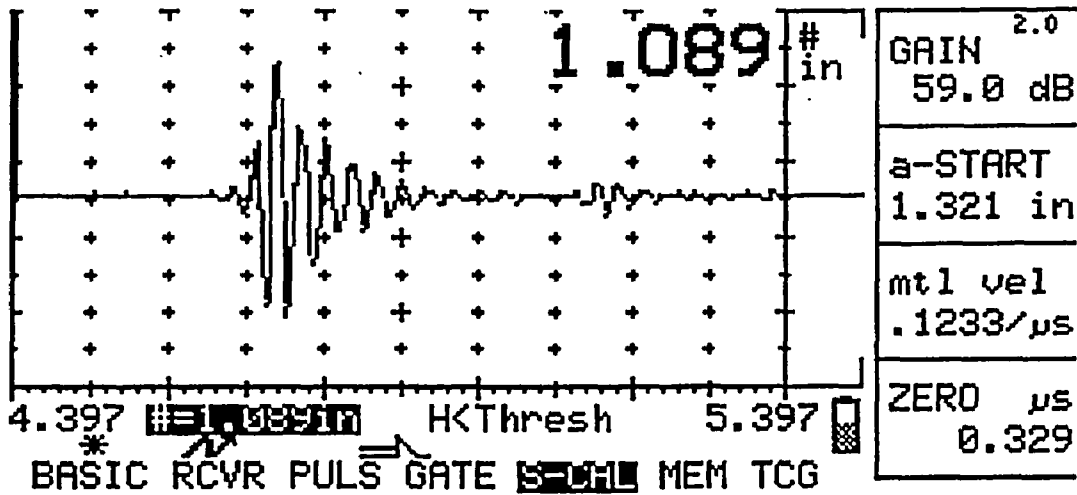

45° Post Waveform

HSBCT
4/19/02


10 J47102-
15 05 10

REPORT NUMBER


R172

00166

Nozzle Examination 60° Waveforms

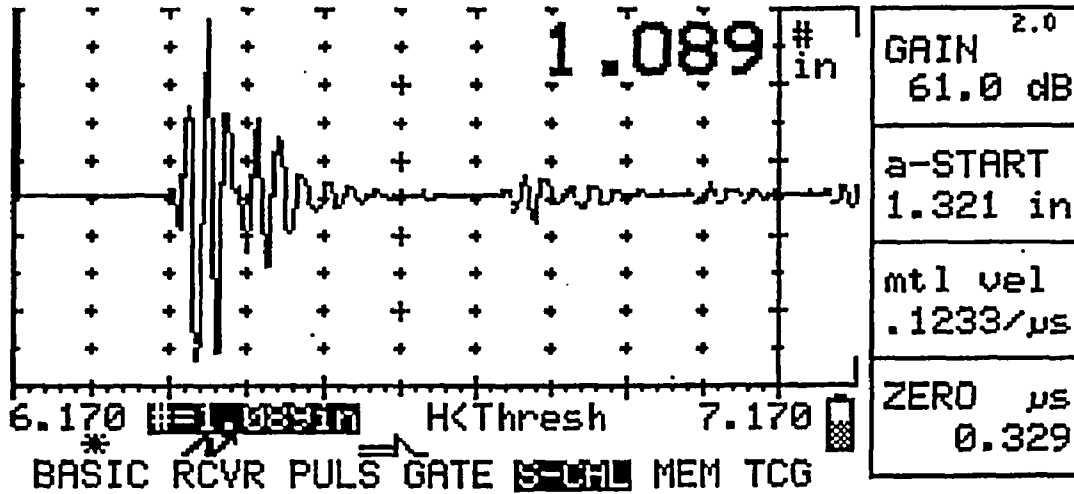

60° Pre Waveform

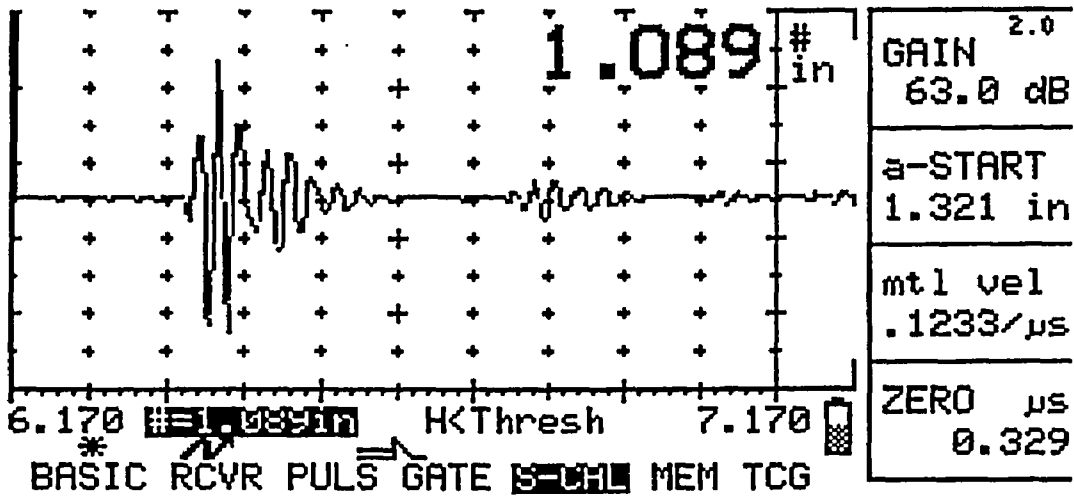

60° Post Waveform

HSBCT
4/19/00


11 8 414/00
16 0.5 IC

TVA	BEAM SPREAD AND RESOLUTION DATA SHEET	REPORT NO. R172
------------	--	---------------------------

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18
 PROCEDURE NO.: N-OT-9 REV.: 9 PCR: 0206 *Handwritten note: 3-30-02*
 SEARCH UNIT-MAKE: Krautkramer SIZE: 5X1 FREQ.: 2.25
 S/N: DB 34843 ANGLE: 45
 ULTRASONIC INSTRUMENT-MAKE: Sumec 135 S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	1 1/8	1.9	1 1/4	2.	2.1	1 5/8	2.4	2	1 7/8	2.3
2T	2 7/8	4	3	4.1	4.3	3 1/4	4.8	4 1/8	3 3/4	4.6
3/4T	4 1/4	6	4 1/2	6.3	6.5	4 7/8	7	5 7/8	5 1/4	6.8

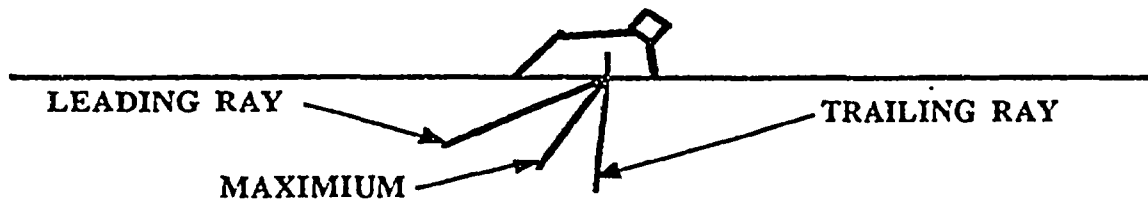

RESOLUTION

NEAR SURFACE REFLECTOR: Notch OD DEPTH: 25 SIZE: .253 CAL BLK.: BF 18
 FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANIL: <u>[Signature]</u>
LEVEL: <u>II</u> DATE: <u>3-30-02</u>	LEVEL: <u>II</u> DATE: <u>4/4/02</u>	DATE: <u>4/19/02</u>
		PAGE: <u>7</u> OF <u>16</u>

TVA

BEAM SPREAD AND
RESOLUTION DATA SHEET

REPORT NO.

R172

PROJECT: BFN UNIT: 3 CALIBRATION BLOCK NO.: BF 18

PROCEDURE NO.: N-UT-9 REV.: 9 PCR: 0206 ~~nta ml 3-30-02~~


SEARCH UNIT-MAKE: Krautkramer SIZE: .5x1 FREQ.: 2.25

S/N: DB 34154 ANGLE: 60

ULTRASONIC INSTRUMENT-MAKE: Sonic 13C S/N: VH 751

BEAM SPREAD

HOLE DEPTH	TRAILING RAY				LEADING RAY					
	20% DAC		50% DAC		100% DAC		20% DAC		50% DAC	
	W	MP	W	MP	MP	W	MP	W	W	MP
1/4T	2 1/8	2.4	2 3/8	2.7	2.9	2 5/8	3.2	3 1/8	2 7/8	3.1
1/2T	4 3/4	4.8	5	5.3	5.8	5 1/4	6.4	6 5/8	6	6.1
3/4T	6 3/8 6 7/8	7.6	7 1/4	8	8.7	7 7/8	9.6	8 5/8	8	9.1

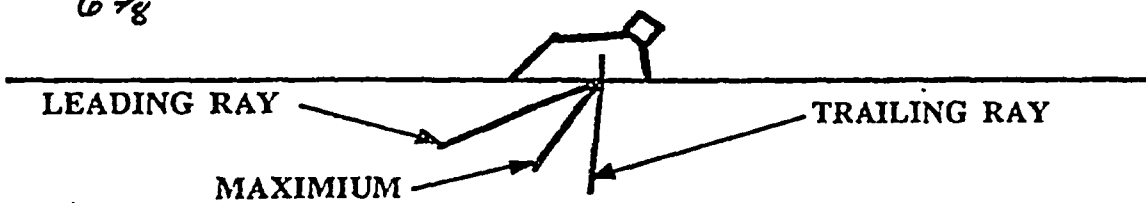

RESOLUTION


NEAR SURFACE REFLECTOR: Notch OD DEPTH: .25 SIZE: .253 CAL BLK.: BF 18

FAR SURFACE REFLECTOR: Notch ID DEPTH: 6.1 SIZE: .253

SCANNING REFLECTORS PROVIDE 50% DAC SIGNALS AT SCANNING SPEED Y N

EXAMINER: Mike W. Henry REVIEWED BY: [Signature] ANII: [Signature]
 LEVEL: II DATE: 3-30-02 LEVEL: III DATE: 4/4/02 DATE: 4/19/02
 PAGE: 18 OF 16

REPORT NUMBER
R172 00169

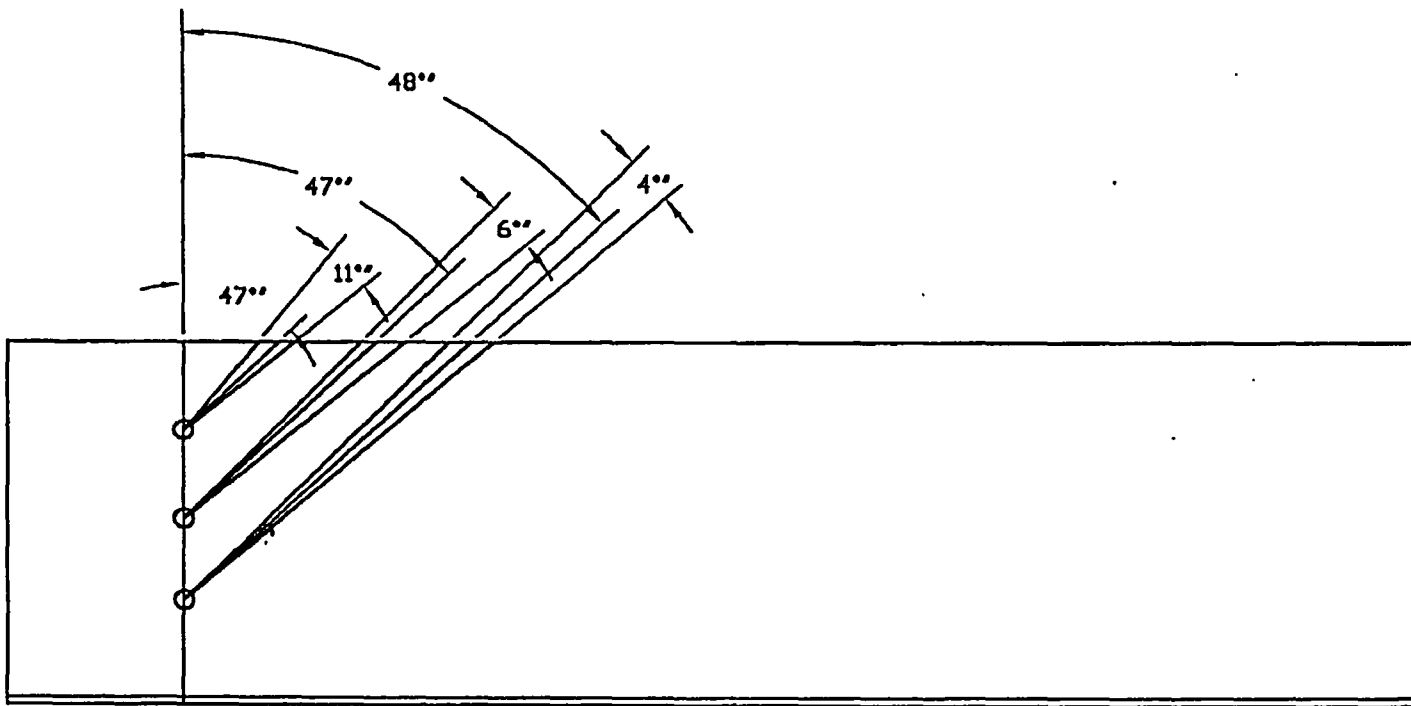

21 50 RTM
4/17/02

HSBCT
2/7/02
4/17/02


Browns Ferry Unit 3

Beamspread

MARCH 2002

BF-18

REPORT NUMBER
R172 00170

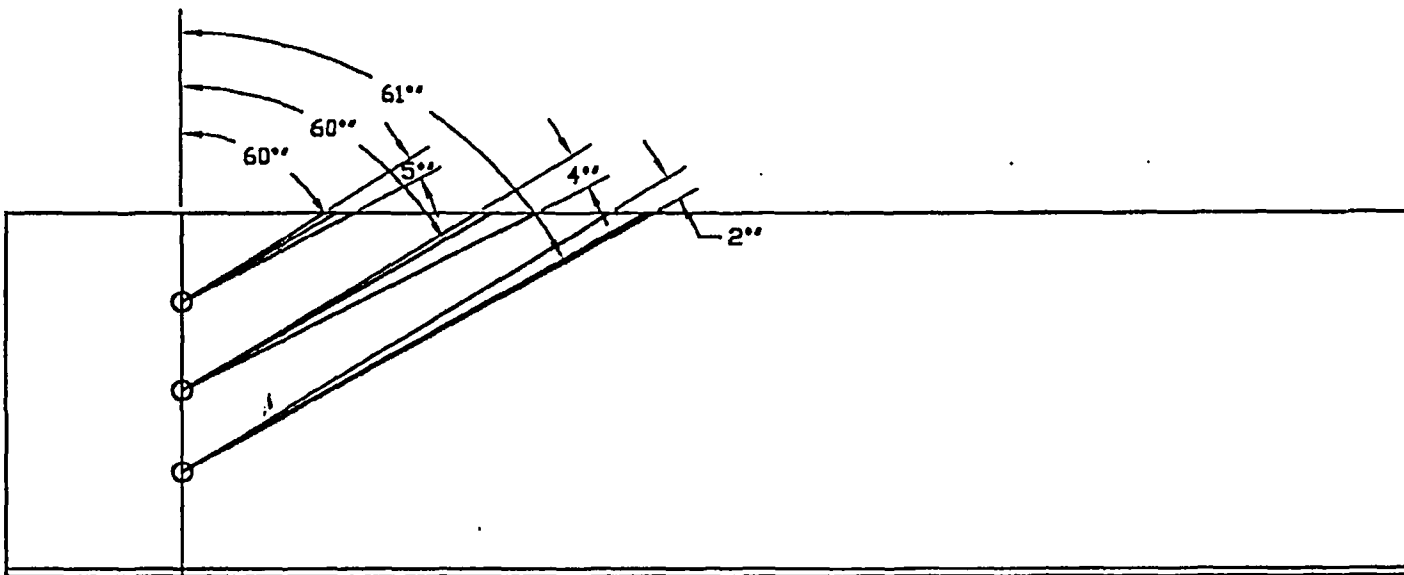

HSBCT
CPX
4/18/02


Browns Ferry Unit 3

Beamspread

MARCH 2002

BF-18

4/18/02 15 08 10

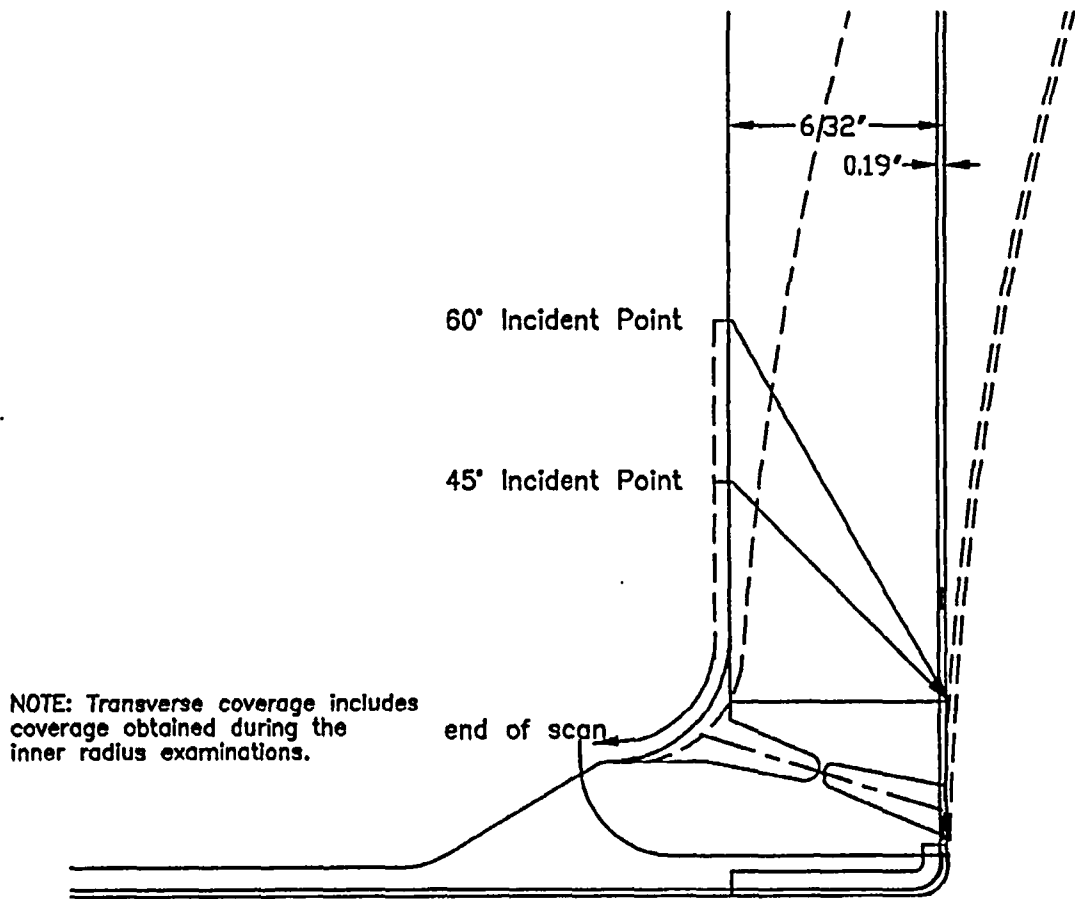

NOTE: Transverse coverage includes coverage obtained during the inner radius examinations.

end of scan

Report Number
R172

H5BCT
4/19/02

Browns Ferry Unit 3
N9 Nozzle-to-Shell
March 2002
SP-N9-NS

00171

5/1/02
K.astic

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: R173	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: N9-IR	
EXAMINATION METHOD				SYSTEM RPV	
				ISI DWG. NO. 3-ISI-0332-C	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	
CATEGORY: B-D					
PROCEDURE: N-UT-55		REV: 9	TC: N/A 23-02	COFIG.:	Nozzle TO Vessel
EXAMINER: MIKE KLEINJAN <i>jk</i>		EXAMINER: 23440206 DAVID KLEINJAN		EXAMINER: N/A	
LEVEL: II		LEVEL: II		LEVEL: N/A	

This report contains the data associated with the manual ultrasonic examination of code category B-D, Nozzle Inner radius. This examination report satisfies ASME section XI requirements for the inner radius examination.

N9-IR: This examination was performed using a 16° and 13° in the blend radius in two directions CW/CCW

100% code coverage was obtained

This exam was performed with equipment, Procedures, and personnel qualified in accordance with ASME Section XI

No Recordable Indication

RESOLUTION BY: Mike Kleinjan <i>mk Kleinjan</i>		REVIEWED BY: <i>Paul [Signature]</i>		ANII: <i>What Todd</i>	
LEVEL: II DATE: 4-4-02		LEVEL: II DATE: 4/4/02		DATE: 4/19/02	
				PG. 1 OF 4 <i>5/11/02</i>	

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R173					
PROJECT: BFN UNIT: 3		CYCLE: 10		CALIBRATION DATE: 04-01-02							
PROC.: N-UT- 55		REV: 9		TC: N/A		CALIBRATION BLOCK NO.: BF-85-IR		TEMP: 65.4° F			
INSTR. MFG: STAVELEY		DUE DATE: 08-11-02		SIMULATOR BLOCK NO: N/A							
MODEL/TYPE: SONIC-137		M & TE NO.: VH-5473		THERMOMETER S/N: 522352		DUE DATE: 05-17-02					
TRANSDUCER MFG: KRAUTKRAMER				COUPLANT SONOTRACE BATCH: 01141							
S/N DB 3516/3		SIZE: 1.0"		FREQ: 2.25 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>					
CABLE TYPE: RG 174		LENGTH: 120 inches		ANGLE VERIFICATION							
DAC				BLOCK TYPE: CS IIW		S/N: DB 55074					
				NOMINAL ANGLE: 13°		ACTUAL ANGLE: N/A					
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">100 80 60 40 20 0</div> <div style="margin-left: 10px; writing-mode: vertical-rl; transform: rotate(180deg);">A M P L I T U D E</div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: 10 inches</p>				INSTRUMENT SETTINGS							
				REFLECTOR			REFERENCE		MEMORY		
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER		
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	50.0 dB		13		
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A		
				FREQ: 2.25	MHz		REJECT: OFF		%		
				ANGLE: N/A	deg		DAMPING: 200		ohms		
				DELAY: 0.875	msec		PULSER: 222				
				ZERO: N/A	msec		FILTER: FILT 1				
				VELOCITY: 0.234	msec		REP RATE: 4 KHZ				
RANGE: 10.0	inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK								
DISPLAY MODE: PE			POWER: AC								
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF									
CALIBRATION TIMES											
REF. REFLECTOR: N/A			GAIN: N/A dB								
AMPLITUDE: N/A %			METAL PATH: N/A"								
VERIFICATION TIMES		1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A	
LINEARITY CHECK											
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20
	SIGNAL 2		50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6
	AMP	80%	32 TO 48		16 TO 24		20%	64 TO 96		40%	64 TO 96
			40		20			80			80
COMMENTS:						WELDS/ITEMS EXAMINED:					
Wedge ID D-14795-251						REACTOR PRESSURE VESSEL					
						N9-IR					
EXAMINER: DAVID KLEINJAN <i>D.K. Kleinjan</i> LEVEL: II			EXAMINER: MIKE KLEINJAN <i>Mike W. Kleinjan</i> LEVEL: II			REVIEWER: <i>Paul Whately</i> LEVEL: III DATE: 4/1/02			ANII: <i>What Paul</i> DATE: 4/1/02 PG.: 44 OF 27 5/17/02 2 of 4		

00174

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R173
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT: 3 CYCLE: 10	CALIBRATION DATE: 04-01-02
PROC.: N-UT- 55 REV:9 4-15-02 TC: N/A	CALIBRATION BLOCK NO.: BF-85-IR TEMP: 65.4° F
INSTR. MFG: STAVELEY DUE DATE: 08-11-02	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: SONIC-137 M & TE NO.: VH-5473	THERMOMETER S/N: 522352 DUE DATE: 05-17-02
TRANSDUCER MFG: KRAUTKRAMER	COUPLANT SONOTRACE BATCH: 01141
S/N DB 35164 SIZE: 1.0" FREQ: 2.25 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG 174 LENGTH: 120 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: CS IIW S/N: DB 55074
	NOMINAL ANGLE: 16° ACTUAL ANGLE: N/A

<p style="text-align: center;">DISPLAY WIDTH: 10 inches</p>	A M P L I T U D E	INSTRUMENT SETTINGS			
	REFLECTOR		REFERENCE	MEMORY	
	SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
	AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	47.0 dB	16
	CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
	FREQ: 2.25 MHz	REJECT: OFF		%	
	ANGLE: N/A deg	DAMPING: 200		ohms	
	DELAY: 1.01 msec	PULSER: 222			
	ZERO: N/A msec	FILTER: FILT 1			
	VELOCITY: 0.234 msec	REP RATE: 4 KHZ			
RANGE: 10.0 inches	TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK				
DISPLAY MODE: PE		POWER: AC			
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			

REF. REFLECTOR: N/A GAIN: N/A dB	CALIBRATION TIMES								
AMPLITUDE: N/A % METAL PATH: N/A"	INITIAL TIME: 0820				FINAL TIME: 1107				
VERIFICATION TIMES	1)N/A	2)N/A	3)N/A	4)N/A	5)N/A	6)N/A	7)N/A	8)N/A	9)N/A

LINEARITY CHECK										
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET		+12	SET		+6
	AMP	80%	32 TO 48	16 TO 24	20 %		64 TO 96	40%		64 TO 96
			40	20			80			80

COMMENTS: Wedge ID D-14795-252	WELDS/ITEMS EXAMINED: REACTOR PRESSURE VESSEL N9-IR
--	--

EXAMINER: DAVID KLEINJAN <i>D.K. Kleijan</i> LEVEL: II	EXAMINER: MIKE KLEINJAN <i>Mike Kleijan</i> LEVEL: II	REVIEWER: <i>[Signature]</i> LEVEL: III DATE: 4/19/02	ANII: <i>Albert Tall</i> DATE: 4/19/02 PG: 47 OF 44 3/11/02 3 OF 4
---	--	---	---

TVA

MANUAL ULTRASONIC VESSEL EXAMINATION DATA SHEET

REPORT NO.

R173

PROJECT: BFN UNIT: 3 WELD ID: N9 CONFIG.: INNER RADIUS COMPONENT: N/A

CAL. SHT. NO.: NA PROCEDURE: N-UT-55 REV.: 7 PCR.: 02-98
DC 4-1002 TEMP.: 85 PYRO.: 522352

SCAN SENS.: * dB EXAM START: 9:45 EXAM END: 10:30 EXAM ANGLE: 13°, 16°

Lo LOCATION: TDC Wo LOCATION: φ OF WELD

IND NO.	20%			50%			100%			MAX. AMP.			20%			50%			100%		
	Mp1	W1	L1	Mp1	W1	L1	Mp1	W1	L1	Mp	W	L	Mp2	W2	L2	Mp2	W2	L2	Mp2	W2	L2
				*																	
13°	SCAN	dB	56				SCANNING	#10/11		BLEND			RADIUS								
16°	SCAN	dB	53				SCANNING	#10/11		BLEND			RADIUS								
	NO RECORDABLE INDICATION																				

COMMENTS: A MATERIAL NOISE LEVEL OF 5-10% WAS OBSERVED

EXAMINER: [Signature] LEVEL: II DATE: 04-01-02 REVIEWED BY: [Signature] LEVEL: II DATE: 4/1/02
 EXAMINER: [Signature] LEVEL: II DATE: 04-01-02 ANII: [Signature] DATE: 4/19/02 PAGE 24 OF 4

00175

Inspection Report R-188
Nozzle N10-Inner Radius

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R188</i>	
PROJECT: BFN UNIT: 3		CYCLE: 11		COMPONENT ID: N10-IR	
EXAMINATION METHOD				SYSTEM: RVP ISI DWG. NO: 3-ISI-0411-C-01	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: B-D
PROCEDURE: 54-ISI-850*		REV: 3	TC: *	COFIG.:	VESSEL to NOZZLE
EXAMINER: <i>FR</i> <i>DREW PETERSON</i> <i>PER TEL CON</i> <i>Waffler</i>		EXAMINER: <i>NA</i>		EXAMINER: <i>NA</i>	
LEVEL: <i>Waffler</i> <i>3-18-04</i>		LEVEL:		LEVEL:	

* SDCN 30-5037583-00

This report contains the data associated with the manual ultrasonic examination of the N10-IR Nozzle to RPV lower head weld inner radius.

The inner radius was examined with a 65 deg shear and a 70 deg shear from the head side and no recordable indications were observed.




The procedure utilized for the examination was 54-ISI-850 rev-3. Note: Refer to EPRI Model IR-2007-43 for a description of the scanning volume and coverage plots. Examination combined volume coverage 90%.

Note 1: This ultrasonic examination was performed in accordance the criteria of 10CFR 50.55a(b) (2) (xv) (G) and the minimum coverage requirements of 10CFR 50.55a(b) (2) (xv) (K) were met.

This examination satisfies the requirements of ASME Sec.XI, Category B-D, for item number B3.90, figure number IWB 2500-7(b) exam volume, and was performed using ASME Sec XI, Appendix VIII qualified personnel, procedures, and equipment as amended by the Final Rule.

RESOLUTION BY: <i>Waffler</i>	REVIEWED BY: <i>Waffler</i>	ANII: <i>Scott St. Louis</i>
LEVEL: <i>III</i> DATE: <i>3/19/04</i>	LEVEL: <i>II</i> DATE: <i>3-18-04</i>	DATE: <i>3/29/04</i>
		PG. <i>1</i> OF <i>6</i>

00332


TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: <i>R188</i>																																																																													
PROJECT: BFN UNIT 3 CYCLE: 11			CALIBRATION DATE: 3-4-04																																																																																
PROC.: 54-ISI-850 REV:03 TC: (2)			CALIBRATION BLOCK NO.: BF-18 TEMP: 69° F																																																																																
INSTR. MFG: Staveley DUE DATE: 5-12-04			SIMULATOR BLOCK NO: N/A																																																																																
MODEL/TYPE: Sonic136 M & TE NO.: VH-8035 ✓			THERMOMETER S/N: VH-8875 ✓ DUE DATE: 7-19-04																																																																																
TRANSDUCER MFG: Benchmark/KBA			COUPLANT Sonotrace BATCH: 01141																																																																																
S/N DB 35289 ✓ SIZE: .5x1.0 ✓ FREQ: ✓ 2.25 MHz			EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>																																																																																
CABLE TYPE: R6-174 LENGTH: 300 inches ✓			ANGLE VERIFICATION																																																																																
DAC			BLOCK TYPE: IIW		S/N: 7500586																																																																														
			NOMINAL ANGLE: 70°		ACTUAL ANGLE: 70°																																																																														
<table border="1"> <tr><td>100</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>80</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>60</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>40</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>20</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>0</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table> <p>DISPLAY WIDTH: inches 20.0°</p>			100												80												60												40												20												0												INSTRUMENT SETTINGS								
			100																																																																																
			80																																																																																
			60																																																																																
			40																																																																																
			20																																																																																
			0																																																																																
			REFLECTOR			REFERENCE			MEMORY																																																																										
			SCAN DIRECT. NTCH SDH			SENSITIVITY			NUMBER																																																																										
			AXIAL <input type="checkbox"/> CIRC <input type="checkbox"/>			50.4 dB NA dB			3 NA																																																																										
*FREQ: 2.25 MHz			*REJECT: OFF %																																																																																
ANGLE: 70° deg			*DAMPING: 500 / ohms																																																																																
DELAY: 2.44 msec			*PULSER: 222 µs /																																																																																
ZERO: N/A msec			FILTER: 2																																																																																
VELOCITY: 0.128 / msec			*PRR/PRF: 2kHz																																																																																
RANGE: 20.0 inches			TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK																																																																																
*DISPLAY MODE: P-E			TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>																																																																																
REF. REFLECTOR: N/A GAIN: N/A			CALIBRATION TIMES																																																																																
AMPLITUDE: N/A METAL PATH: N/A			INITIAL TIME: 0815			FINAL TIME: 1200																																																																													
VERIFICATION TIMES			1)	2)	3)	4)	5)	6)	7)	8)	9)																																																																								
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !																																																																																			
LINEARITY CHECK																																																																																			
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	10																																																																							
	SIGNAL 2		50	45	40	35	30	25	20	15	10	5																																																																							
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6																																																																								
	AMP	80	32-48		16-24		20	64-96		40	64-96																																																																								
			40		20			80			85																																																																								
COMMENTS:						WELDS/ITEMS EXAMINED:																																																																													
(1) No intermediate connections used						N10-IR																																																																													
(2) SDCN 30-5037583-00																																																																																			
EXAMINER: 						EXAMINER: N/A			REVIEWER: 			ANI: 																																																																							
LEVEL: II						LEVEL: II			DATE: 3/29/04			DATE: 3-14-04																																																																							
						PG. 2 OF 6																																																																													

00333

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: <i>R188</i>
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT 3	CYCLE: 11	CALIBRATION DATE: 3-4-04
PROC.: 54-ISI-850	REV:03 TC: (2)	CALIBRATION BLOCK NO.: BF-18 TEMP: 69° F
INSTR. MFG: Staveley	DUE DATE: 5-12-04	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: Sonic136	M & TE NO.: VH-8035 ✓	THERMOMETER S/N: VH-8875 ✓ DUE DATE: 7-19-04
TRANSDUCER MFG: Benchmark/KBA		COUPLANT Sonotrace BATCH: 01141
S/N DB 34852 ✓ SIZE: 5x1.0 ✓	FREQ: √2.25 MHz	EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>

CABLE TYPE: R6-174	LENGTH: 300 inches ✓	ANGLE VERIFICATION
DAC		BLOCK TYPE: ITW S/N: 7500586
		NOMINAL ANGLE: 65° ACTUAL ANGLE: 65°

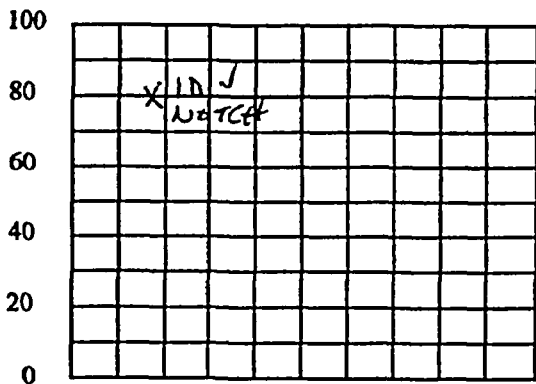

DISPLAY WIDTH: inches 5.0**

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	61.4 dB	4
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	NA dB	NA
*FREQ: 2.25 MHz		*REJECT: OFF %		
ANGLE: 65° deg		*DAMPING: 500 ohms		
DELAY: 14.1 msec		*PULSER: 222 us		
ZERO: N/A msec		FILTER: 2		
VELOCITY: 0.127 msec		*PRR/PRF: 2kHz		
RANGE: 5.0** inches		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK		
*DISPLAY MODE: P-E		TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>		

REF. REFLECTOR: N/A	GAIN: N/A	CALIBRATION TIMES								
AMPLITUDE: N/A	METAL PATH: N/A	INITIAL TIME: 0820		FINAL TIME: 1157						
VERIFICATION TIMES		1)	2)	3)	4)	5)	6)	7)	8)	9)

*** PDI QUALIFIED INSTRUMENT SETTINGS:**
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	10
	SIGNAL 2	50	45	40	35	30	25	20	15	10	5
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12	SET	+6	
	AMP	80	32-48		16-24		20	64-96	40	64-96	
			40		20			80		85	

COMMENTS:	WELDS/ITEMS EXAMINED:
** Screen 5.0" with 13.0" delayed off	N10-IR
(1) No intermediate connections used	
(2) SDCN 30-5037583-00	

EXAMINER: 	EXAMINER: N/A	REVIEWER: 	ANII:
LEVEL: II	LEVEL: II	LEVEL: II DATE: 3-14-04	DATE: 3/29/04
			PG. 3 OF 6

TVA

MANUAL ULTRASONIC VESSEL
EXAMINATION DATA SHEET

REPORT NO.
R188

PROJECT: BFN UNIT: 3 WELD ID: N10-IR CONFIG.: IR COMPONENT: RPV
 CAL. SHT. NO.: N/A PROCEDURE: 54-ISI-850 REV.: 03 PCR.: * TMP.: 80 F PYRO.: VH-8875
 SCAN SENS.: 84.4 dB EXAM START 09:50 EXAM END 10:20 EXAM ANGLE: 70°
 Lo LOCATION: N/A Wo LOCATION: N/A

IND NO.	20%			50%			100%			MAX. AMP			20%			50%			100%		
	Mpl	Wl	Ll	Mpl	Wl	Ll	Mpl	Wl	Ll	Mpl	Wl	Ll	Mpl	Wl	Ll	Mpl	Wl	Ll	Mpl	Wl	Ll
NO RECORDABLE INDICATIONS																					

COMMENTS: (1) 70° IR
 (2) * SDCN 30-5037583 2004-93
 (3) Refer to EPRI Model IR-~~2003-31~~ for a description of scan directions.

EXAMINER: [Signature] LEVEL: II DATE: 3-4-04
 EXAMINER: N/A LEVEL: _____ DATE: _____
 REVIEWED BY: [Signature] LEVEL: II DATE: 3-14-04
 ANL: [Signature] DATE: 3/29/02 PAGE 4 OF 6

110334

TVA

MANUAL ULTRASONIC VESSEL
EXAMINATION DATA SHEET

REPORT NO.
R188

PROJECT: BFN UNIT: 3 WELD ID: N10-IR CONFIG.: IR COMPONENT: RPV


CAL. SHT. NO.: N/A PROCEDURE: 54-ISI-850 REV.: 03 PCR: * TMP.: 80 F PYRO.: VH-8875



SCAN SENS.: 80.6 dB EXAM START 09:20 EXAM END 09:45 EXAM ANGLE: 65°

Lo LOCATION: N/A Wo LOCATION: N/A

IND NO.	20%			50%			100%			MAX. AMP			20%			50%			100%		
	Mpl	W1	L1	Mpl	W1	L1	Mpl	W1	L1	Mpl	W1	L1	Mpl	W1	L1	Mpl	W1	L1	Mpl	W1	L1
NO RECORDABLE INDICATIONS																					

COMMENTS: (1) 65° IR
(2) * SDCN 30-5037583-00 *2004-43 NP 3-20-04*
(3) Refer to EPRI Model IR-2003-31 for a description of scan directions.

EXAMINER:  LEVEL: II DATE: 3-4-04
EXAMINER: N/A LEVEL: _____ DATE: _____

REVIEWED BY:  LEVEL: II DATE: 3-14-04
ANIL:  DATE: 3/29/04 PAGE 5 OF 6

110335



Ultrasonic Examination Limitation and Coverage Report

Browns Ferry Unit-3 Standby Liquid Control Nozzle Inner Radius

N10-IR

The ultrasonic examination volume includes the clad and inner 1/2" thickness as measured from the inside diameter surface. The EPRI Model parameters were used to inspect the examination volume using 65, and 70 degree shear wave scans.

The combined model scans were used to calculate the total examination coverage and limited area not covered by these techniques. The examination limitations are shown in square inches in order to simplify calculations. See the applicable Ultrasonic Examination Limitation/Coverage Sketch and the Browns Ferry Unit 3 - N10 Model Plots.

Required Examination Area: = 5.35 sq. in.

Model Combined Area Examined: = 4.815 sq. in.

Model Limited Area Not Examined: = .45 sq. in.

Model Percentages: 90%

Reviewed By: 

Level: II

Date: 3-19-04

Page: 6 of 6




Ultrasonic Examination Limitation/Coverage Sketch

Browns Ferry Unit - 3

N10 Liquid Control Nozzle Inner Radius/Nozzle to Shell Weld

Component No.: N10-NV

Legend	
	60 deg Radial
	60 deg Tangential
	Upper 85%
	Lower 15%
	Inner Radius

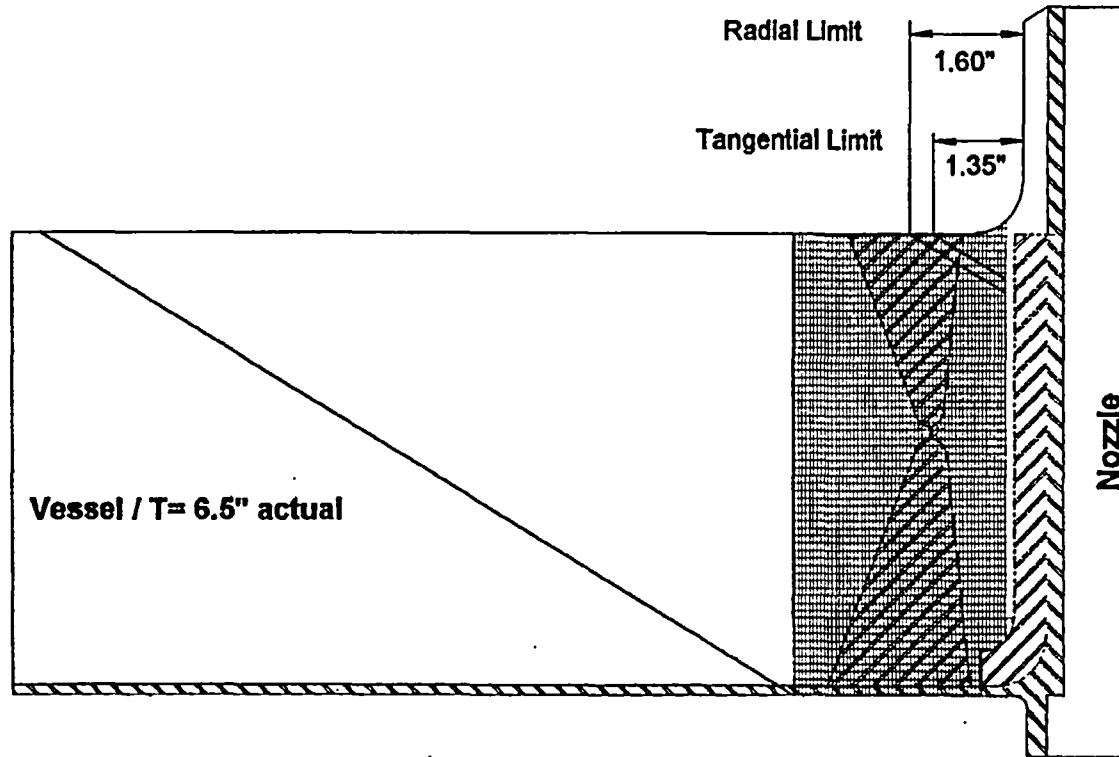

Examiner:	Level: II Date: 3-14-04	Examiner: N/A	Level: Date:
Reviewed By:	Date: 3-19-04	ANII:	Date: 3/29/04
			Page: 9 of 10

2187 10329

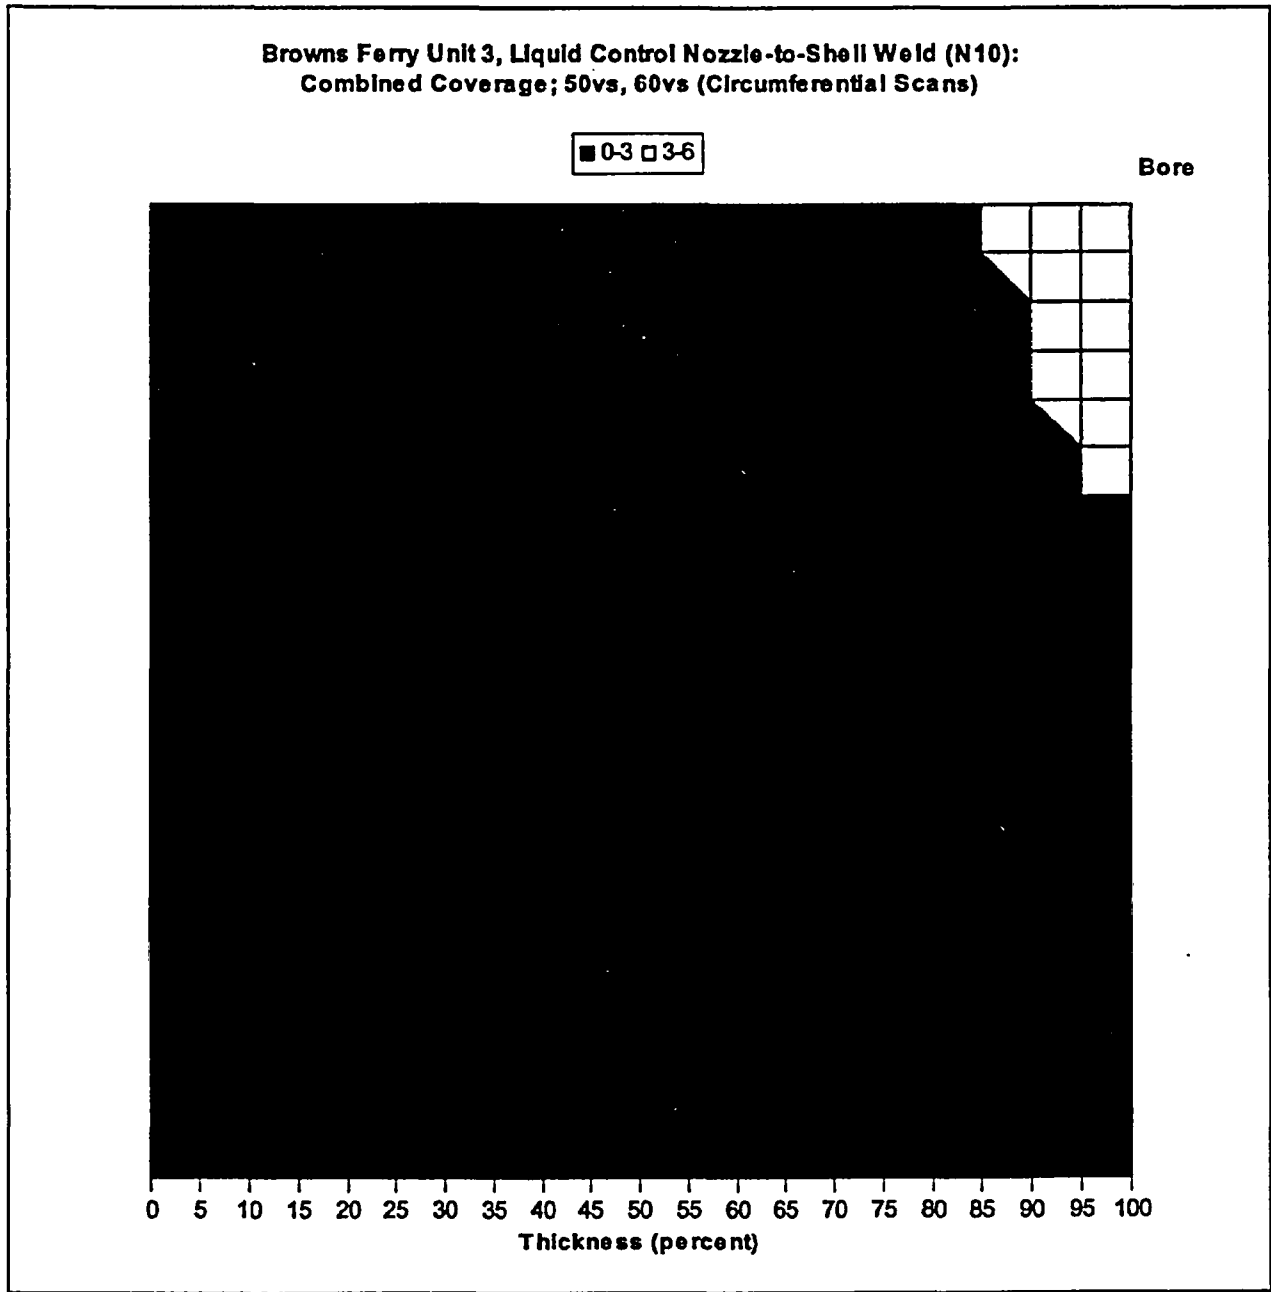


Figure 10. Browns Ferry Standby Liquid Control Nozzle-to-Shell Weld (N10): Summary Coverage Map; Union of Vessel Techniques, 50/(13 to 40)v and 60/(12 to 90)v.

ps 10/10

Attachment B

Inspection Reports
For RHR Piping Welds Listed
In The Table Below

COMPONENT WELD	REPORT NUMBER	CYCLE NUMBER	EXAMINATION COVERAGE
DRHR-3-19	R-086	11	50%
DRHR-3-21	R-140	10	50%
TRHR-3-191	R-189	11	50%
RWCU-3-007-G004	R-081	11	50%

Inspection Report R-086
Weld DRHR-3-19

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND		REPORT NUMBER: <i>R086</i>	
PROJECT: <i>BFN</i> UNIT: <i>3</i> CYCLE <i>11</i>			COMPONENT ID: <i>DRHR-3-19</i>		
EXAMINATION METHOD			SYSTEM: <i>RHRS</i> ISI DWG NO: <i>3-ISI-0330-C-01</i>		
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CONFIGURATION	
PROCEDURE <i>N-UT-64</i>		REV <i>7</i>	TC <i>N/A</i>	CATEGORY	
EXAMINER: <i>Dickey Michael</i>		EXAMINER:		EXAMINER:	
EXAMINER: <i>Dickey Michael</i>		EXAMINER:		EXAMINER:	
LEVEL: <i>II</i>		LEVEL:		LEVEL:	
LEVEL:		LEVEL:		LEVEL:	

Total coverage calculated to be approximately *100 % ASME Code Coverage*
50% (10 CFR 50.550) coverage achieved

This report contains the UT data associated with the manual
 Ultrasonic examination of weld *DRHR-3-19* for ASME Section XI
 Category R-A Item number *R1.11 And N40913* Risk Informed.
in 3/6/04

This exam was performed with 45° shear scans 4, 5 & 6
 and 60° RL scans 4

There was No Recordable Indications with the 45° shear
 ID geometry was observed below recordables.

60° RL observed the previously recorded root geometry below
 Recordable levels

45° Exams was performed to maintain 5% to 20% ID Roll
 60° RL Exam was performed to maintain 5% to 20% IC Noise


This examination was performed with equipment procedures
 and personnel qualified in accordance with ASME Section XI
 Appendix VIII as amended by the Rule

Ⓢ Single sided exam. Main Weld TVANDE LITE 3/6/04

RESOLUTION BY <i>Dickey Michael</i> <i>Dickey Michael</i>	REVIEWED BY <i>Mark Willet</i>	ANI: <i>B.O. Tiner</i>
LEVEL <i>II</i> DATE <i>3 4 04</i>	LEVEL: <i>III</i> DATE <i>3/6/04</i>	DATE <i>3/29/04</i> Page: <i>1</i> OF <i>5</i>

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER <u>R086</u>
---------------------------------------	--	-------------------------------------

PROJECT <u>BFN</u> UNIT/CYCLE <u>3/11</u> PROCEDURE: <u>N-UT-64</u> REV: <u>7</u> TC: <u>N/A</u>	CALIBRATION DATE: <u>3-4-04</u> CALIBRATION BLOCK NO. <u>WB 85</u> TEMP: <u>73 °F</u> SIMULATOR BLOCK: <u>Rompas</u> THERMOMETER S/N <u>531992</u> DUE DATE <u>12-11-04</u> COUPLANT: <u>Ultracel II</u> BATCH: <u>790662</u>
MANUFACTURER <u>KBA</u> MODEL: <u>Comp G</u> S/N <u>00FCYR</u> SIZE: <u>.50"</u> FREQ: <u>1.5</u> MH SHAPE: <u>Round</u> # ELEMENTS: <u>1</u> # CONS: <u>0</u> CABLE TYPE <u>RG 174</u> LENGTH: <u>6'</u>	BLOCK TYPE: <u>Rompas</u> S/N: <u>790662</u> NOMINAL ANGLE: <u>45°</u> ACTUAL ANGLE <u>45°</u>
MODE: <input checked="" type="checkbox"/> SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL	MANUFACTURER <u>KBA</u> DUE DATE <u>5-27-04</u> MODEL NO.: <u>USN 52L</u> S/N: <u>E18733</u>

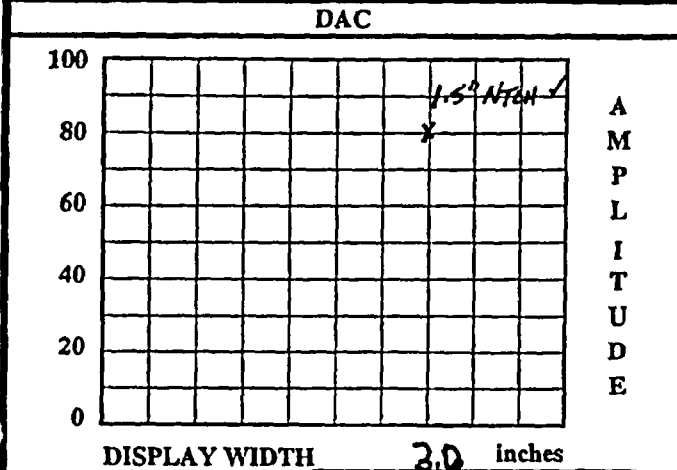

INSTRUMENT SETTINGS

REFLECTOR			REFERENCE SENSITIVITY	MEMORY NUMBER
SCAN DIRECT.	NTC	SDH		
AXIAL	<input type="checkbox"/>	<input type="checkbox"/>	14 dB	16
CIRC.	<input type="checkbox"/>	<input type="checkbox"/>	14 dB	16
FREQ: <u>2-8</u> MH	REJECT: = <u>0</u> %		DAMPING: <u>1000</u> ohms	
ANGLE: <u>45</u> deg	PULSER: <u>Single</u>		PRR/PRF: <u>High</u>	
DELAY: <u>0.0</u> msec	TOF: <u>N/A</u>		POWER: <u>N/A</u>	
ZERO: <u>6.121</u> msec	DISP. MODE: <u>FULL WAVE</u>			
VELOCITY: <u>.116</u> msec				
RANGE: <u>3.0</u> inches				

REF. REFLECTOR: <u>N/A</u> GAIN: <u>N/A</u> dB	CALIBRATION TIMES			
AMPLITUDE: <u>N/A</u> % METAL PATH: <u>N/A</u>	INITIAL TIME: <u>2120</u>	FINAL TIME <u>0015</u>		
VERIFICATION TIMES	1) <u>N/A</u>	2) <u></u>	3) <u></u>	4) <u></u>

*PDI QUALIFIED INSTRUMENT SETTINGS:
 VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2
 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE!

LINEARITY CHECK

VERTICAL	SIGNAL									
	SIGNAL 1	100	90	80	70	60	50	40	30	20
	SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12dB	SET	+12	SET	+6		
	AMP	80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96		
			40%	20%		80%		80%		

COMMENTS	WELD/ITEMS EXAMINED
	DRHR-3-19

EXAMINER: <u>Dickay Michael</u> LVL: <u>II</u>	ANI: <u>B. F. Tino</u>
EXAMINER: <u>Ullrich Walter</u> LVL: <u></u>	DATE <u>5/29/04</u>
REVIEWER: <u>Ullrich Walter</u> LVL: <u>III</u> DATE <u>3/6/04</u>	PAGE <u>2</u> OF <u>5</u>

TENNESSEE VALLEY
AUTHORITY

DIGITAL ULTRASONIC
CALIBRATION
DATA SHEET

REPORT NUMBER
R086

PROJECT BFN UNIT/CYCLE 3/11
PROCEDURE: N-UT-64 REV: 7 TC: N/A

CALIBRATION DATE: 3-4-04
CALIBRATION BLOCK NO. WB 85 TEMP: 73 °F
SIMULATOR BLOCK: Rompas 790662
THERMOMETER S/N 531993 DUE DATE 12-11-04
COUPLANT: Ultracel II BATCH: 012251

MANUFACTURER RTO
MODEL: TLRA SN 85-630 ✓
SIZE: 2 (10x18) ✓ FREQ: 2 MH
SHAPE: Rect. # ELEMENTS: 2 # CONS: 0
CABLE TYPE RG 174 LENGTH: 6'


ANGLE VERIFICATION
BLOCK TYPE: Rompas SN: 790662
NOMINAL ANGLE: 60° ACTUAL ANGLE 60°

MODE: SHEAR LONG RL

INSTRUMENT
MANUFACTURER KBA DUE DATE 5-27-04
MODEL NO.: USN 52 L SN: E18733 ✓

DAC

INSTRUMENT SETTINGS

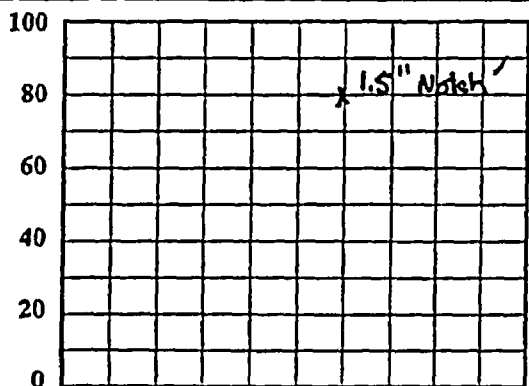

DISPLAY WIDTH 5.0 inches

REFLECTOR			REFERENCE SENSITIVITY	MEMORY NUMBER
SCAN DIRECT.	NTC	SDH		
AXIAL	<input type="checkbox"/>	<input type="checkbox"/>	59 dB	15
CIRC.	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB	N/A
FREQ:	<u>2-8</u>	MH ✓	REJECT: = <u>0</u> %	
ANGLE:	<u>60</u>	deg	DAMPING: <u>1000</u> ohms ✓	
DELAY:	<u>0.0</u>	msec	PULSER: <u>Qual</u> ✓ *	
ZERO:	<u>9.559</u>	msec	PRR/PRF: <u>High</u> ✓	
VELOCITY:	<u>2290</u>	msec	TOF: <u>N/A</u>	
RANGE:	<u>5.0</u>	inches	POWER: <u>N/A</u>	
DISP. MODE:	<u>FULL WAV</u> ✓			

REF. REFLECTOR: N/A GAIN: N/A dB
AMPLITUDE: N/A % METAL PATH: N/A

CALIBRATION TIMES

INITIAL TIME: 2115 FINAL TIME 0013
VERIFICATION TIMES 1) N/A 2) 3) 4) 5) 6) 7) 8) 9) N/A

*PDI QUALIFIED INSTRUMENT SETTINGS:
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE!

LINEARITY CHECK

VERTICAL	SIGNAL 1													
		100	90	80	70	60	50	40	30	20	[REDACTED]			
ATTENUATOR	SIGNAL 2		-6 dB		-12dB		SET		+12		SET		+6	
	AMP	80%	32 TO 48	16 TO 24	20%	64 TO 96	40%	64 TO 96	80%	80%	[REDACTED]			
			40%	20%		80%		80%		[REDACTED]				


COMMENTS: [REDACTED] WELD/ITEMS EXAMINED:

DRHR-3-19

EXAMINER: Rickey Michael LVL.: II
EXAMINER: N/A LVL.:
REVIEWER: Walter Welch LVL.: III DATE 3/6/04

ANII: B. F. Rice
DATE 3/29/04
PAGE 3 OF 5

TENNESSEE VALLEY AUTHORITY	MANUAL ULTRASONIC PIPING EXAMINATION DATA SHEET	REPORT NUMBER <u> R086 </u>
---------------------------------------	--	---

PROJECT: <u>BFN</u> UNIT/CYCLE <u>3/11</u> SYSTEM <u>RHRS</u> WELD I.D.: <u>DRHR-3-19</u> CONFIG.: <u>TEE</u> TO <u>P</u> <div style="text-align: center;">  </div>	EXAMINATION DATE <u>3-4-04</u> START TIME: <u>2250</u> END TIME: <u>2348</u> EXAM SURFACE <input type="checkbox"/> ID <input checked="" type="checkbox"/> OD MATERIAL TYPE: <input type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS SURFACE TEMP. <u>77°</u> PYRO NO. <u>531992</u>									
PROCEDURE: <u>N-UT-64</u> REV: <u>7</u> TC: <u>N/A</u> Wo REFERENCE: <u>Weld E</u> Lo REFERENCE: <u>TDC</u>	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td>EXAMINATION ANGLE</td> <td><u>45</u> DEG.</td> <td><u>60</u> DEG.</td> </tr> <tr> <td>AXIAL SCAN SENSITIVITY</td> <td><u>34</u> dB</td> <td><u>59</u> dB</td> </tr> <tr> <td>CIRC. SCAN SENSITIVITY</td> <td><u>34</u> dB</td> <td><u>N/A</u> dB</td> </tr> </table>	EXAMINATION ANGLE	<u>45</u> DEG.	<u>60</u> DEG.	AXIAL SCAN SENSITIVITY	<u>34</u> dB	<u>59</u> dB	CIRC. SCAN SENSITIVITY	<u>34</u> dB	<u>N/A</u> dB
EXAMINATION ANGLE	<u>45</u> DEG.	<u>60</u> DEG.								
AXIAL SCAN SENSITIVITY	<u>34</u> dB	<u>59</u> dB								
CIRC. SCAN SENSITIVITY	<u>34</u> dB	<u>N/A</u> dB								

IND NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP % DAC	EXAM NO. 3-14	NOM. ANG.	NRI	INDICATION INFORMATION: TYPE, DAMPING, ETC.
	L1	L Max	L2	W MAX	MP MAX	D MAX					
								4	45°	<input checked="" type="checkbox"/>	
								5	45°	<input checked="" type="checkbox"/>	
								6	45°	<input checked="" type="checkbox"/>	
								4	60°	<input checked="" type="checkbox"/>	Proximately recorded root geometry scan at below recordable levels
										<input type="checkbox"/>	
										<input type="checkbox"/>	

REMARKS/LIMITATIONS

REMARKS/LIMITATIONS


EXAMINER: <u>Dickens Michael</u> LEVEL: <u>II</u> EXAMINER: _____ LEVEL: _____ REVIEWED BY: <u>Wade Wheel</u> LEVEL: <u>III</u> DATE <u>3/6/04</u>	ANI: <u>B. P. Rio</u> DATE <u>3/29/04</u> PAGE <u>4</u> OF <u>5</u>
--	---

<h1>TVA</h1>	<h2>WALL THICKNESS PROFILE SHEET</h2>	REPORT NO: <i>R086</i>
--------------	---------------------------------------	---------------------------


PROJECT: <u>BFP</u>	WELD NO: <u>DRHR-3-19</u>
UNIT: <u>3</u>	SYSTEM: <u>RHR</u>

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	N/A			
2	1.050			
3	1.160			
4	1.152			
5	1.092			

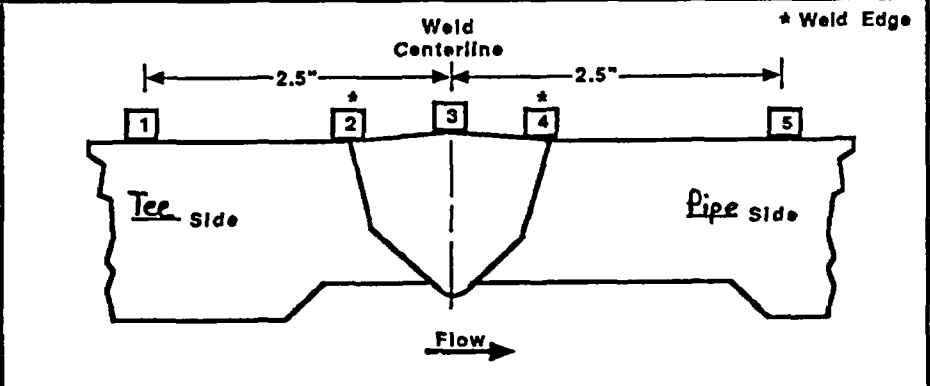

CROWN HEIGHT: <u>Tapered</u>	DIAMETER: <u>20"</u>
CROWN WIDTH: <u>1.3"</u>	WELD LENGTH: <u>63"</u>

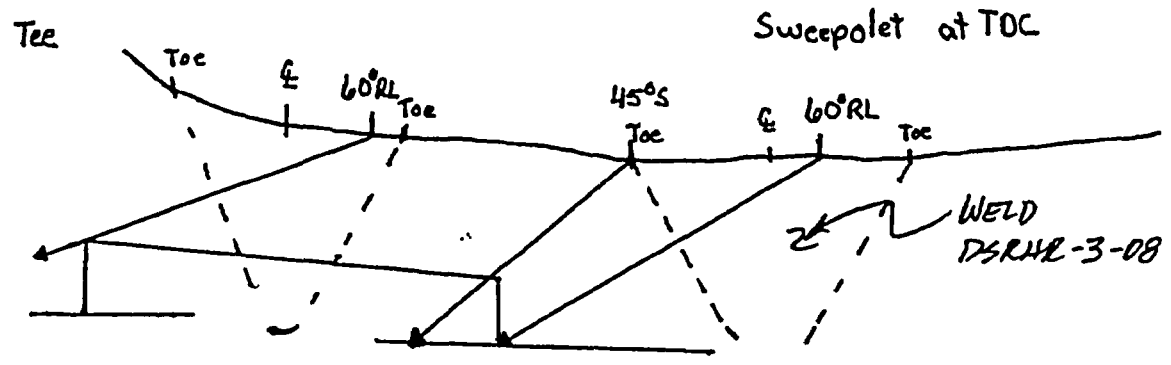

Area Missed 6" Wide TOC 45° Shear, coverage obtained using 60°RL on 3/6/04
Previous T+C

EXAMINER: <u>Rickey Michael</u>	REVIEWED BY: <u>Walter White</u>	ANII: <u>B. F. Rice</u>
LEVEL: <u>II</u>	LEVEL: <u>III</u>	DATE: <u>3/29/04</u>
DATE: <u>3-4-04</u>	DATE: <u>3/6/04</u>	PAGE <u>5</u> OF <u>5</u>

Inspection Report R-140
Weld DRHR-3-21

00153

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>2140</i>	
PROJECT: BFN UNIT: 3		CYCLE: 10		COMPONENT ID: DRHR-3-21	
EXAMINATION METHOD				SYSTEM: RHR ISI DWG. NO. 3-ISI-0330-C-01	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: R-A
PROCEDURE: N-UT-64		REV:5	TC:N/A	CONFIG.:	ELBOW TO VALVE
EXAMINER: <i>Richard Money</i> Richard Money LEVEL: II		EXAMINER: N/A LEVEL:		EXAMINER: N/A LEVEL:	

Component # DRHR-3-21, a stainless steel elbow to valve weld, was ultrasonically examined utilizing a 45 degree shear wave and a 60 degree refracted longitudinal wave. Scans 3, 5, and 6, were performed utilizing a 1/2 node calibration. Single sided examination. All scans were performed maintaining a 5 to 20 % ID roll.

This examination satisfies the requirements of ASME Section XI *and URG 0313*
Essentially 100 % of the ASME Section XI required volume was examined.
50 % of 10CFR50.55a required volume examined.

This examination was performed with equipment, procedures, and personnel qualified in accordance with ASME Section XI, Appendix VIII as amended by the rule.

No recordable indications were observed.

RESOLUTION BY: <i>Richard Money</i> Richard Money LEVEL: II DATE: 3-31-2002		REVIEWED BY: <i>Darlene Duley</i> LEVEL: <i>II</i> DATE: <i>4-2-01</i>		ANII: <i>W. H. H. J.</i> DATE: <i>4/17/02</i> PG. <i>1</i> OF <i>5</i>	
--	--	--	--	--	--

00154

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R140							
PROJECT: <i>BFN</i> UNIT: <i>3</i> CYCLE: <i>10</i>			CALIBRATION DATE: <i>3-31-2002</i>				CALIBRATION BLOCK NO.: <i>BF-87</i> ✓ TEMP: <i>76°F</i>							
PROC.: <i>N-UT-</i> <i>64</i> REV: <i>5</i> TC: <i>N/A</i>			SIMULATOR BLOCK NO.: <i>83-3236</i>				THERMOMETER S/N: <i>562779</i> DUE DATE: <i>7-12-02</i>							
INSTR. MFG: <i>Krautkramer</i> DUE DATE: <i>6-15-02</i>			COUPLANT <i>Ultragel II</i> BATCH: <i>00325</i>				EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>							
MODEL/TYPER: <i>USN-52L</i> M & TE NO.: <i>E21665</i>			TRANSDUCER MFG: <i>KBA</i>				ANGLE VERIFICATION							
S/N <i>00FCYT</i> SIZE: <i>0.5"</i> FREQ: <i>1.5</i> MHz			BLOCK TYPE: <i>Rompas</i> S/N: <i>83-3236</i>				NOMINAL ANGLE: <i>45</i> ACTUAL ANGLE: <i>43</i>							
CABLE TYPE: <i>RG-174</i> LENGTH: <i>72</i> inches			DAC				INSTRUMENT SETTINGS							
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">100 80 60 40 20 0</div> <div style="border: 1px solid black; width: 250px; height: 150px; position: relative;"> <div style="position: absolute; top: 50px; left: 50px; font-size: small;"> <i>10 NOTCHES</i> <i>Ax Ccc</i> </div> </div> <div style="margin-left: 10px; text-align: center;"> A M P L I T U D E </div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: <i>3.0</i> inches</p>			REFLECTOR			REFERENCE		MEMORY						
			SCAN DIRECT.			NTCH		SDH		SENSITIVITY		NUMBER		
			AXIAL			<input checked="" type="checkbox"/>		<input type="checkbox"/>		27.0 dB		1		
			CIRC			<input checked="" type="checkbox"/>		<input type="checkbox"/>		31.0 dB		1		
			*FREQ: <i>2-8</i> MHz			*REJECT: <i>0</i> %		*DAMPING: <i>1000</i> ohms		*PULSER: <i>Single</i>		*REP RATE: <i>High</i>		
			ANGLE: <i>43</i> deg			*DAMPING: <i>1000</i> ohms		*PULSER: <i>Single</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		
			DELAY: <i>0.0</i> msec			*PULSER: <i>Single</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		
			ZERO: <i>6.080</i> msec			*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		
			VELOCITY: <i>0.1210</i> msec			*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		
			RANGE: <i>3.0</i> inches			*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		*REP RATE: <i>High</i>		
*DISPLAY MODE: <i>Full</i>			POWER: <i>Battery</i>		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK		POWER: <i>Battery</i>		TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK					
DUAL: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF			TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF		CALIBRATION TIMES		CALIBRATION TIMES		CALIBRATION TIMES					
REF. REFLECTOR: <i>N/A</i> GAIN: <i>N/A</i> dB			INITIAL TIME: <i>9:45</i>		FINAL TIME: <i>14:32</i>		INITIAL TIME: <i>9:45</i>		FINAL TIME: <i>14:32</i>					
AMPLITUDE: <i>N/A</i> METAL PATH: <i>SD</i>			9) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>					
VERIFICATION TIMES			1) <i>N/A</i>		2) <i>N/A</i>		3) <i>N/A</i>		4) <i>N/A</i>					
1) <i>N/A</i>			2) <i>N/A</i>		3) <i>N/A</i>		4) <i>N/A</i>		5) <i>N/A</i>					
2) <i>N/A</i>			3) <i>N/A</i>		4) <i>N/A</i>		5) <i>N/A</i>		6) <i>N/A</i>					
3) <i>N/A</i>			4) <i>N/A</i>		5) <i>N/A</i>		6) <i>N/A</i>		7) <i>N/A</i>					
4) <i>N/A</i>			5) <i>N/A</i>		6) <i>N/A</i>		7) <i>N/A</i>		8) <i>N/A</i>					
5) <i>N/A</i>			6) <i>N/A</i>		7) <i>N/A</i>		8) <i>N/A</i>		9) <i>N/A</i>					
6) <i>N/A</i>			7) <i>N/A</i>		8) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>					
7) <i>N/A</i>			8) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>					
8) <i>N/A</i>			9) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>					
9) <i>N/A</i>			9) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>		9) <i>N/A</i>					
* PDI QUALIFIED INSTRUMENT SETTINGS:														
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !														
LINEARITY CHECK														
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20			
	SIGNAL 2		50	45	40	35	30	25	20	15	10			
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET		+12		SET		+6	
	AMP	80%	32 TO 48		16 TO 24		20%		64 TO 96		40%		64 TO 96	
			40		20				80				80	
COMMENTS: <i>1/2 NODE CALIBRATION</i>					WELDS/ITEMS EXAMINED:									
					<i>DRHR-3-21</i>									
EXAMINER: <i>Richard Money</i> Richard Money LEVEL: <i>II</i>			EXAMINER: N/A LEVEL:			REVIEWER: <i>Debra Easley</i> LEVEL: <i>III</i> DATE: <i>4-20-02</i>			ANII: <i>Robert Todd</i> DATE: <i>4/17/02</i> PG: <i>2</i> OF <i>5</i>					

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: R140																																																																										
PROJECT: <i>BFN</i> UNIT: <i>3</i> CYCLE: <i>10</i>			CALIBRATION DATE: <i>3-31-2002</i>				CALIBRATION BLOCK NO.: <i>BF-87</i> TEMP: <i>76°F</i>																																																																										
PROC.: <i>N-UT-</i> <i>64</i> REV: <i>5</i> TC: <i>N/A</i>			SIMULATOR BLOCK NO: <i>83-3236</i>				DUE DATE: <i>6-15-02</i>																																																																										
INSTR. MFG: <i>Krautkramer</i>			MODEL/TYPER: <i>USN-52L</i> M & TE NO.: <i>E21685</i>				THERMOMETER S/N: <i>562779</i> DUE DATE: <i>7-12-02</i>																																																																										
TRANSDUCER MFG: <i>*BA Siba</i> PER D. <i>Tripod 2/26/02</i>			COUPLANT <i>Ultragel</i> BATCH: <i>00325</i>				S/N <i>223A94001</i> SIZE: <i>2(10X18)</i> FREQ: <i>2.0</i> MHz																																																																										
CABLE TYPE: <i>RG-174</i> LENGTH: <i>72</i> inches			EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>				ANGLE VERIFICATION																																																																										
DAC			BLOCK TYPE: <i>Rompas</i> S/N: <i>83-3236</i>				NOMINAL ANGLE: <i>60</i> ACTUAL ANGLE: <i>59</i>																																																																										
			INSTRUMENT SETTINGS																																																																														
<table border="1" style="width:100%; border-collapse: collapse;"> <tr><td>100</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>80</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>60</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>40</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>20</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>0</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table> <p>DISPLAY WIDTH: 4.0 inches</p>			100												80												60												40												20												0												REFLECTOR			REFERENCE		MEMORY	
			100																																																																														
			80																																																																														
			60																																																																														
			40																																																																														
			20																																																																														
			0																																																																														
						SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER																																																																			
						AXIAL		<input checked="" type="checkbox"/>		<input type="checkbox"/>		57.0 dB		22																																																																			
						CIRC		<input type="checkbox"/>		<input type="checkbox"/>		N/A dB		N/A																																																																			
			*FREQ: <i>2-8</i> MHz				*REJECT: <i>0</i> %																																																																										
			ANGLE: <i>59</i> deg				*DAMPING: <i>1000</i> ohms																																																																										
			DELAY: <i>0.0</i> msec				*PULSER: <i>Dual</i>																																																																										
			ZERO: <i>8.408</i> msec				FILTER: <i>N/A</i>																																																																										
			VELOCITY: <i>0.230</i> msec				*REP RATE: <i>High</i>																																																																										
			RANGE: <i>4.0</i> inches				TOF: <input type="checkbox"/> PEAK <input checked="" type="checkbox"/> FLANK																																																																										
			*DISPLAY MODE: <i>Full</i>				POWER: <i>Battery</i>																																																																										
			DUAL: <input checked="" type="checkbox"/> ON <input type="checkbox"/> OFF				TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF																																																																										
REF. REFLECTOR: <i>N/A</i> GAIN: <i>N/A</i> dB			CALIBRATION TIMES																																																																														
AMPLITUDE: <i>N/A</i> % METAL PATH: <i>N/A</i> "			INITIAL TIME: <i>10:00</i>				FINAL TIME: <i>14:30</i>																																																																										
VERIFICATION TIMES			1) <i>N/A</i>	2) <i>N/A</i>	3) <i>N/A</i>	4) <i>N/A</i>	5) <i>N/A</i>	6) <i>N/A</i>	7) <i>N/A</i>	8) <i>N/A</i>	9) <i>N/A</i>																																																																						
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !																																																																																	
LINEARITY CHECK																																																																																	
VERTICAL		SIGNAL 1		100	90	80	70	60	50	40	30	20																																																																					
		SIGNAL 2		50	45	40	35	30	25	20	15	10																																																																					
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6																																																																				
		AMP	80%	32 TO 48		16 TO 24		20 %		64 TO 96		40%	64 TO 96																																																																				
				40	20			80		80																																																																							
COMMENTS: <i>1/2 NODE CALIBRATION</i>						WELDS/ITEMS EXAMINED:																																																																											
						<i>DRHR-3-21</i>																																																																											
EXAMINER: <i>Richard Money</i> Richard Money LEVEL: <i>II</i>			EXAMINER: <i>N/A</i> LEVEL:			REVIEWER: <i>Darlene Duley</i> LEVEL: <i>IV</i> DATE: <i>4-2002</i>			APP: <i>What Hill</i> DATE: <i>4/17/02</i> PG.: <i>3</i> OF <i>5</i>																																																																								

TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: R140					
PROJECT: BFMP UNIT: 3			CYCLE: 10			EXAMINATION DATE: 3-31-2002						
PROCEDURE: N-UT-64			REV: 5		TC: N/A	START TIME: 1155		END TIME: 1245				
SYSTEM: RARS		ISI DWG. NO: 3-151-0330-C-01				EXAM SURFACE			<input type="checkbox"/> ID <input checked="" type="checkbox"/> OD			
COMPONENT ID: DRHR-3-21					MATL. TYPE:		<input type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS					
CONFIGURATION ELBOWS TO WAIVE FLOW →					SURFACE TEMP.: 78 F			PYRO. NO.: 562779				
					CAL DUE DATE: 7-12-02							
Wo REFERENCE: WELD CENTERLINE					EXAM ANGLE		45 DEG		60 DEG			
Lo REFERENCE: TDC					CIRC. SCAN SENSITIVITY			39 dB		N/A dB		
					AXIAL SCAN SENSITIVITY			39 dB		63 dB		
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.	
	L1	L MAX	L2	W MAX	MP MAX	D MAX						
NRI							%	3	45/60	f	NRI	
NRI							%	5	45	x	NRI	
NRI							%	6	45	x	NRI	
							%					
							%					
							%					
							%					
							%					
							%					
							%					
							%					
							%					
REMARKS / LIMITATIONS: MAINTAINED 5% to 20% ID Roll during Scanning												
SINGLE SIDED EXAM. (NO SCAN 4)												
EXAMINER: Richard Young					LEVEL: II			ANH: What Fall				
EXAMINER: N/A					LEVEL:			DATE: 4/17/02				
REVIEWER: Darlene Duley					LEVEL: III			DATE: 4-2-02		PAGE 4 OF 5		

00157

REPORT NO:

#140

TVA


WALL THICKNESS
PROFILE SHEET

PROJECT: BNP
UNIT: 3


WELD NO: DRHR-3-21
SYSTEM: RHR

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	1.23			
2	1.19			
3	1.20			
4	N/A			
5	N/A			

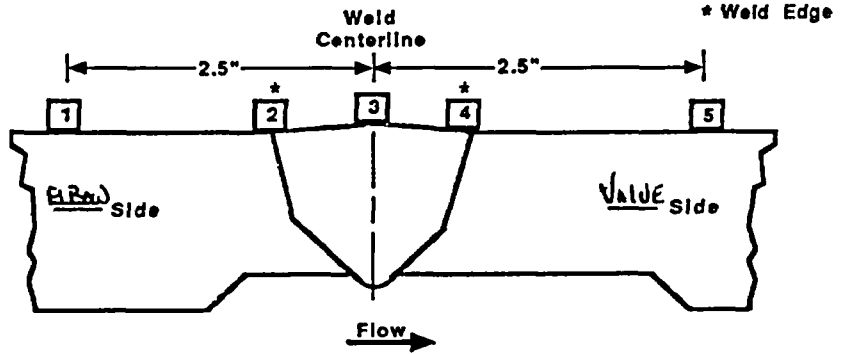

CROWN HEIGHT: Flush DIAMETER: 20"
CROWN WIDTH: 1.5" WELD LENGTH: 60.45"

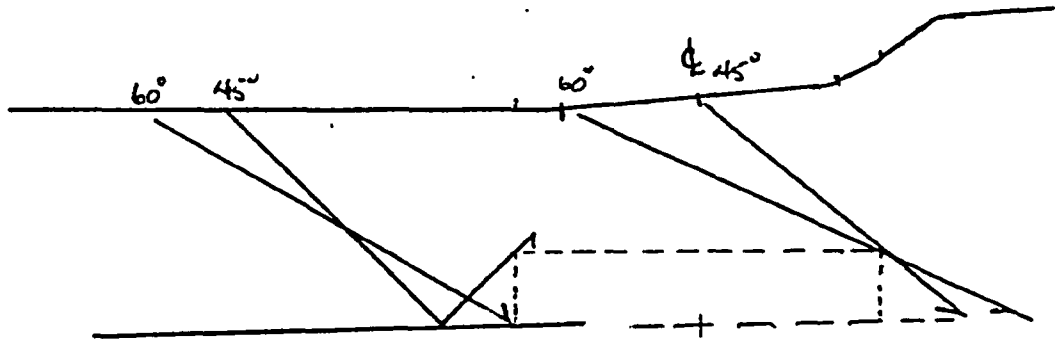

THICKNESS & CONTOUR DATA TAKEN from Previous DATA

EXAMINER: Richard Hany
LEVEL: II
DATE: 3-31-2002

REVIEWED BY: DeAnn Pruley
LEVEL: III DATE: 4-2-02

ANII: Albert Hall
DATE: 4/17/02
PAGE 5 OF 5

Inspection Report R-189
Weld TRHR-3-191

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R189</i>	
PROJECT: BFN UNIT: 3		CYCLE: 11		COMPONENT ID: TRHR-3-191	
EXAMINATION METHOD				SYSTEM: RHR ISI DWG. NO: 3-ISI-0330-C-01	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: R-A
PROCEDURE: N-82-UT		REV: 1	TC: NA	COFIG.: VALVE	to ELBOW
EXAMINER: EDWARD MAZYCK <i>PER TEL-CON WMAZ 3-17-04</i>		EXAMINER: <i>NA</i>	EXAMINER: <i>NA</i>	EXAMINER: <i>NA</i>	EXAMINER: <i>NA</i>
LEVEL:		LEVEL:	LEVEL:	LEVEL:	LEVEL:

This report contains the data associated with the manual ultrasonic examination of the TRHR-3-191 Weld

The weld was examined with a 45, 60 degree RL and 45, 60 degree S transducers from the elbow side and recordable indications were observed which plotted to root geometry. The procedure utilized for this examination was N-UT-82 rev-1.

Examination volume combined coverage 100%.

10CFR 50.55a coverage is 50% due to single side access and cast austenitic material of valve body. WMAZ 4/6/04


This examination satisfies the requirements of ASME Sec. XI, Category R-A, for item number R1.16C, also the exam volume required by procedure, and was performed using ASME Sec XI, Appendix VIII qualified personnel, procedures, and equipment as amended by the Final Rule.

Reference RFR# 3-ISI-16, 4/27 3/22/04

RESOLUTION BY: <i>WMAZ</i>	REVIEWED BY: <i>WMAZ</i>	ANI: <i>Sal Thurl</i>
LEVEL: <i>III</i> DATE: <i>3/19/04</i>	LEVEL: <i>II</i> DATE: <i>3-16-04</i>	DATE: <i>3/29/04</i>
		PG. <i>1</i> OF <i>10</i>

TENNESSEE VALLEY AUTHORITY				DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R189</i>						
PROJECT: BFN UNIT 3				CYCLE: 11				CALIBRATION DATE: 03/06/04						
PROC.: N-UT-82				REV:01 TC: N/A				CALIBRATION BLOCK NO.: BF-87 TEMP: 67° F						
INSTR. MFG: Staveley				DUE DATE: 5/11/04				SIMULATOR BLOCK NO: 7500551						
MODEL/TYPE: Sonic136				M & TE NO.: VH-8034				THERMOMETER S/N: VH-9058 DUE DATE: 04/06/04						
TRANSDUCER MFG: RTD / TRLA				COUPLANT Sonotrace				BATCH: 01141						
S/N DB 34638				SIZE: 2(10x18) FREQ: 2.0 MHz				EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>						
CABLE TYPE: RG-174				LENGTH: 72 inches				ANGLE VERIFICATION						
DAC				BLOCK TYPE: Rompus				S/N: 7500551						
				NOMINAL ANGLE: 60RL°				ACTUAL ANGLE: 60RL°						
<p>AMPLITUDE DEPTH</p> <p>DISPLAY WIDTH: inches 2.0° Depth</p>				INSTRUMENT SETTINGS										
				REFLECTOR			REFERENCE		MEMORY					
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER					
				AXIAL	<input checked="" type="checkbox"/>	<input type="checkbox"/>	65.0 dB		18					
				CIRC	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A					
				*FREQ: 2.25 MHz			*REJECT: OFF %							
				ANGLE: 60RL° deg			*DAMPING: 500 ohms							
				DELAY: 1.30" msec			*PULSER: 250 μ s							
				ZERO: N/A msec			FILTER: 2							
				VELOCITY: 0.257" msec			*PRR/PRF: 4 KHz							
RANGE: 4.0' inches			TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK											
*DISPLAY MODE: Dual			TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>											
REF. REFLECTOR: Near Hole				GAIN: 58.0 dB				CALIBRATION TIMES						
AMPLITUDE: 54%				METAL PATH: .36" Depth				INITIAL TIME: 1940		FINAL TIME: 0105				
VERIFICATION TIMES		1) 2135	2) 0005	3)	4)	5)	6)	7)	8)	9)				
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !														
LINEARITY CHECK														
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	10		
	SIGNAL 2		50	45	40	35	30	25	20	15	10	5		
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12	SET	+6				
	AMP	80	32-48		16-24		20	64-96	40	64-96				
			40		20			80		80				
COMMENTS:						WELDS/ITEMS EXAMINED:								
60° RL was used to perform axial scans.						TRHR-3-191								
Cal. Check was performed between transducer changes.						Valve to Elbow								
Far hole .76" depth @80% 58.0db														
Near hole .36" depth @54% 58.0db														
EXAMINER:			EXAMINER:			REVIEWER:			ANI:					
Edward Mazyck			<i>N/A</i>			<i>[Signature]</i>			<i>Ed Flank</i>					
<i>[Signature]</i>									DATE: 3/29/04					
LEVEL: II			LEVEL:			LEVEL: II DATE: 3/16/04			PG. 2 OF 10					

TENNESSEE VALLEY AUTHORITY			DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R189							
PROJECT: BFN UNIT 3		CYCLE: 11		CALIBRATION DATE: 03/06/04									
PROC.: N-UT-82		REV:01		TC: N/A		CALIBRATION BLOCK NO.: BF-87							
INSTR. MFG: Staveley		DUE DATE: 5/11/04			TEMP: 67° F								
MODEL/TYPE: Sonic136		M & TE NO.: VH-8034			SIMULATOR BLOCK NO: 7500551								
TRANSDUCER MFG: KBA / COMP-B			THERMOMETER S/N: VH-9058			DUE DATE: 04/06/04							
S/N DB 34739		SIZE: 0.5"		FREQ: 1.5 MHz		COUPLANT Sonotrace BATCH: 01141							
CABLE TYPE: RG-174		LENGTH: 72 inches			EXAM TYPE: SHEAR <input checked="" type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>								
ANGLE VERIFICATION													
BLOCK TYPE: Rompus					S/N: 7500551								
NOMINAL ANGLE: 60°					ACTUAL ANGLE: 60°								
INSTRUMENT SETTINGS													
REFLECTOR						REFERENCE		MEMORY					
SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER					
AXIAL		<input checked="" type="checkbox"/>		<input type="checkbox"/>		40.4 dB		16					
CIRC		<input type="checkbox"/>		<input type="checkbox"/>		N/A dB		N/A					
*FREQ: 2.25 MHz				*REJECT: OFF %									
ANGLE: 60° deg				*DAMPING: 500 ohms									
DELAY: 0.314 msec				*PULSER: 334 ps									
ZERO: N/A msec				FILTER: 2									
VELOCITY: 0.123 msec				*PRR/PRF: 4 KHz									
RANGE: 4.0 inches				TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK							
*DISPLAY MODE: P E				TCG: ON <input type="checkbox"/>		OFF <input checked="" type="checkbox"/>							
INSTRUMENT SETTINGS													
CALIBRATION TIMES													
REF. REFLECTOR: Near Hole			GAIN: 36.0 dB			INITIAL TIME: 0200			FINAL TIME: 0610				
AMPLITUDE: 80%			METAL PATH: .38" Depth			4)			5)				
VERIFICATION TIMES			1) 2105	2) 2330	3)	6)	7)	8)	9)				
* PDI QUALIFIED INSTRUMENT SETTINGS:													
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !													
LINEARITY CHECK													
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20	10	
		SIGNAL 2	50	45	40	35	30	25	20	15	10	5	
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET	+6
		AMP	80	32-48		16-24		20		64-96		40	
				40		20				80		80	
COMMENTS:						WELDS/ITEMS EXAMINED:							
60° shear was used to perform axial scans.						TRHR-3-191							
Cal. Check was performed between transducer changes.						Valve to Elbow							
Far Hole .80" depth @40% 36.0db													
Near hole .38" depth @80% 36.0db													
EXAMINER: Edward P. Mazyck <i>Edward P. Mazyck</i>			EXAMINER: N/A			REVIEWER: <i>[Signature]</i>			ANII: <i>[Signature]</i>				
LEVEL: II			LEVEL:			LEVEL: II			DATE: 3/29/04				
						DATE: 3-16-04			PG. 3 OF 10				

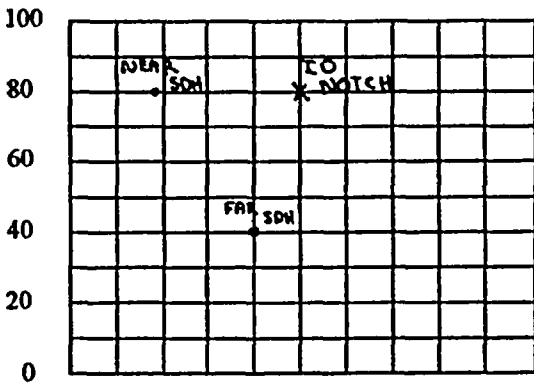

DISPLAY WIDTH: inches 2.0" Depth

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R189</i>									
PROJECT: BFN UNIT 3		CYCLE: 11		CALIBRATION DATE: 03/06/04											
PROC.: N-UT-82		REV:01 TC: N/A		CALIBRATION BLOCK NO.: BF-87		TEMP: 67° F									
INSTR. MFG: Staveley		DUE DATE: 5/11/04		SIMULATOR BLOCK NO: 7500551											
MODEL/TYPE: Sonic136		M & TE NO.: VH-8034		THERMOMETER S/N: VH-9058		DUE DATE: 04/06/04									
TRANSDUCER MFG: RTD / TRLA				COUPLANT Sonotrace		BATCH: 01141									
S/N DB 35359		SIZE:2(15x25)		FREQ: 2.0 MHz		EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>									
CABLE TYPE: R6-174		LENGTH: 72 inches		ANGLE VERIFICATION											
DAC		BLOCK TYPE: Rompus		S/N: 7500551											
		NOMINAL ANGLE: 45RL°		ACTUAL ANGLE: 45RL°											
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">100 80 60 40 20 0</div> <div style="border: 1px solid black; width: 200px; height: 200px; position: relative;"> <div style="position: absolute; top: 10%; left: 10%; font-size: 8px;">FAR SDH</div> <div style="position: absolute; top: 15%; left: 25%; font-size: 8px;">RD NOTCH</div> <div style="position: absolute; top: 25%; left: 10%; font-size: 8px;">NEAR SDH</div> </div> <div style="margin-left: 10px; font-size: 12px; line-height: 1;">A M P L I T U D E</div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: inches 2.0' Depth</p>		INSTRUMENT SETTINGS		REFLECTOR		REFERENCE		MEMORY							
		SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER					
		AXIAL		<input checked="" type="checkbox"/>		<input type="checkbox"/>		52.0 dB		19					
		CIRC		<input type="checkbox"/>		<input type="checkbox"/>		N/A dB		N/A					
		*FREQ: 2.25		MHz		*REJECT: OFF		%							
		ANGLE: 45RL°		deg		*DAMPING: 500		ohms							
		DELAY: 1.36°		msec		*PULSER: 250		µs							
		ZERO: N/A		msec		FILTER: 2									
		VELOCITY: 0.248°		msec		*PRR/PRF: 4 KHz									
		RANGE: 2.82°		inches		TOF: <input checked="" type="checkbox"/> PEAK		<input type="checkbox"/> FLANK							
*DISPLAY MODE: Dual				TCG: ON <input type="checkbox"/>		OFF <input checked="" type="checkbox"/>									
REF. REFLECTOR: Near Hole		GAIN: 45.0 dB		CALIBRATION TIMES											
AMPLITUDE: 20%		METAL PATH: .34° Depth		INITIAL TIME: 1945		FINAL TIME: 0110									
VERIFICATION TIMES		1) 2210	2)	3)	4)	5)	6)	7)	8)	9)					
<p>* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !</p>															
LINEARITY CHECK															
VERTICAL		SIGNAL 1	100	90	80	70	60	50	40	30	20	10			
		SIGNAL 2	50	45	40	35	30	25	20	15	10	5			
ATTENUATOR		GAIN	SET	-6 dB		-12 dB		SET		+12		SET		+6	
		AMP	80	32-48		16-24		20		64-96		40		64-96	
				40		20				80				80	
COMMENTS:					WELDS/ITEMS EXAMINED:										
45° RL was used to perform axial scans.					TRHR-3-191										
Cal. Check was performed between transducer changes.					Valve to Elbow										
Far hole .74° depth @80% 45 db															
Near hole .34° depth @ 20% 45 db															
EXAMINER: Edward Mazyck <i>Edward P. Mazyck</i>			EXAMINER: <i>N/A</i>			REVIEWER: <i>[Signature]</i>			ANII: <i>[Signature]</i>						
LEVEL: II			LEVEL:			LEVEL: II DATE: 3-16-04			DATE: 3/29/04						
									PG. 4 OF 10						

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R189</i>																																																																					
PROJECT: BFN UNIT 3		CYCLE: 11		CALIBRATION DATE: 03/06/04																																																																							
PROC.: N-UT-82		REV:01		TC: N/A		CALIBRATION BLOCK NO.: BF-87		TEMP: 67 ° F																																																																			
INSTR. MFG: Staveley		DUE DATE: 5-11-04		SIMULATOR BLOCK NO: 7500551																																																																							
MODEL/TYPE: Sonic136		M & TE NO.: VH-8034		THERMOMETER S/N: VH-9058		DUE DATE: 04-06-04																																																																					
TRANSDUCER MFG: RTD / TRLA				COUPLANT Sonotrace		BATCH: 01141																																																																					
S/N DB 35258		SIZE:2(10x18)		FREQ: 1.0 MHz		EXAM TYPE: SHEAR <input type="checkbox"/>		LONG <input type="checkbox"/>																																																																			
CABLE TYPE: R6-174		LENGTH: 72 inches		ANGLE VERIFICATION																																																																							
DAC				BLOCK TYPE: Rompus		S/N: 7500551																																																																					
				NOMINAL ANGLE: 45RL°		ACTUAL ANGLE: 45RL°																																																																					
<div style="display: flex; align-items: center;"> <table border="1" style="border-collapse: collapse; text-align: center;"> <tr><td>100</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>80</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>60</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>40</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>20</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>0</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table> <div style="margin-left: 10px;"> <p style="margin-top: 0;">A M P L I T U D E</p> </div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: inches 2.0° Depth</p>				100											80											60											40											20											0											INSTRUMENT SETTINGS					
				100																																																																							
				80																																																																							
				60																																																																							
				40																																																																							
				20																																																																							
				0																																																																							
				REFLECTOR		REFERENCE		MEMORY																																																																			
				SCAN DIRECT.	NTCH	SDH	SENSITIVITY		NUMBER																																																																		
				AXIAL	<input type="checkbox"/>	<input type="checkbox"/>	N/A dB		N/A																																																																		
CIRC	<input checked="" type="checkbox"/>	<input type="checkbox"/>	49.6 dB		20																																																																						
*FREQ: 1.0		MHz		*REJECT: OFF		%																																																																					
ANGLE: 45RL°		deg		*DAMPING: 500		ohms																																																																					
DELAY: 1.35°		msec		*PULSER: 500		qs																																																																					
ZERO: N/A		msec		FILTER: 3																																																																							
VELOCITY: 0.248°		msec		*PRR/PRF: 2 KHz																																																																							
RANGE: 2.82°		inches		TOF: <input checked="" type="checkbox"/> PEAK		<input type="checkbox"/> FLANK																																																																					
*DISPLAY MODE: Dual				TCG: ON <input type="checkbox"/>		OFF <input checked="" type="checkbox"/>																																																																					
REF. REFLECTOR: Near Hole				GAIN: 46.4 dB		CALIBRATION TIMES																																																																					
AMPLITUDE: 62%		METAL PATH: .36° Depth		INITIAL TIME: 2000		FINAL TIME: 0115																																																																					
VERIFICATION TIMES		1) 2305	2)	3)	4)	5)	6)	7)	8)	9)																																																																	
* PDI QUALIFIED INSTRUMENT SETTINGS:																																																																											
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !																																																																											
LINEARITY CHECK																																																																											
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	10																																																															
	SIGNAL 2		50	45	40	35	30	25	20	15	10	5																																																															
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6																																																																			
	AMP	80	32-48	16-24	20	64-96	40	64-96																																																																			
			40	20		80		80																																																																			
COMMENTS:					WELDS/ITEMS EXAMINED:																																																																						
45° RL was used to perform circumferential scans.					TRHR-3-191																																																																						
Cal. Check was performed between transducer change.					Valve to Elbow																																																																						
Far hole .76° depth @80% 46.4db																																																																											
Near hole .36° depth @62% 46.4db																																																																											
EXAMINER: Edward Mazyck <i>Edward P. Mazyck</i>			EXAMINER: LEVEL: <i>N/A</i>			REVIEWER: LEVEL: <i>II</i> DATE: <i>3-16-04</i>			ANI: <i>Paul Flood</i> DATE: <i>3/29/04</i> PG. <i>5</i> OF <i>10</i>																																																																		

00342

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R189</i>						
PROJECT: BFN UNIT 3		CYCLE: 11		CALIBRATION DATE: 03/06/04								
PROC.: N-UT-82		REV:01 TC: N/A		CALIBRATION BLOCK NO.: BF-87		TEMP: 67 ° F						
INSTR. MFG: Staveley		DUE DATE: 5/11/04		SIMULATOR BLOCK NO: 7500551								
MODEL/TYPE: Sonic136		M & TE NO.: VH-8034		THERMOMETER S/N: VH-9058		DUE DATE: 04-06-04						
TRANSDUCER MFG: KBA / COMP-B		COUPLANT Sonotrace		BATCH: 01141								
S/N DB 34739		SIZE: 0.5"		FREQ: 1.5 MHz		EXAM TYPE: SHEAR <input checked="" type="checkbox"/>		LONG <input type="checkbox"/>		RL <input type="checkbox"/>		
CABLE TYPE: R6-174		LENGTH: 72 inches		ANGLE VERIFICATION								
DAC		BLOCK TYPE: Rompus				S/N: 7500551						
		NOMINAL ANGLE: 45s°				ACTUAL ANGLE: 45s°						
<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">100 80 60 40 20 0</div> <div style="border: 1px solid black; width: 200px; height: 150px; position: relative;"> <div style="position: absolute; top: 10%; left: 10%; font-size: 8px;">NEAR SDH</div> <div style="position: absolute; top: 40%; left: 30%; font-size: 8px;">FAR SDH</div> <div style="position: absolute; top: 15%; left: 60%; font-size: 8px;">ED NOTCH</div> </div> <div style="margin-left: 10px; font-size: 12px; line-height: 1.2;">A M P L I T U D E</div> </div> <p style="margin-top: 10px;">DISPLAY WIDTH: inches 2.0" Depth</p>		REFLECTOR		REFERENCE		MEMORY						
		SCAN DIRECT.		NTCH		SDH		SENSITIVITY		NUMBER		
		AXIAL		<input type="checkbox"/>		<input type="checkbox"/>		N/A dB		N/A		
		CIRC		<input checked="" type="checkbox"/>		<input type="checkbox"/>		24.0 dB		17		
		*FREQ: 2.25		MHz		*REJECT: OFF		%				
		ANGLE: 45s°		deg		*DAMPING: 500		ohms				
		DELAY: 0.290"		msec		*PULSER: 334 ns						
		ZERO: N/A		msec		FILTER: 2						
		VELOCITY: 0.123"		msec		*PRR/PRF: 4 KHz						
		RANGE: 2.82"		inches		TOF: <input type="checkbox"/> PEAK		<input checked="" type="checkbox"/> FLANK				
*DISPLAY MODE: P E				TCG: ON <input type="checkbox"/>		OFF <input checked="" type="checkbox"/>						
REF. REFLECTOR: Near Hole		GAIN: 27.0 dB		CALIBRATION TIMES								
AMPLITUDE: 50%		METAL PATH: .36" Depth		INITIAL TIME: 1955		FINAL TIME: 0125						
VERIFICATION TIMES		1)2242	2)	3)	4)	5)	6)	7)	8)	9)		
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !												
LINEARITY CHECK												
VERTICAL	SIGNAL 1		100	90	80	70	60	50	40	30	20	10
	SIGNAL 2		50	45	40	35	30	25	20	15	10	5
ATTENUATOR	GAIN	SET	-6 dB		-12 dB		SET	+12		SET	+6	
	AMP	80	32-48		16-24		20	64-96		40	64-96	
			40		20			80			80	
COMMENTS:					WELDS/ITEMS EXAMINED:							
45° shear was used to perform circumferential scans.					TRHR-3-191							
Cal. Check was performed between transducer changes.					Valve to Elbow							
Far hole .76" depth @35% 27db												
Near hole .36" depth @ 50% 27db												
EXAMINER: Edward P. Mazyck <i>Edward P. Mazyck</i>			EXAMINER: <i>N/A</i>			REVIEWER: <i>[Signature]</i>			ANII: <i>Set Howard</i>			
LEVEL: II			LEVEL:			LEVEL: II DATE: 3-16-04			DATE: 3/29/04			
									PG. 6 OF 10			

00343

TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: <i>R159</i>					
PROJECT: BFN UNIT: 3			CYCLE: 11		EXAMINATION DATE: 03/06/04							
PROCEDURE: N-UT-82			REV: 1		TC: N/A		START TIME: 2243		END TIME: 2325			
SYSTEM: RHRS			ISI DWG. NO: 3-ISI-0330-C / Rev.01			EXAM SURFACE		<input type="checkbox"/> ID		<input checked="" type="checkbox"/> OD		
COMPONENT ID: TRHR-3-191			MATL. TYPE:		<input checked="" type="checkbox"/> CS		<input checked="" type="checkbox"/> SS		<input type="checkbox"/> CSCL		<input type="checkbox"/> CCSS	
CONFIGURATION VALVE TO ELBOW FLOW →						SURFACE TEMP.: 62 'F		PYRO. NO.: VH-9058				
						CAL DUE DATE: 04/06/04						EXAM ANGLE
W _o REFERENCE: SS/CS INTERFACE						CIRC. SCAN SENSITIVITY		49.6 dB		24.0 dB		
L _o REFERENCE: OUTSIDE RADIUS OF ELBOW						AXIAL SCAN SENSITIVITY		N/A dB		N/A dB		
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.	
	L1	L MAX	L2	W MAX	MP MAX	D MAX						
							%	5	45 RL	X		
							%	6	45 RL	X		
							%	5	45 S	X		
							%	6	45 S	X		
							%					
REMARKS / LIMITATIONS: 45°RL and 45°S where used to perform circumferential scans parallel to the weld and on the weld. No exam perform upstream due to component configuration. 100% coverage was achieved per procedure requirements.												
EXAMINER: Edward P. Mazyck						<i>Edward P. Mazyck</i>			LEVEL: II		ANI: <i>Paul Flood</i>	
EXAMINER:									LEVEL:		DATE: 3/24/04	
REVIEWER: <i>[Signature]</i>									LEVEL: II		DATE: 3-16-04	
									PAGE 67		OF 10	

3/16/04


TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: <i>R189</i>				
PROJECT: BFN UNIT: 3 CYCLE: 11			EXAMINATION DATE: 03/06/04								
PROCEDURE: N-UT-82 REV: 1 TC: N/A			START TIME: 2106 END TIME: 2133								
SYSTEM: RHRS ISI DWG. NO: 3-ISI-0330-C / Rev.01			EXAM SURFACE <input type="checkbox"/> ID <input checked="" type="checkbox"/> OD								
COMPONENT ID: TRHR-3-191			MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS								
CONFIGURATION VALVE TO ELBOW FLOW →			SURFACE TEMP.: 62 °F PYRO. NO.: VH-9058								
			CAL DUE DATE: 04/06/04								
W _o REFERENCE: SS/CS INTERFACE			EXAM ANGLE		45 RL DEG		60 Shear DEG				
L _o REFERENCE: OUTSIDE RADIUS OF ELBOW			CIRC. SCAN SENSITIVITY		N/A dB		N/A dB				
			AXIAL SCAN SENSITIVITY		52.0 dB		40.4 dB				
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.
	L1	L MAX	L2	W MAX	MP MAX	D MAX					
1		31.5"		.6"	2.1"	1.05"	65%	4	60°s		Root geometry seen Intermittently 360° at and below recordable.
							%	4	45RL	X	
							%				
							%				
							%				
REMARKS / LIMITATIONS: 45°RL and 60°S where used to perform axial scans perpendicular to the weld and across the weld. No exam perform upstream due to component configuration.											
100% coverage was achieved per procedure requirements.											
EXAMINER: Edward P. Mazyck <i>Edward P. Mazyck</i> LEVEL: II ANI: <i>[Signature]</i>											
EXAMINER: LEVEL: DATE: 3/29/04											
REVIEWER: <i>[Signature]</i> LEVEL: II DATE: 3-16-04 PAGE 8 OF 10											

00345

TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: <i>R189</i>				
PROJECT: BFN UNIT: 3 CYCLE: 11			EXAMINATION DATE: 03/06/04								
PROCEDURE: N-UT-82 REV: 1 TC: N/A			START TIME: 2137 END TIME: 2208								
SYSTEM: RHRS ISI DWG. NO: 3-ISI-0330-C / Rev. 01			EXAM SURFACE <input type="checkbox"/> ID <input checked="" type="checkbox"/> OD								
COMPONENT ID: TRHR-3-191			MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS								
CONFIGURATION			SURFACE TEMP.: 62 °F PYRO. NO.: VH-9058								
VALVE TO ELBOW			CAL DUE DATE: 04/06/04								
FLOW →			EXAM ANGLE		60RL DEG		N/A DEG				
Wo REFERENCE: SS/CS INTERFACE			CIRC. SCAN SENSITIVITY		N/A dB		N/A dB				
Lo REFERENCE: OUTSIDE RADIUS OF ELBOW			AXIAL SCAN SENSITIVITY		65.0 dB		N/A dB				
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.
	L1	L MAX	L2	W MAX	MP MAX	D MAX					
1		31.25"		.4"	1.92"	.96"	60%	4	60RL	X	W-Max taken from SS/CS Interface. Root Geometry
							%				
							%				
							%				
							%				

REMARKS / LIMITATIONS: Indication #1 Root Geometry seen Intermittently 360° at and below recordable levels. Contour was taken on inside Radius of Elbow where indication was plotted.											
60°RL was used to perform axial scans perpendicular to the weld and on the weld.											
100% coverage was achieved per procedure requirements.											
EXAMINER: Edward P. Mazyck			<i>Edward P. Mazyck</i>				LEVEL: II			ANI: <i>[Signature]</i>	
EXAMINER:							LEVEL:			DATE: 3/29/04	
REVIEWER:							LEVEL:			DATE:	
										PAGE 98 OF 10	

WT 3/17/04

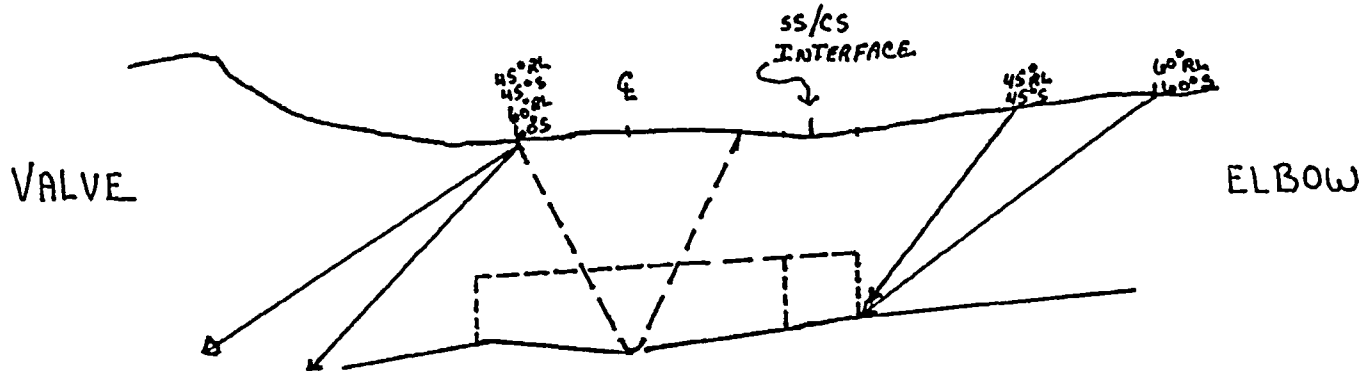

CONTOUR TAKEN OUTSIDE RADIUS OF ELBOW 0°

Site: Browns Ferry / Unit - 3

Weld TRHR-3-191: Coverage Plot

Scale: 1" = 1"

Examiner: *Edward P. Mazyck* Level: II Date: 03/06/04

Examiner: _____ Level: _____ Date: _____

Reviewed By: *[Signature]* Date: 3-16-04

ANII: *[Signature]* Date: 3/19/04

Page: 10 of 10

2189
00346

Inspection Report R-081
Weld RWCU-3-007-G004

TENNESSEE VALLEY AUTHORITY		EXAMINATION SUMMARY AND RESOLUTION SHEET		REPORT NUMBER: <i>R081</i>	
PROJECT: BFN UNIT: 3		CYCLE: 11		COMPONENT ID: RWCU 3-007-G004	
EXAMINATION METHOD				SYSTEM: 069	
				ISI DWG. NO. 3-ISI-0332-C <i>part 3/24/04</i>	
MT <input type="checkbox"/>	PT <input type="checkbox"/>	UT <input checked="" type="checkbox"/>	VT <input type="checkbox"/>	CODE CLASS: 1	CATEGORY: <i>R-A</i>
PROCEDURE: N-UT-82		REV:1	TC:N/A	COFIG.:	Pipe TO Valve
EXAMINER: <i>W. Bentley</i>		EXAMINER: <i>N/A</i>		EXAMINER: <i>N/A</i>	
LEVEL: <i>III</i>		LEVEL:		LEVEL:	

Weld RWCU 3-007-G004 is a dissimilar metal weld consisting of a ferritic steel pipe, 4" schedule 80, welded to a stainless steel valve. The weld is category RI and was examined in accordance with NUREG 0313 (*IG-500*) *ASME Section XI Peak Unformed, category R-A, item R1.16A Max weld III 3/14/04*

The examination was in accordance with NDE procedure N-UT-82 which incorporates PDI procedure PDI-UT-10, "Generic Procedure for the Ultrasonic Examination of Dissimilar Metal Piping Welds". Weld RWCU 3-007-G004 has a maximum thickness of 0.382" and a crown with <0.50" and contains no buttering. Therefore the primary mode of examination was shear wave as stated in the procedure paragraph 6.2.1, "the primary mode of propagation for components with material thickness <0.40" and widths (including buttering) equal to or less than 0.50" shall be shear". A 45 and 60-degree shear wave examination was performed in 3 directions, one axially and two circumferential. A 70-degree shear wave examination was performed in one axial direction. Additionally, a 45-degree RL wave examination was performed in one axial and two circumferential directions. The configuration of the valve prevents scans from the valve side.

To further ensure that there were no flaws in the examination area a supplemental examination, as permitted in the procedure paragraph 8.7, was performed utilizing a 60 and 70-degree RL wave examination in the axial direction.

The 70-degree shear wave examination identified a signal from the weld root and was observed 360-degrees along the welds at varying amplitudes.


100% ASME code coverage was achieved.
50% 10CFR50 55(a) coverage was achieved due to single sided exam Max weld III 3/14/04 TIA/NDE III

RESOLUTION BY: <i>Logan Bentley</i>	REVIEWED BY: <i>Darlene Durling</i>	ANI: <i>B.S. Rice</i>
LEVEL: <i>III</i> DATE: <i>3-3-04</i>	LEVEL: <i>III</i> DATE: <i>3-4-04</i>	DATE: <i>3/26/04</i>
		PG. 1 OF 16

TVA
Office of Nuclear Power

PROJECT: BFN SYSTEM: D69
Unit: 1 WELD NO.: RWCU-3-007-G004

REPORT NO.:
R081

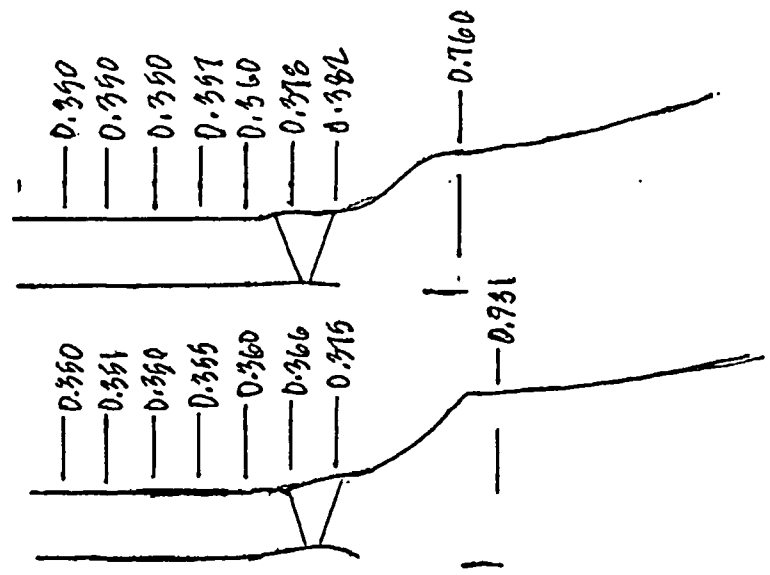

BY: Logan Bentley LEVEL: III DATE: 3.2.04 PAGE 2 OF 16

TVA

**WALL THICKNESS
PROFILE SHEET**

REPORT NO:


R081

PROJECT: BEN
UNIT: 3


WELD NO: R.W.CM-3-007-6004
SYSTEM: 069

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1				
2				
3				
4				
5				

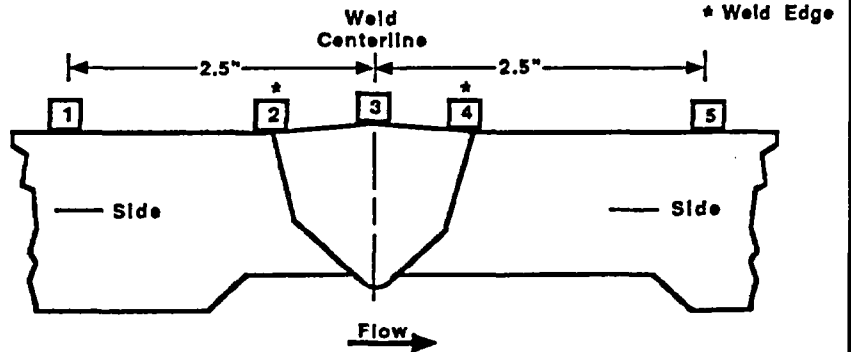

CROWN HEIGHT: FLUSH DIAMETER: 4.9
CROWN WIDTH: 0.30 WELD LENGTH: 14.25

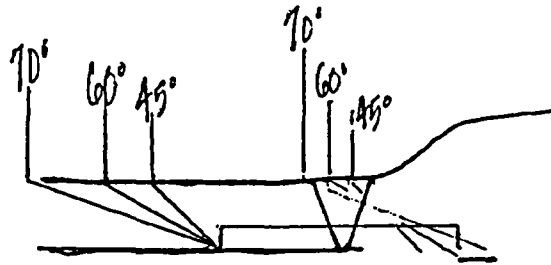

Coverage Plots

EXAMINER: [Signature]
LEVEL: III
DATE: 3.2.04

REVIEWED BY: [Signature]
LEVEL: III DATE: 3.4.04

ANII: B. J. Rio
DATE: 3/29/04
PAGE 3 OF 10

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET				REPORT NUMBER: <i>R081</i>																																																																													
PROJECT: <i>BGN UNIT 3</i>		CYCLE: <i>11</i>		CALIBRATION DATE: <i>3-2-04</i>		CALIBRATION BLOCK NO.: <i>113-850</i> TEMP: <i>66 F</i>																																																																													
PROC.: <i>N-UT-02</i>		REV: <i>0</i>		TC: <i>N/A</i>		SIMULATOR BLOCK NO.: <i>N/A</i>																																																																													
INSTR. MFG: <i>KRAUTKRAMER</i>		DUE DATE: <i>10-7-04</i>		THERMOMETER S/N: <i>522350</i>		DUE DATE: <i>6-16-04</i>																																																																													
MODEL/TYPE: <i>USN 60</i>		M & TE NO.: <i>E36303</i>		COUPLANT <i>WRAPAL II</i>		BATCH: <i>D3125 M</i>																																																																													
TRANSducer MFG: <i>KBA COMP G</i>		S/N <i>00F8TD</i>		SIZE: <i>0.375</i>		FREQ: <i>2.25</i> MHz		EXAM TYPE: <input checked="" type="checkbox"/> SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>																																																																											
CABLE TYPE: <i>R4-174</i>		LENGTH: <i>72</i> inches		ANGLE VERIFICATION																																																																															
DAC		BLOCK TYPE: <i>DSC</i>		S/N: <i>A03671</i>		NOMINAL ANGLE: <i>45°</i> ACTUAL ANGLE: <i>45°</i>																																																																													
		INSTRUMENT SETTINGS																																																																																	
<table border="1" style="width:100%; border-collapse: collapse;"> <tr><td>100</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>80</td><td></td><td></td><td></td><td>*</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>60</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>40</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>20</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>0</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table> <p style="text-align: center;">DISPLAY WIDTH: inches <i>1.50</i></p>		100												80				*								60												40												20												0												REFLECTOR		REFERENCE		MEMORY					
		100																																																																																	
		80				*																																																																													
		60																																																																																	
		40																																																																																	
		20																																																																																	
		0																																																																																	
		SCAN DIRECT.		NTCH		SDH		SENSITIVITY																																																																											
		AXIAL		<input checked="" type="checkbox"/>		<input type="checkbox"/>		<i>25</i> dB																																																																											
		CIRC		<input type="checkbox"/>		<input type="checkbox"/>		dB																																																																											
*FREQ: <i>2.25</i> MHz		*REJECT: <i>0</i> %		*DAMPING: <i>1000</i> ohms																																																																															
ANGLE: <i>45°</i> deg		*PULSER: <i>HIGH</i>		FILTER: <i>FIXED</i>																																																																															
DELAY: <i>8.0113</i> msec		*PRR/PRF: <i>AUTO HIGH</i>		TOP: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK																																																																															
ZERO: * <i>0.015</i> msec		*DISPLAY MODE: <i>FULL WAVE</i>		TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>																																																																															
VELOCITY: <i>0.1243</i> msec		RANGE: <i>1.50</i> inches																																																																																	
REF. REFLECTOR: <i>N</i>		GAIN: dB		CALIBRATION TIMES																																																																															
AMPLITUDE: <i>A</i>		METAL PATH:		INITIAL TIME: <i>1219</i>		FINAL TIME: <i>1500</i>																																																																													
VERIFICATION TIMES		1) 2) 3) 4) 5) 6) 7) 8) 9)																																																																																	
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !																																																																																			
LINEARITY CHECK																																																																																			
VERTICAL		SIGNAL 1		100		90		80		70		60		50		40		30		20		10																																																													
ATTENUATOR		SIGNAL 2		50		<i>45</i>		<i>40</i>		<i>35</i>		<i>30</i>		<i>25</i>		<i>20</i>		<i>15</i>		<i>10</i>		<i>5</i>																																																													
GAIN		SET		-6 dB		-12 dB		SET		+12		SET		+6																																																																					
AMP		80		32-48		16-24		20		64-96		40		64-96																																																																					
				<i>40</i>		<i>20</i>				<i>80</i>				<i>80</i>																																																																					
COMMENTS: * <i>Display Delay</i>						WELDS/ITEMS EXAMINED:																																																																													
<i>OK ON 1/2" THICKNESS NOTCH</i>						<i>KWCU 3-007-9004</i>																																																																													
EXAMINER: <i>M. Bentley</i>			EXAMINER: <i>N/A</i>			REVIEWER: <i>Darlene Dooly</i>			ANH: <i>B.F. Rice</i>			DATE: <i>3/29/04</i>			PG. <i>4</i> OF <i>16</i>																																																																				
LEVEL: <i>III</i>			LEVEL:			LEVEL: <i>III</i>			DATE: <i>3-4-04</i>																																																																										

TENNESSEE VALLEY AUTHORITY	ULTRASONIC PIPING EXAMINATION DATA SHEET	REPORT NUMBER: R081
-------------------------------	--	-------------------------------

PROJECT: BEN UNIT: 1 CYCLE: 11	EXAMINATION DATE: 3-2-04
PROCEDURE: N-UT-62 REV: 1 TC: N/A	START TIME: 1300 END TIME: 1500
SYSTEM: D09 ISI DWG. NO: 3-151-0332-C	EXAM SURFACE <input type="checkbox"/> ID <input checked="" type="checkbox"/> OD
COMPONENT ID: RWCU-3-007-000A	MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS

CONFIGURATION PIPE TO VALVE FLOW →	SURFACE TEMP.: 100 F PYRO. NO.: 522350
W ₀ REFERENCE: WELD CENTER LINE	CAL DUE DATE: 6-16-04
Lo REFERENCE: TOP DEAD CENTER	EXAM ANGLE: 45 DEG <input checked="" type="checkbox"/> N DEG <input type="checkbox"/>
	CIRC. SCAN SENSITIVITY: 41 dB <input checked="" type="checkbox"/> A dB <input type="checkbox"/>
	AXIAL SCAN SENSITIVITY: 41 dB <input checked="" type="checkbox"/> dB <input type="checkbox"/>

IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.
	L1	L MAX	L2	W MAX	MP MAX	D MAX					
							%	3	45'S	<input checked="" type="checkbox"/>	
							%	4*	45'S		
							%	5	45'S	<input checked="" type="checkbox"/>	
							%	6	45'S	<input checked="" type="checkbox"/>	
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				


REMARKS / LIMITATIONS:
*** SCAN 4 NOT AVAILABLE DUE TO CONFIGURATION.**

EXAMINER: Roger Bentley <i>RMBentley</i>	LEVEL: III	ANI: R. F. Rice
EXAMINER: N/A	LEVEL: N/A	DATE: 3/25/04
REVIEWER: Barbara Duley	LEVEL: III	DATE: 3-4-04
		PAGE 5 OF 16

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R081
-------------------------------	---	-------------------------------

PROJECT: B/N UNIT 3 ^{100%} CYCLE: 11	CALIBRATION DATE: 3-2-04
PROC.: N-UT-82 REV: 01 TC: N/A	CALIBRATION BLOCK NO.: 11/B-89 TEMP: 86 °F
INSTR. MFG: KRAUTKRAMER DUE DATE: 10-7-04	SIMULATOR BLOCK NO: N/A
MODEL TYPE: USN-60 M & TE NO.: E-36303	THERMOMETER S/N: 522390 DUE DATE: 6-16-04
TRANSDUCER MFG: KBA COMP G	COUPLANT ULTRAGEL II BATCH: 03125M
S/N 004870 SIZE: 0.375 FREQ: 2.25 MHz	EXAM TYPE: <input checked="" type="checkbox"/> SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>
CABLE TYPE: RG-174 LENGTH: 72 inches	ANGLE VERIFICATION

DAC	BLOCK TYPE: DSC S/N: A 02611
	NOMINAL ANGLE: 60° ACTUAL ANGLE: 60°

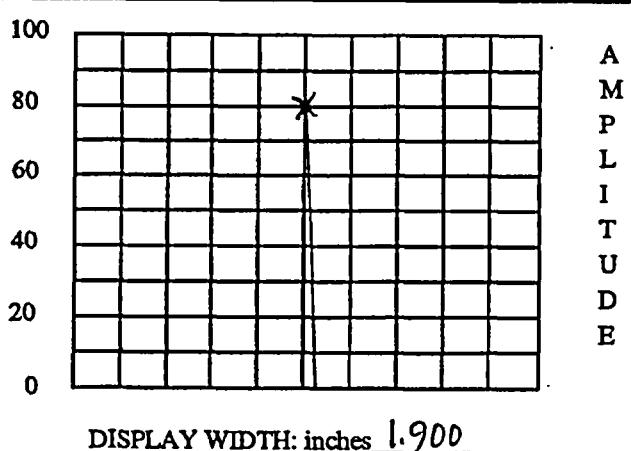

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input type="checkbox"/>	45 dB	
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	dB	
*FREQ:	2.25 MHz	*REJECT:	0 %	
ANGLE:	60° deg	*DAMPING:	1000 ohms	
DELAY:	9.9900 msec	*PULSER:	HIGH	
ZERO:	* 0.015 msec	FILTER:	FIXED	
VELOCITY:	0.1254 msec	*PRR/PRF:	AUTO HIGH	
RANGE:	1.900 inches	TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK		
*DISPLAY MODE:	FULL WAVE	TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>		

REF. REFLECTOR: N GAIN: dB	CALIBRATION TIMES
AMPLITUDE: A METAL PATH:	INITIAL TIME: 1216 FINAL TIME: 1455
VERIFICATION TIMES	1) 2) 3) 4) 5) 6) 7) 8) 9)

*** PDI QUALIFIED INSTRUMENT SETTINGS:**
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	10
		SIGNAL 2	50	45	40	35	30	25	20	15	10
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6			
	AMP	80	32-48	16-24	20	64-96	40	64-96			
			40	20		80		60			

COMMENTS: * DISPLAY DELAY	WELDS/ITEMS EXAMINED:
0" CR ON 1/2" THICKNESS NOTCH	RNCL 3-007-G004

EXAMNER: Koger Bentley LEVEL: III	EXAMNER: N/A LEVEL: N/A	REVIEWER: D. Aulme LEVEL: III DATE: 3-4-04	ANI: B. F. Rice DATE: 3/29/04 PG. 6 OF 16
--	--	--	---

TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: <i>R081</i>				
PROJECT: <i>BFN</i> UNIT: <i>1</i> CYCLE: <i>11</i>		EXAMINATION DATE: <i>3-2-04</i>									
PROCEDURE: <i>N-UT-62</i> REV: <i>1</i> TC: <i>N/A</i>		START TIME: <i>1300</i>		END TIME: <i>1900</i>							
SYSTEM: <i>069</i>	ISI DWG. NO: <i>3-151-0332-C</i>			EXAM SURFACE	<input type="checkbox"/> ID <input checked="" type="checkbox"/> OD						
COMPONENT ID: <i>RWCU 3-007-600A</i>			MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS								
CONFIGURATION <i>PIPE</i> TO <i>VALVE</i> <i>FLOW</i> →			SURFACE TEMP.: <i>100</i> °F PYRO. NO.: <i>922350</i>								
			CAL DUE DATE: <i>6-16-04</i>								
W ₀ REFERENCE: <i>WELD CENTER LINE</i>			EXAM ANGLE	<i>60</i> DEG	<i>N</i> DEG						
L ₀ REFERENCE: <i>TOP DEAD CENTER</i>			CIRC. SCAN SENSITIVITY	<i>53</i> dB	<i>A</i> dB						
			AXIAL SCAN SENSITIVITY	<i>53</i> dB	<i>dB</i>						
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.
	L1	L MAX	L2	W MAX	MP MAX	D MAX					
							%	<i>3</i>	<i>60°S</i>	<input checked="" type="checkbox"/>	
							%	<i>4*</i>	<i>60°S</i>		
							%	<i>5</i>	<i>60°S</i>	<input checked="" type="checkbox"/>	
							%	<i>6</i>	<i>60°S</i>	<input checked="" type="checkbox"/>	
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
REMARKS / LIMITATIONS:											
<i>* NO SCAN A DUE TO CONFIGURATION</i>											
EXAMINER: <i>ROGER BENTLEY</i> <i>WRBentley</i>			LEVEL: <i>III</i>			ANI: <i>B. J. Rie</i>					
EXAMINER: <i>N/A</i>			LEVEL: <i>N/A</i>			DATE: <i>3/29/04</i>					
REVIEWER: <i>Andrew Duley</i>			LEVEL: <i>III</i>			DATE: <i>3-4-04</i>					
						PAGE <i>1</i> OF <i>10</i>					

TENNESSEE VALLEY AUTHORITY		DIGITAL ULTRASONIC CALIBRATION DATA SHEET			REPORT NUMBER: R081																																																																										
PROJECT: BFN UNIT 3 <small>web</small> CYCLE: 11		CALIBRATION DATE: 3-2-04			PROC.: N-UT-82 REV: 01 TC: N/A																																																																										
INSTR. MFG: KRAUTKRAMER DUE DATE: 10-1-04		CALIBRATION BLOCK NO.: WB-85 TEMP: 86 °F			SIMULATOR BLOCK NO: N/A																																																																										
MODEL/TYPE: USA 60 M&TE NO.: E36303		THERMOMETER S/N: 522390 DUE DATE: 6-16-04			TRANSducer MFG: KAA COMP G																																																																										
S/N 00FBTD SIZE: 0.379 FREQ: 2.25 MHz		COUPLANT ULTRAGEL II BATCH: D3125 M			EXAM TYPE: <input checked="" type="checkbox"/> SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input type="checkbox"/>																																																																										
CABLE TYPE: R4-174 LENGTH: 72 inches		ANGLE VERIFICATION			BLOCK TYPE: DSC S/N: A03671																																																																										
DAC		NOMINAL ANGLE: 70°			ACTUAL ANGLE: 67°																																																																										
<div style="display: flex; align-items: center;"> <table border="1" style="border-collapse: collapse; text-align: center;"> <tr><td>100</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>80</td><td></td><td></td><td></td><td>*</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>60</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>40</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>20</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>0</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table> <div style="margin-left: 10px; text-align: center;"> A M P L I T U D E </div> </div> <p>DISPLAY WIDTH: inches 2.60</p>		100												80				*								60												40												20												0												INSTRUMENT SETTINGS			REFLECTOR		
		100																																																																													
		80				*																																																																									
		60																																																																													
		40																																																																													
		20																																																																													
		0																																																																													
		SCAN DIRECT.			NTCH	SDH	REFERENCE SENSITIVITY		MEMORY NUMBER																																																																						
		AXIAL			<input type="checkbox"/>	<input type="checkbox"/>	KB dB																																																																								
		CIRC			<input type="checkbox"/>	<input type="checkbox"/>	dB																																																																								
*FREQ: 2.25 MHz			*REJECT: 0 %		*DAMPING: 1000 ohms																																																																										
ANGLE: 67° deg			*PULSER: HIGH		*PRR/PREF: AUTO HIGH																																																																										
DELAY: 7.5519 msec			*FILTER: FIXED		TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK																																																																										
ZERO: 0.015 msec			*DISPLAY MODE: <input checked="" type="checkbox"/> FULL WAVE		TCG: <input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF																																																																										
VELOCITY: 0.1246 msec			RANGE: 2.50 inches																																																																												
REF. REFLECTOR: N GAIN: dB		CALIBRATION TIMES																																																																													
AMPLITUDE: A METAL PATH:		INITIAL TIME: 1212		FINAL TIME: 1459																																																																											
VERIFICATION TIMES		1)	2)	3)	4)	5)	6)	7)	8)	9)																																																																					
* PDI QUALIFIED INSTRUMENT SETTINGS: VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !																																																																															
LINEARITY CHECK																																																																															
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	10																																																																				
	SIGNAL 2	50	45	40	35	30	25	20	15	10	5																																																																				
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6																																																																							
	AMP	80	32-48	16-24	20	64-96	40	64-96																																																																							
			40	20	80		80																																																																								
COMMENTS: * DISPLAY DELAY					WELDS/ITEMS EXAMINED:																																																																										
0 CAL ON 1/2" THICKNESS NOTCH					K/CL 3-007-900A																																																																										
EXAMINER: M. Bentley					EXAMINER: N/A			REVIEWER: Darlene Duley		ANI: B. J. Rice																																																																					
LEVEL: III		LEVEL: N/A			LEVEL: III		DATE: 3-4-04		DATE: 3/29/04																																																																						
								PG. 8 OF 16																																																																							


TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: <i>R081</i>				
PROJECT: <i>BN</i> UNIT: <i>3</i> CYCLE: <i>11</i>		EXAMINATION DATE: <i>3-2-04</i>									
PROCEDURE: <i>N-UT-B2</i> REV: <i>1</i> TC: <i>N/A</i>		START TIME: <i>1300</i>		END TIME: <i>1900</i>							
SYSTEM: <i>D68</i>	ISIDWG. NO: <i>3-151-0332-C</i>			EXAM SURFACE	<input type="checkbox"/> ID <input checked="" type="checkbox"/> OD						
COMPONENT ID: <i>RINCU 3-007-9004</i>			MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS								
CONFIGURATION <i>PIPE</i> TO <i>WAVE</i> <i>FLOW</i> →			SURFACE TEMP.: <i>100</i> °F PYRO. NO.: <i>522350</i>								
			CAL DUE DATE: <i>6-16-04</i>								
W ₀ REFERENCE: <i>WELD CENTER LINE</i>			EXAM ANGLE	<i>70</i> ° DEG	<i>N</i> DEG						
L ₀ REFERENCE: <i>TOP DEAD CENTER</i>			CIRC. SCAN SENSITIVITY	<i>48</i> dB	<i>A</i> dB						
			AXIAL SCAN SENSITIVITY	<i>N/A</i> dB	<i></i> dB						
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N° R I	IND. INFO: TYPE, DAMPING, ETC.
	L1	L MAX	L2	W MAX	MP MAX	D MAX					
<i>1</i>		<i>6.5</i>		<i>0.15</i>	<i>1.00</i>		<i>50</i> %	<i>3</i>	<i>70</i> 's		<i>Root Geometry*</i>
							%	<i>A*</i>	<i>70</i> 's		
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
REMARKS / LIMITATIONS:											
<i>* Root Geometry intermittent 360° at lower amplitudes</i>											
<i>* NO SCAN A DUE TO CONFIGURATION.</i>											
EXAMINER: <i>Roger Bentley</i>			LEVEL: <i>III</i>			ANI: <i>B.F. Rio</i>					
EXAMINER: <i>N/A</i>			LEVEL: <i>N/A</i>			DATE: <i>3/29/04</i>					
REVIEWER: <i>Douglas Daley</i>			LEVEL: <i>III</i>			DATE: <i>3-4-04</i>					
						PAGE <i>9</i> OF <i>16</i>					

<h1>TVA</h1>	<h2>WALL THICKNESS PROFILE SHEET</h2>	REPORT NO: R081
--------------	---------------------------------------	---------------------------


PROJECT: <u>BFN</u>	WELD NO: <u>RWCU 3-007-G004</u>
UNIT: <u>3 Cycle II</u>	SYSTEM: <u>DL9</u>

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	0.35	0.35		
2	0.375	0.364		
3	0.362	0.375		
4	N/A	N/A		
5	0.76	0.93		

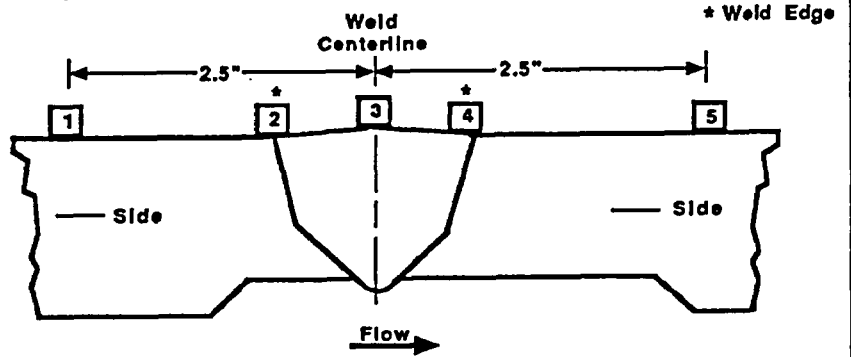


CROWN HEIGHT: <u>FLUSH</u>	DIAMETER: <u>4.5</u>
CROWN WIDTH: <u>0.30</u>	WELD LENGTH: <u>14.25</u>

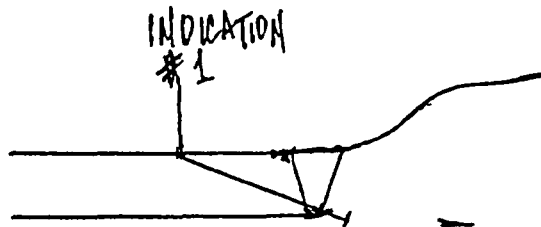

EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>B. J. Rice</u>
LEVEL: <u>III</u>	DATE: <u>3-4-04</u>	DATE: <u>3/29/04</u>
DATE: <u>3-2-04</u>		PAGE <u>10</u> OF <u>16</u>

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R081
-------------------------------	---	-------------------------------

PROJECT: BEN UNIT 3 ¹¹⁰⁰ CYCLE: 11	CALIBRATION DATE: 3-2-04
PROC.: N-11-82 REV: 01 TC: N/A	CALIBRATION BLOCK NO.: 11B-89 TEMP: 86 F
INSTR. MFG: KRAUTKRAMER DUE DATE: 10-1-04	SIMULATOR BLOCK NO: N/A
MODEL/TYPE: HSN 60 M & TE NO.: E 36303	THERMOMETER S/N: 922390 DUE DATE: 6-16-04
TRANSDUCER MFG: RTD TRLA (NOTE)	COUPLANT UTRAGEL II BATCH: 03129M
S/N 03-893 SIZE: 2(7x10) FREQ: 2.0 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG-174 LENGTH: 72 inches	ANGLE VERIFICATION

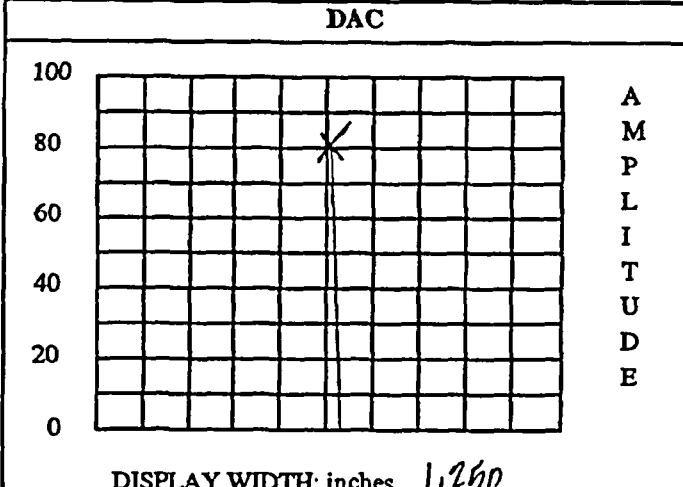

BLOCK TYPE: DSC	S/N: A03691			
NOMINAL ANGLE: 45°	ACTUAL ANGLE: 45°			
INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input type="checkbox"/>	41 dB	
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	dB	
*FREQ: 2.25 MHz	*REJECT: 0 %			
ANGLE: 45° deg	*DAMPING: 1000 ohms			
DELAY: 6.8981 msec	*PULSER: HIGH			
ZERO: 0.015 msec	FILTER: FIXED			
VELOCITY: 0.2279 msec	*PRR/PRF: AUTO HIGH			
RANGE: 1.240 inches	TOP: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK			
*DISPLAY MODE: FULL WAVE	TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>			

REF. REFLECTOR: N GAIN: dB	CALIBRATION TIMES								
AMPLITUDE: A METAL PATH:	INITIAL TIME: 1210	FINAL TIME: 1510							
VERIFICATION TIMES	1)	2)	3)	4)	5)	6)	7)	8)	9)

* PDI QUALIFIED INSTRUMENT SETTINGS:
 VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2
 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	10
	SIGNAL 2	50	45	40	35	30	25	20	15	10	5
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6			
	AMP	80	32-48	16-24	20	64-96	40	64-96			
			40	20		80		80			

COMMENTS: * DISPLAY DELAY	WELDS/ITEMS EXAMINED:
NOTE: FS=20MM SQUINT=10°	KRUCU 3-007-G004
0 CAL ON 1/2" THICKNESS NOTCH	


EXAMINER: <i>M. M. Bentley</i>	EXAMINER: N/A	REVIEWER: <i>Paula Bentley</i>	ANI: B. F. Rio
LEVEL: III	LEVEL: N/A	DATE: 3-24-04	DATE: 3/29/04
		PG. 11	OF 16

TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: 3081					
PROJECT: BFA UNIT: 3 CYCLE: 11			EXAMINATION DATE: 3-2-04									
PROCEDURE: N-UT-82 REV: 1 TC: N/A			START TIME: 1300 END TIME: 1900									
SYSTEM: 069 ISIDWG. NO: 3-151-0332-C			EXAM SURFACE <input type="checkbox"/> ID <input checked="" type="checkbox"/> OD									
COMPONENT ID: BWCU 3-007-600A			MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS									
CONFIGURATION PIPE TO VALVE FLOW $\xrightarrow{\hspace{2cm}}$			SURFACE TEMP.: 100 °F PYRO. NO.: 522350									
			CAL DUE DATE: 6-16-04									
W ₀ REFERENCE: WELD CENTER LINE			EXAM ANGLE		45° RL DEG		N DEG					
L ₀ REFERENCE: TOP DEAD CENTER			CIRC. SCAN SENSITIVITY		56 dB		A dB					
			AXIAL SCAN SENSITIVITY		56 dB		 dB					
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.	
	L1	L MAX	L2	W MAX	MP MAX	D MAX						
							%	3	45° RL	<input checked="" type="checkbox"/>		
							%	4*	45° RL			
							%	5	45° RL	<input checked="" type="checkbox"/>		
							%	6	45° RL	<input checked="" type="checkbox"/>		
							%					
							%					
							%					
							%					
							%					
							%					
							%					
							%					
							%					
REMARKS / LIMITATIONS:												
* NO SCAN A DUE TO CONFIGURATION.												
EXAMINER: ROGER BENTLEY <i>W.Bentley</i>			LEVEL: III				ANI: B.F. Rice					
EXAMINER: N/A			LEVEL: N/A				DATE: 3/29/04					
REVIEWER: Debrae Dooly			LEVEL: III				DATE: 3-4-04		PAGE 12 OF 16			

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R081
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT 3 CYCLE: 11	CALIBRATION DATE: 3-2-04
PROC.: N-UT-82 REV: 1 TC: N/A	CALIBRATION BLOCK NO.: 11B-85⁰ TEMP: 86 F
INSTR. MFG: KRAUTKRAMER DUE DATE: 10.1.04	SIMULATOR BLOCK NO.: N/A
MODEL/TYPE: USN-60 M & TE NO.: E36303	THERMOMETER S/N: 522350 DUE DATE: 6.16.04
TRANSDUCER MFG: RTD TRLA (NOTE)	COUPLANT ULTRAGEL II BATCH: 03125M
S/N 03-896 SIZE: 2(7x10) FREQ: 2.0 MHz	EXAM TYPE: <input type="checkbox"/> SHEAR <input type="checkbox"/> LONG <input checked="" type="checkbox"/> RL
CABLE TYPE: RG-174 LENGTH: 72 inches	

DAC		ANGLE VERIFICATION	
BLOCK TYPE: DSC	S/N: A03671	NOMINAL ANGLE: 60°	ACTUAL ANGLE: 60°

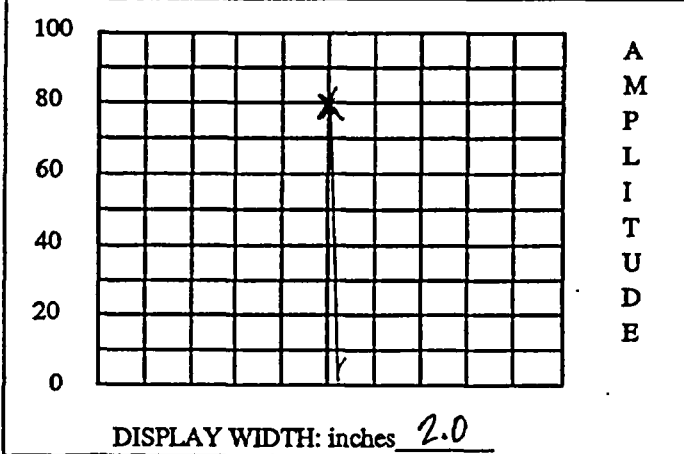

INSTRUMENT SETTINGS				
REFLECTOR			REFERENCE	MEMORY
SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
AXIAL	<input type="checkbox"/>	<input type="checkbox"/>	57 dB	
CIRC	<input type="checkbox"/>	<input type="checkbox"/>	dB	
*FREQ: 2.25 MHz			*REJECT: 0 %	
ANGLE: 60 deg			*DAMPING: 1000 ohms	
DELAY: 7.0259 msec			*PULSER: HIGH	
ZERO: 0.015 msec			FILTER: FIXED	
VELOCITY: 0.2246 msec			*PRR/PRF: AUTO HIGH	
RANGE: 2.00 inches			TOF: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK	
*DISPLAY MODE: FULL WAVE			TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>	

REF. REFLECTOR: N GAIN: dB	CALIBRATION TIMES	
AMPLITUDE: A METAL PATH:	INITIAL TIME: 1217	FINAL TIME: 1904
VERIFICATION TIMES	1) 2) 3)	4) 5) 6) 7) 8) 9)

* PDI QUALIFIED INSTRUMENT SETTINGS:
 VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2
 OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	10
	SIGNAL 2	50	40	40	36	30	29	20	19	10	9
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6			
	AMP	80	32-48	16-24	20	64-96	40	64-96			
			40	20		80		80			

COMMENTS: * DISPLAY DELAY	WELDS/ITEMS EXAMINED:
NOTE: FS=25 SQUINT=3°	RINCH 3-007-G004
QUAL ON 1/2" THICKNESS NOTCH	
SUPPLEMENTAL EXAM	

EXAMINER: <i>M. Bentley</i>	EXAMINER: N/A	REVIEWER: <i>Debra Dooloy</i>	ANI: B. F. Rico
LEVEL: III	LEVEL:	DATE: 3-4-04	DATE: 3/29/04
		PG. 13 OF 16	

TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: 3081				
PROJECT: WPA		UNIT: 3	CYCLE: 11		EXAMINATION DATE: 3-2-04						
PROCEDURE: N-UT-82		REV: 1	TC: N/A		START TIME: 1300		END TIME: 1500				
SYSTEM: 069		ISIDWG. NO: 3-151-D332-C			EXAM SURFACE <input type="checkbox"/> ID <input checked="" type="checkbox"/> OD						
COMPONENT ID: R1.01 3-007-6004		MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS			SURFACE TEMP.: 100 F		PYRO. NO.: 522350				
CONFIGURATION Pipe TO VALVE FLOW →					CAL DUE DATE: 6-16-04						
W ₀ REFERENCE: 1/2" CD CENTER LINE		EXAM ANGLE: 60° RL			CIRC. SCAN SENSITIVITY: 57 dB		N DEG: A				
L ₀ REFERENCE: TOP DEAD CENTER		AXIAL SCAN SENSITIVITY: 57 dB									
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.
	L1	L MAX	L2	W MAX	MP MAX	D MAX					
							%	3	60° RL	<input checked="" type="checkbox"/>	
							%	4*	60° RL		
							%	5	60° RL	<input checked="" type="checkbox"/>	
							%	6	60° RL	<input checked="" type="checkbox"/>	
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
REMARKS / LIMITATIONS:											
* NO SCAN 4 DUE TO CONFIGURATION											
EXAMINER: REGGIE BENNETT				LEVEL: III				ANI: B. F. Rios			
EXAMINER: N/A				LEVEL: N/A				DATE: 3/29/04			
REVIEWER: Darlene Duley				LEVEL: III				DATE: 3-4-04		PAGE 14 OF 16	

TENNESSEE VALLEY AUTHORITY	DIGITAL ULTRASONIC CALIBRATION DATA SHEET	REPORT NUMBER: R081
-------------------------------	---	-------------------------------

PROJECT: BFN UNIT 3	CYCLE: 11	CALIBRATION DATE: 3-2-04
PROC.: N-UT-B2	REV: 1 TC: N/A	CALIBRATION BLOCK NO.: 618-85⁰ TEMP: 86 F
INSTR. MFG: KRAUTKRAMER	DUE DATE: 10-7-04	SIMULATOR BLOCK NO: N/A
MODEL TYPE: US1-60	M & TE NO.: E-36303	THERMOMETER S/N: 522360 DUE DATE: 6-16-04
TRANSDUCER MFG: PTD TRIA (NTE)	COUPLANT ULTRAGEL II BATCH: 03125 M	
S/N 03-909 SIZE: 2(1x10)	FREQ: 2.0 MHz	EXAM TYPE: SHEAR <input type="checkbox"/> LONG <input type="checkbox"/> RL <input checked="" type="checkbox"/>
CABLE TYPE: RG-174	LENGTH: 172 inches	

DAC	ANGLE VERIFICATION
	BLOCK TYPE: DSC S/N: A-03671
	NOMINAL ANGLE: 70 ACTUAL ANGLE: 67°

100 80 60 40 20 0		A M P L I T U D E	INSTRUMENT SETTINGS				
			REFLECTOR		REFERENCE	MEMORY	
			SCAN DIRECT.	NTCH	SDH	SENSITIVITY	NUMBER
			AXIAL	<input type="checkbox"/>	<input type="checkbox"/>	69 dB	
			CIRC	<input type="checkbox"/>	<input type="checkbox"/>	dB	
			*FREQ: 2.25 MHz		*REJECT: 0 %		
			ANGLE: 67° deg		*DAMPING: 000 ohms		
			DELAY: 6.7450 msec		*PULSER: HIGH		
			ZERO: X 0.015 msec		FILTER: FIXED		
			VELOCITY: 0.2269 msec		*PRR/PRF: AUTO HIGH		
RANGE: 3.00 inches		TOP: <input checked="" type="checkbox"/> PEAK <input type="checkbox"/> FLANK					
*DISPLAY MODE: FULL WAVE		TCG: ON <input type="checkbox"/> OFF <input checked="" type="checkbox"/>					

DISPLAY WIDTH: inches **3.00**

REF. REFLECTOR: N	GAIN: dB	CALIBRATION TIMES		
AMPLITUDE: A	METAL PATH:	INITIAL TIME: 1211	FINAL TIME: 1919	
VERIFICATION TIMES	1) 2) 3)	4) 5) 6)	7) 8) 9)	

* PDI QUALIFIED INSTRUMENT SETTINGS:
VERIFY INSTRUMENT SETTINGS AND CALIBRATION SEQUENCE ARE IN ACCORDANCE WITH TABLE 2
OF THE APPLICABLE PDI QUALIFICATION IMPLEMENTATION PROCEDURE !

LINEARITY CHECK											
VERTICAL	SIGNAL 1	100	90	80	70	60	50	40	30	20	10
	SIGNAL 2	50	47	40	35	30	25	20	15	10	5
ATTENUATOR	GAIN	SET	-6 dB	-12 dB	SET	+12	SET	+6			
	AMP	80	32-48	16-24	20	64-96	40	64-96			
			40	40		80		80			

COMMENTS: * DISPLAY DELAY	WELDS/ITEMS EXAMINED:
NOTE: FS = 25 SQUINT = 6°	KMCU 3-007-6004
① CAL ON 1/2" THICKNESS NOTCH	
SUPPLEMENTAL EXAM	

EXAMINER: [Signature]	EXAMINER: N/A	REVIEWER: [Signature]	ANI: B. J. Rico
LEVEL: III	LEVEL: N/A	LEVEL: III	DATE: 3/29/04
		DATE: 3-2-04	PG. 15 OF 16

TENNESSEE VALLEY AUTHORITY			ULTRASONIC PIPING EXAMINATION DATA SHEET				REPORT NUMBER: R081				
PROJECT: BFN UNIT: 3 CYCLE: 11			EXAMINATION DATE: 3-2-04								
PROCEDURE: N-UT-82 REV: 1 TC: N/A			START TIME: 1300 END TIME: 1600								
SYSTEM: 069 ISI DWG. NO: 3-151-0332-C			EXAM SURFACE <input type="checkbox"/> ID <input checked="" type="checkbox"/> OD								
COMPONENT ID: RWCU 3-007-6004			MATL. TYPE: <input checked="" type="checkbox"/> CS <input checked="" type="checkbox"/> SS <input type="checkbox"/> CSCL <input type="checkbox"/> CCSS								
CONFIGURATION PIPE TO VALVE FLOW →			SURFACE TEMP.: 100 F PYRO. NO.: 522350								
			CAL DUE DATE: 6-16-04								
W ₀ REFERENCE: WELD CENTER LINE			EXAM ANGLE: 60° DEG		<input type="checkbox"/> N DEG						
L ₀ REFERENCE: TOP DEAD CENTER			CIRC. SCAN SENSITIVITY: 69 dB		<input type="checkbox"/> A dB						
			AXIAL SCAN SENSITIVITY: 69 dB		<input type="checkbox"/> dB						
IND. NO.	L (in) FROM REF.			AT MAX AMP			MAX AMP %DAC	EXAM NO. 3-14	NOM. ANG.	N R I	IND. INFO: TYPE, DAMPING, ETC.
	L1	L MAX	L2	W MAX	MP MAX	D MAX					
							%	3	70°RL	<input checked="" type="checkbox"/>	
							%	4*	70°RL		
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
							%				
REMARKS / LIMITATIONS:											
*NO SCAN & DUE TO CONFIGURATION											
EXAMINER: Roger Bentley			LEVEL: III			ANI: B. F. Rice					
EXAMINER: N/A			LEVEL: N/A			DATE: 3/29/04					
REVIEWER: Jaime Deloy			LEVEL: III			DATE: 3-4-04					
						PAGE: 16 OF 16					