

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8609110126 DOC. DATE: 86/09/02 NOTARIZED: NO DOCKET #
 FACIL: 50-438 Bellefonte Nuclear Plant, Unit 1, Tennessee Valley Au 05000438
 50-439 Bellefonte Nuclear Plant, Unit 2, Tennessee Valley Au 05000439
 AUTH. NAME RIVERS, M. E. AUTHOR AFFILIATION Tennessee Valley Authority
 RECIP. NAME RECIP. NAME Alabama, State of

SUBJECT: Forwards supplemental info for renewal of NPDES Permit AL-0024635. Info reflects current permit & subsequent correspondence last issued on 850508, including reductions in monitoring frequencies. *SG6 Rpt*

DISTRIBUTION CODE: COO1L COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 114
 TITLE: Licensing Submittal: Environmental Rept Amdt & Related Correspondence

NOTES: DIA lcy. Application for permit renewal filed. 05000438
 DIA lcy. Application for permit renewal filed. 05000439

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PWR-B EB	1 1	PWR-B PD6 LA 19	1 1
	PWR-B PD6 PD 18	1 1	KALMAN, G 04	1 1
INTERNAL:	ACRS 20	16 16	ADM/LFMB	1 0
	AEOD/PTB	1 1	ELD/HDB2	1 0
	NRR BWR ADTS	1 1	NRR PWR-B ADTS	1 1
	<u>REG FILE</u>	1 1	RGZ2	1 1
EXTERNAL:	LPDR 03	1 1	NRC PDR 02	1 1
	NSIC 05	1 1		
NOTES:		1 1		

TENNESSEE VALLEY AUTHORITY

KNOXVILLE, TENNESSEE 37902

SEP 2 1986

Permit Coordination Center
Alabama Department of
Environmental Management
1751 Federal Drive
Montgomery, Alabama 36130

Gentlemen:

BELLEFONTE NUCLEAR PLANT (BLN) - NPDES PERMIT NO. AL0024635 - RENEWAL APPLICATION

Enclosed are two copies of NPDES Forms 1 and 2C and the NPDES Supplementary Information Form for renewal of the BLN permit (Enclosure 1). A check for the appropriate permit fee is being provided under separate cover.

Proposed changes to the permit are requested and justified in Enclosure 2. Except for various changes for clarification and some reductions in monitoring frequencies, the permit application package reflects the current permit and subsequent correspondence (last issued May 8, 1985). While construction efforts at BLN have been reduced considerably (fuel load for Unit 1 is now projected for July 1993 instead of 1988), we have retained all of the discharges in the permit for continuity and operational flexibility.

Because of the reduction in the construction effort at BLN, some of the previously active discharges presently have no flow. For purposes of Form 2C, Item V, past Discharge Monitoring Report data have been summarized where applicable. For those operational discharges which have not previously had a discharge, waste characterization based on similar discharges at TVA's other nuclear plants have been used.

If you have any questions concerning the enclosed information, please call Madonna Martin at (615) 632-6695 in Knoxville, Tennessee.

Sincerely,



Martin E. Rivers, Director
Environmental Quality

Enclosures

cc: See page 2

Cool

8609110126 860902
PDR ADOCK 05000438
A PDR

Permit Coordination Center

SEP 2 1986

cc (Enclosures):

Dr. J. Nelson Grace, Regional Administrator
U.S. Nuclear Regulatory Commission, Region II
101 Marietta Street, NW., Suite 2900
Atlanta, Georgia 30303

Mr. B. Youngblood, Project Director
PWR Project Directorate No. 4
Division of Pressurized Water
Reactor (PWR) Licensing A
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

FORM 1 GENERAL LABEL ITEMS EPA I.D. NUMBER III. FACILITY NAME V. FACILITY MAILING ADDRESS VI. FACILITY LOCATION		U.S. ENVIRONMENTAL PROTECTION AGENCY GENERAL INFORMATION <i>Consolidated Permits Program</i> (Read the "General Instructions" before starting.)		I. EPA I.D. NUMBER FAL5640090002	
PLEASE PLACE LABEL IN THIS SPACE				GENERAL INSTRUCTIONS If a preprinted label has been provided, affix it in the designated space. Review the information carefully; if any of it is incorrect, cross through it and enter the correct data in the appropriate fill-in area below. Also, if any of the preprinted data is absent (the area to the left of the label space lists the information that should appear), please provide it in the proper fill-in area(s) below. If the label is complete and correct, you need not complete items I, III, V, and VI (except VI-B which must be completed regardless). Complete all items if no label has been provided. Refer to the instructions for detailed item descriptions and for the legal authorizations under which this data is collected.	

SPECIFIC QUESTIONS		MARK 'X'		SPECIFIC QUESTIONS		MARK 'X'			
		YES	NO	FORM ATTACHED			YES	NO	FORM ATTACHED
A. Is this facility a publicly owned treatment works which results in a discharge to waters of the U.S.? (FORM 2A)			X		B. Does or will this facility (either existing or proposed) include a concentrated animal feeding operation or aquatic animal production facility which results in a discharge to waters of the U.S.? (FORM 2B)			X	
C. Is this a facility which currently results in discharges to waters of the U.S. other than those described in A or B above? (FORM 2C)		X		X	D. Is this a proposed facility (other than those described in A or B above) which will result in a discharge to waters of the U.S.? (FORM 2D)			X	
E. Does or will this facility treat, store, or dispose of hazardous wastes? (FORM 3)			X		F. Do you or will you inject at this facility industrial or municipal effluent below the lowermost stratum containing, within one quarter mile of the well bore, underground sources of drinking water? (FORM 4)			X	
G. Do you or will you inject at this facility any produced water or other fluids which are brought to the surface in connection with conventional oil or natural gas production, inject fluids used for enhanced recovery of oil or natural gas, or inject fluids for storage of liquid hydrocarbons? (FORM 4)			X		H. Do you or will you inject at this facility fluids for special processes such as mining of sulfur by the Frasch process, solution mining of minerals, in situ combustion of fossil fuel, or recovery of geothermal energy? (FORM 4)			X	
I. Is this facility a proposed stationary source which is one of the 28 industrial categories listed in the instructions and which will potentially emit 100 tons per year of any air pollutant regulated under the Clean Air Act and may affect or be located in an attainment area? (FORM 5)			X		J. Is this facility a proposed stationary source which is NOT one of the 28 industrial categories listed in the instructions and which will potentially emit 250 tons per year of any air pollutant regulated under the Clean Air Act and may affect or be located in an attainment area? (FORM 5)			X	

III. NAME OF FACILITY	
1	SKIP BELLEFONTE NUCLEAR PLANT

IV. FACILITY CONTACT			
A. NAME & TITLE (last, first, & title)		B. PHONE (area code & no.)	
2	RUSSELL RAY N	205	254 5536

V. FACILITY MAILING ADDRESS			
A. STREET OR P.O. BOX			
3	PO BOX 2000		
B. CITY OR TOWN		C. STATE	D. ZIP CODE
4	HOLLYWOOD	AL	35752

VI. FACILITY LOCATION					
A. STREET, ROUTE NO. OR OTHER SPECIFIC IDENTIFIER					
5	7 MILES NE SCOTTSBORO, ALABAMA				
B. COUNTY NAME					
6	JACKSON				
C. CITY OR TOWN			D. STATE	E. ZIP CODE	F. COUNTY CODE (if known)
6	HOLLYWOOD		AL	35752	

CONTINUED FROM THE FRONT

VII. SIC CODES (4-digit, in order of priority)

A. FIRST				B. SECOND			
C	7	4	9	1	1	C	7
13	14	15	16	17	18	19	20
(specify) ELECTRIC POWER GENERATION				(specify)			
C. THIRD				D. FOURTH			
C	7	C	7				
13	14	15	16				
(specify)				(specify)			

VIII. OPERATOR INFORMATION

A. NAME												B. Is the name listed in Item VIII-A also the owner?			
C	8 TENNESSEE VALLEY AUTHORITY											<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO			
13	14	15	16	17	18	19	20	21	22	23	24	25	26		
C. STATUS OF OPERATOR (Enter the appropriate letter into the answer box; if "Other", specify.)										D. PHONE (area code & no.)					
F - FEDERAL		M - PUBLIC (other than federal or state)		O - OTHER (specify)		F (specify)		C	6		1		5		
S - STATE		O - OTHER (specify)						A	6		3		2		
P - PRIVATE								13	16		19		22		
E. STREET OR P.O. BOX															
201 SUMMER PLACE BLDG															
F. CITY OR TOWN												G. STATE	H. ZIP CODE	IX. INDIAN LAND	
B KNOXVILLE												TN	37902	Is the facility located on Indian lands?	
														<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	

X. EXISTING ENVIRONMENTAL PERMITS

A. NPDES (Discharges to Surface Water)						D. PBD (Air Emissions from Proposed Sources)					
C	9	N	A L 0 0 2 4 6 3 5			C	9	P			
13	14	15	16	17	18	19	20	21	22	23	24
B. UIC (Underground Injection of Fluids)						E. OTHER (specify)					
C	9	U				C	9	A	L 5 6 4 0 0 9 0 0 0 2		
13	14	15	16	17	18	19	20	21	22	23	24
						(specify) HAZARDOUS WASTE GENERATOR IDENTIFICATION NO.					
C. RCRA (Hazardous Wastes)						E. OTHER (specify)					
C	9	R				C	9				
13	14	15	16	17	18	19	20	21	22	23	24
						(specify)					

XI. MAP

Attach to this application a topographic map of the area extending to at least one mile beyond property boundaries. The map must show the outline of the facility, the location of each of its existing and proposed intake and discharge structures, each of its hazardous waste treatment, storage, or disposal facilities, and each well where it injects fluids underground. Include all springs, rivers and other surface water bodies in the map area. See instructions for precise requirements.

XII. NATURE OF BUSINESS (provide a brief description)

PRODUCTION OF ELECTRIC POWER BY THERMONUCLEAR FISSION AND OTHER ASSOCIATED OPERATIONS.

XIII. CERTIFICATION (see instructions)

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attachments and that, based on my inquiry of those persons immediately responsible for obtaining the information contained in the application, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.

A. NAME & OFFICIAL TITLE (type or print)		B. SIGNATURE		C. DATE SIGNED	
M.E. RIVERS DIRECTOR ENVIRONMENTAL QUALITY					

COMMENTS FOR OFFICIAL USE ONLY

C	
13	14

Alabama Department of Environmental Management
Water Division—Industrial Waste Control Section
NPDES Permit Application • Supplementary Information

Instructions: This form should be typed or printed in ink. Do not complete shaded blocks.

1. CARD **20** FACILITY # **11111111** FACILITY NAME **BELLEFONTE NUCLEAR PLT**
 1 2 3 10 15 36
 FACILITY LOCATION **JACKSON COUNTY ALA** FACILITY CITY **HOLLYWOOD ALABAMA**
 37 56 57 74
AL AREA **111** CARD CODE **1**
 75 76 77 79 80

2. CARD **21** FACILITY # **11111111** PRIMARY SIC CODE **A 4911** SECONDARY SIC CODE **20 23** MAJ/MIN **1** NPDES PERMIT # (if known) **AL0024635** CARD CODE **R0**
 1 2 3 10 15 16 19 20 23 28 29 37 80

3. CARD **22** FACILITY # **11111111** RESPONSIBLE OFFICIAL OR CORPORATE OFFICER * **W. E. RIVERS** TITLE **DIR ENVI QUAL**
 1 2 3 10 15 29 30 41
 MAILING ADDRESS **201 SUMMER PL BLDG** CITY **KNOXVILLE** STATE **TN** ZIP CODE **37902** CARD CODE **R0**
 42 60 61 72 73 74 75 79 80

4. CARD **23** FACILITY # **11111111** FACILITY CONTACT PERSON **RAY W RUSSELL** TITLE **SIRV MNGR**
 1 2 3 10 15 29 30 39
 MAILING ADDRESS **PO BOX 2000** CITY **HOLLYWOOD** STATE **AL**
 40 60 61 72 73 74
 ZIP CODE **35752** CARD CODE **1**
 75 79 80

5. CARD **24** FACILITY # **11111111** CONTACT TELEPHONE # **205 - 259 - 5536** CARD CODE **1**
 1 2 3 10 15 17 18 20 21 24 80

* See Attached 'Signatory Requirements for Permit Applications' for proper person(s)

6. Parent corporation of applicant, if any, and mailing address: NOT APPLICABLE

7. Subsidiary corporation(s) of applicant operating in Alabama, if any: NOT APPLICABLE

8. Permit numbers and/or names of any Alabama water pollution control permits presently held by the applicants parent or subsidiary corporations:

<u>Permit Name</u>	<u>Permit #</u>	<u>Held By</u>
NOT APPLICABLE		

9. Provide a description of the location of all sites involved in the storage of solid or liquid waste generated by the facility for which the NPDES application is being made. Where possible the locations should be noted on the map required by item XI of the NPDES application being made:

<u>Description of Waste</u>	<u>Description of Storage Location</u>
CHEMICAL METAL CLEANING WASTE	APPROXIMATELY 1 MILLION GALLON RUBBER LINED POND LOCATED APPROXIMATELY 1/4-MILE NORTH WEST OF THE REACTOR BUILDING
ALUM SLUDGE	ASPHALT LINED PONDS LOCATED APPROXIMATELY 1/4-MILE SOUTH WEST OF THE REACTOR BUILDING
SUMP COLLECTION PONDS	TWIN 750,000 GALLON RIPRAP-LINED PONDS LOCATED APPROXIMATELY 1/2-MILE SOUTH OF THE REACTOR BUILDING

6. Parent corporation of applicant, if any, and mailing address: NOT APPLICABLE
7. Subsidiary corporation(s) of applicant operating in Alabama, if any: NOT APPLICABLE
8. Permit numbers and/or names of any Alabama water pollution control permits presently held by the applicants' parent or subsidiary corporations:

<u>Permit Name</u>	<u>Permit #</u>	<u>Held By</u>
<u>NOT APPLICABLE</u>		

9. Provide a description of the location of all sites involved in the storage of solid or liquid waste generated by the facility for which the NPDES application is being made. Where possible the locations should be noted on the map required by item XI of the NPDES application being made:

<u>Description of Waste</u>	<u>Description of Storage Location</u>
<u>PHOSPHATE METAL CLEANING WASTE</u>	<u>2.6 ACRE AND 7.5 ACRE EARTHEN PONDS LOCATED APPROXIMATELY 1/4 MILE NORTH WEST OF THE REACTOR BLDG. *</u>

* NOTE: THESE PONDS HAVE TO DATE BEEN USED AS STORAGE PONDS FOR LAND APPLICATION OF PHOSPHATE METAL CLEANING WASTE AS APP'D BY AQEM ON MARCH 22, 1984. NO PHOSPHATE METAL CLEANING IS ANTICIPATED BEFORE 1992. THEREFORE DIKES OF THESE PONDS HAVE BEEN BREACHED AS APP'D BY AQEM ON JUNE 10, 1986.

10. Provide a description of the location of the ultimate disposal sites of solid or liquid waste by products (such as sludges) from any treatment system for which this NPDES application is being made.

Description of Waste

Description of Ultimate Disposal

PHOSPHATE METAL CLEANING WASTE

LAND APPLICATION ONSITE. APPROVED BY
ADEM ON MARCH 22, 1984

SLUDGE FROM EXTENDED AERATION
SEWAGE TREATMENT PLANT

DISPOSAL BY PRIVATE CONTRACTOR IN CITY OF
SCOTTSBORO, ALABAMA MUNICIPAL SEWAGE
TREATMENT PLANT

11. The information in this form must be certified by a responsible official, as defined by NPDES regulations (See attached 'Signatory Requirements for Permit Applications')

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information including the possibility of fine and imprisonment for knowing violations.

M. E. RIVERS
DIR. ENVIRONMENTAL QUALITY

Name and Title of Responsible Official

Signature

Date Signed

BELLEFONTE NUCLEAR PLANT
NPDES PERMIT NO. AL0024635

FORM 2C ITEM V
SUPPLEMENTARY INFORMATION

The following outfall numbers either designate (1) plant raw water intake functions and are without limitation; or (2) operational discharges which have not begun discharging. Therefore, item V has not been completed for these outfalls.

Outfall number 011
Outfall number 013
Outfall number 015
Outfall number 016
Outfall number 017

FORM
20
 NPDES



U.S. ENVIRONMENTAL PROTECTION AGENCY
 APPLICATION FOR PERMIT TO DISCHARGE WASTEWATER
 EXISTING MANUFACTURING, COMMERCIAL, MINING AND SILVICULTURAL OPERATIONS
 Consolidated Permits Program

I. OUTFALL LOCATION

For each outfall, list the latitude and longitude of its location to the nearest 15 seconds and the name of the receiving water.

A. OUTFALL NUMBER (list)	B. LATITUDE			C. LONGITUDE			D. RECEIVING WATER (name)
	1. DEG.	2. MIN.	3. SEC.	1. DEG.	2. MIN.	3. SEC.	
002	34	43	00	85	56	00	TOWN CREEK
003	34	42	00	85	55	15	TENNESSEE RIVER
004	34	42	30	85	56	15	TOWN CREEK
001	34	42	00	85	55	15	TENNESSEE RIVER
Note: ALL OTHER OUTFALL NUMBERS ARE INTERNAL MONITORING POINTS DISCHARGING THROUGH OUTFALL NUMBER 003 LOCATED AS SHOWN ABOVE.							

II. FLOWS, SOURCES OF POLLUTION, AND TREATMENT TECHNOLOGIES

- A. Attach a line drawing showing the water flow through the facility. Indicate sources of intake water, operations contributing wastewater to the effluent, and treatment units labeled to correspond to the more detailed descriptions in Item B. Construct a water balance on the line drawing by showing average flows between intakes, operations, treatment units, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide a pictorial description of the nature and amount of any sources of water and any collection or treatment measures.
- B. For each outfall, provide a description of: (1) All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water, and storm water runoff; (2) The average flow contributed by each operation; and (3) The treatment received by the wastewater. Continue on additional sheets if necessary.

1. OUTFALL NO (list)	2. OPERATION(S) CONTRIBUTING FLOW		3. TREATMENT		
	A. OPERATION (list)	B. AVERAGE FLOW (include units)	A. DESCRIPTION	B. LIST CODES FROM TABLE 2C-1	
001	CONSTRUCTION DOMESTIC SEWAGE. ALSO MAY RECEIVE FLOW FROM THE FOLLOWING:	0.032 MGD	THREE EXTENDED AERATION PACKAGE SEWAGE TREATMENT PLANTS IN PARALLEL;	1	L
			1-30,000 GPD, 2-15,000 GPD, WITH FLOW EQUALIZATION.	1	U
			WASTE SLUDGE PERIODICALLY REMOVED BY PRIVATE CONTRACTOR FOR DISPOSAL IN SCOTTSBORO, AL. SEWAGE TREATMENT PLANT.	5	A
	1. PHOSPHATE METAL CLEANING WASTE POND DISCHARGE (OUTFALL NUMBER 001A) TO THE CONSTRUCTION STP EFFLUENT.	UNKNOWN	TO DATE THIS WASTEWATER HAS BEEN DISPOSED OF BY LAND APPLICATION ONSITE FOLLOWING SEDIMENTATION IN 2.6 ACRE AND 7.5 ACRE STORAGE PONDS OPERATED IN PARALLEL.	1	F
			DISCHARGE TO THE EFFLUENT OF THE CONSTRUCTION STP IS A FUTURE DISPOSAL OPTION WHICH WOULD FOLLOW CHEMICAL TREATMENT IN THE STORAGE PONDS AS NECESSARY. SLUDGES MAY BE REMOVED, IF NECESSARY.	1	U
				5	Q

OFFICIAL USE ONLY (effluent guidelines sub-categories)

Please print or type in the unshaded areas only.

EPA I.D. NUMBER (copy from Item 1 of Form 1)
AL5640090002

Form Approved OMB No. 158-R0173

FORM
2C
 NPDES



U.S. ENVIRONMENTAL PROTECTION AGENCY
APPLICATION FOR PERMIT TO DISCHARGE WASTEWATER
EXISTING MANUFACTURING, COMMERCIAL, MINING AND SILVICULTURAL OPERATIONS
Consolidated Permits Program

I. OUTFALL LOCATION

For each outfall, list the latitude and longitude of its location to the nearest 15 seconds and the name of the receiving water.

A. OUTFALL NUMBER (list)	B. LATITUDE			C. LONGITUDE			D. RECEIVING WATER (name)
	1. DEG.	2. MIN.	3. SEC.	1. DEG.	2. MIN.	3. SEC.	

II. FLOWS, SOURCES OF POLLUTION, AND TREATMENT TECHNOLOGIES

A. Attach a line drawing showing the water flow through the facility. Indicate sources of intake water, operations contributing wastewater to the effluent and treatment units labeled to correspond to the more detailed descriptions in Item B. Construct a water balance on the line drawing by showing average flows between intakes, operations, treatment units, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide a pictorial description of the nature and amount of any sources of water and any collection or treatment measures.

B. For each outfall, provide a description of: (1) All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water, and storm water runoff; (2) The average flow contributed by each operation; and (3) The treatment received by the wastewater. Continue on additional sheets if necessary.

1. OUTFALL NO (list)	2. OPERATION(S) CONTRIBUTING FLOW		3. TREATMENT	
	a. OPERATION (list)	b. AVERAGE FLOW (include units)	e. DESCRIPTION	d. LIST CODES FROM TABLE 2C-1
001 Cont.			FOR DISPOSAL IN AN APPROVED LANDFILL.	
	2. CHEMICAL METAL CLEANING WASTE TREATMENT POND EFFLUENT (OUTFALL NUMBER 001B) TO INFLUENT OR EFFLUENT OF THE CONSTRUCTION STP.	47,000 GPD	TO DATE THIS WASTEWATER HAS BEEN DISCHARGED TO THE STP EFFLUENT FOLLOWING IN-POND NEUTRALIZATION. OPTIONS INCLUDE IN-POND CHEMICAL TREATMENT AND/OR TREATMENT BY THE CONSTRUCTION STP. SLUDGES WILL BE REMOVED AT CONSTRUCTION COMPLETION FOR DISPOSAL VIA AN APPROVED DISPOSAL METHOD.	1 F 2 K 5 Q
002	CONSTRUCTION HOLDING POND EFFLUENT WHICH RECEIVES FLOW FROM THE FOLLOWING:			
	1. CONSTRUCTION RAINFALL RUNOFF	60,000 GPD (BASED UPON ANNUAL AVERAGE PRECIPITATION)	PERMANENT YARD DRAINAGE POND WITH CAPACITY OF 40.1 ACRE- FEET WITH OIL SKIMMING WHICH DISCHARGES TO A 18.4 ACRE- FEET CONSTRUCTION HOLDING	1 U

OFFICIAL USE ONLY (effluent guidelines sub-categories)

Please print or type in the unshaded areas only.

EPA I.D. NUMBER (copy from Item 1 of Form 1)
AL5640090002

Form Approved OMB No. 158-R0173

FORM
2C
 NPDES



U.S. ENVIRONMENTAL PROTECTION AGENCY
 APPLICATION FOR PERMIT TO DISCHARGE WASTEWATER
 EXISTING MANUFACTURING, COMMERCIAL, MINING AND SILVICULTURAL OPERATIONS
 Consolidated Permits Program

I. OUTFALL LOCATION

For each outfall, list the latitude and longitude of its location to the nearest 15 seconds and the name of the receiving water.

A. OUTFALL NUMBER (list)	B. LATITUDE			C. LONGITUDE			D. RECEIVING WATER (name)
	1. DEG.	2. MIN.	3. SEC.	1. DEG.	2. MIN.	3. SEC.	

II. FLOWS, SOURCES OF POLLUTION, AND TREATMENT TECHNOLOGIES

- A. Attach a line drawing showing the water flow through the facility. Indicate sources of intake water, operations contributing wastewater to the effluent, and treatment units labeled to correspond to the more detailed descriptions in Item B. Construct a water balance on the line drawing by showing average flows between intakes, operations, treatment units, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide a pictorial description of the nature and amount of any sources of water and any collection or treatment measures.
- B. For each outfall, provide a description of: (1) All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water, and storm water runoff; (2) The average flow contributed by each operation; and (3) The treatment received by the wastewater. Continue on additional sheets if necessary.

1. OUTFALL NUMBER (list)	2. OPERATION(S) CONTRIBUTING FLOW		3. TREATMENT		
	A. OPERATION (list)	B. AVERAGE FLOW (include units)	C. DESCRIPTION	D. LIST CODES FROM TABLE 2C-1	
002 Cont.			POND WITH OIL SKIMMING.		
	2. YARD DRAINAGE	603,000 GPD (BASED ON ANNUAL AVERAGE PRECIPITATION)	YARD DRAINAGE POND AND CONSTRUCTION HOLDING POND	1	U
	3. CONCRETE MIXING PLANT WASTES (OUTFALL NUMBERS 009 AND 010)	80,000 GPD	2.2 ACRE-FEET PLANT AND TRUCK WASHWATER SETTLING POND WITH OIL SKIMMING AND 1.4 ACRE-FEET AGGREGATE WASHWATER SETTLING POND WITH OIL SKIMMING WITH A COMBINED DISCHARGE TO YARD DRAINAGE POND; SETTLING IMPOUNDMENT FOR AGGREGATE PILE SPRAY RUNOFF WHICH DISCHARGES TO YARD DRAINAGE POND.	1 5	U Q
003	DIFFUSER DISCHARGE WHICH RECEIVES FLOW FROM THE FOLLOWING:		MIXING BY SUBMERGED MULTIPOINT DIFFUSERS	1	0

OFFICIAL USE ONLY (effluent guidelines sub-categories)

FORM
2C
 NPDES



U.S. ENVIRONMENTAL PROTECTION AGENCY
 APPLICATION FOR PERMIT TO DISCHARGE WASTEWATER
EXISTING MANUFACTURING, COMMERCIAL, MINING AND SILVICULTURAL OPERATIONS
 Consolidated Permits Program

I. OUTFALL LOCATION

For each outfall, list the latitude and longitude of its location to the nearest 15 seconds and the name of the receiving water.

A. OUTFALL NUMBER (list)	B. LATITUDE			C. LONGITUDE			D. RECEIVING WATER (name)
	1. DEG.	2. MIN.	3. SEC.	1. DEG.	2. MIN.	3. SEC.	

II. FLOWS, SOURCES OF POLLUTION, AND TREATMENT TECHNOLOGIES

A. Attach a line drawing showing the water flow through the facility. Indicate sources of intake water, operations contributing wastewater to the effluent and treatment units labeled to correspond to the more detailed descriptions in Item B. Construct a water balance on the line drawing by showing average flows between intakes, operations, treatment units, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide pictorial description of the nature and amount of any sources of water and any collection or treatment measures.

B. For each outfall, provide a description of: (1) All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater cooling water, and storm water runoff; (2) The average flow contributed by each operation; and (3) The treatment received by the wastewater. Continue on additional sheets if necessary.

1. OUTFALL NO. (list)	2. OPERATION(S) CONTRIBUTING FLOW		3. TREATMENT		
	B. OPERATION (list)	B. AVERAGE FLOW (include units)	4. DESCRIPTION	D. LIST CODES FROM TABLE 2C.1	
003 Cont.	1. ESSENTIAL RAW COOLING WATER SYSTEM TEST FLOWS.	36,000,000 GPD	DECHLORINATION (WHEN NECESSARY).	2	E
	2. RAW SERVICE WATER SYSTEM TEST FLOWS AND CONSTRUCTION PHASE MAKEUP	364,000 GPD	NEUTRALIZATION OF DEMINERALIZER WASTES, TWO 2.3 ACRE-FEET SUMP COLLECTION	2	K
	DEMINERALIZER SPENT REGENERANT DISCHARGE.		SETTLING PONDS WITH OIL SKIMMING.	1	U
	3. COOLING TOWER BLOWDOWN (OUTFALL NUMBER 014) DURING PLANT OPERATION	65,304,000 GPD	DECHLORINATION (WHEN NECESSARY).	2	E
	WHICH INCLUDES RECIRCULATED:				
	A. MAKEUP DEMINERALIZER SPENT REGENERANTS (OUTFALL NUMBER 015).	48,000 GPD	NEUTRALIZATION, PARTIAL EVAPORATION.	2	K
	B. OPERATIONAL SEWAGE TREATMENT PLANT EFFLUENT (OUTFALL NUMBER 012).	36,000 GPD	THREE 12,000 GPD SEPTIC TANK SAND FILTER SEWAGE TREATMENT PLANTS IN PARALLEL WITH FLOW EQUALIZATION FOLLOWED BY PARTIAL EVAPORATION.	1	L
				1	U
				3	C
				1	V
				1	F
				5	B

OFFICIAL USE ONLY (effluent guidelines sub-categories)

FORM
2C
NPDES



U.S. ENVIRONMENTAL PROTECTION AGENCY
APPLICATION FOR PERMIT TO DISCHARGE WASTEWATER
EXISTING MANUFACTURING, COMMERCIAL, MINING AND SILVICULTURAL OPERATIONS
Consolidated Permits Program

I. OUTFALL LOCATION

For each outfall, list the latitude and longitude of its location to the nearest 15 seconds and the name of the receiving water.

A. OUTFALL NUMBER (list)	B. LATITUDE			C. LONGITUDE			D. RECEIVING WATER (name)
	1. DEG.	1. MIN.	1. SEC.	1. DEG.	1. MIN.	1. SEC.	

II. FLOWS, SOURCES OF POLLUTION, AND TREATMENT TECHNOLOGIES

A. Attach a line drawing showing the water flow through the facility; indicate sources of intake water, operations contributing wastewater to the effluent, and treatment units tapered to correspond to the more detailed descriptions in Item B. Construct a water balance on the line drawing by showing average flows between intakes, operations, treatment units, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide a pictorial description of the nature and amount of any sources of water and any collection or treatment measures.

B. For each outfall, provide a description of: (1) All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water, and storm water runoff; (2) The average flow contributed by each operation; and (3) The treatment received by the wastewater. Continue on additional sheets if necessary.

1. OUTFALL NO. (list)	2. OPERATION(S) CONTRIBUTING FLOW		3. TREATMENT	
	A. OPERATION (list)	D. AVERAGE FLOW (include units)	B. DESCRIPTION	C. LIST CODES FOR TABLE 2C-1
003 Cont.	C. COOLING TOWER	UNKNOWN	GRIT ACCUMULATED IN THE	1 U
	DESILTING BASIN.		COOLING TOWER WILL BE	1 F
	(OUTFALL NUMBER 016)		PERIODICALLY FLUSHED TO A	5 Q
			SETTLING POND. SLUDGE REMOVED FROM THE POND AS NECESSARY FOR DISPOSAL IN AN APPROVED LANDFILL.	
	4. CONDENSATE DEMINERALIZER SPENT REGENERANTS	180,000 GPD	NEUTRALIZATION, DIATOMACEOUS EARTH FILTRATION.	2 K 1 C
	(OUTFALL NUMBER 013).			
	5. SUMP COLLECTION PONDS		SEDIMENTATION WITH OIL SKIMMING.	1 U
	(OUTFALL NUMBER 007) DISCHARGE WHICH RECEIVES FLOW FROM THE FOLLOWING:			
	A. BUILDING SUMPS AND DRAINS.	745,000 GPD	OIL SKIMMING ON PART OF DISCHARGE.	
	B. ALUM SLUDGE SETTLING PONDS.	31,000 GPD	TWO 0.5 ACRE-FEET ALUM SLUDGE SETTLING PONDS. SLUDGE WILL BE DISPOSED OF IN AN APPROVED DISPOSAL SITE.	1 U 5 Q
	C. AUXILIARY BOILER BLOWDOWN		NONE	

OFFICIAL USE ONLY (do not include such categories)

FORM
20
 NPDES



U.S. ENVIRONMENTAL PROTECTION AGENCY
 APPLICATION FOR PERMIT TO DISCHARGE WASTEWATER
 EXISTING MANUFACTURING, COMMERCIAL, MINING AND SILVICULTURAL OPERATIONS
 Consolidated Permits Program

I. OUTFALL LOCATION

For each outfall, list the latitude and longitude of its location to the nearest 15 seconds and the name of the receiving water.

A. OUTFALL NUMBER (list)	B. LATITUDE			C. LONGITUDE			D. RECEIVING WATER (name)
	1. DEG.	2. MIN.	3. SEC.	1. DEG.	2. MIN.	3. SEC.	

II. FLOWS, SOURCES OF POLLUTION, AND TREATMENT TECHNOLOGIES

A. Attach a line drawing showing the water flow through the facility. Indicate sources of intake water, operations contributing wastewater to the effluent and treatment units labeled to correspond to the more detailed descriptions in Item B. Construct a water balance on the line drawing by showing average flows between intakes, operations, treatment units, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide a pictorial description of the nature and amount of any sources of water and any collection or treatment measures.

B. For each outfall, provide a description of: (1) All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water, and storm water runoff; (2) The average flow contributed by each operation; and (3) The treatment received by the wastewater. Continue on additional sheets if necessary.

1. OUTFALL NO. (list)	2. OPERATION(S) CONTRIBUTING FLOW		3. TREATMENT				
	B. OPERATION (list)	D. AVERAGE FLOW (include units)	B. DESCRIPTION	D. LIST CODES FROM TABLE 20-1			
003 Cont.	6. LIQUID RADWASTE SYSTEM (OUTFALL NUMBER 011).	350,000 GPD	EVAPORATION, AND ION	1	F		
			EXCHANGE. SLUDGE IS	2	J		
			DISPOSED OF AS LOW LEVEL				
			RADIOACTIVE WASTE.				
004	EAST CULVERT IMPOUNDMENT. (BASED UPON ANNUAL AVERAGE PRECIPITATION.	217,000 GPD	EAST CULVERT IMPOUNDMENT	1	U		
			WITH CAPACITY OF 2.9 ACRE-				
			FEET.				
005	INTAKE TRASH SLUICE WHICH RECEIVES FLOW FROM THE FOLLOWING:						
			1. INTAKE SCREEN AND STRAINER BACKWASH.	664,000 GPD	NONE		
			2. BUILDING DRAINAGE.	36,000 GPD	OIL SKIMMING ON PART OF THE DRAINAGE.		
017	PLANT RAW WATER INTAKE	100,000,000 GPD	THIS IS NOT A WASTEWATER				
			OUTFALL. LISTED AS A SERIAL				
			IDENTIFICATION NUMBER FOR				
			MONITORING PURPOSES ONLY.				
			WASTEWATER TREATMENT IS NOT				
			REQUIRED. TREATMENT FOR				

OFFICIAL USE ONLY (effluent guidelines sub-categories)

FORM 20 NPDES



U.S. ENVIRONMENTAL PROTECTION AGENCY APPLICATION FOR PERMIT TO DISCHARGE WASTEWATER EXISTING MANUFACTURING, COMMERCIAL, MINING AND SILVICULTURAL OPERATIONS Consolidated Permits Program

I. OUTFALL LOCATION

For each outfall, list the latitude and longitude of its location to the nearest 15 seconds and the name of the receiving water.


Table with columns: A. OUTFALL NUMBER (list), B. LATITUDE (1. DEG., 2. MIN., 3. SEC.), C. LONGITUDE (1. DEG., 2. MIN., 3. SEC.), D. RECEIVING WATER (name). The table is mostly empty with some diagonal lines.

II. FLOWS, SOURCES OF POLLUTION, AND TREATMENT TECHNOLOGIES

- A. Attach a line drawing showing the water flow through the facility. Indicate sources of intake water, operations contributing wastewater to the effluent and treatment units labeled to correspond to the more detailed descriptions in Item B. Construct a water balance on the line drawing by showing average flows between intakes, operations, treatment units, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide pictorial description of the nature and amount of any sources of water and any collection or treatment measures.
B. For each outfall, provide a description of: (1) All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water, and storm water runoff; (2) The average flow contributed by each operation; and (3) The treatment received by the wastewater. Continue on additional sheets if necessary.

Table with columns: 1. OUTFALL NO. (list), 2. OPERATION(S) CONTRIBUTING FLOW (a. OPERATION (list), b. AVERAGE FLOW (include units)), 3. TREATMENT (a. DESCRIPTION, b. LIST CODES FROM TABLE 2C-1). Contains entry for outfall 017 with description of aquatic control measures and a note about other outfalls.

OFFICIAL USE ONLY (effluent guidelines sub-categories)

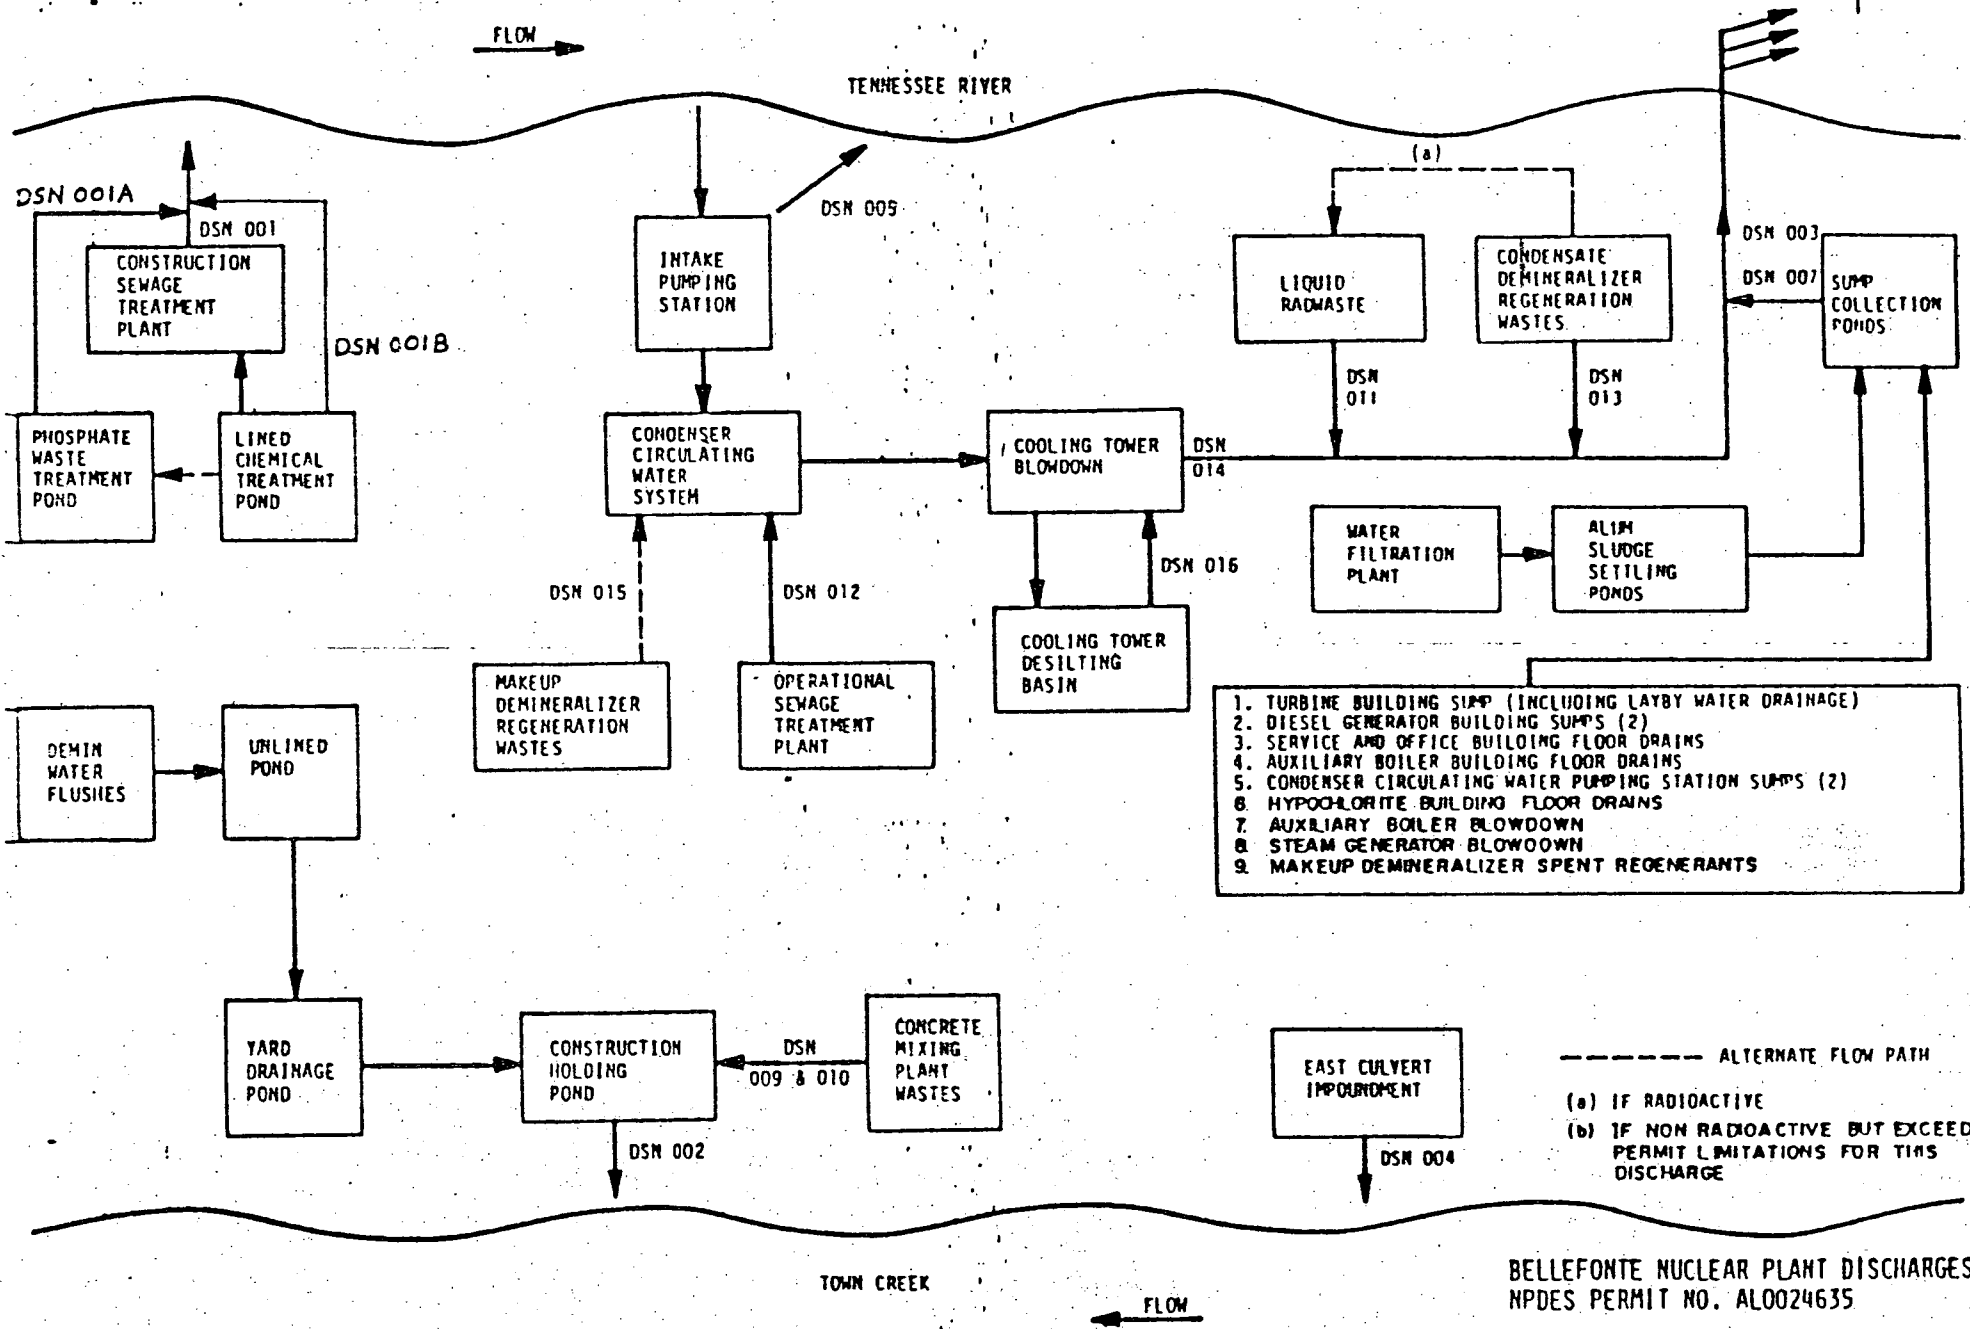

1. TURBINE BUILDING SUMP (INCLUDING LAYBY WATER DRAINAGE)
2. DIESEL GENERATOR BUILDING SUMP'S (2)
3. SERVICE AND OFFICE BUILDING FLOOR DRAINS
4. AUXILIARY BOILER BUILDING FLOOR DRAINS
5. CONDENSER CIRCULATING WATER PUMPING STATION SUMP'S (2)
6. HYPOCHLORITE BUILDING FLOOR DRAINS
7. AUXILIARY BOILER BLOWDOWN
8. STEAM GENERATOR BLOWDOWN
9. MAKEUP DEMINERALIZER SPENT REGENERANTS

----- ALTERNATE FLOW PATH
 (a) IF RADIOACTIVE
 (b) IF NON RADIOACTIVE BUT EXCEEDS PERMIT LIMITATIONS FOR THIS DISCHARGE

BELLEVILLE NUCLEAR PLANT DISCHARGES
 NPDES PERMIT NO. ALO024635

CONTINUED FROM THE FRONT

C. Except for storm runoff, leaks, or spills, are any of the discharges described in Items II-A or B intermittent or seasonal?
 YES (complete the following table) NO (go to Section III)

1. OUTFALL NUMBER (list)	2. OPERATION (1) CONTRIBUTING FLOW (list)	3. FREQUENCY		4. FLOW				5. DURATION (in days)
		a. DAYS PER WEEK (specify average)	b. MONTHS PER YEAR (specify average)	6. FLOW RATE (in mgd)		7. TOTAL VOLUME (specify with units)		
				1. LONG TERM AVERAGE	2. MAXIMUM DAILY	1. LONG TERM AVERAGE	2. MAXIMUM DAILY	
001A	PHOSPHATE METAL CLEANING	-----	SEE NOTE BELOW	-----	-----	10.0/yr	.220	
001B	CHEMICAL METAL CLEANING	-----	SEE NOTE BELOW	-----	-----	1.0/yr	.015	

Note: NO CHEMICAL CLEANING ACTIVITIES ARE PLANNED UNTIL 1992. DUE TO THE UNPREDICTABILITY OF NRC REGULATORY REQUIREMENTS AND PLANT SCHEDULES HOWEVER, THE OPTION TO CHEMICALLY CLEAN PLANT SYSTEMS MUST BE LEFT OPEN. IT IS NOT POSSIBLE TO ESTIMATE THE VOLUME AND FREQUENCY OF WASTEWATER DISCHARGE ASSOCIATED WITH FUTURE CLEANING ACTIVITIES. VALUES GIVEN ABOVE ARE BASED ON 1984-1986 DATA.

III. MAXIMUM PRODUCTION

A. Does an effluent guideline limitation promulgated by EPA under Section 304 of the Clean Water Act apply to your facility?
 YES (complete Item III-B) NO (go to Section IV)

B. Are the limitations in the applicable effluent guideline expressed in terms of production (or other measure of operation)?
 YES (complete Item III-C) NO (go to Section IV)

C. If you answered "Yes" to Item III-B, list the quantity which represents an actual measurement of your maximum level of production, expressed in the terms and units used in the applicable effluent guideline, and indicate the affected outfalls.

1. MAXIMUM QUANTITY			2. AFFECTED OUTFALLS (list outfall numbers)
a. QUANTITY PER DAY	b. UNITS OF MEASURE	c. OPERATION, PRODUCT, MATERIAL, ETC. (specify)	
N/A			

IV. IMPROVEMENTS

A. Are you now required by any Federal, State or local authority to meet any implementation schedule for the construction, upgrading or operation of wastewater treatment equipment or practices or any other environmental programs which may affect the discharges described in this application? This includes, but is not limited to, permit conditions, administrative or enforcement orders, enforcement compliance schedule letters, stipulations, court orders, and grant or loan conditions.
 YES (complete the following table) NO (go to Item IV-B)

1. IDENTIFICATION OF CONDITION AGREEMENT, ETC.	2. AFFECTED OUTFALLS		3. BRIEF DESCRIPTION OF PROJECT	4. FINAL COMPLIANCE DATE	
	a. NO.	b. SOURCE OF DISCHARGE		a. REQUIRED	b. PROJECTED
N/A					

B. OPTIONAL: You may attach additional sheets describing any additional water pollution control programs (or other environmental projects which may affect your discharges) you now have underway or which you plan. Indicate whether each program is now underway or planned, and indicate your actual or planned schedules for construction. MARK "X" IF DESCRIPTION OF ADDITIONAL CONTROL PROGRAMS IS ATTACHED

V. INTAKE AND EFFLUENT CHARACTERISTICS

A, B, & C: See instructions before proceeding - Complete one set of tables for each outfall - Annotate the outfall number in the space provided. NOTE: Tables V-A, V-B, and V-C are included on separate sheets numbered V-1 through V-9.

D. Use the space below to list any of the pollutants listed in Table 2c-3 of the instructions, which you know or have reason to believe is discharged or may be discharged from any outfall. For every pollutant you list, briefly describe the reasons you believe it to be present and report any analytical data in your possession.

1. POLLUTANT	2. SOURCE	1. POLLUTANT	2. SOURCE
NONE			

VI. POTENTIAL DISCHARGES NOT COVERED BY ANALYSIS

A. Is any pollutant listed in Item V-C a substance or a component of a substance which you do or expect that you will over the next 5 years use or manufacture as an intermediate or final product or byproduct?

YES (list all such pollutants below)

NO (go to Item VI-B)

N/A

B. Are your operations such that your raw materials, processes, or products can reasonably be expected to vary so that your discharges of pollutants may during the next 5 years exceed two times the maximum values reported in Item V7?

YES (complete Item VI-C below)

NO (go to Section VII)

C. If you answered "Yes" to Item VI-B, explain below and describe in detail the sources and expected levels of such pollutants which you anticipate will be discharged from each outfall over the next 5 years, to the best of your ability at this time. Continue on additional sheets if you need more space.

N/A

CONTINUED FROM THE FRONT

VII. BIOLOGICAL TOXICITY TESTING DATA

Do you have any knowledge or reason to believe that any biological test for acute or chronic toxicity has been made on any of your discharges or on a receiving water in relation to your discharge within the last 3 years?

YES (Identify the test(s) and describe their purposes below)

NO (go to Section VIII)

N/A

VIII CONTRACT ANALYSIS INFORMATION

Were any of the analyses reported in Item V performed by a contract laboratory or consulting firm?

YES (list the name, address, and telephone number of, and pollutants analyzed by, each such laboratory or firm below)

NO (go to Section IX)

A. NAME	B. ADDRESS	C. TELEPHONE (area code & no.)	D. POLLUTANTS ANALYZED (list)
N/A			

IX. CERTIFICATION

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.

A. NAME & OFFICIAL TITLE (type or print)

M.E. RIVERS
DIRECTOR ENVIRONMENTAL QUALITY

B. PHONE NO. (area code & no.)

615-632-6578

C. SIGNATURE

D. DATE SIGNED

EPA I.D. NUMBER (copy from Item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-R0173

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

OUTFALL NO
001

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)		5. NO. OF ANALYSES	
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	6. LONG TERM AVERAGE VALUE		
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION		(2) MASS
a. Biochemical Oxygen Demand (BOD5)	19	4.8	11	3.0	3.8	1.0	24	MG/L	LB/D			
b. Chemical Oxygen Demand (COD)	10	6.8					1	MG/L	LB/D			
c. Total Organic Carbon (TOC)	4.0	2.7					1	MG/L	LB/D			
d. Total Suspended Solids (TSS)	7.0	2.1	6.0	1.7	<2.3	<0.67	24	MG/L	LB/D			
e. Ammonia (as N)	0.04	0.03					1	MG/L	LB/D			
f. Flow	VALUE 0.081		VALUE 0.050		VALUE 0.030		365	MGD		VALUE		
g. Temperature (winter)	VALUE		VALUE		VALUE			°C		VALUE		
h. Temperature (summer)	VALUE 25.9		VALUE		VALUE		1	°C		VALUE		
i. pH	MINIMUM 6.2	MAXIMUM 7.7	MINIMUM 6.7	MAXIMUM 6.9	X		24	STANDARD UNITS		X		

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark "X" in column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK 'X'		3. EFFLUENT						4. UNITS		5. INTAKE (optional)		6. NO. OF ANALYSES	
	a. PRESENT	b. ABSENT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	7. LONG TERM AVERAGE VALUE		
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION		(2) MASS
a. Bromide (24959-67-9)		X												
b. Chlorine, Total Residual		X												
c. Color	X		10.0						1	PCU				
d. Fecal Coliform	X		240						1	COLONIES/100 ML				
e. Fluoride (16984-48-8)	X													
f. Nitrate-Nitrite (as N)	X		5.2	3.5					1	MG/L	LB/D			

EPA I.D. NUMBER (copy from Item 1 of Form 1) | OUTFALL NUMBER

AL5640090002

001

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (all seven pages) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. FRACTION OF POLLUTANT	b. RELEVANT TOXICITY	c. LEVEL OF TEST	b. MAXIMUM DAILY VALUE		d. MAXIMUM 30 DAY VALUE (if available)		e. LONG TERM AVG. VALUE (if available)		f. NO. OF ANALYSES	g. CONCENTRATION	h. MASS	i. LONG TERM AVERAGE VALUE		j. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, CYANIDE, AND TOTAL PHENOLS															
1M. Antimony, Total (7440-36-0)			X												
2M. Arsenic, Total (7440-38-2)			X												
3M. Beryllium, Total (7440-41-7)			X												
4M. Cadmium, Total (7440-43-9)			X												
5M. Chromium, Total (7440-47-3)			X												
6M. Copper, Total (7550-50-8)			X												
7M. Lead, Total (7439-97-6)			X												
8M. Mercury, Total (7439-97-6)			X												
9M. Nickel, Total (7440-02-0)			X												
10M. Selenium, Total (7782-49-2)			X												
11M. Silver, Total (7440-22-4)			X												
12M. Thallium, Total (7440-28-0)			X												
13M. Zinc, Total (7440-66-6)			X												
14M. Cyanide, Total (57-12-5)			X												
15M. Phenols, Total		X		<10											

DIOXIN

2,3,7,8 Tetra-chlorodibenzo-p-

DESCRIBE RESULTS

1. POLLUTANT AND NUMBER (if available)	2. MARK 'X'			3. EFFLUENT				4. LIMITS		5. INTAKE		NO. OF ANALYSES
	TESTING METHOD	SAMPLING POINT	CONCENTRATION	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY AVERAGE VALUE (if available)		C. LONG TERM AVERAGE VALUE (if available)		A. LONG TERM AVERAGE VALUE		
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - VOLATILE COMPOUNDS												
1V. Acrolein (107-02-8)			X									
2V. Acrylonitrile (107-13-1)			X									
3V. Benzene (71-43-2)			X									
4V. Bis (Chloromethyl) Ether (542-88-1)			X									
5V. Bromoform (75-25-2)			X									
6V. Carbon Tetrachloride (56-23-5)			X									
7V. Chlorobenzene (108-90-7)			X									
8V. Chlorodibromomethane (124-48-1)			X									
9V. Chloroethane (75-00-3)			X									
10V. 2-Chloroethylvinyl Ether (110-75-8)			X									
11V. Chloroform (67-66-3)			X									
12V. Dichlorobromomethane (75-27-4)			X									
13V. Dichlorodifluoromethane (75-71-8)			X									
14V. 1,1-Dichloroethane (75-34-3)			X									
15V. 1,2-Dichloroethane (107-06-2)			X									
16V. 1,1-Dichloroethylene (75-35-4)			X									
17V. 1,2-Dichloropropane (78-87-5)			X									
18V. 1,2-Dichloroethylene (542-75-6)			X									
19V. Ethylbenzene (100-41-4)			X									
20V. Methyl Bromide (74-83-9)			X									
21V. Methyl Chloride (74-87-3)			X									

NUM. (if avail)	ANAL. REQ. NO.	C. DE. TEST	B. MAXIMUM DAILY VALUE		D. MAXIMUM CONC. (if avail)		E. CONC. THATION	F. CONC. THATION	G. CONC. THATION	H. CONC. THATION		I. NO. OF ANAL. YLS
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS												
1B. Aconaphthene (83-32-9)		X										
2B. Aconaphtylene (208-96-8)		X										
3B. Anthracene (120-12-7)		X										
4B. Benzidine (92-87-5)		X										
5B. Benzo (a) Anthracene (56-55-3)		X										
6B. Benzo (a) Pyrene (50-32-8)		X										
7B. 3,4-Benzo-fluoranthene (205-99-2)		X										
8B. Benzo (ghi) Perylene (191-24-2)		X										
9B. Benzo (k) Fluoranthene (207-08-9)		X										
10B. Bis (2-Chloro-ethoxy) Methane (111-91-1)		X										
11B. Bis (2-Chloro-ethyl) Ether (111-44-4)		X										
12B. Bis (2-Chloro-propyl) Ether (39638-32-9)		X										
13B. Bis (2-Ethyl-hexyl) Phthalate (117-81-7)		X										
14B. 4-Bromo-phenyl Phenyl Ether (101-55-3)		X										
15B. Butyl Benzyl Phthalate (85-68-7)		X										
16B. 2-Chloro-naphthalene (91-58-7)		X										
17B. 4-Chloro-phenyl Phenyl Ether (7005-72-3)		X										
18B. Chrysene (218-01-9)		X										
19B. Dibenzo (a,h) Anthracene (53-70-3)		X										
20B. 1,2-Dichloro-benzene (95-50-1)		X										
21B. 1,3-Dichloro-benzene (541-73-1)		X										

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. LIMIT				4. UNITS		5. INTAKE (1)					
	A. TEST METHOD	B. SOURCE	C. REASON FOR EXCLUSION	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVG. VALUE (if available)		H. NO. OF ANALYSES	G. CONCENTRATION	I. MASS	F. LONG TERM AVERAGE VALUE		J. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)															
43B. N-Nitrosodiphenylamine (86-30-6)			X												
44B. Phenanthrene (85-01-8)			X												
45B. Pyrene (129-00-0)			X												
46B. 1,2,4-Trichlorobenzene (120-82-1)			X												
GC/MS FRACTION - PESTICIDES															
1P. Aldrin (309-00-2)			X												
2P. α -BHC (319-84-6)			X												
3P. β -BHC (319-85-7)			X												
4P. γ -BHC (58-89-9)			X												
5P. δ -BHC (319-86-8)			X												
6P. Chlordane (57-74-9)			X												
7P. 4,4'-DDT (50-29-3)			X												
8P. 4,4'-DDE (72-55-9)			X												
9P. 4,4'-DDD (72-54-8)			X												
10P. Dieldrin (60-57-1)			X												
11P. α -Endosulfan (115-29-7)			X												
12P. β -Endosulfan (115-29-7)			X												
13P. Endosulfan Sulfate (1031-07-8)			X												
14P. Endrin (72-20-8)			X												
15P. Endrin Aldehyde (7421-93-4)			X												
16P. Heptachlor (76-44-8)			X												

EPA I.D. NUMBER (copy from Item 1 of Form 1) | OUTFALL NUMBER

AL5640090002

001

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS	5. INTAKE (optional)					
	A. ANALYSIS METHOD	B. ANALYSIS UNIT	C. ANALYSIS DATE	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)			H. NO. OF ANALYSES	A. CONCENTRATION	L. MASS	E. LONG TERM AVERAGE VALUE		D. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS					(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)																
17P. Heptachlor Epoxide (1024-57-3)			X													
10P. PCB-1242 (53469-21-9)			X													
19P. PCB-1254 (11097-69-1)			X													
20P. PCB-1221 (11104-28-2)			X													
21P. PCB-1232 (11141-16-5)			X													
22P. PCB-1248 (12672-29-6)			X													
23P. PCB-1260 (11096-82-5)			X													
24P. PCB-1016 (12674-11-2)			X													
25P. Toxaphene (8001-35-2)			X													

EPA Form 3510-2C(6-80)

PAGE V-9

FOOTNOTES:

- 1- DATA TAKEN FROM OMRs SUBMITTED TO ADEM FOR THE PERIOD AUGUST 1985 - JULY 1986.
- 2- DATA FROM ONE GRAB SAMPLE COLLECTED AUGUST 18, 1986.

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **001A**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (all seven pages) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. STEERING OF EQUIP.	b. BELIEVED PRESENT	c. BELIEVED ABSENT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, CYANIDE, AND TOTAL PHENOLS															
1M. Antimony, Total (7440-36-01)			X												
2M. Arsenic, Total (7440-38-2) <i>11</i>		X		1.0						1	µg/L				
3M. Beryllium, Total (7440-41-7)			X												
4M. Cadmium, Total (7440-43-9) <i>11</i>		X		0.1						1	µg/L				
5M. Chromium, Total (7440-47-3) <i>11</i>		X		1.0						1	µg/L				
6M. Copper, Total (7550-50-8) <i>21</i>		X		<0.01						2	mg/L				
7M. Lead, Total (7439-97-6) <i>11</i>		X		2.0						1	µg/L				
8M. Mercury, Total (7439-97-6) <i>11</i>		X		0.2						1	µg/L				
9M. Nickel, Total (7440-02-0) <i>11</i>		X		22						1	µg/L				
10M. Selenium, Total (7782-49-2) <i>11</i>		X		5.0						1	µg/L				
11M. Silver, Total (7440-22-4)			X												
12M. Thallium, Total (7440-28-0)			X												
13M. Zinc, Total (7440-66-6) <i>11</i>		X		20						1	µg/L				
14M. Cyanide, Total (57-12-5)			X												
15M. Phenols, Total			X												
DIOXIN															
2,3,7,8 Tetrachlorodibenzo-p-dioxin (1429-28-1)			X	DESCRIBE RESULTS											

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (if available)			
	A. TEST METHOD OR EQUIP. NO.	B. REGULATORY OR STATE	C. BL. OR SER.	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVERAGE VALUE (if available)		F. NO. OF ANALYSES	G. CONCENTRATION	H. MASS	I. LONG TERM AVERAGE VALUE		J. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GCMS FRACTION - VOLATILE COMPOUNDS															
1V. Acrolein (107-02-8)			X												
2V. Acrylonitrile (107-13-1)			X												
3V. Benzene (71-43-2)			X												
4V. Bis (Chloromethyl) Ether (542-88-1)			X												
5V. Bromoform (75-25-2)			X												
6V. Carbon Tetrachloride (56-23-5)			X												
7V. Chlorobenzene (108-90-7)			X												
8V. Chlorodibromomethane (124-48-1)			X												
9V. Chloroethane (75-00-3)			X												
10V. 2-Chloroethylvinyl Ether (110-75-8)			X												
11V. Chloroform (67-66-3)			X												
12V. Dichlorobromomethane (75-27-4)			X												
13V. Dichlorodifluoromethane (75-71-8)			X												
14V. 1,1-Dichloroethane (75-34-3)			X												
15V. 1,2-Dichloroethane (107-06-2)			X												
16V. 1,1-Dichloroethylene (75-35-4)			X												
17V. 1,2-Dichloropropane (78-87-5)			X												
18V. 1,2-Dichloropropylene (542-75-6)			X												
19V. Ethylbenzene (100-41-4)			X												
20V. Methyl Bromide (74-83-9)			X												
21V. Methyl Chloride (74-87-3)			X												

NUM. (if available)	ATRS INC. REF. QUAN. UN.	D. OF. INVE. FOL. REPT.	C. OF. ASSESS. AB. REPT.	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30-DAY VALUE (if available)		E. LONG TERM VALUE (if available)		NO. OF ANAL. YLS	F. UNITS		G. INTAKE (mg/d)		H. NO. OF ANAL. YLS
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS		CONCENTRATION	U. MASS	LONG TERM AVERAGE VALUE (1) CONCENTRATION	LONG TERM AVERAGE VALUE (2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS															
1B. Acenaphthene (83-32-9)															
2B. Acenaphthylene (208-96-8)															
3B. Anthracene (120-12-7)															
4B. Benzidine (92-87-5)															
5B. Benzo (a) Anthracene (56-55-3)															
6B. Benzo (a) Pyrene (50-32-8)															
7B. 3,4-Benzo-fluoranthene (205-99-2)															
8B. Benzo (ghi) Perylene (191-24-2)															
9B. Benzo (k) Fluoranthene (207-08-9)															
10B. Bis (2-Chloroethoxy) Methane (111-91-1)															
11B. Bis (2-Chloroethyl) Ether (111-44-4)															
12B. Bis (2-Chloroisopropyl) Ether (39638-32-9)															
13B. Bis (2-Ethylhexyl) Phthalate (117-81-7)															
14B. 4-Bromophenyl Phenyl Ether (101-55-3)															
15B. Butyl Benzyl Phthalate (85-68-7)															
16B. 2-Chloronaphthalene (91-58-7)															
17B. 4-Chlorophenyl Phenyl Ether (7005-72-3)															
18B. Chrysene (218-01-9)															
19B. Dibenzo (a,h) Anthracene (53-70-3)															
20B. 1,2-Dichlorobenzene (95-50-1)															
21B. 1,3-Dichlorobenzene (641-73-1)															

1. POLLUTANT NUMBER (if available)	2. MARK 'X'				3. EFFICIENT						4. UNITS		5. INTAKE (if final)			
	ANAL. METHOD	D. OR. ANAL. DATE	C. OR. ANAL. DATE	E. OR. ANAL. DATE	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVG. VALUE (if available)		H. NO. OF ANALYSES	I. CONCENTRATION	J. MASS	K. LONG TERM AVERAGE VALUE		L. NO. OF ANALYSES
					(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)																
43B. N-Nitrosoulphonylamine (86-30-6)			X													
44B. Phenanthrene (85-01-8)			X													
45B. Pyrene (129-00-0)			X													
46B. 1,2,4-Trichlorobenzene (120-82-1)			X													
GC/MS FRACTION - PESTICIDES																
1P. Aldrin (309-00-2)			X													
2P. α -BHC (319-B4-6)			X													
3P. β -BHC (319-85-7)			X													
4P. γ -BHC (58-89-9)			X													
5P. δ -BHC (319-86-8)			X													
6P. Chlordane (57-74-9)			X													
7P. 4,4'-DDT (50-29-3)			X													
8P. 4,4'-DDE (72-55-9)			X													
9P. 4,4'-DDD (72-54-8)			X													
10P. Dieldrin (60-67-1)			X													
11P. α -Endosulfan (115-29-7)			X													
12P. β -Endosulfan (115-29-7)			X													
13P. Endosulfan Sulfate (1031-07-8)			X													
14P. Endrin (72-20-8)			X													
15P. Endrin Aldehyde (7421-93-4)			X													
16P. Heptachlor (76-44-8)			X													

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **001A**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. TYPE OF ANALYSIS	B. DATE OF ANALYSIS	C. USE OF ANALYSIS	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVG. VALUE (if available)		E. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	D. LONG TERM AVERAGE VALUE		B. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)			X												
18P. PCB-1242 (53469-21-9)			X												
19P. PCB-1254 (11097-69-1)			X												
20P. PCB-1221 (11104-28-2)			X												
21P. PCB-1232 (11141-16-5)			X												
22P. PCB-1248 (12672-29-6)			X												
23P. PCB-1260 (11096-82-5)			X												
24P. PCB-1015 (12674-11-2)			X												
25P. Toxaphene (8001-35-2)			X												

PAGE V-9

EPA Form 3510-2C(16-80)

FOOT NOTES:

- 1- DATA FROM ANALYSES OF UNTREATED TRISODIUM PHOSPHATE FLUSHING WASTE PRIOR TO ENTERING POND SUBMITTED TO ADEM IN APRIL 1983 ENGINEERING REPORT REQUESTING APPROVAL FOR ONSITE DISPOSAL VIA LAND APPLICATION. APPROVAL GRANTED MARCH 22, 1984. TO DATE THERE HAS BEEN NO DISCHARGE THROUGH DSN 001A. HOWEVER TVA WISHES TO RETAIN THIS TREATMENT AND DISCHARGE OPTION.
- 2- DATA IS AVERAGE OF MARCH 10 AND APRIL 22, 1986, ANALYSES OF THE MOST RECENT UNTREATED TRISODIUM PHOSPHATE METAL CLEANING WASTE HELD IN THE SMALL UNLINED AND LARGE UNLINED PHOSPHATE STORAGE PONDS FOR DISPOSAL VIA LAND APPLICATION.
- 3- ACCUMULATED PHOSPHATE METAL CLEANING WASTE HAS BEEN DISPOSED OF VIA LAND APPLICATION. THEREFORE SAMPLES FOR THESE ANALYSES COULD NOT BE COLLECTED.

EPA I.D. NUMBER (copy from Item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-R0173

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

OUTFALL NO

0013

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	59	8.9					1	MG/L	LB/D			
b. Chemical Oxygen Demand (COD)	89	13.4					1	MG/L	LB/D			
c. Total Organic Carbon (TOC)	NO DATA											
d. Total Suspended Solids (TSS)	2.0	0.3					1	MG/L	LB/D			
e. Ammonia (as N)	NO DATA											
f. Flow	VALUE 0.018		VALUE 0.016		VALUE 0.014		61	MGD		VALUE		
g. Temperature (winter)	VALUE AMBIENT		VALUE		VALUE				°C	VALUE		
h. Temperature (summer)	VALUE AMBIENT		VALUE		VALUE				°C	VALUE		
i. pH	MINIMUM 6.7	MAXIMUM 7.9	MINIMUM 7.4	MAXIMUM 7.9	X		61	STANDARD UNITS		X		

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK 'X'		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. PRESENT	b. ABSENT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Bromine (24959-67-9)	X													
b. Chlorine, Total Residual	X													
c. Color	X													
d. Fecal Coliform	X													
e. Fluoride (16904-48-8)	X													
f. Nitrate-Nitro (as N)	X													

EPA I.O. NUMBER (copy from Item 1 of Form 1) OUTFALL NUMBER

AL5640090002

0013

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (all seven pages) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. TYPE OF OUTFALL	b. RECEIVING WATER BODY	c. RECEIVING WATER USE	b. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	b. CONCENTRATION	b. MASS	b. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, CYANIDE, AND TOTAL PHENOLS															
1M. Antimony, Total (7440-36-0)			X												
2M. Arsenic, Total (7440-38-2)			X												
3M. Beryllium, Total (7440-41-7)			X												
4M. Cadmium, Total (7440-43-9)			X												
5M. Chromium, Total (7440-47-3)			X												
6M. Copper, Total (7550-50-8) 3j			X	0.02	0.0028	<0.01	<0.0014	<0.01	<0.0012	61	MG/L	LB/D			
7M. Lead, Total (7439-97-6)			X												
8M. Mercury, Total (7439-97-0)			X												
9M. Nickel, Total (7440-02-0)			X												
10M. Selenium, Total (7782-49-2)			X												
11M. Silver, Total (7440-22-4)			X												
12M. Thallium, Total (7440-28-0)			X												
13M. Zinc, Total (7440-66-6)			X												
14M. Cyanide, Total (57-12-5)			X												
15M. Phenols, Total			X												
DIOXIN															
2,3,7,8-Tetra-chlorodibenzo-p-dioxin (117-81-1) C			X	DESCRIBE RESULTS											

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT				4. USES		5. INTAKE			
	A. TEST METHOD AND EQUIP. NO.	B. ANAL. TECH. NO.	C. ANAL. DATE	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVERAGE VALUE (if available)		F. NO. OF ANALYSES	G. LONG TERM AVERAGE VALUE		H. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS		(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - VOLATILE COMPOUNDS													
1V. Acrolein (107-02-8)			X										
2V. Acrylonitrile (107-13-1)			X										
3V. Benzene (71-43-2)			X										
4V. Bis (Chloromethyl) Ether (542-88-1)			X										
5V. Bromoform (75-25-2)			X										
6V. Carbon Tetrachloride (66-23-5)			X										
7V. Chlorobenzene (108-90-7)			X										
8V. Chlorodibromomethane (124-48-1)			X										
9V. Chloroethane (75-00-3)			X										
10V. 2-Chloroethylvinyl Ether (110-75-8)			X										
11V. Chloroform (67-66-3)			X										
12V. Dichlorobromomethane (75-27-4)			X										
13V. Dichlorodifluoromethane (75-71-8)			X										
14V. 1,1-Dichloroethane (75-34-3)			X										
15V. 1,2-Dichloroethane (107-06-2)			X										
15V. 1,1-Dichloroethylene (75-35-4)			X										
17V. 1,2-Dichloropropane (78-87-5)			X										
18V. 1,2-Dichloropropylene (542-75-6)			X										
19V. Ethylbenzene (100-41-4)			X										
20V. Methyl Bromide (74-83-9)			X										
21V. Methyl Chloride (74-87-3)			X										

NUMBER (if available)	TEST INC. DE- QUA- LU	A. RE- LEASE FRACTION (%)	C. OR- GANO- GENIC TEST	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)			E. LONG TERM VALUE (if available)		F. NO. OF ANAL- YSES	G. INTAKE		H. NO. OF ANAL- YSES
				(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION		(ii) MASS	(i) CONCENTRATION	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS														
1B. Acenaphthene (83-32-9)														
2B. Acenaphthylene (208-96-8)														
3B. Anthracene (120-12-7)														
4B. Benzidine (92-87-5)														
5B. Benzo (a) Anthracene (56-55-3)														
6B. Benzo (a) Pyrene (50-32-8)														
7B. 3,4-Benzo- fluoranthene (205-99-2)														
8B. Benzo (ghi) Perylene (191-24-2)														
9B. Benzo (k) Fluoranthene (207-08-9)														
10B. Bis (2-Chloro- ethoxy) Methane (111-91-1)														
11B. Bis (2-Chloro- ethyl) Ether (111-44-4)														
12B. Bis (2-Chloro- isopropyl) Ether (39638-32-9)														
13B. Bis (2-Ethyl- hexyl) Phthalate (117-81-7)														
14B. 4-Bromo- phenyl Phenyl Ether (101-55-3)														
15B. Butyl Benzyl Phthalate (85-68-7)														
16B. 2-Chloro- naphthalene (91-58-7)														
17B. 4-Chloro- phenyl Phenyl Ether (7005-72-3)														
18B. Chrysene (218-01-9)														
19B. Dibenz (a,h) Anthracene (53-70-3)														
20B. 1,2-Dichloro- benzene (95-50-1)														
21B. 1,3-Dichloro- benzene (541-73-1)														

1. POLLUTANT NAME (if available)	2. MARK 'X'			3. EFFICIENCY					4. UNITS		5. INTAKE (optional)				
	A. TEST METHOD OR QUIP- TYPE	D. BE- NEFICIAL EFFECTS	C. PE- RMANENT EFFECTS	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVG. VALUE (if available)		F. NO OF ANAL- YSES	A. CONCEN- TRATION	B. MASS	G. LONG TERM ALLOWED VALUE		H. NO. OF ANAL- YSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)															
43B. N-Nitro- sodiphenylamine (86-30-6)			X												
44B. Phenanthrene (85-01-8)			X												
45B. Pyrene (129-00-0)			X												
46B. 1,2,4-Trichlorobenzene (120 B2-1)			X												
GC/MS FRACTION - PESTICIDES															
1P. Aldrin (309-00-2)			X												
2P. α-BHC (319-84-6)			X												
3P. β-BHC (319-85-7)			X												
4P. γ-BHC (58-89-9)			X												
5P. δ-BHC (319-86-8)			X												
6P. Chlordane (57-74-9)			X												
7P. 4,4'-DDT (50-29-3)			X												
8P. 4,4'-DDE (72-55-9)			X												
9P. 4,4'-DDD (72-54-8)			X												
10P. Dieldrin (40-67-1)			X												
11P. α-Endosulfan (115-29-7)			X												
12P. β-Endosulfan (115-29-7)			X												
13P. Endosulfan Sulfate (1031-07-8)			X												
14P. Endrin (72-20-8)			X												
16P. Endrin Aldehyde (7421-93-4)			X												
16P. Heptachlor (76-44-8)			X												

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **0013**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT				4. UNITS		5. INTAKE (optional)					
	A. TEST METHOD	B. DATE OF ANALYSIS	C. ANALYST	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVERAGE VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	e. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)			X												
18P. PCB-1242 (53469-21-9)			X												
19P. PCB-1264 (11097-69-1)			X												
20P. PCB-1221 (11104-28-2)			X												
21P. PCB-1232 (11141-16-5)			X												
22P. PCB-1248 (12672-29-6)			X												
23P. PCB-1260 (11098-82-5)			X												
24P. PCB-1016 (12674-11-2)			X												
25P. Toxaphene (8001-35-2)			X												

EPA Form 3510-2C(16-80)

PAGE V-9

FOOTNOTES:

- 1- DATA FROM MARCH 13, 1985, GRAB SAMPLING OF THE MOST RECENT BATCH OF CHEMICAL METAL CLEANING WASTE TREATED/DISCHARGED VIA THE CONSTRUCTION S.T.P.
- 2- ALL CHEMICAL METAL CLEANING WASTE ACCUMULATED TO DATE HAS BEEN TREATED/DISCHARGED. THERE - SAMPLES FOR THESE ANALYSES COULD NOT BE COLLECTED.
- 3- DATA TAKEN FROM DMRS SUBMITTED TO ADEM FOR THIS DISCHARGE FOR THE PERIOD AUGUST 1985 - JULY 1986.

EPA I.D. NUMBER (copy from item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-R0173

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

OUTFALL NO

002

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVRG. VALUE (if available)		d. NO. OF ANALYSES	b. CONCENTRATION	d. MASS	3. LONG TERM AVERAGE VALUE		d. NO. OF ANALYSE
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	3.4	156					1	MG/L	LB/D			
b. Chemical Oxygen Demand (COD)	20	917					1	MG/L	LB/D			
c. Total Organic Carbon (TOC)	8.0	367					1	MG/L	LB/D			
d. Total Suspended Solids (TSS)	110	3029	60	1358	25	414	40	MG/L	LB/D			
e. Ammonia (as N)	<0.01						1	MG/L				
f. Flow	VALUE 5.5		VALUE 1.81		VALUE 1.1		40	MGD		VALUE		
g. Temperature (winter)	VALUE		VALUE		VALUE				°C	VALUE		
h. Temperature (summer)	VALUE 28.9		VALUE		VALUE		1		°C	VALUE		
i. pH	MINIMUM 7.2	MAXIMUM 8.3	MINIMUM 7.5	MAXIMUM 7.9	X		40	STANDARD UNITS		X		

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. PRESENT	b. ABSENT	b. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVRG. VALUE (if available)		d. NO. OF ANALYSES	b. CONCENTRATION	d. MASS	3. LONG TERM AVERAGE VALUE		d. NO. OF ANALYSE
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Bromide (24059-67-9)	X	X												
b. Chlorine, Total Residual	X	X												
c. Color	X	X	20						1	PCU				
d. Fecal Coliform	X	X												
e. Fluoride (16984-48-8)	X	X												
f. Nitrate-Nitrite (as N)	X	X	<0.01						1	MG/L				

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** **002** **OUTFALL NUMBER**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (*secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions*), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (*all seven pages*) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. STEERING EQUIP.	b. RESIDUALS	c. RESIDUALS	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, CYANIDE, AND TOTAL PHENOLS															
1M. Antimony, Total (7440-36-0)		X		<0.1						1	MG/L				
2M. Arsenic, Total (7440-38-2)		X		<0.1						1	MG/L				
3M. Beryllium, Total (7440-41-7)		X		<0.001						1	MG/L				
4M. Cadmium, Total (7440-43-9)		X		<0.005						1	MG/L				
5M. Chromium, Total (7440-47-3)		X		<0.05						1	MG/L				
6M. Copper, Total (7550-50-8)		X		<0.01						1	MG/L				
7M. Lead, Total (7439-97-6)		X		<0.05						1	MG/L				
8M. Mercury, Total (7439-97-6)		X		<0.2						1	µg/L				
9M. Nickel, Total (7440-02-0)		X		<0.05						1	MG/L				
10M. Selenium, Total (7782-49-2)		X		<0.1						1	MG/L				
11M. Silver, Total (7440-22-4)		X		<0.01						1	MG/L				
12M. Thallium, Total (7440-28-0)		X		<0.05						1	MG/L				
13M. Zinc, Total (7440-66-6)		X		<0.01						1	MG/L				
14M. Cyanide, Total (57-12-5)		X		<0.02						1	MG/L				
15M. Phenols, Total		X		<2.0						1	µg/L				
DIOXIN															
2,3,7,8 Tetra chlorodibenzo P. Dioxin (1116-14-6)				DESCRIBE RESULTS											

DISCHARGE SERIAL NUMBER 003

- (1) Part V.A. - 1.f. -- All values based upon pump capacities; maximum 30-day and long term average values recorded during system testing and startup.
- (2) Part V.A - 1.h. and i. -- Maximum daily value is from one grab sample and not from four per 24-hours.
- (3) Part V.A - 2.b. and c., and Part V.B - 3.b. and c. -- Values are from grab sample analyses data from Discharge Monitoring Reports (DMR's).
- (4) Part V.A - 2.d., and Part V.B - 3.d. -- Two numbers are reported in some cases; the first for maximum daily and the second for long term average.
- (5) Part V.C - 1. (13B.) -- Identified in EPA report "Priority Pollutant Methodology Quality Assurance Review" by Kleopfer, Dias, and Fairless as problem priority pollutants since frequently found in blanks and samples because of laboratory contamination.
- (6) Part V.C - 1. (29B) -- Source of Di - N - Octyl Phthalate assumed to be same as (5), above.
- (7) *DUE TO CONSTRUCTION SLOWDOWN AND THE PHYSICAL CONFIGURATION OF THE DIFFUSER SYSTEM, LOW FLOW CONDITIONS HAVE PREVENTED FLOW MEASUREMENT AND SAMPLING OF THIS DISCHARGE. DATA PRESENTED ARE FROM SAN RAFAEL PERMIT APPLICATION SUBMITTED JANUARY 20, 1981.*

EPA I.D. NUMBER (copy from Item 1 of Form 1) | OUTFALL NUMBER

AL5640090002

002

Form Approved OMB No. 15B-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. PRESENT IN THIS OUTFALL	B. OCCURS FREQUENTLY	C. OCCURS RARELY	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVG. VALUE (if available)		F. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	a. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)			X												
18P. PCB-1242 (53469-21-9)			X												
19P. PCB-1254 (11097-69-1)			X												
20P. PCB-1221 (11104-26-2)			X												
21P. PCB-1232 (11141-16-5)			X												
22P. PCB-1248 (12672-29-6)			X												
23P. PCB-1260 (11096-82-5)			X												
24P. PCB-1016 (12674-11-2)			X												
25P. Toxaphene (8001-35-2)			X												

EPA Form 3510-2C(16-80)

PAGE V-9

FOOTNOTES:

1- DATA FROM ONE GRAB SAMPLE COLLECTED AUGUST 18, 1986.

2- DATA TAKEN FROM DMRS SUBMITTED TO ADEM FOR THE PERIOD AUGUST 1985- JULY 1986.

1. PELLETS AND C. NUMBER (if available)	2. MARK X			3. EFFLUENT				4. LIMITS		5. INTAKE		6. NO. OF ANALYSES
	A. TEST NO. OR QUID. NO.	B. PELLET NO. OR SECT.	C. RE. LEVEL NO. OR SECT.	8. MAXIMUM DAILY VALUE		9. MAXIMUM 30 DAY VALUE (if available)		10. LONG TERM AVG. VALUE (if available)		11. LONG TERM AVERAGE VALUE		
				(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	
GC/MS FRACTION - VOLATILE COMPOUNDS												
1V. Acrolein (107-02-8)			X									
2V. Acrylonitrile (107-13-1)			X									
3V. Benzene (71-43-2)			X									
4V. Bis (Chloromethyl) Ether (542-88-1)			X									
5V. Bromoform (75-25-2)			X									
6V. Carbon Tetrachloride (56-23-5)			X									
7V. Chlorobenzene (108-90-7)			X									
8V. Chlorodibromomethane (124-48-1)			X									
9V. Chloroethane (75-00-3)			X									
10V. 2-Chloroethylvinyl Ether (110-75-8)			X									
11V. Chloroform (67-68-3)			X									
12V. Dichlorobromomethane (75-27-4)			X									
13V. Dichlorodifluoromethane (75-71-8)			X									
14V. 1,1-Dichloroethane (75-34-3)			X									
15V. 1,2-Dichloroethane (107-06-2)			X									
16V. 1,1-Dichloroethylene (75-35-4)			X									
17V. 1,2-Dichloropropane (78-87-5)			X									
18V. 1,2-Dichloropropylene (542-75-6)			X									
19V. Ethylbenzene (100-41-4)			X									
20V. Methyl Bromide (74-83-9)			X									
21V. Methyl Chloride (74-87-3)			X									

NO. (if c)	AVG. CONC. (µg/L)	NO. OF ANALYSES	C. RE-USE	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE		E. LONG TERM VALUE		NO. OF ANALYSES	F. USES		G. HETA		H. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS		(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS															
18. Acenaphthene (83-32-9)			X												
28. Acenaphthylene (208-96-8)			X												
38. Anthracene (120-12-7)			X												
48. Benzidine (92-87-5)			X												
58. Benzo (a) Anthracene (56-55-3)			X												
68. Benzo (a) Pyrene (50-32-8)			X												
78. 3,4-Benzo-fluoranthene (205-99-2)			X												
88. Benzo (ghi) Perylene (191-24-2)			X												
98. Benzo (k) Fluoranthene (207-08-9)			X												
108. Bis (2-Chloroethoxy) Methane (111-91-1)			X												
118. Bis (2-Chloroethyl) Ether (111-44-4)			X												
128. Bis (2-Chloroisopropyl) Ether (39638-32-9)			X												
138. Bis (2-Ethylhexyl) Phthalate (117-81-7)			X												
148. 4-Bromophenyl Phenyl Ether (101-55-3)			X												
158. Butyl Benzyl Phthalate (85-68-7)			X												
168. 2-Chloronaphthalene (91-58-7)			X												
178. 4-Chlorophenyl Phenyl Ether (7005-72-3)			X												
188. Chrysene (218-01-9)			X												
198. Dibenzo (a,h) Anthracene (53-70-3)			X												
208. 1,2-Dichlorobenzene (95-50-1)			X												
218. 1,3-Dichlorobenzene (541-73-1)			X												

1. POLLUTANT ANNUAL NO. (if available)	2. MARKING			3. LIMITS				4. UNITS		5. INTAKE (annual)					
	A. TEST METHOD OUTLINE	B. SE- VERITY SCALE	C. SE- VERITY SCALE	D. MAXIMUM DAILY VALUE		E. MAXIMUM 30 DAY VALUE (if available)		F. LONG TERM AVG. VALUE (if available)		G. NO. OF ANALYSES	H. CONCENTRATION	I. MASS	J. LONG TERM AVG. VALUE		K. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)															
43B. N-Nitrosodiphenylamine (86-30-6)			X												
44B. Phenanthrene (85-01-8)			X												
45B. Pyrene (129-00-0)			X												
46B. 1,2,4-Trichlorobenzene (120-82-1)			X												
GC/MS FRACTION - PESTICIDES															
1P. Aldrin (309-00-2)			X												
2P. α -BHC (319-84-6)			X												
3P. β -BHC (319-85-7)			X												
4P. γ -BHC (58-89-9)			X												
5P. δ -BHC (319-86-8)			X												
6P. Chlordane (57-74-9)			X												
7P. 4,4'-DDT (50-29-3)			X												
8P. 4,4'-DDE (72-55-9)			X												
9P. 4,4'-DDD (72-54-8)			X												
10P. Dieldrin (60-57-1)			X												
11P. α -Endosulfan (115-29-7)			X												
12P. β -Endosulfan (115-29-7)			X												
13P. Endosulfan Sulfate (1031-07-8)			X												
14P. Endrin (72-20-8)			X												
15P. Endrin Aldehyde (7421-93-4)			X												
16P. Heptachlor (76-44-8)			X												

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

EPA ID. NUMBER (copy from Item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-R0173

OUTFALL NO

003

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT (7)						4. NO. OF ANALYSES	3. UNITS (specify if blank)		4. INTAKE (optional)		5. NO. OF ANALYSES
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available) (3)		C. LONG TERM AVG. VALUE (if available) (3)			B. CONCENTRATION	D. MASS	6. LONG TERM AVERAGE VALUE		
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	3.2	390					1	mg/l	lbs/day			
b. Chemical Oxygen Demand (COD)	15	1850					1	mg/l	lbs/day			
c. Total Organic Carbon (TOC)	2.1	260					1	mg/l	lbs/day			
d. Total Suspended Solids (TSS)	8	980					1	mg/l	lbs/day			
e. Ammonia (as N)	<0.01						1	mg/l		VALUE		
f. Flow (1)	VALUE 14.7		VALUE 2.95		VALUE 1.06		1-33	MGD		VALUE		
g. Temperature (winter)	VALUE		VALUE		VALUE			°C		VALUE		
h. Temperature (summer) (2)	VALUE 18.5		VALUE		VALUE		1	°C		VALUE		
i. pH (2)	MINIMUM	MAXIMUM	MINIMUM	MAXIMUM			1-25	STANDARD UNITS				

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK 'A'		3. EFFLUENT (7)						4. UNITS	5. INTAKE (optional)		6. NO. OF ANALYSES		
	a. PRESENT	b. ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available) (3)		C. LONG TERM AVG. VALUE (if available) (3)			B. CONCENTRATION	D. MASS		6. LONG TERM AVERAGE VALUE	
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS					(1) CONCENTRATION	(2) MASS
a. Bromide (24959-67-9)		X												
b. Chlorine (2) Total Residual	X		0.05	6	<0.08	<4	<0.02	<0.85	1-28	mg/l	lbs/day			
c. Color	X		4						1	PCU				
d. Fecal Coliform (2)		X												
e. Fluoride (15984-48-8)		X												
f. Nitrate-Nitrite (as N)	X		0.29	35					1	mg/l	lbs/day			

ITEM V-B CONTINUED FROM FRONT

1. POLLUTANT AND CAS NO. (if available)	2. MARK X		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. SOURCE CONTROL	B. NAME	C. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVG. VALUE (if available)		G. NO. OF ANALYSES	F. CONCENTRATION	H. MASS	I. ON-TERM AVERAGE VALUE		J. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
g. Nitrogen, Total Organic (as N)	X		0.35	43					1	mg/l	lbs/day			
h. Oil and Grease (2)	X		<5						1	mg/l				
i. Phosphorus (as P), Total (7723-14-0)	X		0.05	6					1	mg/l	lbs/day			
j. Radioactivity														
(1) Alpha, Total		X												
(2) Beta, Total		X												
(3) Radium, Total		X												
(4) Radium-226, Total		X												
k. Sulfate (as SO ₄) (14994-70-1)	X		66	8100					1	mg/l	lbs/day			
l. Sulfide (as S)		X												
m. Sulfite (as SO ₃) (14265-45-3)		X												
n. Surfactants	X		<0.1						1	mg/l				
o. Aluminum, Total (7429-90-5)	X		500	60					1	µg/l	lbs/day			
p. Barium, Total (7440-39-3)														
q. Boron, Total (7440-42-8)														
r. Cobalt, Total (7440-48-4)		X												
s. Iron, Total (7439-89-6)	X		810	100					1	µg/l	lbs/day			
t. Magnesium, Total (7439-95-4)	X		5.2	640					1	mg/l	lbs/day			
u. Molybdenum, Total (7439-98-7)		X												
v. Manganese, Total (7439-96-5)	X		40	5					1	µg/l	lbs/day			
w. Tin, Total (7440-51-5)		X												
x. Titanium, Total (7440-32-6)		X												

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (all seven pages) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. TESTING METHOD	B. REGULATED BY STATE	C. REGULATED BY FEDERAL GOVT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, CYANIDE, AND TOTAL PHENOLS															
1M. Antimony, Total (7440-36 0)	X			<2						1	µg/l				
2M. Arsenic, Total (7440 38 2)	X			7	0.86					1	µg/l	lbs/day			
3M. Beryllium, Total (7440 41 7)	X			<10						1	µg/l				
4M. Cadmium, Total (7440-43 9)	X			<0.1						1	µg/l				
5M. Chromium, Total (7440 47-3)	X			<1						1	µg/l				
6M. Copper, Total (7550 50 8)	X			<10						1	µg/l				
7M. Lead, Total (7439 97 6)	X			5	0.61					1	µg/l	lbs/day			
8M. Mercury, Total (7439-97-6)	X			<0.2						1	µg/l				
9M. Nickel, Total (7440 11-2)	X			50						1	µg/l				
10M. Selenium, Total (7782-49 2)	X			<1						1	µg/l				
11M. Silver, Total (7440-22-4)	X			<10						1	µg/l				
12M. Thallium, Total (7440-28-0)	X			<0.05						1	mg/l				
13M. Zinc, Total (7440 66-6)	X			20	2					1	µg/l	lbs/day			
14M. Cyanide, (2) Total (57-12 5)	X			<0.02						1	mg/l				
15M. Phenols, (2) Total	X			<1						1	µg/l				
DIOXIN															
2,3,7,8 Tetra-chlorodibenro P Dioxin (1764 01 6)			X	DESCRIBE RESULTS											

CONTINUED FROM THE FRONT

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK X			3. EFFLUENT						4. UNITS		5. INTAKE <i>(if available)</i>			
	1. TEST DATE	2. USE OF FACILITY (PMA, SBR, GBR, SBR)	3. USE OF FACILITY (SBR, SBR)	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVG. VALUE <i>(if available)</i>		1. NO. OF ANALYSES	2. CONCENTRATION	3. MASS	4. LONG TERM AVERAGE VALUE		5. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GRAMS FRACTION - VOLATILE COMPOUNDS															
1V. Acrolein (107-02-8)	X			<100						1	ug/l				
2V. Acrylonitrile (107-13-1)	X			<100						1	ug/l				
3V. Benzene (71-43-2)	X			<10						1	ug/l				
4V. Bis (Chloro-ethyl) Ether (542-88-1)	X			<10						1	ug/l				
5V. Bromoform (75-25-2)	X			<10						1	ug/l				
6V. Carbon Tetrachloride (54-22-5)	X			<10						1	ug/l				
7V. Chlorobenzene (106-90-7)	X			<10						1	ug/l				
8V. Chloroform (67-68-6)	X			<10						1	ug/l				
9V. Chloroethane (75-00-3)	X			<10						1	ug/l				
10V. 2 Chloroethylvinyl Ether (110-75-8)	X			<10						1	ug/l				
11V. Chloroform (67-68-6)	X			18	2					1	ug/l	lbs/day			
12V. Dichlorobromomethane (75-27-4)	X			<10						1	ug/l				
13V. Dichlorodifluoromethane (75-71-9)	X			<10						1	ug/l				
14V. 1,1 Dichloroethane (75-34-3)	X			<10						1	ug/l				
15V. 1,2 Dichloroethane (107-06-2)	X			<10						1	ug/l				
16V. 1,1-Dichloroethylene (75-35-4)	X			<10						1	ug/l				
17V. 1,2 Dichloropropane (78-87-5)	X			<10						1	ug/l				
18V. 1,2-Dichloropropane (542-75-6)	X			<10						1	ug/l				
19V. Ethylbenzene (100-41-4)	X			<10						1	ug/l				
20V. Methyl Bromide (74-83-9)	X			<10						1	ug/l				
21V. Methyl Chloride (74-87-3)	X			<10						1	ug/l				

CONTINUED FROM PAGE V-4

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK X			3. EFFLUENT				4. UNITS		5. INTAKE (optional)				
	A. TOXIC SUBSTANCES	B. PESTICIDES	C. SOLUBLE SOLIDS	D. MAXIMUM DAILY VALUE		E. MAXIMUM 30 DAY VALUE (if available)		F. LONG TERM AVG. VALUE (if available)		G. CONCENTRATION	H. MASS	I. LONG TERM AVERAGE VALUE		J. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS					
GC/MS FRACTION - VOLATILE COMPOUNDS (continued)														
22V. Methylene Chloride (75 09 2)	X			<10						1	µg/l			
23V. 1,1,2,2 Tetra chloroethane (79 34 5)	X			<10						1	µg/l			
24V. Tetrachloro ethylene (127 18 4)	X			<10						1	µg/l			
25V. Toluene (108 88 3)	X			<10						1	µg/l			
26V. 1,2-Trans-Dichloroethylene (156 60 5)	X			<10						1	µg/l			
27V. 1,1,1-Trichloroethane (71 55 6)	X			<10						1	µg/l			
28V. 1,1,2 Trichloroethane (79 00 5)	X			<10						1	µg/l			
29V. Trichloroethylene (79 01 6)	X			<10						1	µg/l			
30V. Trichlorofluoromethane (75 69 4)	X			<10						1	µg/l			
31V. Vinyl Chloride (75 01 4)	X			<10						1	µg/l			
GC/MS FRACTION - ACID COMPOUNDS														
1A. 2 Chloropheno (98 57 8)	X			<25						1	µg/l			
2A. 2,4-Dichloro phenol (120 83 2)	X			<25						1	µg/l			
3A. 2,4-Dimethyl phenol (105 67 9)	X			<25						1	µg/l			
4A. 4,6-Dinitro O Cresol (534 52 1)	X			<250						1	µg/l			
5A. 2,4 Dinitrophenol (51 28 5)	X			<250						1	µg/l			
6A. 2 Nitrophenol (88 75 5)	X			<25						1	µg/l			
7A. 4 Nitrophenol (100 02 7)	X			<25						1	µg/l			
8A. P-Chloro M Cresol (59 50 7)	X			<25						1	µg/l			
9A. Pentachloro phenol (87 36 5)	X			<25						1	µg/l			
10A. Phenol (108 95 2)	X			<25						1	µg/l			
11A. 2,4,6-Tri chlorophenol (88 06 2)	X			<25						1	µg/l			

CONTINUED FROM THE FRONT

1. POLLUTANT AND CAS NUMBER <small>(if available)</small>	2. MAMP #			3. EFFLUENT						4. UNITS	5. INTAKE (optional)					
	A. SOURCE	B. USE	C. TYPE	D. MAXIMUM DAILY VALUE		E. MAXIMUM 30 DAY VALUE		F. LONG TERM AVG. VALUE			G. NO. OF ANALYSES	H. CONCENTRATION	I. MASS	J. LONG TERM AVERAGE VALUE		K. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS					(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS																
18. Acenaphthene (83-32-9)	X			<10							1	ug/l				
28. Acenaphthylene (204-96-8)	X			<10							1	ug/l				
38. Anthracene (120-12-7)	X			<10							1	ug/l				
48. Benzidine (92-87-5)	X			<10							1	ug/l				
58. Benzo (a) Anthracene (56-55-3)	X			<10							1	ug/l				
68. Benzo (a) Pyrene (20-32-8)	X			<10							1	ug/l				
78. 3,4-Benzo-fluoranthene (205-95-2)	X			<10							1	ug/l				
88. Benzo (ghi) Perylene (191-24-2)	X			<10							1	ug/l				
98. Benzo (k) Fluoranthene (207-08-9)	X			<10							1	ug/l				
108. Bis (2-Chloro-ethoxy) Methane (111-91-1)	X			<10							1	ug/l				
116. Bis (2-Chloro-ethyl) Ether (111-44-4)	X			<10							1	ug/l				
126. Bis (2-Chloro-propyl) Ether (35638-32-9)	X			<10							1	ug/l				
138. Bis (2-Ethyl-hexyl) Phthalate (117-81-7)	X			2700	330						1	ug/l	lbs/day			
148. 4-Bromophenyl Phenyl Ether (101-53-3)	X			<10							1	ug/l				
158. Butyl Benzyl Phthalate (85-68-7)	X			<10							1	ug/l				
168. 2-Chloronaphthalene (91-58-7)	X			<10							1	ug/l				
178. 4-Chlorophenyl Phenyl Ether (7005-72-3)	X			<10							1	ug/l				
188. Chrysene (218-01-9)	X			<10							1	ug/l				
198. Dibenz (a,h) Anthracene (53-70-3)	X			<10							1	ug/l				
208. 1,2-Dichlorobenzene (95-50-1)	X			<10							1	ug/l				
218. 1,3-Dichlorobenzene (541-73-1)	X			<10							1	ug/l				

CONTINUED FROM THE FRONT

1. POLLUTANT AND CAS NUMBER <small>(if available)</small>	2. MARKS		3. EFFLUENT				4. NO. OF ANALYSES	5. UNITS		6. INTAKE		
	A	B	A. MAXIMUM DAILY VALUE		B. LONG TERM AVG. VALUE			C. CONCENTRATION	D. MASS	C. LONG TERM AVERAGE VALUE		D. NO. OF ANALYSES
			(I) MASS	(II) MASS	(I) MASS	(II) MASS				(I) MASS	(II) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)												
43B. 2-Nitro-1-naphthylamine (86-30-6)	X		<10				1	ug/l				
44L. Pheanthrene (85-01-8)	X		<10				1	ug/l				
45B. Pyrene (129-00-0)	X		<10				1	ug/l				
46B. 1,2,4-Trichlorobenzene (120-82-1)	X		<10				1	ug/l				
GC/MS FRACTION - PESTICIDES												
1P. Aldrin (309-00-2)		X										
2P. α -BHC (319-84-6)		X										
3P. β -BHC (319-85-7)		X										
4P. γ -BHC (58-89-9)		X										
5P. δ -BHC (319-86-3)		X										
6P. Chlordane (52-74-9)		X										
7P. 2,4'-DDE (50-29-3)		X										
8P. 4,4'-DDE (72-55-9)		X										
9P. 4,4'-DDD (72-54-8)		X										
10P. Dieldrin (60-57-1)		X										
11P. α -Endosulfan (115-29-7)		X										
12P. β -Endosulfan (115-29-7)		X										
13P. Endosulfan Sulfate (1031-07-8)		X										
14P. Etoxin (72-20-8)		X										
15P. Etoxin Alkylate (7421-93-4)		X										
16P. Etoxin Alkylate (76-44-8)		X										

CONTINUED FROM PAGE V-6

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK X	3. EFFLUENT						4. UNITS		5. INTAKE (optimal)		
		B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVG. VALUE (if available)		CONCENTRATION	D MASS	6. LONG TERM AVERAGE VALUE		7. NO. OF ANALYSES
		(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS					
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)												
22B. 1,4-Dichloro benzene (100-46-7)	X	<10					1	µg/l				
23B. 3,3'-Dichloro benzidine (91-94-1)	X	<10					1	µg/l				
24B. Diethyl Phthalate (84-66-2)	X	<10					1	µg/l				
25B. Dimethyl Phthalate (131-11-3)	X	<10					1	µg/l				
26B. Di-N-Butyl Phthalate (84-74-2)	X	<10					1	µg/l				
27B. 2,4-Dinitro-toluene (121-14-2)	X	<10					1	µg/l				
28B. 2,6-Dinitro-toluene (606-20-2)	X	<10					1	µg/l				
29B. Di-N-Octyl Phthalate (117-84-0) (6)	X	22	3				1	µg/l	lbs/day			
30B. 1,2-Diphenyl-hydrazine (as Acro benzene) (122-66-7)	X	<10					1	µg/l				
31B. Lauranthrene (206-44-0)	X	<10					1	µg/l				
32B. Fluorene (86-73-7)	X	<10					1	µg/l				
33B. Hexa-chlorobenzene (118-71-1)	X	<10					1	µg/l				
34B. Hexa-chlorobutadiene (87-68-3)	X	<10					1	µg/l				
35B. Hexachloro cyclopentadiene (77-47-4)	X	<10					1	µg/l				
36B. Hexachloro-ethane (67-72-1)	X	<10					1	µg/l				
37B. Indeno (1,2,3-cd) Pyrene (193-39-6)	X	<25					1	µg/l				
38B. Isophorone (78-69-1)	X	<10					1	µg/l				
39B. Naphthalene (91-20-3)	X	<10					1	µg/l				
40B. Nitrobenzene (98-95-3)	X	<10					1	µg/l				
41B. N-Nitro-sodimethylamine (62-76-9)	X	<10					1	µg/l				
42B. N-Nitrosodi-N-Propylamine (621-64-7)	X						1	µg/l				

CONTINUED FROM PAGE 4

EPA ID NUMBER copy from Item 1 of Form 1 OUTFALL NUMBER

AL564009002

003

Form Approved OMB No. 158-R0173

1. POLLUTANT AND CAS NO.	2. NAME		3. EFFLUENT			7. NO. OF ANALYSES	4. UNITS		5. INTAKE (optional)		
			6. MAXIMUM DAILY VALUE	8. MAXIMUM 30 DAY VALUE	9. LONG TERM AVERAGE VALUE		CONCENTRATION	U MASS	LONG TERM AVERAGE VALUE	NO. OF AREAS	YSL
	CONCENTRATION	U MASS	CONCENTRATION	U MASS	CONCENTRATION	U MASS			CONCENTRATION	U MASS	
GCMS FRACTION - PESTICIDES (continued)											
17P. Heptachlor Epoxide (1024-57-3)			X								
18P. PCB-1242 (53469-21-9)			X								
19P. PCB-1254 (11097-69-1)			X								
20P. PCB-1221 (11184-29-2)			X								
21P. PCB-1232 (11141-16-5)			X								
22P. PCB-1248 (12672-29-6)			X								
23P. PCB-1260 (11095-82-5)			X								
24P. PCB-1016 (12674-11-2)			X								
25P. Toxaphene (80013-2)			X								

AL5640090002

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

OUTFALL #

004

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						d. NO. OF ANALYSES	3. UNITS (specify if blank)		4. INTAKE (optional)		
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)			a. CONCENTRATION	b. MASS	3. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	3.7	50					1	MG/L	LB/D			
b. Chemical Oxygen Demand (COD)	20	272					1	MG/L	LB/D			
c. Total Organic Carbon (TOC)	7.9	108					1	MG/L	LB/D			
d. Total Suspended Solids (TSS)	67	912	36	228	<17	<28	39	MG/L	LB/D			
e. Ammonia (as N)	0.13	1.77					1	MG/L	LB/D			
f. Flow	VALUE 1.632		VALUE 0.416		VALUE 0.075		39	MGD		VALUE		
g. Temperature (winter)	VALUE AMBIENT		VALUE		VALUE			°C		VALUE		
h. Temperature (summer)	VALUE 29.0		VALUE		VALUE		1	°C		VALUE		
i. pH	MINIMUM 7.1	MAXIMUM 8.0	MINIMUM 7.4	MAXIMUM 7.8	X		39	STANDARD UNITS		X		

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK 'X'		3. EFFLUENT						d. NO. OF ANALYSES	4. UNITS		5. INTAKE (optional)		
	a. PRESENT	b. ABSENT	b. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)			a. CONCENTRATION	b. MASS	3. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Bromide (24959-67-9)	X	X												
b. Chlorine, Total Residual	X	X												
c. Color	X		30						1	PCU				
d. Fecal Coliform	X	X												
e. Fluoride (16984-48-8)	X	X												
f. Nitrate-Nitrite (as N)	X		0.06	0.82					1	MG/L	LB/D			

EPA I.D. NUMBER (copy from Item 1 of Form 1) **OUTFALL NUMBER**

A. L5640090002

004

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (all seven pages) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT				4. UNITS		5. INTAKE (optional)				
	a. TESTING EQUIP.	b. ANALYSIS TEST	c. RELEVANT AGENT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		b. CONCENTRATION	b. MASS	d. LONG TERM AVERAGE VALUE		e. NO. OF ANALYSES
				(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS			(i) CONCENTRATION	(ii) MASS	
METALS, CYANIDE, AND TOTAL PHENOLS														
1M. Antimony, Total (7440-36-0)		X		<0.1						1	MG/L			
2M. Arsenic, Total (7440-38-2)		X		<0.1						1	MG/L			
3M. Beryllium, Total (7440-41-7)		X		<0.001						1	MG/L			
4M. Cadmium, Total (7440-43-9)		X		<0.005						1	MG/L			
5M. Chromium, Total (7440-47-3)		X		<0.05						1	MG/L			
6M. Copper, Total (7550-50-8)		X		<0.01						1	MG/L			
7M. Lead, Total (7439-97-6)		X		<0.05						1	MG/L			
8M. Mercury, Total (7439-97-6)		X		<0.2						1	MG/L			
9M. Nickel, Total (7440-02-0)		X		<0.05						1	MG/L			
10M. Selenium, Total (7782-49-2)		X		<0.1						1	MG/L			
11M. Silver, Total (7440-22-4)		X		<0.01						1	MG/L			
12M. Thallium, Total (7440-28-0)		X		<0.05						1	MG/L			
13M. Zinc, Total (7440-66-6)		X		<0.01						1	MG/L			
14M. Cyanide, Total (57-12-5)		X		<0.02						1	MG/L			
15M. Phenols, Total		X		<2.0						1	MG/L			

DIOXIN

2,3,7,8 Tetra-chlorodibenzo-p-dioxin (11761-01-0)

X

DESCRIBE RESULTS

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. USES		5. INTAKE (if available)		NO. OF ANALYSES
	TESTING METHOD	IS BELIEVED TO BE PRESENT	IS BELIEVED TO BE ABSENT	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. 30 DAY AVERAGE VALUE (if available)		CONCENTRATION	U. MASS	F. LONG TERM AVERAGE VALUE		
				(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS			(i) CONCENTRATION	(ii) MASS	
GC/MS FRACTION - VOLATILE COMPOUNDS														
1V. Acrolein (107-02-8)			X											
2V. Acrylonitrile (107-13-1)			X											
3V. Benzene (71-43-2)			X											
4V. Bis (Chloromethyl) Ether (542-88-1)			X											
5V. Bromoform (75-25-2)			X											
6V. Carbon Tetrachloride (56-23-5)			X											
7V. Chlorobenzene (108-90-7)			X											
8V. Chlorodibromomethane (124-48-1)			X											
9V. Chloroethane (75-00-3)			X											
10V. 2-Chloroethylvinyl Ether (110-75-8)			X											
11V. Chloroform (67-66-3)			X											
12V. Dichlorobromomethane (75-27-4)			X											
13V. Dichlorodifluoromethane (75-71-8)			X											
14V. 1,1-Dichloroethane (75-34-3)			X											
15V. 1,2-Dichloroethane (107-06-2)			X											
16V. 1,1-Dichloroethylene (75-35-4)			X											
17V. 1,2-Dichloropropane (78-87-5)			X											
18V. 1,2-Dichloropropylene (542-75-6)			X											
19V. Ethylbenzene (100-41-4)			X											
20V. Methyl Bromide (74-83-9)			X											
21V. Methyl Chloride (74-87-3)			X											

NO. (if any)	SYMBOL	CAS NO.	C. O. NO.	A. MAXIMUM DAILY VALUE		B. MAXIMUM 10 DAY VALUE		C. LONG TERM VALUE		NO. OF ANALYSES	D. UNITS		E. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS		(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS													
1B.	Acanaphthene	(83-32-9)											
2B.	Acanaphthylene	(208-96-8)											
3B.	Anthracene	(120-12-7)											
4B.	Benzidine	(92-87-5)											
5B.	Benzo (a) Anthracene	(56-55-3)											
6B.	Benzo (a) Pyrene	(50-32-8)											
7B.	3,4-Benzo-fluoranthene	(205-99-2)											
8B.	Benzo (ghi) Perylene	(191-24-2)											
9B.	Benzo (k) Fluoranthene	(207-08-9)											
10B.	Bis (2-Chloroethoxy) Methane	(111-91-1)											
11B.	Bis (2-Chloroethyl) Ether	(111-44-4)											
12B.	Bis (2-Chloroisopropyl) Ether	(39638-32-9)											
13B.	Bis (2-Ethylhexyl) Phthalate	(117-81-7)											
14B.	4-Bromophenyl Phenyl Ether	(101-55-3)											
15B.	Butyl Benzyl Phthalate	(85-68-7)											
16B.	2-Chloronaphthalene	(91-58-7)											
17B.	4-Chlorophenyl Phenyl Ether	(7005-72-3)											
18B.	Chrysene	(218-01-9)											
19B.	Dibenzo (a,h) Anthracene	(53-70-3)											
20B.	1,2-Dichlorobenzene	(95-50-1)											
21B.	1,3-Dichlorobenzene	(541-73-1)											

1. POLYANNUAL (if available)	2. MARK 'X'			3. LIFELINE				4. UNITS			5. INTAKE (Annual)				
	A: TEST INC. OR QUANT. X.U.	B: OBS. IN FIELD SENT	C: OBS. IN LAB. AS SEMI	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)															
43B. N-Nitrosodiphenylamine (86-30-6)			X												
44B. Phenanthrene (85-01-8)			X												
45B. Pyrene (129-00-0)			X												
46B. 1,2,4-Trichlorobenzene (120-82-1)			X												
GC/MS FRACTION - PESTICIDES															
1P. Aldrin (309-00-2)			X												
2P. α -BHC (319-84-6)			X												
3P. β -BHC (319-85-7)			X												
4P. γ -BHC (58-89-9)			X												
5P. δ -BHC (319-86-8)			X												
6P. Chlordane (57-74-9)			X												
7P. 4,4'-DDT (50-29-3)			X												
8P. 4,4'-DDE (72-55-9)			X												
9P. 4,4'-DDD (72-54-8)			X												
10P. Dieldrin (60-57-1)			X												
11P. α -Endosulfen (115-29-7)			X												
12P. β -Endosulfen (115-29-7)			X												
13P. Endosulfan Sulfate (1031-07-8)			X												
14P. Endrin (72-20-8)			X												
15P. Endrin Aldehyde (7421-93-4)			X												
16P. Heptachlor (76-44-8)			X												

EPA I.D. NUMBER (copy from Item 1 of Form 1) **A15640090002** OUTFALL NUMBER **004**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. TEST METH. OVER AN.	B. DE- LIVER PMT. SENT	C. DE- LIVER AD- SENT	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		E. NO. OF ANAL- YSES	A. CONCEN- TRATION	B. MASS	B. LONG TERM AVERAGE VALUE		D. NO. OF ANAL- YSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)			X												
18P. PCB-1242 (53469-21-9)			X												
19P. PCB-1254 (11097-69-1)			X												
20P. PCB-1221 (11104-28-2)			X												
21P. PCB-1232 (11141-16-5)			X												
22P. PCB-1248 (12672-29-6)			X												
23P. PCB-1260 (11098-82-5)			X												
24P. PCB-1016 (12674-11-2)			X												
25P. Toxaphene (8001-35-2)			X												

EPA Form 3510-2C(16-80)

PAGE V-9

FOOTNOTES:

1- DATA FROM ONE GRAB SAMPLE COLLECTED AUGUST 18, 1986.

2- DATA TAKEN FROM DMRS SUBMITTED TO ADEM FOR THE PERIOD AUGUST 1985 - JULY 1986.

EPA I.D. NUMBER (copy from Item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-R0173

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

OUTFALL
007

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVRG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	3. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	<1.0						1	MG/L				
b. Chemical Oxygen Demand (COD)	10	100					1	MG/L	LB/D			
c. Total Organic Carbon (TOC)	4.2	42					1	MG/L	LB/D			
d. Total Suspended Solids (TSS)	24	120	13	65	6.0	<30	45	MG/L	LB/D			
e. Ammonia (as N)	0.01	0.1					1	MG/L	LB/D			
f. Flow	1.2		0.68		0.47		55	MGD				
g. Temperature (winter)	VALUE		VALUE		VALUE				°C			
h. Temperature (summer)	29.4		VALUE		VALUE		1		°C			
i. pH	MINIMUM	MAXIMUM	MINIMUM	MAXIMUM			1	STANDARD UNITS				

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK 'X'		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. present	b. absent	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVRG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	3. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Bromine (24959-67-9)		X												
b. Chlorine, Total Residual	X		<0.02						1	MG/L				
c. Color	X		7.0						1	PCU				
d. Fecal Coliform		X												
e. Fluoride (16984-48-8)		X												
f. Nitrate-Nitrite (as N)	X		<0.01						1	MG/L				

ITEM V-B CONTINUED FROM FRONT

1. POLLUTANT AND CAS NO. (if available)	2. MARK 'X' a. 2-100% b. 1-50% c. 1-10% d. 1-5% e. 1-1%		3. EFFLUENT				4. UNITS		5. INTAKE (optional)		6. NO. OF ANALYSES													
			b. MAXIMUM DAILY VALUE		d. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		a. AVERAGE VALUE															
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS														
g. Nitrogen, Total Organic (as N)	X	X	0.41	4.1																				
h. Oil and Grease 2)	X	X	10	<65	<6.3			<5.2																
i. Phosphorus (as P), Total (7223 14 0)	X	X	0.08	0.8																				
j. Radioactivity																								
(1) Alpha, Total	X	X																						
(2) Beta, Total	X	X																						
(3) Radium, Total	X	X																						
(4) Radium 226, Total	X	X																						
k. Sulfate (as S(1/2)) (14808 79 8)	X	X	19	190																				
l. Sulfide (as S)	X	X																						
m. Sulfite (as S(1/2)) (14265-45-3)	X	X																						
n. Surfactants	X	X	<0.1																					
o. Aluminum, Total (7429 90-5)	X	X	<0.05																					
p. Barium, Total (7440 39-3)	X	X																						
q. Boron, Total (7440 42 8)	X	X																						
r. Cobalt, Total (7440 48-4)	X	X																						
s. Iron, Total (7439 89 6)	X	X	0.08	0.8																				
t. Magnesium, Total (7439 95 4)	X	X	5.66	57																				
u. Molybdenum, Total (7439 98 7)	X	X																						
v. Manganese, Total (7439 96 5)	X	X	0.044	0.44																				
w. Tin, Total (7440 31 5)	X	X																						

TAN:JM

EPA I.O. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **007**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the Instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (all seven pages) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	a. TYPE OF EQUIP. USED	b. RECEIVED PERCENT	c. DISCHARGED PERCENT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM (AVG. VALUE) (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, CYANIDE, AND TOTAL PHENOLS															
1M. Antimony, Total (7440-36-0)		X		<0.1						1	MG/L				
2M. Arsenic, Total (7440-38-2)		X		<0.1						1	MG/L				
3M. Beryllium, Total (7440-41-7)		X		<0.001						1	MG/L				
4M. Cadmium, Total (7440-43-9)		X		<0.005						1	MG/L				
5M. Chromium, Total (7440-47-3)		X		<0.05						1	MG/L				
6M. Copper, Total (7550-50-8)		X		<0.01						1	MG/L				
7M. Lead, Total (7439-97-6)		X		<0.05						1	MG/L				
8M. Mercury, Total (7439-97-6)		X		<0.2						1	MG/L				
9M. Nickel, Total (7440-02-0)		X		<0.05						1	MG/L				
10M. Selenium, Total (7782-49-2)		X		<0.1						1	MG/L				
11M. Silver, Total (7440-22-4)		X		<0.01						1	MG/L				
12M. Thallium, Total (7440-28-0)		X		<0.05						1	MG/L				
13M. Zinc, Total (7440-66-6)		X		<0.01						1	MG/L				
14M. Cyanide, Total (57-12-5)		X		<0.02						1	MG/L				
15M. Phenols, Total		X		<10						1	MG/L				

DIOXIN

2,3,7,8 Tetra-chlorodibenzo P-dioxin (119311-6)

DESCRIBE RESULTS



1. POLL AND NUMB (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE		6. NO. OF ANALYSES	
	A. TEST NO. OR DATE	B. CALIBRATION PERCENT	C. RECOVERY PERCENT	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVERAGE VALUE (if available)		F. NO. OF ANALYSES	G. CONCENTRATION	H. MASS	B. 1. ORG. 1. R. AVERAGE VALUE		
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION		(2) MASS
GC/MS FRACTION - VOLATILE COMPOUNDS															
1V. Acrotain (107-02-8)	X			<100						1	µg/L				
2V. Acrylonitrile (107-13-1)	X			<100						1	µg/L				
3V. Benzene (71-43-2)	X			<10						1	µg/L				
4V. Bis (Chloromethyl) Ether (542-88-1)	X			<10						1	µg/L				
5V. Bromoform (75-25-2)	X			<10						1	µg/L				
6V. Carbon Tetrachloride (56-23-5)	X			<10						1	µg/L				
7V. Chlorobenzene (108-90-7)	X			<10						1	µg/L				
8V. Chlorodibromomethane (124-48-1)	X			<10						1	µg/L				
9V. Chloroethane (75-00-3)	X			<10						1	µg/L				
10V. 2-Chloroethylvinyl Ether (110-75-8)	X			<10						1	µg/L				
11V. Chloroform (67-66-3)	X			14	0.14					1	µg/L	LB/D			
12V. Dichlorobromomethane (75-27-4)	X			<10						1	µg/L				
13V. Dichlorodifluoromethane (75-71-8)	X			<10						1	µg/L				
14V. 1,1-Dichloroethane (75-34-3)	X			<10						1	µg/L				
15V. 1,2-Dichloroethane (107-06-2)	X			<10						1	µg/L				
16V. 1,1-Dichloroethylene (75-35-4)	X			<10						1	µg/L				
17V. 1,2-Dichloropropene (78-87-5)	X			<10						1	µg/L				
18V. 1,2-Dichloropropylene (542-76-6)	X			<10						1	µg/L				
19V. Ethylbenzene (100-41-4)	X			<10						1	µg/L				
20V. Methyl Bromide (74-83-9)	X			<10						1	µg/L				
21V. Methyl Chloride (74-87-3)	X			<10						1	µg/L				

CONTINUED FROM PAGE V-4

EPA I.O. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **007**

Form Approved OMB No. 158-R0173

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT				4. NO. OF ANALYSES	4. UNITS		5. INTAKE (optional)				
	TYPE OF EQUIP.	D. RE. SPEC. PRESENT	C. S. LEVEL ABSENT	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)			E. LONG TERM AVG. VALUE (if available)		B. CONCENTRATION	D. MASS	B. LONG TERM AVERAGE VALUE		D. NO. ANALYSE
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS		(1) CONCENTRATION	(2) MASS			(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - VOLATILE COMPOUNDS (continued)															
22V. Methylene Chloride (75-09-2)	X			<10						1	µg/L				
23V. 1,1,2,2-Tetrachloroethane (79-34-5)	X			<10						1	µg/L				
24V. Tetrachloroethylene (127-18-4)	X			<10						1	µg/L				
25V. Toluene (108-88-3)	X			<10						1	µg/L				
26V. 1,2-Trans-Dichloroethylene (156-60-5)	X			<10						1	µg/L				
27V. 1,1,1-Trichloroethane (71-55-6)	X			<10						1	µg/L				
28V. 1,1,2-Trichloroethane (79-00-5)	X			<10						1	µg/L				
29V. Trichloroethylene (79-01-6)	X			<10						1	µg/L				
30V. Trichlorofluoromethane (75-69-4)	X			<10						1	µg/L				
31V. Vinyl Chloride (75-01-4)	X			<10						1	µg/L				
GC/MS FRACTION - ACID COMPOUNDS															
1A. 2-Chloropheno (95-57-8)	X			<10						1	µg/L				
2A. 2,4-Dichlorophenol (120-83-2)	X			<10						1	µg/L				
3A. 2,4-Dimethylphenol (105-67-9)	X			<10						1	µg/L				
4A. 4,6-Dinitro-O-Cresol (534-52-1)	X			<10						1	µg/L				
5A. 2,4-Dinitrophenol (51-28-5)	X			<10						1	µg/L				
6A. 2-Nitrophenol (88-75-5)	X			<10						1	µg/L				
7A. 4-Nitrophenol (100-02-7)	X			<10						1	µg/L				
3A. P-Chloro-M-Cresol (59-60-7)	X			<10						1	µg/L				
9A. Pentachlorophenol (87-86-5)	X			<10						1	µg/L				
10A. Phenol (100-95-2)	X			<10						1	µg/L				
11A. 2,4,6-Trichlorophenol (87-55-3)	X			<10						1	µg/L				

1. NAME (If unknown)	2. CAS NO.	3. CLASSIFICATION	4. MAXIMUM DAILY VALUE		5. MAXIMUM CONC. BY VAL.		6. NO. OF ANALYSES	7. RESULTS		8. LIMITS		9. NO. OF ANALYSES
			(a) CONCENTRATION	(b) MASS	(a) CONCENTRATION	(b) MASS		(a) CONCENTRATION	(b) MASS	(a) CONCENTRATION	(b) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS												
1B. Acenaphthene (83-32-9)			<10				1	µg/L				
2B. Acenaphthylene (208-96-8)			<10				1	µg/L				
3B. Anthracene (120-12-7)			<10				1	µg/L				
4B. Benzidine (92-87-5)			<50				1	µg/L				
5B. Benzo (a) Anthracene (56-55-3)			<10				1	µg/L				
6B. Benzo (a) Pyrene (50-32-8)			<10				1	µg/L				
7B. 3,4-Benzo-fluoranthene (205-99-2)			<10				1	µg/L				
8B. Benzo (ghi) Perylene (191-24-2)			<10				1	µg/L				
9B. Benzo (h) Fluoranthene (207-08-9)			<10				1	µg/L				
10B. Bis (2-Chloroethoxy) Methane (111-91-1)			<10				1	µg/L				
11B. Bis (2-Chloroethyl) Ether (111-44-4)			<10				1	µg/L				
12B. Bis (2-Chloro- <i>isopropyl</i>) Ether (39638-32-9)			<10				1	µg/L				
13B. Bis (2-Ethylhexyl) Phthalate (117-81-7)			<10				1	µg/L				
14B. 4-Bromophenyl Phenyl Ether (101-55-3)			<10				1	µg/L				
15B. Butyl Benzyl Phthalate (85-68-7)			<10				1	µg/L				
16B. 2-Chloronaphthalene (91-58-7)			<10				1	µg/L				
17B. 4-Chlorophenyl Phenyl Ether (7005-72-3)			<10				1	µg/L				
18B. Chrysene (218-01-9)			<10				1	µg/L				
19B. Dibenzo (a,h) Anthracene (53-70-3)			<10				1	µg/L				
20B. 1,2-Dichlorobenzene (96-50-1)			<10				1	µg/L				
21B. 1,3-Dichlorobenzene (541-73-1)			<10				1	µg/L				

CONTINUED FROM PAGE V-6

EPA I.D. NUMBER (copy from Item 1 of Form 1) | OUTFALL NUMBER

AL5640090002

007

Form Approved OMB No. 150-R0173

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. TYPE OF ANALYSIS	B. BE-HEAVY METALS	C. CC-TOXIC ORGANICS	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
				(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS				(i) CONCENTRATION	(ii) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)															
22B. 1,4 Dichlorobenzene (106-46-7)	X			<10						1	µg/L				
23B. 3,3'-Dichlorobenzidine (91-94-1)	X			<25						1	µg/L				
24B. Diethyl Phthalate (84-66-2)	X			<10						1	µg/L				
25B. Dimethyl Phthalate (131-11-3)	X			<10						1	µg/L				
26B. Di-n-Butyl Phthalate (84-74-2)	X			<10						1	µg/L				
27B. 2,4 Dinitrotoluene (121-14-2)	X			<10						1	µg/L				
28B. 2,6 Dinitrotoluene (606-20-2)	X			<10						1	µg/L				
29B. Di-n-Octyl Phthalate (117-84-0)	X			<10						1	µg/L				
30B. 1,2-Olphenylhydrazine (as Azobenzene) (122-66-7)	X			<10						1	µg/L				
31B. Fluoranthene (206-44-0)	X			<10						1	µg/L				
32B. Fluorene (86-73-7)	X			<10						1	µg/L				
33B. Hexachlorobenzene (118-71-1)	X			<10						1	µg/L				
34B. Hexachlorobutadiene (87-68-3)	X			<10						1	µg/L				
35B. Hexachlorocyclopentadiene (77-47-4)	X			<10						1	µg/L				
36B. Hexachloroethane (67-72-1)	X			<10						1	µg/L				
37B. Indenn (1,2,3-cd) Pyrene (193-39-5)	X			<10						1	µg/L				
38B. Isophthalene (78-59-1)	X			<10						1	µg/L				
39B. Naphthalene (91-20-3)	X			<10						1	µg/L				
40B. Nitrobenzene (98-95-3)	X			<10						1	µg/L				
41B. N-Nitrosodimethylamine (62-75-9)	X			<10						1	µg/L				
42B. Nitrobenzene	X			<10						1	µg/L				

1. POLL AND NUM (if available)	2. MARK 'X'			3. LIMITS				4. UNITS		5. INTAKE (Annual)					
	A. YES/NO/QUI	B. 10% EXCEEDS	C. 10% EXCEEDS	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVG. VALUE (if available)		I. NO. OF ANALYSES	II. CONCENTRATION	III. MASS	B. LONG TERM AVERAGE VALUE		II. NO. OF ANALYSES
				(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS				(i) CONCENTRATION	(ii) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)															
43B. N-Nitrosodiphenylamine (86-30-6)	X			<10						1	µg/L				
44B. Phenanthrene (85-01-8)	X			<10						1	µg/L				
45B. Pyrene (129-00-0)	X			<10						1	µg/L				
46B. 1,2,4-Trichlorobenzene (120-82-1)	X			<10						1	µg/L				
GC/MS FRACTION - PESTICIDES															
1P. Aldrin (309-00-2)		X													
2P. α-BHC (319-84-6)		X													
3P. β-BHC (319-85-7)		X													
4P. γ-BHC (58-89-9)		X													
5P. δ-BHC (319-86-8)		X													
6P. Chlordane (57-74-9)		X													
7P. 4,4'-DDT (60-29-3)		X													
8P. 4,4'-DDE (72-55-9)		X													
9P. 4,4'-DDD (72-54-8)		X													
10P. Dieldrin (60-57-1)		X													
11P. α-Endosulfen (115-29-7)		X													
12P. β-Endosulfen (115-29-7)		X													
13P. Endosulfan Sulfate (1031-07-8)		X													
14P. Endrin (72-20-8)		X													
15P. Endrin Aldehyde (7421-93-4)		X													
16P. Heptachlor (76-44-0)		X													

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **007**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. LISTED TOXIC SUBSTANCES	B. ORGANIC CHLORIDES	C. ORGANIC PHOSPHORUS	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	e. CONCENTRATION	f. MASS	g. LONG TERM AVERAGE VALUE		h. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)			X												
18P. PCB-1242 (63469-21-9)			X												
19P. PCB-1254 (11097-69-1)			X												
20P. PCB-1221 (11104-28-2)			X												
21P. PCB-1232 (11141-16-5)			X												
22P. PCB-1248 (12672-29-6)			X												
23P. PCB-1260 (11098-82-5)			X												
24P. PCB-1016 (12674-11-2)			X												
25P. Toxaphene (8001-35-2)			X												

EPA Form 3510-2C(6-80)

PAGE V-9

FOOTNOTES:

1- DATA FROM ONE GRAB SAMPLE COLLECTED AUGUST 18, 1986.

2- DATA TAKEN FROM DMRS SUBMITTED TO ADEM FOR THE PERIOD AUGUST 1985 - JULY 1986.

EPA I.D. NUMBER (copy from Item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-R0173

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

OUTFALL NO.

309

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT							3. UNITS (specify if blank)		4. INTAKE (optional)		b. NO. OF ANALYSES
	b. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	b. CONCENTRATION	b. MASS	a. LONG TERM AVERAGE VALUE		
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	NO	DATA										
b. Chemical Oxygen Demand (COD)	NO	DATA										
c. Total Organic Carbon (TOC)	NO	DATA										
d. Total Suspended Solids (TSS)	30	18.9	16	2.6	7.0	0.56	7	MG/L	LB/D			
e. Ammonia (as N)	NO	DATA										
f. Flow	VALUE 0.0754		VALUE 0.0196		VALUE 0.007		25	MGD		VALUE		
g. Temperature (winter)	VALUE NO DATA		VALUE		VALUE			°C		VALUE		
h. Temperature (summer)	VALUE NO DATA		VALUE		VALUE			°C		VALUE		
i. pH	MINIMUM NO	MAXIMUM DATA	MINIMUM	MAXIMUM	X			STANDARD UNITS		X		

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK 'X'		3. EFFLUENT						4. UNITS		5. INTAKE (optional)		b. NO. OF ANALYSES	
	a. PRESENT	b. ABSENT	b. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	b. CONCENTRATION	b. MASS	a. LONG TERM AVERAGE VALUE		
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION		(2) MASS
a. Bromine (24959-67-91)														
b. Chlorine, Total Residual														
c. Color														
d. Fecal Coliform														
e. Fluoride (16984-48-8)														
f. Nitrate-Nitrite (as N)														

EPA I.D. NUMBER (copy from Item 1 of Form 1) OUTFALL NUMBER

AL5640090002

009

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. TYPE OF ANALYSIS	B. DATE OF ANALYSIS	C. DATE OF RECEIPT	D. MAXIMUM DAILY VALUE		E. MAXIMUM 30 DAY VALUE (if available)		F. LONG TERM AVG. VALUE (if available)		G. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	H. LONG TERM AVERAGE VALUE		I. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)															
18P. PCB-1242 (53469-21-9)															
19P. PCB-1254 (11097-69-1)															
20P. PCB-1221 (11104-28-2)															
21P. PCB-1232 (11141-16-5)															
22P. PCB-1248 (12672-29-6)															
23P. PCB-1260 (11096-82-5)															
24P. PCB-1016 (12674-11-2)															
25P. Toxaphene (8001-35-2)															

EPA Form 3510-2C (6-80)

PAGE V-9

FOOTNOTES:

1- DUE TO CONSTRUCTION SLOWDOWN, THIS OUTFALL HAS TEMPORARILY CEASED TO DISCHARGE. THEREFORE SAMPLE FOR THESE ANALYSES COULD NOT BE COLLECTED.

2- DATA TAKEN FROM DMRS SUBMITTED TO ADEM FOR THE PERIOD MAY 1985 - OCTOBER 1985.

EPA I.D. NUMBER (copy from Item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-R0173

OUTFALL NO

010

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	3. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	NO	DATA										
b. Chemical Oxygen Demand (COD)	NO	DATA										
c. Total Organic Carbon (TOC)	NO	DATA										
d. Total Suspended Solids (TSS)	1.0	0.43	1.0	0.17	1.0	0.17	2	MG/L	LB/D			
e. Ammonia (as N)	NO	DATA										
f. Flow	VALUE 0.0512		VALUE 0.0209		VALUE 0.0209		4	MGD			VALUE	
g. Temperature (winter)	VALUE NO DATA		VALUE		VALUE				°C		VALUE	
h. Temperature (summer)	VALUE NO DATA		VALUE		VALUE				°C		VALUE	
i. pH	MINIMUM NO	MAXIMUM DATA	MINIMUM	MAXIMUM	X			STANDARD UNITS		X		

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK "X"	3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
		a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	3. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
		(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS						
a. Benzidine (24959-67-9)													
b. Chlorine, Total Residual													
c. Color													
d. Fecal Coliform													
e. Fluoride (16984-48-8)													
f. Nitrate-Nitrite (as N)													

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **010**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AII CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. ILLU- MINA- TION L.P.	B. NO. OF DIPLO- MATS SENT	C. CON- CENTRA- TION SENT	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		E. LONG TERM AVERAGE VALUE (if available)		H. NO. OF ANAL- YSES	G. CONCENTRATION	I. MASS	F. LONG TERM AVERAGE VALUE		J. NO. OF ANAL- YSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024 57-3)															
18P. PCB-1242 (53469-21-9)															
19P. PCB-1254 (11097-69-1)															
20P. PCB-1221 (11184-28-2)															
21P. PCB-1232 (11141-16-5)															
22P. PCB-1248 (12672-29-6)															
23P. PCB-1260 (11098 82-5)															
24P. PCB-1016 (12674-11-2)															
25P. Toxaphene (8001-35-2)															

EPA Form 3510-2C(16-80)

PAGE V-9

FOOTNOTES:

1- DUE TO CONSTRUCTION SLOWDOWN, THIS OUTFALL HAS TEMPORARILY CEASED TO DISCHARGE. THEREFORE SAMPLES FOR THESE ANALYSES COULD NOT BE COLLECTED.

2- DATA TAKEN FROM DMR SUBMITTED TO ADEM FOR THE MONTH OF MAY 1985.

EPA I.D. NUMBER (copy from Item 1 of Form 1)
AL5640090002

Form Approved OMB No. 158-R0173

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

OUTFALL NO
012

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)		5. NO. OF ANALYSES
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		6. CONCENTRATION	7. MASS	8. LONG TERM AVERAGE VALUE		
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS			(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	6.5	0.108	3.8	0.075	<1.7		24	MG/L	LB/D		
b. Chemical Oxygen Demand (COD)	6.0	0.6					1	MG/L	LB/D		
c. Total Organic Carbon (TOC)	2.5	0.3					1	MG/L	LB/D		
d. Total Suspended Solids (TSS)	8.0	<0.068	<4.5		<1.5		24	MG/L	LB/D		
e. Ammonia (as N)	<0.01						1	MG/L			
f. Flow	0.0126		0.0036		0.0017		24	MGD			
g. Temperature (winter)	VALUE		VALUE		VALUE			°C			
h. Temperature (summer)	24.4		VALUE		VALUE			°C			
i. pH	NO DATA		MINIMUM MAXIMUM		MINIMUM MAXIMUM			STANDARD UNITS			

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)		6. NO. OF ANALYSES
	a. NO. OF ANALYSES	b. NO. OF ANALYSES	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		6. CONCENTRATION	7. MASS	8. LONG TERM AVERAGE VALUE		
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS			(1) CONCENTRATION	(2) MASS	
a. Bromide (24959-67-9)	X	X											
b. Chlorine, Total Residual	X	X											
c. Color	X	X	7.0						1	PCU			
d. Fecal Coliform	X	X	<1						1	COLONIES / 100 ML			
e. Fluoride (16984-48-8)	X	X											
f. Nitrate-Nitrite (as N)	X	X	4.0	4.2					1	MG/L	LB/D		

EPA I.D. NUMBER (copy from Item 1 of Form 1) | OUTFALL NUMBER

A.L5640090002

012

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (all seven pages) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT				4. UNITS		5. INTAKE (optional)				
	a. PRESENT IN OUTFALL	b. BELIEVED PRESENT	c. BELIEVED ABSENT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		a. CONCENTRATION	b. MASS	a. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS					
METALS, CYANIDE, AND TOTAL PHENOLS														
1M Antimony, Total (7440-36-0)			X											
2M Arsenic, Total (7440-38-2)			X											
3M Beryllium, Total (7440-41-7)			X											
4M Cadmium, Total (7440-43-9)			X											
5M Chromium, Total (7440-47-3)			X											
6M Copper, Total (7550-50-8)			X											
7M Lead, Total (7439-97-6)			X											
8M Mercury, Total (7439-97-0)			X											
9M Nickel, Total (7440-02-0)			X											
10M Selenium, Total (7782-49-2)			X											
11M Silver, Total (7440-22-4)			X											
12M Thallium, Total (7440-28-0)			X											
13M Zinc, Total (7440-66-6)			X											
14M Cyanide, Total (57-12-5)			X											
15M Phenols, Total		X		2.0						1	MG/L			

DIOXIN

2,3,7,8 Tetra chlorodibenzo P-dioxin (TCDF) CAS 1781-21-0

DESCRIBE RESULTS

1. POLLUTANT AND CAS NUMBER (if applicable)	2. MARK 'X'			3. EFFLUENT				4. UNITS		5. INTAKE		6. NO. OF ANALYSES		
	A. TESTING REQUIRED	B. ANALYSIS REQUIRED	C. ANALYSIS METHOD	8. MAXIMUM DAILY VALUE		9. MAXIMUM 30 DAY VALUE (if available)		10. LONG TERM AVERAGE VALUE (if available)		CONCENTRATION	U. MASS		11. LONG TERM AVERAGE VALUE	
				(1) CONCENTRATION	(2) MASS	(3) CONCENTRATION	(4) MASS	(5) CONCENTRATION	(6) MASS				(7) CONCENTRATION	(8) MASS
GC/MS FRACTION - VOLATILE COMPOUNDS														
1V. Acrolein (107-02-8)			X											
2V. Acrylonitrile (107-13-1)			X											
3V. Benzene (71-43-2)			X											
4V. Bis (Chloromethyl) Ether (542-88-1)			X											
5V. Bromoform (75-25-2)			X											
6V. Carbon Tetrachloride (56-23-5)			X											
7V. Chlorobenzene (108-90-7)			X											
8V. Chlorodibromomethane (124-48-1)			X											
9V. Chloroethane (75-00-3)			X											
10V. 2-Chloroethylvinyl Ether (110-75-8)			X											
11V. Chloroform (67-66-3)			X											
12V. Dichlorobromomethane (75-27-4)			X											
13V. Dichlorodifluoromethane (75-71-8)			X											
14V. 1,1-Dichloroethane (75-34-3)			X											
15V. 1,2-Dichloroethane (107-06-2)			X											
16V. 1,1-Dichloroethylene (75-35-4)			X											
17V. 1,2-Dichloropropane (78-87-5)			X											
18V. 1,2-Dichloropropylene (542-75-6)			X											
19V. Ethylbenzene (100-41-4)			X											
20V. Methyl Bromide (74-83-9)			X											
21V. Methyl Chloride (74-87-3)			X											

1. NAME (if available)	2. TEST METHOD NO.	3. DATE TESTED	4. CONC. UNIT	5. MAXIMUM DAILY VALUE		6. MAXIMUM 30 DAY VALUE (if available)		7. LONG TERM VALUE (if available)		8. NO. OF ANALYSES	9. UNITS		10. INITIAL AVERAGE VALUE		11. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS		(1) CONCENTRATION	(2) MASS			
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS															
1B. Acenaphthene (83-32-9)			X												
2B. Acenaphthylene (208-96-8)			X												
3B. Anthracene (120-12-7)			X												
4B. Benzidine (92-87-5)			X												
5B. Benzo (a) Anthracene (56-55-3)			X												
6B. Benzo (e) Pyrene (50-32-8)			X												
7B. 3,4-Benzo- fluoranthene (205-99-2)			X												
8B. Benzo (ghi) Perylene (191-24-2)			X												
9B. Benzo (k) Fluoranthene (207-08-9)			X												
10B. Bis (2-Chloro- ethoxy) Methane (111-91-1)			X												
11B. Bis (2-Chloro- ethyl) Ether (111-44-4)			X												
12B. Bis (2-Chloro- isopropyl) Ether (39638-32-9)			X												
13B. Bis (2-Ethyl- hexyl) Phthalate (117-81-7)			X												
14B. 4-Bromo- phenyl Phenyl Ether (101-55-3)			X												
15B. Butyl Benzyl Phthalate (85-68-7)			X												
16B. 2-Chloro- naphthalene (91-58-7)			X												
17B. 4-Chloro- phenyl Phenyl Ether (7005-72-3)			X												
18B. Chrysene (218-01-9)			X												
19B. Dibenzo (a,h) Anthracene (53-70-3)			X												
20B. 1,2-Dichloro- benzene (95-50-1)			X												
21B. 1,3-Dichloro- benzene (541-73-1)			X												

1. POLLUTANT NUMBER (if available)	2. MARK 'X'			3. ELEMENT				4. UNITS		5. INTAKE (optional)						
	A. ANAL. METHOD	B. SOURCE	C. USE	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVG. VALUE (if available)		E. NO. OF ANALYSES	F. CONCENTRATION	G. MASS	H. LONG TERM AVERAGE VALUE		I. NO. OF ANALYSES	
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS		
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)																
43B. N-Nitrosodiphenylamine (86-30-6)			X													
44B. Phenanthrene (85-01-8)			X													
45B. Pyrene (129-00-0)			X													
46B. 1,2,4-Trichlorobenzene (120-82-1)			X													
GC/MS FRACTION - PESTICIDES																
1P. Aldrin (309-00-2)			X													
2P. α -BHC (319-84-6)			X													
3P. β -BHC (319-85-7)			X													
4P. γ -BHC (50-89-9)			X													
5P. δ -BHC (319-86-8)			X													
6P. Chlordane (57-74-9)			X													
7P. 4,4'-DDT (50-29-3)			X													
8P. 4,4'-DDE (72-55-9)			X													
9P. 4,4'-DDD (72-54-8)			X													
10P. Dieldrin (80-57-1)			X													
11P. α -Endosulfen (115-29-7)			X													
12P. β -Endosulfen (115-29-7)			X													
13P. Endosulfen Sulfate (1031-07-8)			X													
14P. Endrin (72-20-8)			X													
15P. Endrin Aldehyde (7421-93-4)			X													
16P. Heptachlor (76-44-0)			X													

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **012**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. TEST PERIOD BEGINS	B. BEGINS	C. BEGINS	B. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVG. VALUE (if available)		D. NO. OF ANALYSES	E. CONCENTRATION	F. MASS	G. LONG TERM AVERAGE VALUE		H. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)			X												
18P. PCB-1242 (53469-21-9)			X												
19P. PCB-1254 (11097-69-1)			X												
20P. PCB-1221 (11104-28-2)			X												
21P. PCB-1232 (11141-16-5)			X												
22P. PCB-1248 (12672-29-6)			X												
23P. PCB-1260 (11098-82-6)			X												
24P. PCB-1016 (12674-11-2)			X												
25P. Toxaphene (8001-35-2)			X												

EPA Form 3510-2C(16-80)

PAGE V-9

FOOTNOTES:

- 1- DATA TAKEN FROM DMRS SUBMITTED TO ADEM FOR THE PERIOD AUGUST 1985 - JULY 1986.
- 2- DATA FROM ONE GRAB SAMPLE COLLECTED AUGUST 18, 1986.

PLEASE PRINT OR TYPE IN THE UNSHADED AREAS ONLY. You may report some or all of this information on separate sheets (use the same format) instead of completing these pages. SEE INSTRUCTIONS.

EPA I.D. NUMBER (copy from Item 1 of Form 1)

AL5640090002

Form Approved OMB No. 158-00173

OUTFALL
01A

V. INTAKE AND EFFLUENT CHARACTERISTICS (continued from page 3 of Form 2-C)

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	a. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
a. Biochemical Oxygen Demand (BOD)	NO	DATA										
b. Chemical Oxygen Demand (COD)	NO	DATA										
c. Total Organic Carbon (TOC)	NO	DATA										
d. Total Suspended Solids (TSS)	NO	DATA										
e. Ammonia (as N)	NO	DATA										
f. Flow	21	20.16	20.16		15.2		21	MGD				
g. Temperature (winter)	NO	DATA						°C				
h. Temperature (summer)	NO	DATA						°C				
i. pH	NO	DATA						STANDARD UNITS				

PART B - Mark "X" in column 2-a for each pollutant you know or have reason to believe is present. Mark "X" in column 2-b for each pollutant you believe to be absent. If you mark column 2-a for any pollutant, you must provide the results of at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NO. (if available)	2. MARK "X"		3. EFFLUENT				d. NO. OF ANALYSES	4. UNITS		5. INTAKE (optional)		b. NO. OF ANALYSES
	a. PRESENT	b. ABSENT	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)			c. LONG TERM AVG. VALUE (if available)	a. CONCENTRATION	b. MASS	a. LONG TERM AVERAGE VALUE	
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION				(2) MASS	
a. Bromide (24959-67-9)	X											
b. Chlorine, Total Residual	X		0.80	<72	<0.10		21	MG/L	LB/D			
c. Color	X											
d. Fecal Coliform	X											
e. Fluoride (16984-48-8)	X											
f. Nitrate-Nitrite (as N)	X											

EPA I.D. NUMBER (copy from Item 1 of Form 1) OUTFALL NUMBER

AL5640090002

014

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE 3 OF FORM 2-C

PART C - If you are a primary industry and this outfall contains process wastewater, refer to Table 2c-2 in the instructions to determine which of the GC/MS fractions you must test for. Mark "X" in column 2-a for all such GC/MS fractions that apply to your industry and for ALL toxic metals, cyanides, and total phenols. If you are not required to mark column 2-a (*secondary industries, non-process wastewater outfalls, and non-required GC/MS fractions*), mark "X" in column 2-b for each pollutant you know or have reason to believe is present. Mark "X" in column 2-c for each pollutant you believe to be absent. If you mark either columns 2-a or 2-b for any pollutant, you must provide the results of at least one analysis for that pollutant. Note that there are seven pages to this part; please review each carefully. Complete one table (*all seven pages*) for each outfall. See instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK 'X'			3. EFFLUENT				4. UNITS a. CONCENTRATION b. MASS	5. INTAKE <i>(optional)</i>		d. NO. ANALYSES
	a. FRACTION OF OUTFALL	b. GC/MS FRACTION	c. PRESENT/ABSENT	b. MAXIMUM DAILY VALUE		c. LONG TERM AVG. VALUE <i>(if available)</i>			a. LONG TERM AVERAGE VALUE	b. NO. ANALYSES	
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				
METALS, CYANIDE, AND TOTAL PHENOLS											
1M Antimony, Total (7440-36-0)	X										
2M Arsenic, Total (7440-38-2)	X										
3M Beryllium, Total (7440-41-7)	X										
4M Cadmium, Total (7440-43-9)	X										
5M Chromium, Total (7440-47-3)	X										
6M Copper, Total (7550-50-8)	X										
7M Lead, Total (7439-97-6)	X										
8M Mercury, Total (7439-97-6)	X										
9M Nickel, Total (7440-02-0)	X										
10M Selenium, Total (7782-49-2)	X										
11M Silver, Total (7440-22-4)	X										
12M Thallium, Total (7440-28-0)	X										
13M Zinc, Total (7440-66-6)	X										
14M Cyanide, Total (57-12-5)	X										
15M Phenols, Total	X										
DIOXIN											
2,3,7,8 Tetra-chlorodibenzo P-dioxin (110-11-1) G			X	DESCRIBE RESULTS							

1. POLLUTANT AND NUMBER (if available)	2. MARK A			3. EFFLUENT				4. LIMITS		5. INTAKE		11. NO. OF ANALYSES
	A. TEST METHOD (if available)	B. BL. CONC. (if available)	C. BL. CONC. (if available)	8. MAXIMUM DAILY VALUE		9. MAXIMUM 30 DAY VALUE (if available)		10. LONG TERM AVERAGE VALUE (if available)		B. LONG TERM AVERAGE VALUE		
				(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	(i) CONCENTRATION	(ii) MASS	
GC/MS FRACTION - VOLATILE COMPOUNDS												
1V. Acrolein (107-02-8)												
2V. Acrylonitrile (107-13-1)												
3V. Benzene (71-43-2)												
4V. Bis (Chloromethyl) Ether (542-88-1)												
5V. Bromoform (75-25-2)												
6V. Carbon Tetrachloride (56-23-5)												
7V. Chlorobenzene (108-90-7)												
8V. Chlorodibromomethane (124-48-1)												
9V. Chloroethane (75-00-3)												
10V. 2-Chloroethylvinyl Ether (110-75-8)												
11V. Chloroform (67-66-3)												
12V. Dichlorobromomethane (75-27-4)												
13V. Dichlorodifluoromethane (75-71-8)												
14V. 1,1-Dichloroethane (75-34-3)												
15V. 1,2-Dichloroethane (107-06-2)												
16V. 1,1-Dichloroethylene (75-35-4)												
17V. 1,2-Dichloropropane (78-87-5)												
18V. 1,2-Dichloropropane (542-75-6)												
19V. Ethylbenzene (100-41-4)												
20V. Methyl Bromide (74-83-9)												
21V. Methyl Chloride (74-87-3)												

NUM. (if available)	A. TEST METHOD	B. SE: FUEL TYPE SENT	C. SE: FUEL ADJ. SENT	8. MAXIMUM DAILY VALUE		D. MAXIMUM 15 DAY VALUE (if available)		E. LONG TERM VALUE (if available)		F. NO. OF ANAL- YSES	3. UNITS		5. TOTAL & LONG-TERM AVERAGE VALUE		6. NO. OF ANAL- YSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS		4. CONCENTRATION	4. MASS	(1) CONCENTRATION	(2) MASS	
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS															
1B. Acenaphthene (83-32-9)															
2B. Acenaphthylene (208-96-8)															
3B. Anthracene (120-12-7)															
4B. Benzidine (92-87-5)															
5B. Benzo (a) Anthracene (56-55-3)															
6B. Benzo (a) Pyrene (50-32-8)															
7B. 3,4-Benzo- fluoranthene (205-99-2)															
8B. Benzo (ghi) Perylene (191-24-2)															
9B. Benzo (k) Fluorenone (207-08-9)															
10B. Bis (2-Chloro- ethoxy) Methane (111-91-1)															
11B. Bis (2-Chloro- ethyl) Ether (111-44-4)															
12B. Bis (2-Chloro- isopropyl) Ether (39638-32-9)															
13B. Bis (2-Ethyl- hexyl) Phthalate (117-81-7)															
14B. 4-Bromo- phenyl Phenyl Ether (101-55-3)															
15B. Butyl Benzyl Phthalate (85-68-7)															
16B. 2-Chloro- naphthalene (91-58-7)															
17B. 4-Chloro- phenyl Phenyl Ether (7005-72-3)															
18B. Chrysene (218-01-9)															
19B. Dibenzo (a,h) Anthracene (53-70-3)															
20B. 1,2-Dichloro- benzene (95-50-1)															
21B. 1,3-Dichloro- benzene (541-73-1)															

1. POLYMER OR NUCLEIC ACID (if available)	2. MARK 'X'			3. EFFICIENCY				4. UNITS			5. INTERPRETATION (optional)				
	A. TEST INC. RE- QUIN- TIL	B. SE- RI- OUS- SENT.	C. RE- LEASE- AB- SENT.	B. MAXIMUM DAILY VALUE		D. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVG. VALUE (if available)		H. NO. OF ANAL- YSES	A. CONCENT- RATION	B. MASS	E. LONG TERM AVG. VALUE		I. NO. OF ANAL- YSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS						
GC/MS FRACTION - BASE/NEUTRAL COMPOUNDS (continued)															
43B. N-Nitrosodiphenylamine (86-30-6)	X														
44B. Phenanthrene (85-01-8)	X														
45B. Pyrene (129-00-0)	X														
46B. 1,2,4-Trichlorobenzene (120-82-1)	X														
GC/MS FRACTION - PESTICIDES															
1P. Aldrin (309-00-2)		X													
2P. α -BHC (319-84-6)		X													
3P. β -BHC (319-85-7)		X													
4P. γ -BHC (58-89-9)		X													
5P. δ -BHC (319-86-8)		X													
6P. Chlordane (57-74-9)		X													
7P. 4,4'-DDT (50-29-3)		X													
8P. 4,4'-DDE (72-55-9)		X													
9P. 4,4'-DDD (72-64-0)		X													
10P. Dieldrin (60-57-1)		X													
11P. α -Endosulfen (115-29-7)		X													
12P. β -Endosulfen (115-29-7)		X													
13P. Endosulfan Sulfate (1031-07-8)		X													
14P. Endrin (72-20-8)		X													
15P. Endrin Aldehyde (7421-93-4)		X													
16P. Heptachlor (76-44-8)		X													

EPA I.D. NUMBER (copy from Item 1 of Form 1) **AL5640090002** OUTFALL NUMBER **014**

Form Approved OMB No. 158-R0173

CONTINUED FROM PAGE V-8

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK 'X'			3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. TEST METHOD QUANTITY	B. RECEIVED DATE	C. RECEIVED DATE	a. MAXIMUM DAILY VALUE		b. MAXIMUM 30 DAY VALUE (if available)		c. LONG TERM AVG. VALUE (if available)		d. NO. OF ANALYSES	a. CONCENTRATION	b. MASS	e. LONG TERM AVERAGE VALUE		b. NO. OF ANALYSES
				(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
GCMS FRACTION - PESTICIDES (continued)															
17P. Heptachlor Epoxide (1024-57-3)			X												
18P. PCB-1242 (53469-21-9)			X												
19P. PCB-1254 (11097-69-1)			X												
20P. PCB-1221 (11104-28-2)			X												
21P. PCB-1232 (11141-16-5)			X												
22P. PCB-1248 (12672-29-6)			X												
23P. PCB-1260 (11096 82-5)			X												
24P. PCB-1016 (12674-11-2)			X												
25P. Toxaphene (8001-35-2)			X												

EPA Form 3510-2C(6-80)

PAGE V-9

FOOTNOTES:

- 1- DUE TO CONSTRUCTION SLOWDOWN, THIS DISCHARGE HAS TEMPORARILY CEASED. THEREFORE SAMPLES FOR THESE ANALYSES COULD NOT BE COLLECTED. DATA VALUES SHOULD BE COMPARABLE TO THOSE PRESENTED FOR OUTFALL NO. 003.
- 2- DATA TAKEN FROM DMRS SUBMITTED TO ADEM FOR THE PERIOD JULY 1984 - JUNE 1985.

ENCLOSURE 2

PROPOSED CHANGES TO THE BELLEFONTE NUCLEAR PLANT
NPDES PERMIT NO. ALOO24635

1. DSN 001A

For clarification purposes, change the sample type for flow monitoring from totalizer to pump log. Totalizer readings are applicable only to the sewage treatment plant (STP) effluent over a 600 V-notch weir. Under this discharge scheme, phosphate waste will be pumped from the storage pond to the STP effluent pump downstream of the V-notch weir. Pump logs will be used in order to determine the quantity of phosphate waste discharged independently from the daily quantity of STP effluent discharged.

2. DSN 001B

TVA requests that the monitoring frequency on oil and grease for this discharge be reduced from the present frequency of daily to 1/week. Since monitoring for oil and grease began in April 1986 until our most recent data in July 1986 (61 days), oil and grease levels have been all less than 5 mg/l except one day when it was 7.0 mg/l (Table 1). (Discharges from DSN001B only occurred during April through June 1986.) These concentrations are considered typical of those anticipated in the future.

3. DSNs 002 and 004

For clarification purposes, change the sample type for flow monitoring from "Weir, Grab" to "Calculation, Weir." DSN 002 flow is determined by calculation using an in-pond staff gauge and known hydraulic characteristic of the skimmer/discharge pipe. DSN 004 flow monitoring is via a V-notch weir.

TVA requests that the measurement frequency for all parameters at these two point sources of runoff be reduced from 1/week to 2/month. Monitoring data for the past 18-month period show only one noncompliance at DSN 002 which was a TSS noncompliance exceeding the permit limit by 10 percent. DSN 004 experienced only two noncompliances during this period and both were caused by algal blooms.

Based on past monitoring data (summarized in Table 2) and the much reduced construction activity at BLN during the upcoming permit period, TVA believes the requested reduction in monitoring frequency for these runoff points is justified.

4. DSN 005

TVA is considering a design change to the chlorination scheme at the intake pumping station. The current scheme is to inject sodium hypochlorite into the pump discharge lines. The proposal under

consideration is to introduce liquid sodium hypochlorite in the immediate vicinity of the pump suction. Under this scenario, however, the strainer backwash and trash sluice return will contain chlorine when the systems are being chlorinated. No change to the chlorination schedules will be made. The trash sluice return will continue to be discharged directly to the Tennessee River. This was possible modification discussed in an August 14 telephone conversation between William Pearse and Madonna Martin (TVA), and Treena Piznar (ADEM).

TVA requests an alternative set of effluent limits and monitoring requirements be provided in the renewed permit to cover this potential design change.

5. DSN 007

For clarification, add the following language to footnote 1: "Quantity reported by multiplying gallons times number of batches for the day."

6. DSN 011

For clarification, add the following language as footnote 2: "Flow measured on individual batches twice per week, quantity reported by multiplying gallons times number of batches per day."

7. DSN 013

Change sample type for flow monitoring at this discharge from "Grab" to "Calculation" to reflect conditions anticipated. In this regard, add the phrase "for the day" to footnote 2 immediately after the word "batches."

8. DSN 014

As previously discussed between TVA (Wally Carpenter) and ADEM (Sonja Massey), the chlorine limitations and monitoring requirements for this discharge point reflect anticipated conditions when BLN becomes operational. It was agreed that the 2-hour time limit and corresponding average free available chlorine effluent limitation are applicable only during chlorination of the condensers. Prior to operation, only the maximum limit for free available chlorine will be applicable to monitor chlorine present in the cooling tower blowdown lines due to chlorination of the essential raw cooling water (ERCW) and raw service water (RSW) systems.

Therefore, for clarification and to reflect reduced construction activity onsite, add a footnote as follows: "Discharge limitations and monitoring requirements applicable only during direct chlorination of the condenser circulating water (CCW) system for control of biofouling. The daily maximum discharge limitation (0.5 mg/l) and measurement frequency (1/week) for free available chlorine shall be applicable at all other times."

9. DSN 015

For clarification to reflect anticipated conditions, revise the following: delete footnote 1; change the sample type for flow monitoring to read "Calculation"; and change the numerical designation of footnote 2 to footnote 1, and add a new footnote 2 with the following language: "Flow measured on individual batches once per month, quantity reported by multiplying gallons times number of batches for the day."

10. Land Application Monitoring Requirements and Limitations

An April 17, 1981, letter from ADEM approved the use of evaporation/pereolation ponds which are now used as storage ponds for land application of phosphate metal cleaning waste. Groundwater monitoring requirements for wells B1 and B2 down-gradient of the ponds were set by ADEM in the 1981 letter and later amended (frequency reduced from weekly to quarterly) in an April 19, 1985, ADEM letter. TVA believes it to be prudent to identify all monitoring requirements for the land application program at BLN in one place. Since monitoring requirements and limitations for the application sites are present in the permit, TVA requests that the reissued permit identify the groundwater monitoring requirements associated with the storage ponds and suggest this be done in the area of Part I, Page I-1q or Page I-1r, relating to land application requirements.

11. Schedule of Compliance

TVA request Part I.C. of the Schedule of Compliance be revised to align the preoperational nonradiological aquatic monitoring program with the current schedule for Unit 1 fuel loading (1993). Accordingly, Part I.C.1.c.(3) should be changed to read: "Collect an additional two years of fisheries, non-fisheries, and water quality data beginning in February, two years before fuel load of Unit 1."

TVA believes this change is necessary because by 1993 the aquatic data base will be ten years old. Two years of data immediately preceding fuel load are required to reestablish baseline information and evaluate the outcome of trends observed in the 1985 preoperational assessment. Based on the current Unit 1 fuel load date, preoperational monitoring would be initiated in February 1991. Several revisions may also be required to the preoperational monitoring study plan submitted to ADEM on June 3, 1980, as amended February 5 and November 17, 1981, to incorporate information gained from the 1985 assessment along with more state-of-the-art monitoring techniques.

12. Schedule of Compliance

Part I.C.1.d.(5) in the present permit has a typographical error in the sixth line. "Unit 2" in this line should actually read "Unit 1."

13. Part III.K.

BLN is referred to here as having a "once through raw cooling water system." Except for blowdown, BLN has a closed condenser cooling water system.

TABLE 2

DISCHARGE CHARACTERISTICS FOR DISCHARGE SERIAL NUMBERS
(DSN) 002 AND 004 AT BELLEFONTE NUCLEAR PLANT
FROM JANUARY 1985 THROUGH JUNE 1986

DSN 002

<u>Parameter</u>	<u>Daily Maximum</u>	<u>Daily Average</u>	<u>Daily Minimum</u>
Total Suspended Solids	110 mg/l*	23 mg/l	3 mg/l
Settleable Solids	0.01 ml/l	0.01 ml/l	0.01 ml/l
pH	8.4 S.U.		7.0 S.U.

*The next highest daily maximum value was 46 mg/l. Therefore, there was only one noncompliance for TSS (10/23/85) during the 18-month reporting period.

DSN 004

<u>Parameter</u>	<u>Daily Maximum</u>	<u>Daily Average</u>	<u>Daily Minimum</u>
Total Suspended Solids	67 mg/l	16 mg/l	1 mg/l
Settleable Solids	0.01 ml/l	0.01 ml/l	0.01 ml/l
pH	9.3 S.U.*		7.1 S.U.

*There were two pH noncompliances (one on 5/20/85 and another on 5/21/85) during the 18-month reporting period. Both noncompliances were caused by algal bloom.

TABLE I
DISCHARGE CHARACTERISTICS FOR DISCHARGE SERIAL NUMBER 001B AT
BELLEFONTE NUCLEAR PLANT FROM APRIL 1986 THROUGH JULY 1986

BELLEFONTE-LINED FCNL DISCHARGE, 1986

DATE	pH	UO ₂ (ug/l)	Fe(ug/l)	Cu(ug/l)	Gallons Disch.	Gallons To Date
1985						520,150
4/24/86	6.7	<5.0	0.24	<0.01	11,300	531,460
4/25	7.9	<5.0	0.15	<0.01	10,920	542,380
4/28	7.4	<5.0	0.09	<0.01	10,860	553,240
4/29	7.5	<5.0	0.10	<0.01	7,640	560,880
4/30	7.6	<5.0	0.14	<0.01	10,890	571,770
5/1	7.8	<5.0	0.06	<0.01	2,440	574,210
5/2	7.6	<5.0	0.05	<0.01	10,670	584,880
5/5	7.4	<5.0	0.03	<0.01	11,270	596,150
5/6	7.7	<5.0	0.11	<0.01	11,430	607,580
5/7	7.7	<5.0	0.04	<0.01	10,240	617,820
5/8	7.6	<5.0	0.05	<0.01	18,160	635,980
5/9	7.8	<5.0	0.07	<0.01	15,200	651,180
5/12	7.6	<5.0	0.10	0.02	16,500	667,680
5/13	7.8	<5.0	0.07	<0.01	15,500	683,180
5/14	7.8	<5.0	0.05	<0.01	14,600	697,780
5/15	7.5	<5.0	0.02	<0.01	18,210	715,990
5/16	7.8	<5.0	<0.01	<0.01	17,620	733,610
5/19	7.9	<5.0	0.01	0.01	16,570	750,180
5/20	7.8	<5.0	0.10	<0.01	17,000	767,180
5/21	7.8	<5.0	0.10	<0.01	18,000	785,180
5/22	7.9	<5.0	0.08	<0.01	17,500	802,680
5/23	7.8	<5.0	<0.01	<0.01	17,000	819,580
5/27	7.8	<5.0	0.12	<0.01	16,400	835,980
5/28	7.7	<5.0	0.10	<0.01	17,150	853,130
5/29	7.9	<5.0	0.11	0.01	11,820	864,950
5/30	7.9	<5.0	0.09	<0.01	16,970	881,920
6/2	7.8	<5.0	0.12	<0.01	15,690	897,610
6/3	7.8	<5.0	0.14	<0.01	17,300	914,910
6/4	7.7	<5.0	0.20	<0.01	17,170	932,080
6/5	7.7	<5.0	0.08	<0.01	17,000	949,080
6/6	7.8	<5.0	0.03	<0.01	16,500	965,580
6/9	7.8	<5.0	0.11	<0.01	15,900	981,480
6/10	7.9	7.0	0.15	<0.01	15,000	996,480
6/11	7.8	<5.0	0.15	<0.01	16,000	1,012,480
6/12	7.9	<5.0	0.20	<0.01	16,400	1,028,880
6/13	7.8	<5.0	0.15	<0.01	16,000	1,044,880
6/16	7.7	<5.0	0.12	<0.01	15,320	1,060,200
6/17	7.7	<5.0	0.14	<0.01	16,580	1,076,780
6/18	7.8	<5.0	0.13	<0.01	16,930	1,093,710
6/19	7.8	<5.0	0.10	<0.01	16,900	1,095,310
6/20	7.9	<5.0	0.15	<0.01	16,300	1,111,610
6/23	7.9	<5.0	0.08	0.01	15,600	1,127,210
6/24	7.9	<5.0	0.07	<0.01	17,000	1,144,210
6/25	7.8	<5.0	0.12	<0.01	17,000	1,161,210
6/26	7.8	<5.0	0.09	<0.01	17,000	1,178,210
6/27	7.7	<5.0	0.10	<0.01	16,100	1,194,310
6/30	7.8	<5.0	0.07	<0.01	15,500	1,209,810
7/1	7.8	<5.0	0.10	<0.01	15,700	1,225,510
7/2	7.8	<5.0	0.08	<0.01	16,900	1,242,410
7/3	7.7	<5.0	0.10	<0.01	16,000	1,258,410

7/7	7.8	<5.0	0.18	<0.01	15,200	1,273,610
7/8	7.8	<5.0	0.12	<0.01	16,600	1,290,210
7/9	7.3	<5.0	0.16	<0.01	16,700	1,306,910
7/10	7.6	<5.0	0.17	<0.01	16,800	1,323,710
7/11	7.9	<5.0	0.23	<0.01	16,000	1,339,710
7/14	7.9	<5.0	0.25	<0.01	16,400	1,356,110
7/15	7.8	<5.0	0.24	<0.01	16,500	1,372,610
7/16	7.8	<5.0	0.35	<0.01	16,200	1,388,810
7/17	7.8	<5.0	0.54	<0.01	16,600	1,405,410
7/18	7.8	<5.0	0.51	<0.01	15,200	1,420,610
7/21	7.8	<5.0	1.04	<0.01	14,600	1,435,210

Discharge discontinued due to low water level in pond.